



ರೈಲು ಮೂಲಸೌಲಭ್ಯ ಅಭಿವೃದ್ಧಿ ಕಂಪನಿ (ಕರ್ನಾಟಕ) ನಿಯಮಿತ

ರೇಲ ಇನ್‌ಫ್ರಾಸ್ಟ್ರಕ್ಚರ್ ಡೆವಲಪ್‌ಮೆಂಟ್‌ಕಂಪನಿ (ಕರ್ನಾಟಕ) ಲಿಮಿಟೆಡ್

**Rail Infrastructure Development Company (Karnataka) Limited  
(K-RIDE)**

(A Joint Venture of Govt. of Karnataka and Ministry of Railways)

## **TENDER DOCUMENT**

**Name of the Work:** "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

**Tender No.:** KRIDE/2023-24/EL/WORK\_INDENT7

**Date:** 15.09.2023

### **RAIL INFRASTRUCTURE DEVELOPMENT COMPANY (KARNATAKA) LIMITED**

Samparka Soudha, 1<sup>st</sup> Floor,  
Dr. Rajkumar Road,  
Opposite Orion Mall,  
Rajajinagar 1<sup>st</sup> Block, Bengaluru-560010  
**Tel:** +91 9036572939

**Email:** [electrical.kride@gmail.com](mailto:electrical.kride@gmail.com), [jgmelec@kride.in](mailto:jgmelec@kride.in)

## TENDER DOCUMENT (Through e-Tendering Mode)

### Tender for the work of:

"BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

TENDER NO:	KRIDE/2023-24/EL/WORK_INDENT7, Date: 15.09.2023
TENDER DOCUMENT CAN BE DOWNLOADED FROM	Date: 15.09.2023
PERIOD OF SALE OF TENDER DOCUMENT	NA
LAST DATE FOR SALE OF TENDER DOCUMENT	NA
LAST DATE AND TIME FOR RECEIPT OF BIDS	Date: 16.10.2023, IST 15:00 Hrs (Only electronic tender permitted.)
DATE AND TIME OF OPENING OF COVER ONE OF TENDER (TECHNICAL BID)	Date: 17.10.2023, IST 15:30 Hrs
PLACE OF OPENING OF COVER ONE OF TENDER (TECHNICAL BID)	The opening of the Technical Bid shall take place at <b>e- procurement portal of K-RIDE</b> i.e., <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a>
PLACE OF OPENING OF COVER TWO OF TENDERS (FINANCIAL BID)	The opening of the Financial Bid shall take place at <b>e- procurement portal of K-RIDE</b> i.e., <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a>
DATE AND TIME OF OPENING OF COVER TWO OF TENDERS	Will be intimated to the Qualified Tenderers through e-procurement portal.
ADDRESS FOR COMMUNICATION	Addl. General Manager/ Electrical K-RIDE (Rail Infrastructure Development Company (Karnataka) Limited) #8, 1 <sup>st</sup> Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall Rajajinagar 1 <sup>st</sup> Block, BENGALURU Tel: +91-9036572939 E Mail: <a href="mailto:electrical.kride@gmail.com">electrical.kride@gmail.com</a> , <a href="mailto:jgmelec@kride.in">jgmelec@kride.in</a>

# CONTENTS

SECTION NO.	DESCRIPTION	PAGE NO.
1	INVITATION FOR TENDERS (IFT)	1-6
2	INSTRUCTIONS TO TENDERERS (ITT)	7-45
3	QUALIFICATION INFORMATION/ BIDDING FORMS	46-92
4	FORM OF TENDER, LETTER OF ACCEPTANCE, NOTICE TO PROCEED WITH THE WORK AND AGREEMENT FORM ETC.,	93-98
5	CONDITIONS OF CONTRACT (CC)	99-121
6	CONTRACT DATA	122-127
7	PARTICULAR CONDITIONS OF CONTRACT	128-224
8A	EMPLOYER'S REQUIREMENT – GENERAL INFORMATION AND SCOPE OF WORK	225-254
8A-1	GENERAL REQUIREMENTS	255-260
8B	TECHNICAL SPECIFICATIONS	261-325
8C	EXPLANATORY NOTES	326-341
9	BILL OF QUANTITIES AND PAYMENT TERMS	342-416
10	FORMAT OF BANK GUARANTEE FOR SECURITY DEPOSIT ETC.,	417-432

# SECTION: 1

## NOTICE FOR INVITATION FOR TENDERS (IFT)

**Rail Infrastructure Development Company (Karnataka) Limited**

**INVITATION FOR BIDS**

(Through e-tendering mode)

**Tender Notice No:** KRIDE/2023-24/EL/WORK\_INDENT7

**Date:** 15.09.2023

**THE RAIL INFRASTRUCTURE DEVELOPMENT COMPANY (KARNATAKA) LIMITED (K-RIDE)**, having its corporate office, at #8, 1<sup>st</sup> Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall, Rajajinagar 1<sup>st</sup> Block, Bengaluru-560010, India, which is a Joint Venture of Government of Karnataka and Ministry of Railways invites Bids from eligible Bids, for the construction of works detailed in the table below under **Single stage: Two tender document system (Technical Bid and Financial Bid)**.

SL. NO.	NAME OF WORK	APPROX. VALUE OF WORK (IN ₹ CRS)	TENDER SECURITY/EMD	PERIOD OF COMPLETION
1	2	3	4	5
1.	"BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"	Rs.1.29 Cr.	Rs. 2,00,000.00	12 months

**NOTE:**

1. The Tenderers shall submit the tender through Karnataka Public Procurement Portal. Tenderers should scan the registration copy; work done certificate and any other document and submit through online. More information can be had from website <https://kppp.karnataka.gov.in/#/portal/portal-home>
2. On the stipulated date of opening of Tenders, initially, only the Technical Bids are opened through Karnataka Public Procurement Portal. The Technical Bids shall be evaluated by the Employer in accordance with the stipulated Qualification and Evaluation criteria. No amendments or changes to the Technical Bids would be permitted after the opening of Technical Bids.
3. Tenderers who are qualified in the technical evaluation, their Price Bid shall be opened at a date and time advised by the Employer (K-RIDE) through e-tendering portal. The Price Bids are evaluated and the Contract is awarded to the Tenderer whose Tender has been determined to be the lowest evaluated substantially responsive tender.
4. Tenderers are advised to note the eligibility and minimum qualifying criteria specified in the Section 2: Instruction to Tenderers of the tender document.

## Section 1: Notice For Invitation For Tenders (IFT)

5. Tenders must be accompanied by a Bid Security as per ITT 13.7 and Section 3: Qualification Information/Bidding Forms in any one of the forms as specified in the tender documents and shall have to be valid for 45 days beyond the validity of the tender. Any Tenders received without Bid security, shall be summarily rejected.
6. Incomplete Tender submission will be considered non-responsive and such Tenders shall not be considered for further evaluation.
7. Tender Documents can be downloaded free of cost from Karnataka Public Procurement Portal i.e., <https://kppp.karnataka.gov.in/#/portal/portal-home> from 15/09/2023 and the Tenders must be submitted online via Karnataka Public Procurement Portal only.

Please note that drawings, if any, referred in the tender document, but not uploaded with the tender document, can be viewed in this office on any working day. The Tenderer can also have a copy of the same on payment of non-refundable cost of Rs. 5,000/- (Rupees Five Thousand only) by a e-Payment mode (credit card/debit card/net banking/UPI) in favour of **Rail Infrastructure Development Company (Karnataka) Limited**, Bangalore.

It will be the responsibility of the Tenderer who is submitting the Tender on downloaded Tender documents to check and see any Addendum/Corrigendum issued in this regard from the website from time to time and ensure submission of bid along with all Addendum/Corrigendum.

In case of any clarification the Tenderer can visit the Rail Infrastructure Development Company (Karnataka) Limited Corporate Office Bengaluru at #8, 1st Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall, Rajajinagar 1st Block, Bengaluru-560010. Tel +91-9036572939.

8. Validity of Tender: Tenders shall remain valid for a period of 180 days after the Tender submission deadline date prescribed by the employer. A Tender valid for a shorter period shall be rejected by the employer as non-responsive.
9. In exceptional circumstances, the Employer may request Tenderers to extend the period of validity of their Tenders. The request and the responses shall be made in writing. If a Tender security is requested in accordance with ITT 13, it shall also be extended up to the date mentioned in the letter of request for extension. A Tenderer may refuse the request without forfeiting its Tender security. A Tenderer granting the request shall not be required or permitted to modify its Tender.
10. If, the office happens to be closed on the date of opening of Tender, the Tenders will be opened on next working day at the same time and venue.
11. A Pre- Bid meeting will be held on 29/09/2023 at 11:30 Hrs. IST at the office of K-RIDE, Bangalore to clarify the issues if any and to answer questions on any matter that may be raised at that stage as stated in Clause - 8 of ITT of the Tender document.
12. Other details can be seen in Tender documents.

## Section 1: Notice For Invitation For Tenders (IFT)

### 13. REGISTRATION:

- a. Tenderers are required to enroll on the e-tendering Portal (<https://kppp.karnataka.gov.in/#/portal/portal-home>) with clicking on the link “Tenderers Registration” on the e-tender Portal by paying requisite registration fee as applicable.
- b. As part of the enrolment process, the Tenderers will be required to choose a unique user name and assign a password for their accounts.
- c. Tenderers are advised to register their valid email address and mobile numbers as part of the registration process. These would be used for any communication with the Tenderer.
- d. Upon enrolment, the Tenderers will be required to register their valid Digital Signature Certificate (Only Class III Certificates with signing + encryption key usage) issued by any Certifying Authority recognized by CCA India with their profile.
- e. Only one valid DSC should be registered by a Tenderer. Please note that the Tenderers are responsible to ensure that they do not lend their DSC"s to others which may lead to misuse.
- f. Tenderers then logs in to the site through the secured log-in by entering their user ID/password and the password of the DSC / e-Token.
- g. The scanned copies of all original documents should be uploaded on portal.
- h. For any query regarding e-procurement on the Karnataka Public Procurement Portal, contact helpdesk number **+91-8046010000, +91-8068948777, [support@eprochelpdesk.com](mailto:support@eprochelpdesk.com)**

### 14. SEARCHING FOR PROPOSAL DOCUMENTS

Once the Tenderers have selected the proposals they are interested in, the Tenderers can pay nonrefundable processing fee as per the Karnataka Public Procurement Portal.

### 15. PRECAUTIONS FOR SUBMITTING / PREPARATION OF PROPOSALS THROUGH E TENDERING PORTAL

- a. Tenderer, in advance, should get ready the proposal documents to be submitted as indicated in the proposal document / schedule and generally, they can be in PDF /JPEG formats.
- b. Tenderer should log into the website well in advance for the submission of the proposal so that it gets uploaded well in time i.e., on or before the proposal submission time. Bidder will be responsible for any delay due to other issues.
- c. The Tenderer has to digitally sign and upload the required proposal documents one by one as indicated in the tendering document.
- d. The server time (which is displayed on the consultant's dashboard) will be considered as the standard time for referencing the deadlines for submission of the proposals by the consultants, opening of proposals etc. The consultants should follow this time during proposal submission.

Section 1: Notice For Invitation For Tenders (IFT)

16. The Tenderer should furnish the Name of the individual / firm/ Company / Joint venture with address and telephone number with place of registration, year of incorporation etc.,
17. **Joint Venture participation is not permitted in this Tender.**
18. The application made by the firm / company / Joint Venture shall be signed by a person holding the power of attorney, in which case the Tenderer shall furnish a copy of power of attorney.
19. **Employees Provident Fund Registration Certificate**

The Contractor shall furnish EPF Registration Certificate before entering into agreement in the event of award of work to them after tender, subject to compliance with the following conditions:

  - a) If the contractor is registered already with the EPF authorities, they should produce a copy of the EPF Registration Certificate.
  - b) If not registered with the EPF authorities, the Tenderer should produce an undertaking at the time of participating in the tender that he shall within 7 days of the close of every month submit a Statement to Engineer showing the recoveries of contribution in respect of Employees by or through him and shall also furnish such information as the Engineer is required to furnish under the provisions of the Scheme to the Commissioner EPF.
  - c) However, having given an undertaking to this effect if the Contractor does not furnish the information, the Employer will deduct the necessary amount from the amount due to the Contractor. Notwithstanding the above, the Contractor will be liable for any consequential penalty /damages levied by the EPF authorities.
20. The necessary certificates / documents in support fulfilling qualifying criteria stipulated separately shall be scanned and attached to e-procurement document. The original documents if required by the Employer shall be produced whenever asked by Employer on Technical Bid/ Financial Bid.
21. The intending Tenderers are advised to visit the site of work before attending the Pre- Bid meeting and also before submitting the Tenders.
22. The qualification criteria as indicated in bid document should be met by the intending Tenderers.
23. Tenderers shall not be under a declaration of ineligibility for corrupt and fraudulent practices issued by the Govt. of Karnataka, Govt of India and any PSUs thereof.
24. **Pre-bid meeting will be held on 29/09/2023 at 11.30AM in the office of K-RIDE Bangalore.**
25. The conditional Tenders will not be accepted.
26. The Employer is not responsible for any delay in accessing Karnataka Public Procurement Portal.
27. Contract prices shall be inclusive of all Taxes, Duties etc., The rates quoted by the tenderer must be inclusive of all Taxes, Duties etc.,
28. The Employer reserves the right to either postpone or to cancel the entire process of tender.



Section 1: Notice For Invitation For Tenders (IFT)

29. If Employer wishes to engage third party consultants for quality control assessment, apart from the Employer quality control and field tests, the Tenderer should co-operate with both Quality control authorities and the third party.
30. Building and other construction workers welfare: The Tenderer shall subscribe 1% of gross amount of each bill payable to him in respect of contract to the building and other construction workers welfare cess as per GO No: LD 300 LET 2006, Bangalore, dated: 18-01-2007. The amount of subscription will be recovered out of payable amount to him in each bill. This component is deemed to have been included in the quoted rate.
31. **Last Date of Receipt and opening of Bids:** The completed Tenders must be submitted through Karnataka Public Procurement Portal <https://kppp.karnataka.gov.in/#/portal/portal-home> not later than **15.00 Hrs** on **16/10/2023** and shall be opened on **17/10/2023** at **15.30 Hrs**. K-RIDE will not be responsible for any delays in the receipt of Tender by K-RIDE. Late Tenders (received after stipulated date and time of submission of Tenders) shall not be accepted under any circumstances. K-RIDE reserves the right to accept/reject any or all proposals without assigning any reason thereof.
32. Any suit or application, arising out of any dispute or differences on account of this tender shall be filed in a competent court at Bengaluru, Karnataka only and no other court or any other district of the country shall have any jurisdiction in the matter.
33. **Address for Communication:** Interested eligible Tenderers may obtain further information from the following address:

**Addl. General Manager/Electrical,  
Rail Infrastructure Development Company (Karnataka) Limited,  
#8, 1<sup>st</sup> Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall  
Rajajinagar 1<sup>st</sup> Block, Bengaluru-560010  
Tel: +91-9036572939  
E-mail: [electrical.kride@gmail.com](mailto:electrical.kride@gmail.com), [jgmelec@kride.in](mailto:jgmelec@kride.in)**

**For any Query regarding e tendering portal/ Tender submission please contacthelpdesk  
Number [+91-8046010000](tel:+91-8046010000), [+91-8068948777](tel:+91-8068948777)  
Email: [support@epochhelpdesk.com](mailto:support@epochhelpdesk.com)**

# SECTION – 2

## INSTRUCTIONS TO TENDERERS (ITT)

SL.NO	DESCRIPTION	PAGE NO
	<b>A. GENERAL</b>	
1	SCOPE OF TENDER	9
2	ELIGIBLE TENDERERS	9
3	QUALIFICATION OF THE TENDERER	12
4	ONE TENDER FOR TENDERER	18
5	COST OF TENDERING	18
6	SITE VISIT	18
	<b>B. TENDER DOCUMENTS</b>	
7	CONTENT OF TENDER DOCUMENTS	19
8	CLARIFICATION OF TENDER DOCUMENT	19
9	AMENDMENT OF TENDER DOCUMENTS	20
	<b>C. PREPARATION OF TENDERS</b>	
10	DOCUMENTS COMPRISING THE TENDER	21
11	TENDER PRICES	21
12	TENDER VALIDITY	21
13	EARNEST MONEY DEPOSIT	22
14	FORMAT AND SIGNING OF TENDER	22
	<b>D. SUBMISSION OF TENDERS</b>	
15	SEALING AND MARKING OF TENDERS	25
16	DEADLINE FOR SUBMISSION OF TENDERS	25
17	LATE TENDERS	25
18	MODIFICATION AND WITHDRAWAL OF TENDERS	25
	<b>E. TENDER OPENING AND EVALUATION</b>	
19	OPENING OF FIRST COVER (DOCUMENT) OF ALL TENDERS AND EVALUATION TO DETERMINE QUALIFIED TENDERERS	26
20	OPENING OF SECOND COVER (DOCUMENT) TENDERS OF QUALIFIED TENDERS AND EVALUATION	26
21	PROCESS TO BE CONFIDENTIAL	27
22	CLARIFICATION OF TENDERS	27
23	EXAMINATION OF TENDERS AND DETERMINATION OF RESPONSIVENESS	27
24	CORRECTION OF ERRORS	27
25	EVALUATION AND COMPARISON OF TENDERS	28
	<b>F. AWARD OF CONTRACT</b>	
26	AWARD CRITERIA	29
27	EMPLOYER'S RIGHT TO ACCEPT ANY TENDER AND TO REJECT ANY OR ALL TENDERS	29
28	NOTIFICATION OF AWARD AND SIGNING OF AGREEMENT	29
29	PERFORMANCE SECURITY	29
30	ADVANCE PAYMENT AND SECURITY	30
31	CORRUPT OR FRAUDULENT PRACTICES	30
32	PURCHASE PREFERENCE TO MAKE IN INDIA	31
33	APPEAL	31

**SECTION 2: INSTRUCTIONS TO TENDERERS (ITT)**  
**TABLE OF CLAUSES**

**A. GENERAL**

**1. SCOPE OF THE TENDER:**

**1.1 THE RAIL INFRASTRUCTURE DEVELOPMENT COMPANY (KARNATAKA) LIMITED (K-RIDE),** Having its Corporate office, at #8, 1<sup>st</sup> Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall, Rajajinagar 1<sup>st</sup> Block, Bengaluru-560010, India, which is a Joint Venture of Government of Karnataka and Ministry of Railways invites Tenders from Eligible Tenderers, for the construction of works details as given in the invitation for the Tenders (IFT). The tenderers may submit the tenders for the works detailed in the IFT.

**2. ELIGIBLE TENDERERS:**

**2.1** The Tenderers shall not be under a declaration of ineligibility for corrupt and fraudulent practices issued by Govt. of Karnataka, Govt of India and PSUs.

**2.2 JOINT VENTURES:**

Tendering by a joint venture of Contractors is permissible, only for Tenders with Estimated value greater than 10 Cr, subject to following conditions:

- a. If the Applicant comprises a number of firms combining their resources in a joint venture, the legal entity constituting the joint venture and the individual partners in the joint venture shall be registered after award of work and shall not be under a declaration of ineligibility for corrupt and fraudulent practices issued by GOK.
- b. The joint venture must satisfy collectively the Qualification criteria. For this purpose, the following data of each member of the joint venture may be added together to meet the collective qualifying criteria:
  - i. Average annual turnover (sub clause 3.2a).
  - ii. Particular experience including key production rates. (Sub clause 3.2b & c).
  - iii. Financial means (sub clause 3.3b liquid assets, 3.6 assessed available Tender capacity & the audited balance sheets or other financial statements acceptable to the employer, for the last five years shall be submitted and must demonstrate current soundness of the applicant's financial position and indicates its prospective long-term profitability.
  - iv. Personnel capabilities (sub clause 3.3c: List of minimum key staff/position required during the contract implementation).
  - v. Equipment capabilities (sub clause 3.3a: own/lease equipment's).
- c. Each partner must satisfy the following criteria individually:

i. General construction experience for the period of years stated in Tender document (Instructions to Tenderers: The intending Tenderer/firm/company/ joint venture shall provide evidence that it has been actively engaged in execution OF “ **WORKS OF WIRING/CABLING, INSTALLATION AND COMMISSIONING OF ELECTRICAL ITEMS SUCH AS LIGHTS, FANS, PUMPS, CHARGING ARRANGEMENT, EARTHING, HVAC ETC (WITH OR WITHOUT SUPPLY OF ITEMS/EQUIPMENTS) FOR 230 V, SINGLE PHASE OR 415 V, 50Hz, 3 PHASE SYSTEM OR HIGHER VOLTAGES.**” work for at least for a period of 5 years prior to the submission of application.) (From FY: 18-19 to FY: 22-23).

- ii. Adequate sources to meet financial commitments on the other contracts (Sub clause 3.5: Accessed availed Tender capacity).
- i. **Financial Soundness (Instructions to Tenderers:** The intending Tenderer/firm/company shall provide the audited balance sheets or other financial statements acceptable to the employer for the last five years and must demonstrate the current soundness of the applicant’s financial position and indicate its prospective long-term profitability. If deemed necessary, the employer shall have the authority to make enquiries with the applicants’ bankers).
  - ii. **Litigation History (Instructions to Tenderers:** The intending Tenderer/firm/company/ joint venture shall provide accurate information on the related application form about any litigation or Arbitration resulting from contracts completed or on going under its execution over the last five years. The consisting history of awards against the tenderer or any partner of a joint venture may result in failure of the application).
  - iii. In accordance with the above, the Application shall include all related information required for individual partners in the joint venture
- d. **Joint venture is restricted to 3 (Three) number of partners.** One of the partners, who is responsible for performing a key function in contract management or is executing a major component of the proposed contract, shall be nominated as being in charge during the tendering periods and, in the event of a successful tender, during contract execution. The partner in charge shall be authorized to incur liabilities and receive instructions for and on behalf of any and all partners of the joint venture; this authorization shall be evidenced by submitting a power of attorney signed by legally authorized signatories of all the partners.
- e. All partners of the joint venture shall be legally liable, jointly and severally, during the tendering process and for the execution of the contract in accordance with the contract terms, and a statement to this effect shall be included in the authorization mentioned under Sub-Clause 2.2(d) above. **To enable the above, each of the partners of the joint venture shall meet not less than 25% of the qualifying criteria specified for Average annual turnover and Line of credit / liquid assets. All members of the joint venture must have experience in execution of similar work.**
- f. A copy of the Joint Venture Agreement (JVA) entered into by the partners shall be submitted with the Application. Pursuant to Sub-Clauses 2.2(c) to 2.2(f) above, the JVA shall include among other things: the JV’s objectives; the proposed management structure; the contribution of each partner to the joint venture operations; the commitment of the partners to joint and several liability for due performance; recourse/sanctions within the JV in the event of default or withdrawal of any partner; and arrangements for providing the required indemnities.

The lead partner shall enter into a Joint Venture agreement of Rs. 200.00 stamp paper in the prescribed format which shall be concluded prior to Tender and enclosed to the Tender document J.V. Partner shall not enter in to multiple JVs with different Tenderers of the same work.

- g. The qualification of a joint venture does not necessarily qualify any of its partners to tender individually or as a partner in any other joint venture or association. In case of dissolution of a joint venture prior to the submission of tenders, any of the constituent firms may qualify if they meet all of the qualification requirements, subject to the return approval of the employer. Individual members of a dissolved joint venture may participate as sub-contractor to qualified applicants, subject to the provisions mentioned below:

- “No firm can be a sub-contractor while submitting a tender individually or as a partner of a joint venture in the same tendering process. A firm, if acting in the capacity of sub-contractor in any tender, may participate in more than one tender, but only in that capacity. A tenderer who submits, or participates in, more than one tender will cause all the proposals in which the tender has participated to be disqualified.”
- A firm shall submit only one Tender in the same Tendering process, either individually as a Tenderer or as partner of Joint Venture.
- The necessary certificates/documents in support of pre-qualification criteria fulfilled as stipulated shall be scanned and attached to e-tender document. Scanned signature of the Tenderer/authorized representatives of the Tenderer shall be attached while uploading the Tender document.

Any Tenderer who is otherwise technically qualified withdraws was from the Tender process at any stage before a final decision is taken on the tender, the EMD of such Tenderer shall be forfeited, the name of such Tenderer shall be removed from the category list of contractors at least for a minimum period of one year in K-RIDE beside making such Tenderer liable for blacklisting.

- Tenders submitted by all Tenderers in the process of Tender evaluation will be opened even if the Tenderer withdraws from the Tender process by not submitting the original documents for verification or for any other reasons and the prices quoted by them will be looked into, to ascertain if there is collision amongst the Tenderers to determine the competitiveness of the L1 price quoted by other Tenderers, as per the decision by the K-RIDE.
- Prior to awarding of the work, the Lowest (L-1) Tenderer should produce the original documents in support of the uploaded documents to enter in to the agreement. If the lowest Tenderer (L-1) does not produce the original documents for entering into the agreement then his Tender can be treated as non-responsive Tender as per clause 26(4) of the KPPP Rules. The name of the Tenderers who do not produce the original documents shall be removed/debarred from the select list of K-RIDE enrollment and barred from participation in any of the tenders to be invited by K-RIDE a part from forfeiting the EMD paid through e-cash.

- The bidder, JV Partner shall not be under Corporate Debt Restructuring (CDE)/ Strategic Debt Restructuring (SDR) or Bureau of Industrial & financial reconstruction (BIFR) in last 5 years to bid submission date. In this regard, the bidder shall submit along with bid, a certificate with a declaration that, the bidder is not under CFR/SDR or BIFR.
- Further information about e-tendering can be had from Karnataka Public Procurement Portal <https://kppp.karnataka.gov.in/#/portal/portal-home>

### 3. QUALIFICATION OF THE TENDERER.

#### 3.1 All the tenderers shall provide the requested information accurately and sufficient details in section 3: Qualification information. The Joint Venture to be formed prior to the Bidding.

Pre-qualification will be based on Applicants meeting all the following minimum pass–fail criteria regarding their general and particular construction experience, financial position, personnel and equipment capabilities, and other relevant information as demonstrated by the Applicant's responses in the Information Forms attached to the Letter of Application. Additional requirements for joint ventures are given in para 2.2

#### 3.2 The following qualification criteria should be met by the intending Tenderers.

a)

1. The intending Tenderer/firm/ company should possess valid class-1 Electrical Contractor License.
2. Required average annual turnover (in all contractual works): The intending Tenderer/firm/ Company/Joint Venture should have achieved a **MINIMUM AVERAGE ANNUAL CONSTRUCTION TURNOVER of Rs. 2.58 Crores in last five financial years from 2018-19 to 2022-23.**

**NOTE:** The Tenderers shall submit certificates to this effect which may be attested certificates from the concern departments/ Client or Audited balance sheet duly certified by the Statutory auditor duly supported by audited balance sheet. The Turnover certificate duly certified by Statutory auditor should be uploaded. Financial turnover of previous years will be given a weightage of 10% per year or part thereof up to the month previous to the Bid submission month as indicated in qualification information (Tender Forms) Form FIN-2 based on the rupee value to bring them to current FY:2023-24 price value.

- b) The Tenderer/Firm/company/JV should have satisfactorily completed at least one similar work such as “WORKS OF WIRING/CABLING, INSTALLATION AND COMMISSIONING OF ELECTRICAL ITEMS SUCH AS LIGHTS, FANS, PUMPS, CHARGING ARRANGEMENT, EARTHING, HVAC ETC (WITH OR WITHOUT SUPPLY OF ITEMS/EQUIPMENTS) FOR 230 V, SINGLE PHASE OR 415 V, 50Hz, 3 PHASE SYSTEM OR HIGHER VOLTAGES.” of Value not less than Rs 0.646 Crores at current FY: 2023-24 price level in the last five financial years. (FY 2018-19 to FY 2022-23).

**NOTE:**

1. The criteria above applies to the Individual Tenderer/Firm/company/Joint venture also. Certificate regarding the same duly signed by an officer not below the rank of the Executive Engineer to be submitted along with the technical Tender.

2. Similar work is defined as below:  
Work of execution of **“WORKS OF WIRING/ CABLING, INSTALLATION AND COMMISSIONING OF ELECTRICAL ITEMS SUCH AS LIGHTS, FANS, PUMPS, CHARGING ARRANGEMENT, EARTHING, HVAC ETC (WITH OR WITHOUT SUPPLY OF ITEMS/ EQUIPMENTS) FOR 230 V, SINGLE PHASE OR 415 V, 50Hz, 3 PHASE SYSTEM OR HIGHER VOLTAGES.”**
  3. The contract is considered as completed if 90% or more of the work is physically completed which is to be substantiated by a certificate from the Employer who has awarded the contract to the Bidder and the contract amount so received should be equal to or more than the minimum value as per eligibility criteria 3.2 (b).
  4. For completed works, the value of work done shall be updated to FY 2023-24 price level assuming 10% inflation for Indian rupees every year or part thereof up to the month previous to the Bid submission month. Credentials if submitted in foreign currency shall be converted into Indian currency i.e., Indian Rupee as under: Bids will be compared in Indian Rupees only. This will be achieved by conversion of the Foreign Currency portion of the Bid into Indian Rupees by using the Exchange Rates published by Financial Benchmarks India Pvt. Ltd (www.fbil.org.in) 28 (twenty-eight) days before the latest date of Bid submittal, and then adding the same to the Indian Rupee portion of the Bid. In case this particular day happens to be a holiday, the exchange rate published by Financial Benchmarks India Pvt. Ltd (www.fbil.org.in) on the next working day will be considered.
  5. In case of JV/Consortium, full value of the work, if done by the same JV shall be considered. However, if qualifying work (s) done by them in JV/Consortium having different constituents, then the value of work as per their percentage participation in such JV/Consortium shall be considered.
- c) The intending Tenderer / firm/ company / Joint Venture should have executed all the components within last five financial years and Each component should have been executed in any one year (Any continuous 12 months).**

Component No.	Nature of Work	Minimum component of work
1	Internal Electrification of a Building.	1 WORK.

**NOTE: -**

1. The criteria above applies to the Individual Tenderer/Firm/ company / Joint Venture also. Certificate regarding the same duly signed by an officer not below the rank of the Executive Engineer should be submitted along with the technical Tender.
  2. The qualifications, capacity, and resources of proposed subcontractors will not be taken into account in assessing those of individual or joint venture Applicants, unless they are named specialist subcontractors.
- Replace CA audit with Statutory Auditor wherever applicable, except in qualification of experts.



### 3.3 Each Tenderer should further demonstrate:

- 3.3 a) **KEY PLANT AND EQUIPMENT: Availability by owning at least 50% of the required following key and critical equipment's for this work and the remaining 50 % can be deployed on lease/hire for all works provided, the relevant documents (Commitment agreements etc.,) for availability for this work are to be furnished:**

The intending Tenderer/firm/company/Joint venture should furnish details of ownership / lease certificates of the following minimum requirement of machineries:

#### **PLANT AND EQUIPMENT**

##### **(I) KEY AND CRITICAL EQUIPMENTS**

SI. No	Item Description	Unit	Qty
1	Electric Hand Driller	No's	1
2	Digital Multi meter	No's	1
3	Insulation Megger	No's	1
4	Digital Earth Tester	No's	1
5	Ladder	No's	2
6	Hand Tool Kit	No's	2
7	Angle Grinder Machine	No's	2
8	Crimping Tool	Each	1
9	Set of Wrench, Socket Spanner	No's	1

##### **(II) Other Plant and equipment to be deployed (The Tenderer has to furnish the details of Own basis and Lease/Hire basis for the following equipment)**

SI. No	Item Description	Unit	Qty
	NIL		

- 3.3 b) **LIQUID ASSETS: The Tenderer / firm/company/Joint Venture should furnish details of liquid assets and or availability of credit facilities of Rs. 0.431 Crores for the work mentioned above for meeting the required funds in the form of own funds /credit lines / certificate from scheduled Nationalized Bank.**

The Bidder should have access to or has available liquid assets, lines of credit and other financial means to meet cash flow. The audited balance sheet and/or banking reference certified by Chartered Accountant with their stamp, signature and membership number shall be submitted by the Tenderer along with the Tender.

Banking reference should contain in clear terms the amount that bank will be in position to lend for this work to the applicant/member of the joint venture. In case the Net Current Assets (as seen from the balance sheet) are negative, only the banking references will be considered. Otherwise, the aggregate of Net Current Assets and submitted banking references will be considered for working out the Liquidity.

The banking reference should be, from a scheduled Bank in India it should not be more than three months old as on date of submission of Bids.

In case of JV firm's overall liquidity of JV firm shall be assessed by arithmetic sum of liquidity of all members of JV as specified in JV matrix.

- 3.3 c) LIST OF MINIMUM KEY TECHNICAL PERSONNEL:** List of Minimum Key Technical personnel required for the work are as under and should be enrolled in company/firm/Joint venture under Employment register and document should be uploaded. The Contractor shall have a competent team of Managers, Engineers, Technical staff etc. so as to complete the work satisfactorily as per various requirements of the contract. The Key Positions not limited to and corresponding qualification and experience are as under:

Sl. No.	Position	Minimum No. of Personnel	Qualification	Minimum Experience in Similar Work [years]
1	Sr. Engineer	1	Graduate in Electrical Engg.	Min. 5 Years and above
2	Technicians/ Electricians	2	Diploma / ITI in Electrical	Min. 5 years of experience

**Note:** The CV's to be given for Serial No. 1 as per Form-6 of section-3 and Serial No. 2 the details to be given as per Form-5 of section-3 (Qualification information /Bidding Forms).

- 3.4 To qualify for a package of contracts made up of this and other contracts for which tenders are invited in this IFT, the Tenderer must demonstrate having experience and resources to meet the aggregate of the qualifying criteria for the individual contracts.**

- 3.5 Sub-contractors' experience and resources shall not be taken into account in determining the Tenderer's compliance with the qualifying criteria**

- 3.6 BID CAPACITY: Tenderers who meet the above specified minimum qualifying criteria, will only be qualified, if their available tender capacity is more than the total tender value. The available tender capacity will be calculated as under:**

**Assessed available tender capacity = (A\*N\*1.5 - B) Where**

A = Maximum value of works executed in any one year during the last five financial years updated to the current price level @10% per year.

N = Number of years prescribed for completion of the works for which tenders are invited.

B = Value of existing commitments and on-going works to be completed during the period of completion of the work for which tenders are invited.

The statements showing the value of existing commitments and on-going works as well as the stipulated period of completion remaining for each of the works listed should be countersigned by the Employer in charge not below the rank of an Executive Engineer or equivalent.

**Note:** Enclose Certificate(s) from Engineer(s) In-charge (not below the rank of Executive Engineer) for value of outstanding work. In case it is not feasible to furnish certificate from all the units the bidder should record the following certificate on Fin-3:

*“Certified that current commitments on all the contracts have been awarded or for which a letter of intent or acceptance has been received or for the works in progress or the works approaching completion, value of outstanding work has been indicated in the above table correctly. It is further certified that if later on the employer discovers that information provided in the table is incorrect then the employer will treat our bid invalid and it will be liable for rejection”.*

**3.7 NETWORTH:** The Bidder’s net worth for the last financial year calculated **should be Positive.**

**3.8 Even though the Tenderers meet the above criteria, they are subject to be disqualified if they have:**

- made misleading or false representations in the forms, statements and attachments submitted in proof of the qualification requirements; and/or
- record of poor performance such as abandoning the works, not properly completing the contract, inordinate delays in completion, litigation history, or financial failures etc.; and/or
- participated in the previous Tender for the same work and had quoted unreasonably high tender prices and could not furnish rational justification.

K-RIDE

**3.9 ELIGIBILITY CRITERIA TABLE/ MATRIX:**

Requirement	Single Entity	Joint Venture			Submission Requirements
		Lead Partner	Other Partners	All partners combined	
<b>Clause: 3.2.(a) 2.</b> (Minimum Average Annual construction turnover)	Must meet the requirement	Must meet 50% of the requirement	Must meet 25% of the requirement	Must meet the requirement	Form FIN-2
<b>Clause: 3.2 (b)</b> One Similar work	Must meet the requirement	Must meet the requirement	Must have experience in similar work.	Must meet the requirement	Form at para 1.3/section:3
<b>Clause: 3.2 (c)</b> Internal Electrification of a Building.	Must meet the requirement	All Partners Combined Must Meet requirement			Form at para 1.4/section:3
<b>Clause: 3.3 (I)</b> Key and Critical Equipment's	Must meet the requirement	All Partners Combined Must Meet requirement			Form at para 1.6/section:3
<b>Clause: 3.3 (II)</b> Other plant and Equipment's	Must meet the requirement	All Partners Combined Must Meet requirement			Form at para 1.6/section:3
<b>Clause: 3.3(b)</b> Liquid Asset	Must meet the requirement	Must meet 50% of the requirement	Must meet 25% of the requirement	Must meet the requirement	Form at para 1.10/section:3
<b>Clause: 3.3(c)</b> Minimum Key Technical Staff	Must meet the requirement	All Partners Combined Must Meet requirement			Form No.5 & 6 of Section 3
<b>Clause: 3.6</b> Bid capacity	Must meet the requirement	All Partners Combined Must Meet requirement			Form at para 1.5/section:3 and Form FIN-3/ section:3
<b>Clause: 3.7</b> Net worth	Must meet the requirement	Must meet the requirement	Must meet the requirement	Must meet the requirement	Form FIN-1/ section:3

3.10 The applicant must attach with their application, a note giving a general description on the approach to the construction methods, technologies, quality assurance schemes proposed, deployment schedule of equipment proposed to be used, etc., for ensuring completion of the work as per specifications within the desired time-frame.

**4. ONE TENDER PER TENDERER:**

4.1 Each tenderer shall submit only one tender for one package. A tenderer who submits or participates in more than one Tender (other than as a sub-contractor or in cases of alternatives that have been permitted or requested) will cause all the proposals with the Tenderer's participation to be disqualified.

**5. COST OF TENDERING:**

5.1 The tenderer shall bear all costs associated with the preparation and submission of his tender, and the Employer will in no case be responsible and liable for those costs.

**6. SITE VISIT:**

6.1 The Tenderer at his own responsibility and risk is encouraged to visit and examine the Site of Works and its surroundings and obtain all information that may be necessary for preparing the Tender and entering into a contract for construction of the Works. The cost of visiting the Site shall be at the Tenderer's own expense.

K-RIDE

## B -TENDER DOCUMENTS

### 7. CONTENT OF TENDER DOCUMENTS

7.1 The set of tender documents shall have all the Section given in content page.

### 8. CLARIFICATION OF TENDER DOCUMENTS

8.1 A prospective tenderer requiring any clarification of the tender documents may notify the Employer in writing or by cable (hereinafter "cable" includes telex, E-Mail and facsimile) at the Employer's address indicated in the invitation to tender. The Employer will respond to any request for clarification which he receives earlier than 15 days prior to the deadline for submission of tenders. Copies of the Employer's response will be forwarded to all purchasers of the tender documents, including a description of the enquiry but without identifying its source.

#### 8.2 Pre-tender meeting:

8.2.1 The tenderer or his authorized representative is invited to attend a pre-tender meeting which will take place at office of **K-RIDE Bangalore.**

**Venue:** #8, 1<sup>st</sup> Floor, Samparka Soudha, Dr. Rajkumar Road,  
Opposite Orion Mall, Rajajinagar 1<sup>st</sup> Block,  
Bengaluru-560010  
Tel +91-9036572939

**Date:** 29/09/2023, **Time:** IST 11.30 Hrs.

8.2.2 The purpose of the meeting will be to clarify issues and to answer questions on any matter that may be raised at that stage.

8.2.3 The tenderer is requested to submit any questions in writing or by cable to reach the Employer not later than one week before the meeting.

8.2.4 Minutes of the meeting, including the text of the questions raised (without identifying the source of enquiry) and the responses given will be published without delay to all purchasers of the tender documents. Any modification of the tender documents listed in Sub-Clause 7.1 which may become necessary as a result of the pre-tender meeting shall be made by the Employer exclusively through the issue of an Corrigendum/Addendum pursuant to Clause 9 and not through the minutes of the pre-tender meeting.

8.2.5 Non-attendance at the Pre-Tender meeting will not be a cause for disqualification of a Tenderer.

## 9. AMENDMENT OF TENDER DOCUMENTS

- 9.1 Before the deadline for submission of Tenders, the Employer may modify the tender documents by issuing corrigendum/addendum
- 9.2 Any corrigendum / addendum issued shall be part of the tender documents and shall be made available on the website or e-portal. The Provisions in corrigendum /addenda shall take priority over the Tender Documents issued previously.
- 9.3 To give prospective Tenderers reasonable time in which to take an addendum into account in preparing their tenders, the Employer shall extend as necessary the deadline for submission of Tenders, in accordance with Sub-Clause 16.2 below.

K-RIDE

## C. PREPARATION OF TENDERS

### 10. DOCUMENTS COMPRISING THE TENDER

10.1 The Tender submitted by the Tenderer shall be in two covers (documents) and shall contain the documents as follows:

#### 10.1.1 First Cover (Document):

- Earnest Money Deposit;
- Qualification Information as per formats given in Section 3;

#### 10.1.2 Second Cover (Document):

- The Tender (in the format indicated in Section 4) (as per Karnataka Public Procurement Portal)
- Priced Schedule (Section 9); online through Karnataka Public Procurement Portal, no hardcopy of commercials should be attached or disclosed. (As per Karnataka Public Procurement Portal)
- And any other materials required to be completing and submitting by Tenderers in accordance with these instructions. The documents listed under Sections 3, 4, 6 and 9 shall be filled in without exception.

#### 10.2 DELETED

### 11. TENDER PRICES

- 11.1 The contract shall be for the whole works as described in Sub-Clause 1.1, based on the price Schedule submitted by the Tenderer.
- 11.2 The Tenderer shall fill the percentage and total amount (both in figures and words) for each schedule of the Works described in the Price Schedule. Corrections, if any, shall be made by crossing out, initialing, dating and rewriting. Schedule for which no amount or lumpsum price is entered by the tenderer will not be paid by the employer when executed and shall be deemed to be covered in the priced schedule.
- 11.3 Contract prices shall be inclusive of all Taxes, Duties etc., The rates quoted by the tenderer must be inclusive of all Taxes, Duties etc.,
- 11.4 The amount quoted by the Tenderer shall be subject to adjustment during the performance of the Contract in accordance with the provisions of Clause of the Conditions of Contract.

### 12. TENDER VALIDITY

- 12.1 Tenders shall remain valid for a period not less than **one hundred and eighty days** after the deadline date for tender submission specified in Clause 16. A tender valid for a shorter period shall be rejected by the Employer as non-responsive.



12.2 In exceptional circumstances, prior to expiry of the original time limit, the Employer may request that the Tenderers may extend the period of validity for a specified additional period. The request and the Tenderers' responses shall be made in writing or by cable. A Tenderer may refuse the request without forfeiting his earnest money deposit. A Tenderer agreeing to the request will not be required or permitted to modify his tender, but will be required to extend the validity of his earnest money deposit for a period of the extension, and in compliance with Clause 13 in all respects.

### 13. EARNEST MONEY DEPOSIT (TENDER/BID SECURITY)

- 13.1 Earnest Money Deposit/ Tender security (as per Karnataka Public Procurement Portal). The Tenderer shall furnish, as part of his tender, earnest money deposit in the amount as shown in column 4 of the Table of IFT for this particular work. This earnest money deposit shall be in favour of Rail Infrastructure Development Company (Karnataka) Limited Payable at Bangalore and may be in the form of as mentioned in Clause 13.7 of ITT (section-2).
- 13.2 Instruments having fixed validity issued as earnest money deposit for the tender shall be valid for 45 days beyond the validity of the tender.
- 13.3 Any tender not accompanied by an acceptable earnest money deposit and not secured as indicated in Sub-Clauses 13.1 and 13.2 above shall be rejected by the Employer as non-responsive.
- 13.4 The earnest money deposit of unsuccessful Tenderers will be returned within 30 days of the end of the tender validity period specified in Sub-Clause 12.1.
- 13.5 The earnest money deposit of the successful Tenderer will be discharged when the Tenderer has signed the Agreement and furnished the required Performance Security.
- 13.6 The earnest money deposit may be forfeited:
- (A) If the Tenderer withdraws the Tender after tender opening during the period of tender validity;
  - (B) If the Tenderer does not accept the correction of the Tender Price, pursuant to Clause 24; or
  - (C) In the case of a successful Tenderer, if the Tenderer fails within the specified time limit to
    - (i) sign the Agreement; or
    - (ii) furnish the required Performance Security

#### 14. FORMAT AND SIGNING OF TENDER

Tenderer shall submit the Tender electronically before the submission date and time published in Karnataka Public Procurement Portal. The Tenderer must submit Technical and Financial Tender as described in ITT.

All pages of the tender where entries or amendments have been made shall be initialed by the person signing the tender. The Tender shall contain no alterations or additions, except those to comply with instructions issued by the Employer, or as necessary to correct errors made by the Tenderer, in which case such corrections shall be initialed by the person signing the Tender.

<b>Language of Tender</b>	The language of the Tender: English
<b>Technical Tender</b>	Alternative technical solutions are not permitted.
<b>Technical Tender Documents</b>	All the Forms of Section 3: Qualification Information/Bidding Forms.
<b>Alternative Bids/Tenders</b>	Alternative Bids are not permitted.
<b>Currencies of Tender and Payment</b>	The amount shall be quoted by the Tenderer entirely in Indian Rupees (INR). For Evaluation and comparison purposes, the currencies of the Tender shall be converted in to Indian Rupees.
<b>Any amendments such as interlineations, erasures, or overwriting shall be valid only if they are signed or initialed by the Person signing the Tender</b>	<p>The written confirmation of authorization to sign on behalf of the Tenderer shall consist of:</p> <ol style="list-style-type: none"> <li>In case of Private/Public Companies, a POA from the Director of the Company who has been authorized by the Board of Directors through resolution to sign on behalf of the Company. Copy of Board Resolution shall also be submitted.</li> <li>In case of proprietorship Tenderers, Power of Attorney by the Proprietors.</li> <li>In case of partnership Tenderers, Power of Attorney duly signed by all the partners.</li> <li>In case of Limited Liability Partnership (LLP), a POA from the Director of the Company who has been authorized by the Board of Directors through resolution to sign on behalf of the Company. Copy of Board Resolution shall also be submitted.</li> <li>In case of Joint Venture, Power of Attorney duly signed by individual partners to the Lead partner as per the form given in Section-4 with stipulated documents.</li> </ol>

The Bid shall be digitally signed by using class-III digital signature of a person who is dully authorized to sign on behalf of the bidder. This authorization shall consist of a written confirmation as specified in the BDS and shall be attached to the bid. The name and position held by each person signing the authorization must be typed or printed below the signature. If either the Letter of Technical Bid or Letter of Price Bid or Bid-Security Declaration (if applicable) is not signed, the Bid shall be rejected. All pages of the bid, except for un-amended printed literature, shall be signed or initialed by the person signing the bid.

Section:2 Instruction To Tenderers (ITT)

---

- I. If the Tender is submitted by proprietary firm, it shall be signed by the proprietor above his full name, full name of his firm with his current address.
- II. If the Tender is submitted by a firm in partnership, it shall be signed by a partner holding the power of Attorney for the firm. A certified copy of the Partnership deed and power of attorney shall accompany the Tender; Alternatively, it shall be signed by all the partners.
- III. If the Tender is submitted by a limited company or a limited corporation, it shall be signed by a duly authorized person holding the power of attorney for the firm. A certified copy of the power of attorney shall accompany the Tender.
- IV. If a Tender is submitted by a Joint venture/Consortium, each firm in the Joint venture/Consortium shall furnish the evidence admissible in law /Power of Attorney to sign the Form of Tender and Lead member as stated in JV Agreement shall sign the Tender documents for submission of Tender.

Any amendments such as interlineations, erasures, or overwriting shall be valid only if they are signed or initialed by the person signing the Tender

K-RIDE

## **D. SUBMISSION OF TENDERS**

### **15. SEALING AND MARKING OF TENDERS**

Tenderer shall submit the Tender electronically before the submission date and time published.

### **16. DEADLINE FOR SUBMISSION OF THE TENDERS**

16.1 Tenders must be submitted online through Karnataka Public Procurement Portal to the Employer on or before the date as specified in the Karnataka Public Procurement Portal and the submission of tender is the responsibility of the Tenderer.

16.2 The Employer may extend the deadline for submission of tenders by issuing an amendment in accordance with Clause 9, in which case all rights and obligations of the Employer and the Tenderers previously subject to the original deadline will then be subject to the new deadline.

### **17. LATE TENDERS**

17.1 In online e-procurement system, the Tenderer shall not be able to submit the Tender after the Tender submission time and date as the icon for the task in the Karnataka Public Procurement Portal will not be available. Any Tender received by the Employer after the deadline prescribed in Clause 16 will be rejected.

17.2 "It shall be the responsibility of the tenderers to ensure that their tender is submitted in the Karnataka public procurement portal within the last date and time specified for the receipt of the tenders

### **18. MODIFICATION AND WITHDRAWAL OF TENDERS**

18.1 Tenderer may modify and correct or upload any relevant document in the portal till Tender submission date and time, as published in the Karnataka Public Procurement Portal.

18.2 No Tender may be modified after the deadline for submission of Tenders.

18.3 Withdrawal or modification of a Tender between the deadline for submission of Tenders and the expiration of the original period of Tender validity specified in Clause 12.1 above or as extended pursuant to Clause 12.2 may result in the forfeiture of the earnest money deposit pursuant to Clause 13.

18.4 DELETED

### **E. TENDER OPENING AND EVALUATION**

#### **19. OPENING OF FIRST COVER (Document):** Opening of First Cover (Document) of all Tenders and evaluation to determine qualified Tenderers:

- 19.1 The Employer will open the First Covers (Document) of all the Tenders received (except those received late or withdrawn), including modifications for First Cover (Document) made pursuant to Clause 18, in the presence of the Tenderers or their representatives who choose to attend as per Karnataka Public Procurement Portal on the date and the place specified in Clause 16. In the event of the specified date of Tender opening being declared a holiday for the Employer, the Tenders will be opened at the appointed time and location on the next working day.
- 19.2 DELETED
- 19.3 The Tenderer name, the presence or absence of earnest money deposit (amount, format and validity), the submission of qualification information and such other information as the Employer may consider appropriate will be announced by the Employer at the opening.
- 19.4 The Employer shall prepare minutes of the Tender opening, including the information disclosed to those present in accordance with Sub-Clause 19.3.
- 19.5 DELETED
- 19.6 The Employer will evaluate and determine whether each tender (a) meets the eligibility criteria defined in ITT Clause 2 is accompanied by the required earnest money deposit as per stipulations in ITT Clause 13 and meets the minimum qualification criteria stipulated in ITT Clause 3. The Employer will draw out a list of qualified Tenderers.

#### **20. OPENING OF SECOND COVER (DOCUMENT) OF QUALIFIED TENDERERS AND EVALUATION:**

- 20.1 The Employer will inform all the Qualified Tenderers the time, date and venue fixed for the opening of the Second Cover (Document) containing the priced Tenders published Karnataka Public Procurement Portal. The Employer will open the Second Covers (Document) of Qualified Tenderers at the appointed time and date in the presence of the Tenderers or their representatives who choose to attend. In the event of the specified date of financial Tender opening being declared a holiday for the Employer, the Second Covers (Document) will be opened at the appointed time and location on the next working day.
- 20.2 DELETED
- 20.3 The Tenderers' names, the Tender prices, the total amount of each Tender, Tender modifications and withdrawals, and such other details as the Employer may consider appropriate, will be announced by the Employer at the opening. No Tender shall be rejected at Tender opening.
- 20.4 The Employer shall prepare minutes of the Second Cover (Document) Tender opening, including the information disclosed to those present in accordance with Sub-Clause 20.3.

## 21. PROCESS TO BE CONFIDENTIAL

- 21.1 Information relating to the examination, clarification, evaluation, and comparison of Tenders and recommendations for the award of a contract shall not be disclosed to Tenderers or any other persons not officially concerned with such process until the award to the successful Tenderer has been announced. Any effort by a Tenderer to influence the Employer's processing of Tenders or award decisions may result in the rejection of his Tender.

## 22. CLARIFICATION OF TENDERS

- 22.1 To assist in the examination, evaluation, and comparison of Tenders, the Employer may, at his discretion, ask any Tenderer for clarification of his Tender, including breakdowns of unit rates. The request for clarification and the response shall be in writing or by cable, but no change in the price or substance of the Tender shall be sought, offered, or permitted except as required to confirm the correction of arithmetic errors discovered by the Employer in the evaluation of the Tenders in accordance with Clause 24.
- 22.2 No Tenderer shall contact the Employer on any matter relating to its Tender from the time of the Tender opening to the time the contract is awarded.

**If they have any query/clarification related to e-Procurement on the Karnataka Public Procurement Portal, contact e-Procurement Help desk from 10:00 AM to 5:00 PM. Ph. No.: +91-8046010000/ 8068948777 or [support@eprochelpdesk.com](mailto:support@eprochelpdesk.com) Karnataka Public Procurement Portal through query option on or before specified time.**

- 22.3 Any effort by the Tenderer to influence the Employer in the Employer's Tender evaluation, Tender comparison or contract award decisions may result in the rejection of the Tenderers' Tender.

## 23. EXAMINATION OF TENDERS AND DETERMINATION OF RESPONSIVENESS

- 23.1 Prior to the detailed evaluation of Tenders, the Employer will determine whether each Tender; (a) has been properly signed; and; (b) is substantially responsive to the requirements of the Tender documents.
- 23.2 A Substantially responsive Tender is one which conforms to all the terms, conditions, and specifications of the Tender documents, without material deviation or reservation. A material deviation or reservation is one (a) which affects in any substantial way the scope, quality, or performance of the Works; (b) which limits in any substantial way, inconsistent with the Tender documents, the Employer's rights or the Tenderer's obligations under the Contract; or (c) whose rectification would affect unfairly the competitive position of other Tenderers presenting substantially responsive Tenders.
- 23.3 If a Tender is not substantially responsive, it will be rejected by the Employer, and may not subsequently be made responsive by correction or withdrawal of the nonconforming deviation or reservation.

## 24. CORRECTION OF ERRORS

- 24.1 Tenders determined to be substantially responsive will be checked by the Employer for any arithmetic errors. Errors will be corrected by the Employer as follows:
- where there is a discrepancy between the amount in figures and in words, the lower of the two will govern
  - Deleted.
- 24.2 The amount stated in the Tender will be adjusted by the Employer in accordance with the above procedure for the correction of errors and, with the concurrence of the Tenderer, shall be considered as binding upon the Tenderer. If the Tenderer does not accept the corrected amount the Tender will be rejected, and the earnest money deposit may be forfeited in accordance with Sub-Clause 13.6 (b).

## 25. EVALUATION AND COMPARISON OF TENDERS

- 25.1 The Employer will evaluate and compare only the Tenders determined to be substantially responsive in accordance with Clause 23.
- 25.2 In evaluating the Tenders, the Employer will determine for each Tender the evaluated Tender Price by adjusting the Tender Price as follows:
- (a) Making any correction for errors pursuant to Clause 24; and
  - (b) DELETED
- 25.3 The Employer reserves the right to accept or reject any variation, deviation, or alternative offer. Variations, deviations, and alternative offers and other factors which are in excess of the requirements of the Tender documents or otherwise result in unsolicited benefits for the Employer shall not be taken into account in Tender evaluation.
- 25.4 The estimated effect of the price adjustment conditions under Clause 40 of the Conditions of Contract, during the implementation of the Contract, will not be taken into account in tender Evaluation
- 25.5 If the tender of the successful tenderer is seriously unbalanced in relation to the Employer's estimate of the cost of the work to be performed under the contract, the Employer may require the Tenderer to produce detailed price analyses for any or all items of the Price Schedule, to demonstrate the internal consistency of those prices with the construction methods and schedule proposed. After evaluation of the price analyses, the Employer may require that the amount of the performance security set forth in Clause 29 be increased at the expense of the successful Tenderer to a level sufficient to protect the Employer against financial loss in the event of default of the successful Tenderer under the contract.

## F. AWARD OF CONTRACT

### 26. AWARD CRITERIA

26.1 Subject to Clause 27, the Employer will award the Contract to the Tenderer whose Tender has been determined to be substantially responsive to the Tender documents and who has offered the lowest evaluated Tender Price, provided that such Tenderer has been determined to be (a) eligible in accordance with the provisions of Clause 2, and qualified in accordance with the provisions of Clause 3.

### 27. EMPLOYER'S RIGHT TO ACCEPT ANY TENDER AND TO REJECT ANY OR ALL TENDERS

27.1 Notwithstanding Clause 26, the Employer reserves the right to accept or reject any Tender, and to cancel the Tender process and reject all Tenders, at any time prior to the award of Contract, without thereby incurring any liability to the affected Tenderer or Tenderers or any obligation to inform the affected Tenderer or Tenderers of the grounds for the Employer's action.

### 28. NOTIFICATION OF AWARD AND SIGNING OF AGREEMENT

28.1 The Tenderer whose Tender has been accepted will be notified of the award by the Employer prior to expiration of the Tender validity period by cable, telex, e-mail or facsimile confirmed by registered letter. This letter (hereinafter and in the *Conditions of Contract* called the "Letter of Acceptance") will state the sum that the Employer will pay the Contractor in consideration of the execution, completion, and maintenance of the Works by the Contractor as prescribed by the Contract (hereinafter and in the Contract called the "Contract Price").

28.2 The notification of award will constitute the formation of the Contract, subject only to the furnishing of Performance Security in accordance with the provisions of Clause 29. Until a formal contract is prepared and executed, the notification of award shall constitute a binding Contract.

28.3 The Agreement will incorporate all agreements between the Employer and the successful Tenderer. It will be kept ready for signature of the successful Tenderer in the office of Employer within 30 days following the notification of award along with the Letter of Acceptance. Within 20 days of receipt, the successful Tenderer will sign the Agreement and deliver it to the Employer.

28.4 Upon the furnishing by the successful Tenderer of the Performance Security, the Employer will promptly notify the other Tenderers that their Tenders have been unsuccessful.

28.5 The Cost of stamp duty of the contract agreement shall be borne by the contractor as per the Karnataka Stamp Duty Act.

### 29. PERFORMANCE SECURITY

29.1 Within 20 days of receipt of the Letter of Acceptance, the successful Tenderer shall deliver to the Employer a Performance Security in any of the forms given below for an amount equivalent to **3% of the Contract price plus additional security for unbalanced tenders (additional**



**security at 50% of the estimated cost of the unbalanced component)** in accordance with Clause 25.5 of ITT and Clause 43 of the Conditions of Contract.

- Banker's cheque/Demand draft, /Pay Order/ BG in favour of K-RIDE, Bangalore or
- A bank guarantee in the form given in Section 10; or
- Specified Small Savings Instruments pledged to K-RIDE, Bangalore.
- Specified small savings instruments in the form of "Fixed Deposits (without any encumbrances)" in the name of K-RIDE

29.2 If the Performance Security deposit is provided by the successful tenderer in the form of Bank Guarantee, it shall be issued either by a Nationalized / Scheduled bank.

29.3 The Performance Security deposit if furnished in cash or demand draft can, if requested, be converted to interest bearing securities at the cost of the contractor.

29.4 Failure of the successful tenderer to comply with the requirements of sub-clause 29.1 and clause 29 of additional ITT, shall constitute sufficient grounds for cancellation of the Tender award and forfeiture of the Earnest money deposit.

### 30. ADVANCE PAYMENT AND SECURITY:

30.1 The Employer will provide an advance payment on the contract price as stipulated In the condition of contract subject to the maximum as stated In the contract data.

### 31. CORRUPT OR FRAUDULENT PRACTICES

31.1 "corrupt practice" means the offering, giving, receiving or soliciting of anything of value to influence the action of the public official in the procurement process or in contract execution;

"Fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of the Procurement Entity, and includes collusive practice among the tenderers either prior to or after tender submission, designed to establish tender prices at artificial non-competitive levels and to deprive the Procurement Entity of the benefits of free and open competition;". The debarment action shall be taken as per KTPP Act.

31.2 The K-RIDE requires that the Tenderers/Suppliers/Contractors, observe the highest standard of ethics during the procurement and execution of such contracts. In pursuance of this policy, K-RIDE:

- a) will reject a proposal for award if it determines that the Tenderer recommended for award has engaged in corrupt or fraudulent practices in competing for the contract in question;
- b) will declare a firm ineligible, either indefinitely or for a stated period of time, to be awarded a K-RIDE contract if it at any time determines that the firm has engaged in corrupt or fraudulent practices in competing for, or in executing, a K-RIDE contract.

31.3 Furthermore, Tenderers shall be aware of the provision stated in sub-clause 50.2 of the Conditions of Contract.

**32. PURCHASE PREFERENCE TO MAKE IN INDIA:**

The provisions of revised 'Public Procurement (Preference to Make in India) Order 2017' issued by Department of Industrial Policy and Promotion under Ministry of Commerce and Industry vide letter no. P-45021/2/2017-PP (BE-II) dated 28.05.2018 shall be applicable to the tendering process and award of the contract shall be done accordingly. In this connection, the minimum local content shall be 50% and the margin of purchase preference shall be 20%. For award of contract, para 3.c. of the revised 'Public Procurement (Preference to Make in India) Order 2017' shall be applicable in addition to the other provisions in the tendering documents in this regard.

**33. APPEAL:**

The Tenderer shall submit online appeal within 30 days period from the date of receipt of order to the Employer through the Karnataka Public Procurement Portal. The Employer may after giving opportunity to the parties pass such order as it deems fit and such order shall be final.

K-RIDE

**ADDITIONAL INSTRUCTIONS TO TENDERERS**  
**(THIS SHOULD BE READ IN CONTINUATION OF ITT)**

ITT Clause Ref.	Description
2.3	<p><b>The following paras are added:</b></p> <p>Wherever the word JV is mentioned, it should be read as JV/Consortium.</p> <p>For any purpose herein, 'Joint Venture' means an ad hoc association of firms that pool their resources and skills to undertake a large or complex contract in the role of "Contractor," with all firms (partners in the JV) being legally liable, jointly and severally, for the execution of the Contract in the event of a partner's withdrawal.</p> <p>A Tenderer may be a natural person, private entity, government-owned entity, or any combination of them with a format intent to enter into an agreement or under an existing agreement in the form of a Joint venture or consortium. The Tenderer must ensure the following</p> <p>(a) In case of Single Entity:</p> <p>(i) Submit Power of Attorney authorizing the signatory of the Tender to commit the Tenderer.</p> <p>(b) In case of Joint Venture/ Consortium:</p> <p>(i) The number of partners in the JV/ Consortium shall not be more than three.</p> <p>(ii) At the time of bidding, the tenderer (JV) to submit the JV Agreement, as per the form given in Section 3: Qualification and Information/Bidding Forms. On issue of LOA, the JV/Consortium Agreement should be registered and shall be submitted along with the performance security.</p> <p>(iii) The JV/ Consortium shall nominate a Representative through Power of Attorney (Form given in Section 3) who shall have the authority to conduct all business for and on behalf of any and all the parties of the JV/ Consortium during the Tendering process and, in the event the JV/ Consortium is awarded the Contract, during contract execution.</p> <p>(iv) Submit Power of Attorney by individual partners to lead partners as per the form given in Section 3.</p> <p>(v) In case a Joint Venture/ Consortium is the successful Tenderer, the appropriate Joint Venture/ Consortium Agreement for execution of work should be entered by the Joint Venture/ Consortium partners. The duly signed Joint Venture/ Consortium Agreement should be submitted along with the tender submission.</p> <p>(vi) The lead member as aforesaid shall be authorized to incur liabilities and receive instructions for and on behalf of any and all the partners of the Joint venture/Consortium and the entire execution of the contract.</p> <p>(vii) All members of the Joint venture/Consortium shall be Jointly and severally responsible for the execution of the Contract.</p> <p>(viii) Change in constitution or percentage participation of JV/Consortium shall not be permitted at any stage after submission of Tenders</p> <p>(c) Only firms that are registered or incorporated in India are eligible to compete. Any Tenderer from a country which shares a land with India will be eligible to Tender in this tender only if the Tenderer is registered with the Competent Authority.</p>

(d) "Tenderer from a country which share a land border with India" for the purpose of this Order means: -

1. An entity incorporated, established or registered in such a country; or
2. A subsidiary of an entity incorporated, established or registered in such a country; or
3. An entity substantially controlled through entities incorporated, established or registered in such a country; or
4. An entity whose beneficial owner is situated in such a country; or
5. An Indian (or other) agent of such an entity; or
6. A natural person who is a citizen of such a country; or,
7. A consortium or joint venture where any member of the consortium or joint venture falls under any of the above

(e) The beneficial owner for the purpose of above clause will be as under:

- (i) In case of a company or Limited Liability Partnership, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person(s), has a controlling ownership interest or who exercises control through other means.

**Explanation-**

- a. "Controlling ownership interest" means ownership of or entitlement to more than twenty-five percent of share or capital or profits of the company;
- b. "Control" shall include the right to appoint majority of the directors or to control the management or policy decisions including by virtue their shareholding or management rights or shareholders agreements or voting agreements;
- (ii) In case of a partnership firm, the beneficial owner is the natural person(s) who, whether acting alone or together, or through one or more juridical person, has ownership of entitlement to more than fifteen percent of capital or profits of the partnership;
- (iii) In case of an unincorporated association or body of individuals, the beneficial owner is the natural person(s), who, whether acting alone or together, or through one or more juridical person, has ownership of or entitlement to more than fifteen percent of the property or capital or profit of such association or body of individuals;
- (iv) Where no natural person is identified under (i) or (ii) or (iii) above, the beneficial owner is the relevant natural person who holds the position of senior managing official;
- (v) In case of a trust, the identification of beneficial owner(s) shall include identification of the author of the trust, the trustee, the beneficiaries with fifteen percent or more interest in the trust and any other natural person exercising ultimate effective control over the trust through a chain of control or ownership.

2.4

**The Tenderer shall submit a Certificate stating that they have read the above clause using the appropriate Performa given in Section 3 - Form 3C1 & 3C2.**

**Tenderer having a conflict of interest shall be disqualified. The conflict of interest is detailed below.**

A Tenderer or any of its constituents shall not have conflict of interest. All Tenderers found to have a conflict of interest shall be disqualified. A Tenderer may be considered to be in a conflict of interest with one or more parties in this Tendering process, if, including but not limited to::

- (a) they have controlling shareholders in common; or
- (b) they receive or have received any direct or indirect subsidy from any of them; or
- (c) they have the same legal representative for purposes of this Tender; or
- (d) they have a relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the Tender of another Tenderer, or
- (e) any firm, either individually or in Joint Venture (JV)/ Consortium, submits more than one offer irrespective of whether the firm is quoting against this Tender. The Tenders submitted by two different Tenderers, having any common participant in JV/ Consortium formation or any common partner in partnership firms, or an individual will be treated as having conflict of interest or
- (f) a Tenderer who is Sub-contractor to another Tenderer will be treated as having conflict of interest. However, this does not limit the inclusion of the same sub-contractor in more than one Tender.
- (g) a Tenderer participated as a consultant in the preparation of the design or specifications of the contract that is the subject of the Tender; or
- (h) A Tenderer was affiliated for any period(s) during last two years before the date of issue of Invitation for Tenders with a firm or entity that has been hired (or is proposed to be hired) by the Employer as Engineer for the contract.

**2.5 The Tenderer shall be disqualified if:**

- (a) The Tenderer or any of its constituents has been blacklisted/ banned from business dealings with all Government Departments by the Government of Karnataka or by Ministry of Railways or by K-RIDE at any time till finalization of Tenders, except in cases where such blacklisting/ banning has been withdrawn by Competent Authority or has ceased or expired on the deadline for submission of the Tenders, for which satisfactory evidence is to be produced.
- (b) Any previous contract of the Tenderer or any of its constituents had been fully terminated or part terminated for its failure as a JV/ Consortium partner with forfeiture of its full Performance Security, by Rail Infrastructure Development Company (Karnataka) Ltd.(K-RIDE) at any time starting from 3 years before the deadline for submission of Tenders and up to one day before the date of opening of price Tenders;

Provided, however, there is no stay order or declaration by any Court against such termination of the contract by Rail Infrastructure Development Company (Karnataka) Ltd. or such termination of the contract has not been revoked by Rail Infrastructure Development Company (Karnataka) Ltd or competent authority of K-RIDE has not passed an order of non-applicability of disqualification of the Tenderer or any of its constituents despite such termination.

- (c) The Tenderer or any of its constituents has been imposed delay damages of 5% or more of contract value by K-RIDE due to delay in the implementation of any previous contract within the period of last 2 years before the deadline for submission of Tenders (Period of 2 years shall be reckoned from the date on which the total accrued amount of Delay Damages has reached 5% or more of the contract

	<p>price) or such accrued delay damages has not been fully recovered before the deadline for submission of Tenders on account of contractor's request for deferring recovery to maintain cash flow and K-RIDE has acceded to the same in the interest of the project or the work under the previous contract in question has not been completed before the deadline for submission of Tenders, unless imposition of such delay damages has been set aside by the Competent Authority.</p> <p>(d) The Tenderer or any of its constituents:</p> <ul style="list-style-type: none"> <li>(i) has suffered bankruptcy/insolvency or</li> <li>(ii) has any ongoing case of insolvency before the NCLT/ any applicable Court where Interim Resolution Professional (IRP) has been appointed or is at any later stage of the insolvency process, as on the deadline of submission of Tenders or thereafter till finalization of Tenders.</li> </ul> <p>(e) The Tenderer is found ineligible by the Employer, in accordance with ITB-3.</p> <p>(f) The Tenderer or its constituent(s) has been declared by K-RIDE to be a poor performer and the period of poor performance is still in force on the deadline for submission of Tenders.</p> <p style="text-align: center;">OR</p> <p>The Tenderer or its constituent(s) has been declared by K-RIDE to be a poor performer at any time after the deadline for submission of Tenders and upto one day before the date of opening of price Tenders.</p> <p>(g) The Tenderer or any of its constituents has changed its name or created a new business entity as covered by the definition of "Allied Firm" under para 1102 (iii) of Chapter XI of Vigilance Manual of Indian Railways (available on website of Indian Railways), consequent to having been banned from business dealings or suspended from business dealings or having been declared poor performer.</p> <p><b>The Tenderer shall submit an affidavit stating that they are not liable to be disqualified as per this sub clause using the Form PS3 given in Section-3: Qualification and Information/Bidding Forms. Non-submission of an affidavit by the Tenderer shall result in summary rejection of his Tender.</b></p> <p>Tenderers shall immediately inform the Employer in case they cease to fulfil eligibility in terms of ITT <b>clause 2</b> above. In case the Tenderer fails to inform the Employer or submits a false affidavit, his Tender shall be summarily rejected and Tender security shall be forfeited. The Tenderer shall also be liable for Banning of Business dealings for a period up to five years</p>
<p><b>2.6</b></p>	<p><b>PARTNERS IN CASE OF JV/CONSORTIUM</b></p> <ul style="list-style-type: none"> <li>(i) Lead partner must have a minimum of 50% participation in the JV/Consortium.</li> <li>(ii) Partners having 25% or more percentage participation shall be termed as substantial partner/other Partners.</li> <li>(iii) In case of JV/Consortium, change in constitution or percentage participation shall not be permitted at any stage after the bid submission.</li> </ul> <p>The bidder, in case of JV/Consortium, shall clearly and unambiguously define the role and responsibilities for each partner in the JV agreement submitted as per Form JV/4 of Section-3, providing clearly that any abrogation/subsequent re-assignment of any responsibility by any partner of JV/Consortium in favor of other JV/Consortium partner or any change in constitution of partners of JV/Consortium (without written approval of Client) from the one given in JV agreement at tender stage, will be treated, as 'breach of</p>

	contract condition' and/or 'concealment of facts' as the case may be and acted accordingly. All Members of the JV/ Consortium must have experience in execution of similar work.
3.3(a)	<p><b>The following para is added:</b></p> <p><b>Materials, Equipment and Services</b></p> <p>The materials, equipment and services to be supplied under the Contract shall be from the approved sources as specified in Section 8A: Works Requirements and Price Schedule Section-9.</p>
7.3	<p><b>The following para is added:</b></p> <p>The Employer is not responsible for the completeness of the Bidding Document and their Addenda, if they were not obtained directly from the source stated by the Employer in the Invitation for Bids.</p> <p>The Bidder is expected to examine all instructions, forms, terms, and specifications in the Bidding Document. Failure to furnish all information or documentation required by the Bidding Document may result in the rejection of the bid.</p>
8.3	<p><b>The following para is added:</b></p> <p>The Pre-Tender meeting may also be attended through video conferencing (VC). Those Tenderers who wish to join the Video Conferencing shall send a request email on the email id (i.e., <a href="mailto:electrical.kride@gmail.com">electrical.kride@gmail.com</a>, <a href="mailto:jgmelec@kride.in">jgmelec@kride.in</a>) by <b>29/09/2023</b> up to <b>11:30 hours IST</b>, so that a link for Video Conferencing can be sent by K-RIDE.</p> <p>Please note that the request received from the Tenderers (With details of the Company, its address, and the name and designation of the person attending the VC) will only be entertained. They should also mention the email id through which VC is desired to be joined.</p> <p>K-RIDE may allow maximum of two email ids for one company to participate in the VC. Any request for VC received after the given date and time for sending the link for VC will not be entertained.</p> <p>Prospective Tenderers will be able to join the VC through the link provided to them on Email ID. During this pre- Proposal meeting, prospective Tenderers may request for clarifications.</p>
10.3	<p><b>The following para is added:</b></p> <p><b>Documents Comprising the Tender</b></p> <ul style="list-style-type: none"> <li>The Tender shall comprise of Tender Security/Tender Security Declaration, Technical Tender and Price Tender. The Tenderer shall submit the Tender through Karnataka Public Procurement Portal.</li> <li>On the stipulated date of opening of Tenders, initially, only the Technical Tenders are opened through Karnataka Public Procurement Portal. The Technical Tenders shall be evaluated by the Employer in accordance with the stipulated Qualification and Evaluation criteria. No amendments or changes to the Technical Tenders would be permitted after the opening of technical Tenders.</li> <li>Tenderers who are qualified in the technical evaluation their price Tender shall be opened at a date and time advised by the Employer(K-RIDE) through e-tendering portal. The Price Tenders are evaluated and the Contract is awarded to the Tenderer whose Tender has been determined to be the lowest evaluated substantially responsive Tender.</li> </ul>

**The Technical Tender shall contain the following:**

- All the Forms of Section-3: Qualification Information/Bidding Forms including letter of technical Bid (LTB) shall be scanned and uploaded.
- The Tenderer shall furnish a commitment in Letter of Technical Bid (LTB) for deployment of equipment and personnel as stipulated in Section 8A: Employers Work's Requirement.
- The Tenderer shall furnish commitment in LTB for submitting construction method statement for all major activities of work and get this approved from the engineer prior to the commencement of work on that activity in case of award of contract.
- The Tenderer shall furnish a commitment in Letter of Technical Bid (LTB) for adhering to mobilisation and construction schedule as stipulated in Section 8A: Employers Work's Requirement.
- **Tenderer should note that non-submission of the Letter of Technical Bid (LTB) by the Tenderer shall result in summary rejection of his Tender.**
- Tenderer shall submit the Approach and Methodology for performing the assignment by using appropriate Performa given in Section 3: Qualification Information/Bidding Forms.
- Scanned copy of Tender Security/Tender Security Declaration form (Section 3), in accordance with ITT Clause 13;
- Scanned copy of written confirmation authorizing the signatory of the Tender to commit the Tenderer, any amendments such as interlineations, erasures, or overwriting shall be valid only if they are signed or initiated by the person signing the Tender.
- Scanned copy of documentary evidence with establishing the Tenderer's qualifications to perform the contract; To establish its qualifications to perform the Contract in accordance with Section 2: ITT the Tenderer shall submit as part of its technical Tender the information requested in the corresponding information sheets included in Section 3: Qualification Information/Bidding Forms.

Domestic Tenderers, individually or in joint ventures, applying for eligibility for domestic preference shall supply all information required to satisfy the criteria for eligibility

- Scanned copy of Approach and Methodology - Performa given in Section-3: Qualification Information/Bidding Forms
- Scanned copy of Joint Venture Agreement entered into by all partners

**The Price Tender shall contain the following:**

- Scanned copy of Letter of Price Tender.
- All Section-3 Documents shall be scanned and submitted.
- Filled/completed schedules as required including Price Schedule in accordance with ITT Clauses should be submitted through Karnataka Public Procurement Portal only;



	<ul style="list-style-type: none"> <li>The Tenderer shall submit through Karnataka Public Procurement Portal, separate Technical Proposal and Price Proposal for each individual contract package, using the appropriate Submission Sheets furnished in Section-3: Qualification Information/Bidding Forms. These Forms must be completed without any alterations to their format, and no substitutes shall be accepted. All blank spaces shall be filled in with the information requested.</li> <li>The Tenderer shall submit, as part of the Price Tender, the Schedules, including the Price Schedule through Karnataka Public Procurement Portal only.</li> </ul>
<p>11.5</p>	<p><b>The following para is added:</b></p> <p><b>Tender Prices</b></p> <ul style="list-style-type: none"> <li>The prices quoted by the Tenderer in the Price Schedule shall conform to the requirements specified below.</li> <li>In the price schedule, the tenderer shall quote rates as single percentage/Amount Above/Below/At par as per the format for each schedule. The price quoted by the bidder in schedule will only be considered for evaluation of bids. Rates offered through any other medium or at any other location will not be considered. If any Tenderer quotes more than one percentage/amount for such schedules, its Tender shall be summarily rejected.</li> <li>The Tenderer shall fill in percentage for all items of the Works described in the Price schedule. <b>Items against which no rate or price is entered by the Tenderer will not be paid for by the Employer when executed and shall be deemed covered by the rates for other items and prices in the price schedule</b></li> <li>The price to be quoted in the Price Schedule, in accordance with ITT, shall be the total price of the Tender.</li> <li>DELETED</li> <li>DELETED</li> <li>Unless otherwise provided in the ITT and the Contract, the Rates quoted by the Tenderer are subject to adjustment during the performance of the Contract in accordance with the provisions of the Conditions of Contract. In such a case, the indices and weightages for the price adjustment formulae shall be as specified in the Tables of Adjustment Data included in Contract Data.</li> <li>DELETED</li> <li>All duties, taxes including GST, royalties, cess and other levies payable by the Contractor under the Contract, or for any other cause (including standard specifications), as of the date 28 days prior to the deadline for submission of Tenders, <b>shall be included in the percentage quoted in the Price Schedule and the total Tender Price submitted by the Tenderer</b>. GST shall be paid by the Tenderer as applicable in accordance with the prevailing rules of Government of India</li> <li>Tenderers should note that during the progress of the works, the foreign currency requirements of the outstanding balance of the Contract Price may be adjusted by agreement between the Employer and the Contractor in order to reflect any changes in foreign currency requirements for the Contract, in accordance with Sub-Clause 14/ITT (Currencies of Bid and Payment) of the</li> </ul>

	<p>Conditions of Contract. Any such adjustment shall be affected by comparing the percentages quoted in the Tender with the amounts already used in the Works and the Contractor's future needs for imported items.</p> <ul style="list-style-type: none"> <li>• <b>Tenderer should note that non-submission of the Letter of Price Tender (LPB) by the Tenderer shall result in summary rejection of his Tender.</b></li> <li>• Online alternative Price Tender corresponding to the alternative Technical Tender, if permissible, in accordance with ITT Clause 14;</li> </ul>
<p><b>13.7</b></p>	<p>The following para is added:</p> <p>In this tender, the tender security/ EMD has to be paid.</p> <p>The firm can choose either of the way for EMD payment. Full EMD as e-payment The Technical bids along with the Earnest Money Deposit (EMD) i.e., Rs. 2,00,000/- can be paid through e-payment as specified in sub clause 10.1.1 and 13.7 of Section. 2 of ITT in the Karnataka Public Procurement Portal only using any of the following Five modes:</p> <p style="padding-left: 40px;">Online Modes</p> <ul style="list-style-type: none"> <li>• Credit Card.</li> <li>• Direct Debit.</li> <li>• Net Banking</li> </ul> <p style="padding-left: 40px;">Offline Modes</p> <ul style="list-style-type: none"> <li>• National Electronic Fund Transfer (NEFT).</li> <li>• Over the Counter (OTC)</li> </ul> <p>The EMD amount of Rs. 2,00,000/- accepted in the form of online and offline modes as mentioned above. For online mode bidder has to pay the EMD through one of the three modes (credit card, debit card &amp; Net banking) mentioned above.</p> <p>For offline payment modes bidder has to pay the EMD through National Electronic Fund Transfer (NEFT) or Over the Counter (OTC). For offline NEFT and OTC mode bidder has to complete the payment as per the user manual given in Karnataka Public Procurement Portal and enter the bank transaction reference number on the Karnataka Public Procurement Portal to complete the procedure.</p> <p>For further details, kindly Click on the  <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a></p> <p>Then click on downloads, user manual for tenderers and click on e-payments.</p> <p>OR</p> <p>In this tender, the tender security/ EMD has to be paid.</p> <p>The Technical bids along with the Earnest Money Deposit (EMD) i.e., Rs. 2,00,000/- should be paid through e-payment as specified in sub clause 10.1.1 and 13.7 of Section. 2 of ITT in the Karnataka Public Procurement Portal only using any of the following four modes:</p> <ul style="list-style-type: none"> <li>• Credit Card.</li> <li>• Direct Debit.</li> </ul>

- National Electronic Fund Transfer (NEFT).
- Over the Counter (OTC).

The part of the EMD amount of **Rs.1.00 lakh** accepted in the form of electronic cash (not through DD/BG) and will be maintained in the Government of Karnataka central pooling account held at ICICI Bank until the contract is closed.

The balance required EMD of **Rs. 1,00,000/-** to be furnished in the form of Bank Guarantee (BG) of any Nationalized Bank/Scheduled Bank (as per RBI guidelines) payable to –Managing Director/K-RIDE, Bengaluru. The EMD shall have to be valid for 45 days beyond the validity of the tender. The scanned copy of the BG should be uploaded to the tender in the Karnataka Public Procurement platform. The Original Bank Guarantee shall compulsorily be produced & submitted for verification after the bid submission closing time but on or before the date of opening of the tender as specified in e-portal to the AGM/Elec in K-RIDE office. The bidder shall note that the Original Bank Guarantee submitted through post/in person, if it does not reach on or before the date of opening of the tender as specified in e-portal to the AGM/Elec in K-RIDE office the bid will not be considered for technical evaluation. The bids of the contractors who have failed to produce and submit the original bank guarantee of earnest money deposit of tender on or before the date of opening of the tender as specified in e-portal to the AGM/Elec, the bids will not be opened. If it is opened by default/manual/electronic error the bid will not be considered for technical evaluation and bid shall be rejected. Non-reconciliation of tender earnest money deposit receipt of payment in Government of Karnataka central pooling account held at the ICICI Bank, the tender gets rejected.

- Bank Guarantee Format

An unconditional bank guarantee using the Form given in Section 3: Qualification Information and Bidding Forms. The bank guarantee shall be from a bank having minimum net worth of over INR 500 million from the specified banks as under:

- (i) a Scheduled Bank in India, or
- (ii) a Foreign Bank having their operations in India, or
- (iii) a Foreign Bank which do not have operations in India is required to provide a counter-guarantee by State Bank of India,

The Scheduled Bank issuing the Bank Guarantee must be on “Structure Financial Messaging System (SFMS)” platform. A separate advice of the BG shall be invariably be sent by the issuing bank to the Employer’s Bank through SFMS and only after this the BG shall become operative and acceptable to the Employer.

Further, the Tender Security in Original form along with a copy of “MT760COV (in case of Bank Guarantee message) / MT767COV (in case of Bank Guarantee amendment message) Report” sent by the BG issuing Bank Sealed in an envelope shall be submitted, as stated in ITT 15.

The Issuing Bank shall send the SFMS to:

**Beneficiary: Rail Infrastructure Development Company (Karnataka) Limited (K-RIDE)**

**Bank Name: Canara Bank**

**Branch: Prime Corporate Branch**

**Account No. 0430201012110**

**IFSC Code: CNRB0002636**

The Tender security shall be valid up to 45 days beyond tender validity, or up to the date mentioned in the letter of request for extension, if any under ITT 12.

In case the Tenderer has opted for Tender security in the form of an unconditional Bank Guarantee, the Tenderer should upload the scanned copy of Bank Guarantee with the Tender. The original Bank Guarantee should be delivered in person to the official nominated as indicated in the Tender data sheet before the opening of technical bid. Non-submission of scanned copy of Bank Guarantee with the Tender on e-tendering portal and/or non-submission of original Bank Guarantee within the specified period shall lead to summary rejection of Tender. The details of the BG, physically submitted should match with the details available in the scanned copy and the data entered during Tender submission time, failing which the Tender will be rejected.

- a. Unless otherwise specified in the BDS, any Tender not accompanied by an enforceable and compliant Tender security as required in accordance with ITT, shall be summarily rejected by the Employer as non-responsive.

	<p>b. The Tender security of the Tenderer who have been determined to be unqualified for opening of their financial Tender shall be returned within 3 working days after the opening of financial Tender. The Tender security of unsuccessful Tenderers shall be returned within 7 working days after issue of LOA to the successful Tenderer.</p> <p>c. The Tender security of the unsuccessful Tenderer shall be returned as promptly as possible once the successful Tenderer has signed the Contract and furnished the required performance security.</p> <p>d. The Tender security may be forfeited:</p> <p>(a) if a Tenderer withdraws its Tender during the period of Tender validity specified by the Tenderer on the Letter of Tenders, except as provided in ITT Clause 12 or</p> <p>(b) if a Tenderer misrepresents or omits the facts in order to influence the procurement process;</p> <p>(c) if the successful Tenderer fails to:</p> <p>(i) sign the Contract in accordance with ITT Clause 28;</p> <p>(ii) furnish a performance security in accordance with ITT 29;</p> <p>(iii) accept the correction of its Tender Price pursuant to ITT 24; or</p> <p>(iv) furnish a domestic preference security if so required.</p> <p>(d) if the undertaking of the affidavit submitted by the Tenderer or its constituents in pursuance to ITT clause 2 or any of the declarations of Letter of Technical Tender or Letter of Price Tender submitted by the Tenderer has been found to be false at any stage during the process of Tender evaluation.</p> <p>e. The Tender Security of a JV/ Consortium shall be in the name of the JV/ Consortium that submits the Tender or the lead member of the JV/Consortium. If the JV/ Consortium has not been legally constituted at the time of Tendering, the Tender Security shall be in the names of all future partners as named in the letter of intent/ of JV/ Consortium mentioned in ITT Clause 2)</p>
<p><b>14</b></p>	<p><b>The following para is added:</b></p> <p>The Tender, as well as all correspondence and documents relating to the Tender exchanged by the Tenderer and the Employer, shall be written in English. Supporting documents and printed literature that are part of the Tender may be in another language provided they are accompanied by an accurate translation of the relevant passages in English in which case, for purposes of interpretation of the Tender, such translation shall govern</p>
<p><b>15</b></p>	<p><b>The following para is added:</b></p> <p><b>Sealing and Marking of Tenders</b></p> <p>The Tenderer shall submit the technical Tender, Price Tender and the Tender Security/Tender Security Declaration through Karnataka Public Procurement Portal i.e., <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a> The original of the Technical Proposal, which will contain all Forms of Section 3 except Price Schedule Section 9 and all other relevant data specified in the Tender document.</p> <p>The Price Bid, shall be submitted through Karnataka Public Procurement Portal only. This “PRICE BID” will contain only Price Schedule and all other relevant data specified in this Tender document. All forms should be typed on the Tenderer’s’ letter head as per the exact format of the Forms.</p> <p>The above forms should be scanned and submitted through <b>Karnataka Public Procurement Portal</b>.</p> <p>No details about price proposal shall be disclosed directly or indirectly in the technical proposal failing which the Tender shall be rejected. <b>Only Electronic Tender submission and opening procedure permitted.</b></p>

<p><b>19.7</b></p>	<p><b>The following para is added:</b></p> <p><b>Tender Opening</b></p> <ul style="list-style-type: none"> <li>• The Employer shall conduct the opening of Technical Tenders through Karnataka Public Procurement Portal i.e., <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a> on the date and at the time mentioned.</li> <li>• The date and time of the opening of Price Tenders will be announced through Karnataka Public Procurement Portal</li> <li>• At the end of the evaluation of the Technical Tenders, the Employer will intimate Tenderers who have submitted substantially responsive technical proposals and who have been determined as being qualified for award to attend the opening of the price Proposals. The date and time, of the opening of Price Tenders will be advised through email/e-procurement. Tenderers shall be given reasonable notice for the opening of Price Tenders.</li> <li>• The Employer will notify Tenderers in writing who have been rejected on the grounds of being substantially non-responsive to the requirements of the Tendering Document and who have been determined as being not qualified as a result of evaluation of technical proposal and their Price Tender shall not be opened. The Tender security of the Tenderers shall be returned as per due process.</li> <li>• The Employer shall conduct the opening of Price Tenders through Karnataka Public Procurement Portal i.e., <a href="https://kppp.karnataka.gov.in/#/portal/portal-home">https://kppp.karnataka.gov.in/#/portal/portal-home</a> of all Tenderers who have submitted substantially responsive Technical Tenders and who have been determined qualified as a result of technical evaluation.</li> </ul>
<p><b>23.4</b></p>	<p><b>The following para is added:</b></p> <p><b>Deviations, Reservations, and Omissions</b></p> <p>During the evaluation of Tenders, the following definitions apply:</p> <ol style="list-style-type: none"> <li>(a) "Deviation" is a departure from the requirements specified in the Tendering Document;</li> <li>(b) "Reservation" is the setting of limiting conditions or withholding from complete acceptance of the requirements specified in the Tendering Document; and</li> <li>(c) "Omission" is the failure to submit part or all of the information or documentation required in the Tendering Document.</li> </ol>
<p><b>24.3</b></p>	<p><b>The following para is added:</b></p> <p><b>Nonconformities, Errors, and Omissions</b></p> <ul style="list-style-type: none"> <li>• Provided that a Tender is substantially responsive, the Employer may waive any nonconformities in the Tender that do not constitute a material deviation, reservation or omission.</li> <li>• Provided that a Tender is substantially responsive, the Employer may request the Tenderer to submit the necessary information or documentation, within a reasonable period of time, to rectify nonmaterial nonconformities in the Tender related to documentation requirements. Requesting information or documentation on such nonconformities shall not be related to any aspect of the price of the Tender. Failure of the Tenderer to comply with the request may result in the rejection of its Tender.</li> </ul>

<p><b>24.4</b></p>	<p><b>The following para is added:</b></p> <p><b>Correction of Arithmetical Errors and Omissions in Tender and Evaluation of Tender Price</b></p> <ol style="list-style-type: none"> <li>1. Provided that the Tender is substantially responsive, the Employer shall correct arithmetical errors and omissions in the Tender and then arrive at the Evaluated Tender Price on the following basis:             <ol style="list-style-type: none"> <li>(a) DELETED</li> <li>(b) if the percentage rate has been quoted both in words and in figures and there is a discrepancy in such rates, then the lower of the two shall prevail and shall be considered for evaluation of the price of the schedule/bill;</li> <li>(c) If the percentage rate has been quoted either in words or in figures only, then the same shall be considered for evaluation of the price of the schedule/bill;</li> <li>(d) If no percentage rate has been indicated for any particular schedule/bill in words, as well as in figures, irrespective of the fact whether the Tenderer has written or not written above/below/at par, in such cases, the rate shall be considered as Zero and the price shall be calculated accordingly;</li> <li>(e) if there is an error in a total corresponding to the addition or subtraction of subtotals, the subtotals shall prevail and the total shall be corrected.</li> <li>(f) DELETED</li> </ol> </li> <li>2. If the Tenderer has submitted the lowest evaluated Tender does not accept the correction of errors and omissions as per above provisions, its Tender shall be disqualified and its Tender security shall be forfeited or its Tender-Securing Declaration executed.</li> </ol>
<p><b>25.6</b></p>	<p><b>The following para is added:</b></p> <p><b>Conversion to Single Currency</b></p> <p>For evaluation and comparison purposes the currencies of the Tender shall be converted into Indian Rupees as stated in BDS.</p> <p>An Abnormally Low Tender is one in which the Tender price, in combination with other elements of the Tender, appears so low that it raises material concerns as to the capability of the Tenderer to perform the contract at the offered price. The Employer may in such cases seek written clarifications from the Tenderer, including detailed price analysis of its Tender price in relation to scope, schedule, allocation of risks and responsibilities, and any other requirements of the Tender document. If, after evaluating the price analyses, the Employer determines that the Tenderer has substantially failed to demonstrate its capability to deliver the contract at the offered price, the Employer may reject the Tender/ proposal.</p> <p>Additional Performance Security in case of abnormally low Tenders will have to be submitted.</p> <p><b>The calculation sheet is as below:</b></p> <p>If the bid, which results in the lowest Evaluated Bid Price is substantially on lower side and/or seriously unbalanced in the opinion of the Employer as per criteria defined below, the Employer may require the bidder to submit additional performance security as under:-</p> <ol style="list-style-type: none"> <li>a) If overall price quoted by the L1 bidder is below the engineer's estimated price by more than 10% and the difference between overall price quoted by the L1 and L2 is more than 5% of the estimated price, then the bid price of L1 bidder shall be treated as substantially on lower side and such bidder</li> </ol>

	<p>shall be bound to furnish additional performance security equal to the (0.9x engineer's estimated price – L1 price) or (0.95 x L2 price – L1 price) whichever is lower, on this account. Example below demonstrates the method of calculation to arrive at additional performance security:</p> <p>Suppose overall price quoted by the L1 bidder is 17% below the estimated price and the overall price quoted by L2 bidder is 8% below the estimated price. In this case the overall price quoted by the L1 bidder is lower by more than 10% of the estimated price and also the difference between overall price quoted by the L2 and L1 bidder is more than 5% of the estimated price, hence the L1 bidder shall be required to furnish additional performance security for an amount equal to {0.9 x engineer's estimated price – (1-17/100) x engineer's estimated price} = {0.07 x engineer's estimated price} = 7% of engineer's estimated price or {0.95 x (1-8/100) x engineer's estimated price – (1-17/100) x engineer's estimated price} = {0.044 x engineer's estimated price} = 4.4% of engineer's estimated price; whichever is lower.</p> <p>As per the above L1 bidder shall be required to submit additional performance security of 4.4% of engineer's estimated price.</p> <p>b) If for any bill/ schedule of quantities % age above or below quoted by the bidder on the estimated price is beyond 15% below the overall % age difference between the quoted contract price and the engineers estimated price, then the price for that particular schedule shall be treated as seriously unbalanced and bidder shall be bound to furnish additional performance security for such unbalanced price. Example below demonstrates the method of calculation to arrive at unbalanced price and additional performance security:</p> <p>Suppose for the L1 bidder overall % age difference between quoted contract price and the engineers estimated price;</p> <p>(Overall contract price – Overall estimated price) x 100 ÷ overall estimated price = + 4 %</p> <p>Maximum % age below permitted over estimated price of any bill / schedule in this case = +4 – 15 = -11%</p> <p>Suppose for the L1 bidder has quoted 20% below estimated price then the pricing shall be treated as unbalanced and the bidder shall be required to furnish additional performance security for an amount equal to (20 – 11) % of the estimated price.</p>
<p><b>26.2</b></p>	<p><b>The following para is added:</b></p> <p><b>Award Criteria</b></p> <ul style="list-style-type: none"> <li>• The Employer shall award the Contract to the Tenderer whose Tender is substantially responsive to the Tendering Document, provided further that the Tenderer is determined to be qualified to perform the Contract satisfactorily and whose offer has been determined to be the lowest evaluated subject to ITT below. In case of more than one Tenders are evaluated to be lowest, Contract shall be awarded to the Tenderer having higher average annual construction turnover (calculated as total certified payments received for contracts in progress or completed) in equivalent INR within the last Two financial years.</li> <li>• The Employer has the right to review at any time prior to award of contract that the qualification criteria as specified in Section-3: Qualification Information and Bidding Forms are still being met by the Tenderer whose offer has been determined to be the lowest evaluated Tender. A Tender shall be rejected if the qualification criteria as specified in Section-3: Qualification Information and Bidding Forms are no longer met by the Tenderer whose offer has been determined to be the lowest</li> </ul>

	<p>evaluated Tender. In this event the Employer shall proceed to the next lowest evaluated Tender to make a similar reassessment of that Tenderer's capabilities to perform satisfactorily.</p>
<p><b>29.5</b></p>	<p><b>The following para is added:</b></p> <p><b>Performance Security</b></p> <p>The successful Tenderers shall have to submit a Performance Guarantee (PG) Within twenty (20) days from the date of issue of Letter of Acceptance (LOA). Extension of time for submission of PG beyond 20 days up to 60 days from the date of issue of LOA may be given by the authority who is competent to sign the contract agreement. However, a penal interest of 12% of per annum shall be charged for the delay beyond 20 days, i.e. From 21nd day after the date of issue of LOA. Further if the 60th day happens to be declared holiday in the office of K-RIDE, submission of PG can be accepted on the next working day.</p> <p>In all other cases if the contractor fails to submit the requisite PG even after 60 days from the date of issue of LOA, the contract is liable to be terminate. In case contract is terminated K-RIDE shall be entitled to forfeit the Tender security and other dues payable against to the contract. In case the tenderer has not submitted by security on the strength of their registration as a start-up recognized by the Department of Industrial Policy and Promotion (DIPP) under Ministry of Commerce and Industry, DIPP shall be informed to this effect. The failed contractor shall be debarred from participating in re-tender for that work.</p> <p>Failure of the successful Tenderer to submit the above-mentioned Performance Security or to sign the Contract Agreement shall constitute sufficient grounds for the annulment of the award and forfeiture of the Tender security or execution of the Tender-Securing Declaration.</p> <p>The above provision shall also not apply to the furnishing of a Domestic Preference Security, if so required.</p>
<p><b>New Clause-1</b></p>	<p><b>LITIGATION HISTORY:</b> (Please see Annexure Tendering Forms).</p> <p>The Tenderer/Tenderers should provide accurate information on any litigation or arbitration resulting from contracts completed or under its execution over the last five years as on date of submission of this tender.</p> <p>If the litigation started by the Tenderer without recourse to measures of Dispute Resolution and Arbitration as provided in the Contract or the litigation in respect of challenge of award of Arbitration by the Tenderer, will be treated as Litigation case indulged by the Tenderer for this Para of Litigation History. A consistent history of awards against the Applicant or any partner of a joint venture may result in failure of the application.</p> <p><b>Note:</b> Tenderers including each of the partners of a Joint Venture, should provide information on any history of litigation or Arbitration resulting from contracts executed in the last 5 years as on date of submission of this tender. A separate sheet should be used for each partner of a Joint Venture</p>
<p><b>New Clause-2</b></p>	<p><b>Jurisdiction of Courts</b></p> <p>The Tendering process shall be governed by and construed in accordance with the laws of India and the Courts as indicated in Tender Data Sheet shall have exclusive jurisdiction over all the disputes/issues arising under, pursuant to and/ or in connection with the Tendering process. <b>The Jurisdiction of Courts is Bengaluru, Karnataka</b></p>



# SECTION-3

## QUALIFICATION INFORMATION/BIDDING FORMS

Section 3: Qualification Information (Bidding Forms)

**INDEX**

**SECTION-3: QUALIFICATION INFORMATION/BIDDING FORMS**

This Section contains the forms which are to be completed by the Bidder and to be submitted as part of this Bid.

Sl. No.	Description	Form Number/ Para No.	Page No.
	<b>A) Qualification Information/Bidding Forms</b>		
1.	Legal status of Tenderer	Para No. 1.1	48
2.	Executed and Payment Received statement for 5 Years	Para No. 1.2	48
3.	Similar Work Experience	Para No. 1.3	49
4.	Quantities of Work executed in Last 5 years	Para No. 1.4	50
5.	Information on Works (Existing, Ongoing and Works for which Tenders already submitted)	Para No. 1.5	51
6.	Availability of Plant and Equipment Details	Para No. 1.6	51
7.	Reports of Financial Standing (Profit and Loss Statements)	Para No. 1.7	51
8.	Qualification and Experience of Key Personnel	Para No. 1.8	51
9.	Tenderers bankers Details	Para No. 1.9	51
10.	Evidence of access to Financial Resources	Para No. 1.10	52
11.	Proposed Subcontracting components	Para No. 1.11	52
12.	Information on Litigation History	Para No. 1.12	53
13.	Proposed Methodology and Program of construction	Para No. 1.13	54
	<b>B) Additional Qualification Information/Bidding Forms</b>		
14.	Letter of Technical Bid	Form PS 1	55
15.	Letter of Price Bid	Form PS 2	58
16.	Format for Affidavit (along with Bid)	Form PS 3	60
17.	Bid Security Declaration Form	Form BDF/1	63
18.	Letter of participation from Each partner of Joint Venture (JV)/ Consortium	Form JV/Consortium/1	64
19.	Power of attorney for authorized signatory of Joint Venture (JV)/ Consortium partners	Form JV/Consortium/2	66
20.	Power of attorney to Lead partner of joint venture (JV)/ Consortium	Form JV/Consortium/3	67
21.	Draft Joint Venture Agreement	Form JV/Consortium/4	69
	<b>Bidder Qualification</b>		
22.	Bidder's Information Sheet	Form ELI - 1	73
23.	JV/Consortium Information Sheet	Form ELI - 2	75
24.	Financial Situation	Form FIN - 1	77
25.	Annual Construction Turnover	Form FIN - 2	79
26.	Current Contract Commitment	Form FIN - 3	80
27.	Deleted	Form No 1	
28.	Checklist for clauses pertaining to Summary Rejection of bid	Form No 2	83
29.	Format for certificate to be submitted by bidder along with the bid	Form 3 C1	84
30.	Format for certificate to be submitted by Bidder along with the bid for subcontracting	Form 3 C2	85
31.	Deleted	Form 4	
32.	Key Personnel for the work	Form 5	86
33.	Format of Curriculum Vitae (cv) for proposed key professional staff	Form 6	87
34.	Undertaking from specialist sub-contractor	Form CL-2	88
35.	Availability of Financial Resources	Form CL-3	89
36.	Evidence of Availability of Credit Line Financial Resources	Form CL-4	90
37.	Work Experience Certificate	Form EXP-1	91

## A) QUALIFICATION INFORMATION/BIDDING FORMS

### 1. QUALIFICATION INFORMATION

The information to be filled in by the Tenderer hereunder will be used for purposes of computing Tender capacity as provided for in Clause 2 of the Instructions to Tenderers. This information will not be incorporated in the Contract.

#### 1.1. Constitution or legal status of Tenderer

Place of Registration: \_\_\_\_\_ [Attach copy]

Principal place of business: \_\_\_\_\_ [Attach Copy]

#### 1.2. Total value of construction works executed and payments received in the preceding five Financial Years. (Rs. In Crores) (attach certificate from Statutory Auditors)

2018-2019: -----

2019-2020: -----

2020-2021: -----

2021-2022: -----

2022-2023: -----

K-RIDE

Section 3: Qualification Information (Bidding Forms)

1.3. Work performed as Contractor (in the same name) on works of similar nature over during the five financial years specified in 1.2 above.

Project Name	Name of Employer	Description of Work	Contract Number	Value of contract Rs. Cr.	Date of Issue of work order	Specified period of completion	Actual date of completion	If partner in a JV/ Consortium, specify participation in total contract amount	Remarks explaining reasons for delay in completion of work
1	2	3	4	5	6	7	8	9	10

**Note:**

- (1) If the qualifying work of similar nature is done by a joint venture/consortium, then Value shall be considered as per percentage participation by the member(s) in that joint venture/consortium.
- (2) Value of \*similar nature of work completed shall be updated up to date of submission as per table given below:

Financial year	2018-19	2019-20	2020-21	2021-22	2022-23
Indian Currency					
Foreign Currency					

- (3) Updated value of completed work in foreign currency shall be converted to Equivalent INR, calculated using the selling exchange rate of Reserve Bank of India as on 28<sup>th</sup> day prior to the last date of submission of bids. In case publication is not available on 28<sup>th</sup> day, previous working day published exchange rate shall be considered for evaluation.

The bidder shall attach a copy of the Certificate(s) issued by the employer in support of the information being furnished in the above form, failing which the claim of the bidder shall be liable to be rejected (in case of experience as a sub-contractor, the employer shall be the owner of the Project who has engaged the main Contractor).

\_\_\_\_\_  
SEAL AND SIGNATURE

Section 3: Qualification Information (Bidding Forms)

1.4. Quantities of work executed as contractor (in the same name) during the last five years.

Year	Name of Work	Name of Employer	Quantity of work performed (As mentioned in Qualification of the Tenderer Clause 3.2)	Remarks (Indicate contract reference Contract No., Award Date, Completion date, Role in contract, total contract amount, JV participation proportion)
2018-19				
2019-20				
2020-21				
2021-22				
2022-23				

**Note:**

- 1) Copy of Certificate(s) issued by the employer in support of the information being furnished above, shall be attached with each respective form, as per detailed requirements indicated in clause 3.2 (c) of Section 2 failing which the claim of the bidder shall be liable to be rejected (in case of experience as a sub-contractor, the employer shall be the owner of the Project who has engaged the main Contractor).

\_\_\_\_\_  
SEAL AND SIGNATURE

Section 3: Qualification Information (Bidding Forms)

1.5. Information on works for which Tenders have been submitted and works which are yet to be completed as on the date of this Tender.

(A) Existing commitments and on-going works:

Description of Work	Place & State	Contract No. & Date	Name and Address of Employer	Value of Contract (Rs. In Crores)	Stipulated period of completion	Value of works remaining to be completed (Rs. In Crores) (Attach certificate from Engineer in charge)	Value of the works to be executed in the next "P+3" months	Anticipated date of completion
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)

(Where P=The completion period (in months) specified for the works)

(B) Works for which Tenders already submitted:

Description of Work	Place & State	Name and Address of Employer	Estimated value of works (Rs. In Crores)	Stipulated period of completion	Date when decision is expected	Remarks if any
(1)	(2)	(3)	(4)	(5)	(6)	(7)

1.6. The following items of equipment are considered essential for successfully carrying out the works. The Tenderer should furnish all the information listed below. (The item of the equipment required nos. and capacity should match with those specified in ITT clause 3.3(a))

Item of Equipment	Requirement			Owned and available no's/Age/Capacity/Condition	Remarks (The details of hired/leased equipment details to be indicated)
	Nos	Capacity	Owned		

1.7. Reports on the financial standing of the tenderer, such as profit and loss statements and auditor's reports for the last five years;

1.8. Qualification and experience of the key technical and management personnel in permanent employment with the tenderer and those that are proposed to be deployed on this contract, if awarded.

1.9. Name, address, and telephone, telex, and fax numbers of the Tenderers' bankers who may provide references if contacted by the Employer.

Section 3: Qualification Information (Bidding Forms)

1.10. Evidence of access to financial resources to meet the qualification requirement specified in ITT Clause 3.3 (b): Cash in hand, Letter of Credit etc. List them and attach certificate from the Banker in the suggested format given in Section 3, Form No.CL3 & CL4.

1.11. Proposals for subcontracting components of works amounting to more than 20% of the contract price.

Item of Work	Value of Sub-Contract	Identified Sub-Contractor (Name and Address)	Experience of similar works (Attach Certificates from the respective Employers)	Remarks (Undertaking from Specialist subcontractors to be provided as per Form CL-2)

K-RIDE

Section 3: Qualification Information (Bidding Forms)

1.12. Information on litigations in which the Tenderer is involved:

**Litigation History**

(This has reference to Eligibility cum Qualification Criteria document.)

Name of Tenderer or member of Joint Venture: -

Sl. No.	Name of the Employer/ Client	Name of the work	No. of cases in the work	cause of Litigation/ arbitration/ details of disputes	Year	Litigation/ arbitration initiated by	Award in favor of Tenderer/ Client	Disputed Amount	Remarks showing present status

**Note:** Tenderers including each of the partners of a Joint Venture, should provide information on any history of litigation or Arbitration resulting from contracts executed in the last 10 years as on date of submission of this tender. A separate sheet should be used for each partner of a Joint Venture



Section 3: Qualification Information (Bidding Forms)

- 1.13. **The proposed methodology and program of construction, backed with equipment planning and deployment, duly supported with broad calculations and quality control procedures proposed to be adopted, justifying their capability of execution and completion of the work as per technical specifications within the stipulated period of completion as per milestones.**

**APPROACH & METHODOLOGY PROPOSED FOR PERFORMING THE ASSIGNMENT**

Name of Project: “.....”

The approach and methodology will be detailed precisely under the following topics:

1. Understanding of the assignment
2. Work Breakdown structure/ Work plan.
3. Composition of the Team
4. Organizational set up/ Construction methodology for execution of the work as outline in Section 8A
5. Documentation and procedures to be prepared, adopted and furnished to K-RIDE (Rail Infrastructure Company (Karnataka) Limited).
6. Reporting Procedure
7. Sourcing of Material

**Note:**

- i. **The approach and methodology should be precise and relevant to the assignment. Include Bar charts.**

**B) ADDITIONAL QUALIFICATION INFORMATION/BIDDING FORMS**

**Form: PS1**

**LETTER OF TECHNICAL BID**

(Separately for each Package) .....

Date.....

Invitation for Bid No.:.....

To,

.....

We, the undersigned, declare that:

- (a) We have examined and have no reservations to the Bidding Documents, including Addenda issued in accordance with Instructions to Tenderer (ITT);
- (b) We offer to execute the Works in conformity with the Bidding Documents;
- (c) Our bid shall be valid for a period of 180 days from the date fixed for the bid submission deadline in accordance with the Bidding Documents, and it shall remain binding upon us and may be accepted at any time before the expiration of that period;
- (d) If our bid is accepted, we commit to obtain a performance security in accordance with the Bidding Documents;
- (e) If our bid is accepted, we commit to deploy key equipment and key personnel consistent with the requirements stipulated in Section 8A: Works Requirements.
- (f) If our bid is accepted, we commit to submit work method statements for all major activities and get these approved from the engineer prior to commencing work on such activities. We also understand that the work shall be executed as per the approved method statements and KEY DATES without any deviations and delay in completion.
- (g) We, including any subcontractors or suppliers for any part of the contract, do not have any conflict of interest in accordance with ITT clause 2.4;
- (h) We declare that we are not participating, as a Bidder or as a subcontractor, in more than one bid in this bidding process in accordance with ITT clause 2.2, other than alternative offers submitted in accordance with ITT clause 14;
- (i) We declare that we are not liable to be disqualified in Accordance with ITT clause 2.5, and we are enclosing the affidavit for the same as per the Performa given in the bid document.

### Section 3: Qualification Information (Bidding Forms)

- (j) We understand that this bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal contract is prepared and executed; and
- (k) We have not made any deviations from the requirement of the bidding document and we have also not made any tampering or changes in the bidding documents on which the bid is being submitted and if any tampering or changes are detected at any stage, we understand the bid will invite summary rejection and invocation of bid security declaration, the contract will be liable to be terminated along with forfeiture of performance security, even if LOA has been issued.
- (l) We understand that we will be considered for participating for which we have submitted the bid security(ies) declaration form and we will be considered for award, subject to fulfilling the eligibility criteria as given in bidding document;
- (m) If our bid is accepted, we opt to take payment into the bank account, nominated by us.
- (n) We declare that the submission of this bid confirms that no agent, middleman or any intermediary has been, or will be engaged to provide any services or any other item of work related to the award and performance of this contract. We further confirm and declare that no agency commission or any payment which may be construed as an agency commission has been, or will be, paid and that the bid price does not include any such amount. We acknowledge the right of the Employer, if he finds to the contrary, to declare our bid to be noncompliant and if the contract has been awarded to declare the contract null and void
- (o) We understand that you are not bound to accept the lowest evaluated bid or any other bid that you may receive.
- (p) A Power of Attorney to sign and submit this letter is attached.
- (q) Having inspected the site, examined the complete bid document including Employer's requirements, Conditions of Contract, Special Conditions of Contract, particular conditions of Contract, Technical Specifications, Safety, Health & Environment (SHE) manual, Eligibility Cum Qualification Criteria, Instructions to Bidder and Addenda/Corrigendum etc., thereto (if any) for above mentioned work and prepared the bid entirely in accordance with all the requirements of the bid document and agree entirely with them.
- (r) We here by confirm that we have visited the sites of work and have become conversant with the local conditions of working.
- (s) For the purpose of your evaluation, study, review and decision-making we are ready to let you inspect our business premises / site, etc.
- (t) We authorize K-RIDE or any of their authorized representative to approach, enquire, verify and check the matter furnished in our submission with the concerned client / owner of the Project / Contract and the concerned Banker of reference provided by us.

**Section 3: Qualification Information (Bidding Forms)**

- (u) We undertake to hold in confidence all documents and information whether Technical or Commercial supplied to us at any time by or on behalf of K-RIDE in connection with this bid and without your written authority or as otherwise required by law not to publish or otherwise disclose the same.
- (v) If our bid is accepted, we agree to establish our project office in Bangalore.
- (w) We have submitted the Statement of Integrity, Eligibility, Social, and Environmental Responsibility signed and abide by the same.
- (x) We understand that this Bid shall be governed by and construed in all respects according to the laws for the time being force in India. The courts at Bangalore will have exclusive jurisdiction in the matter.
- (y) We undertake that, in competing for (and, if the award is made to us, in executing) the above contract, we will strictly observe the laws against fraud and corruption in force in India namely "Prevention of Corruption Act 1988".

We hereby confirm that this Tender complies with the Tender validity and Earnest money deposit required by the Tender documents.

- (z) We confirm and declare that by virtue of our signature below, to the best of knowledge and belief that the information provided by us as required in this Bid Document, all supporting and explanatory information is truthful and exact.

Name.....  
 .....In the capacity  
 of.....  
 ...

Signed  
 .....  
 .....

Duly authorized to sign the Bid for and on behalf of  
 ..... .....

Date  
 .....  
 .....

**(SEAL AND SIGNATURE OF THE BIDDER)**

Section 3: Qualification Information (Bidding Forms)

**LETTER OF PRICE BID**

(To be separately given for each package on the Letter head of the Firm)

Date.....

Invitation for Bid No.....

To,  
.....

We, the undersigned, declare that:

- (a) We have examined and have no reservations to the Bidding Documents, including Addenda issued in accordance with Instructions to Bidders (ITT) 9;
- (b) We offer to execute the Work in conformity with the Bidding Documents;
- (c) The total price of our Bid, indicated in the Price Bid Section 9: Price Schedule.
- (d) We understand that this bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal contract is prepared and executed; and
- (e) We have not made any deviations from the requirement of the bidding document and we have also not made any tampering or changes in the bidding documents on which the bid is being submitted and if any tampering or changes are detected at any stage, we understand the bid will invite summary rejection and forfeiture of bid security/the contract will be liable to be terminated along with forfeiture of performance security, even if LOA has been issued.
- (f) We understand that you are not bound to accept the lowest evaluated bid or any other bid that you may receive.



Section 3: Qualification Information (Bidding Forms)

Name.....

..... In the capacity of  
.....

Signed

.....  
.....

Duly authorized to sign the Bid for and on behalf of

.....

Date

.....

.....

Seal

.....

.....

K-RIDE

**FORMAT FOR AFFIDAVIT TO BE SUBMITTED BY BIDDER ALONGWITH THE BID**

(To be separately given for each package)

*(To be executed in presence of Public Notary on non-judicial stamp paper of the appropriate value in accordance with relevant stamp Act. The stamp paper has to be in the name of the bidder) \*\**

I ..... **(Name and designation)** \*\*..... appointed as the attorney/authorized signatory of the bidder (including its constituents), M/s. \_\_\_\_\_ (hereinafter called the bidder) for the purpose of the Bid for the work of \_\_\_\_\_ as per the bid No. \_\_\_\_\_ of K-RIDE, do hereby solemnly affirm and state on behalf of the bidder including its constituents as under:

- \*1. That the bidder or any of its constituents has not been Blacklisted/ banned for business dealings for all Government Departments or by Ministry of Railways or by K-RIDE at any time and/or no such blacklisting is in force as on the deadline for submission of bids.
- \*2. That none of the previous contracts of the bidder or any of its constituents had been terminated/rescinded for Contractor's failure or part terminated for its failure as a JV/ Consortium partner with forfeiture of its full Performance Security, by Rail Infrastructure Development Company (Karnataka) Ltd. during the period of last 3 years before the deadline for submission of bids.

*(Add Proviso of Clause 2, (ITT) suitably, if any Contract was so terminated).*

- \*3. The bidder or any of its constituents has not been imposed liquidated damages of 5% or more of contract value by any Government Department or by Ministry of Railways or by K-RIDE due to delay in the implementation of any previous contract (either in the capacity of a single entity or as constituent of any other JV/ Consortium) within the period of last 2 years before the deadline for submission of bid [2 years shall be reckoned from the date on which imposed L.D. has exceeded 5% of the contract price] and there are no such accrued delay damages which has not been fully recovered before the deadline for submission of bids on account of contractor's request for deferring recovery to maintain cash flow and K-RIDE has acceded to the same in the interest of the project and the work under the previous contract in question has been completed before the deadline for submission of bid, unless imposition of such delay damages has been set aside by the Competent Authority.
4. That the Bidder or any of its constituents is neither Bankrupt/Insolvent nor is in the process of winding-up nor is such a case pending before any Court on the deadline of submission of the bid.
- \*5. That the name of the Bidder or any of its constituents is not on the list of "Poor Performer" of any Government Department or by Ministry of Railways or by K-RIDE as on the deadline for submission of bid.
6. We declare that the bidder or any of its constituents have not either changed their name or created a new business entity. Consequent to having been banned business dealings for specified period which is not over or suspended business dealings or having been declared as poor performer.

### Section 3: Qualification Information (Bidding Forms)

7. We declare and certify that balance sheets for last five financial years including that for the latest concluded financial year are being submitted.

OR

We declare and certify that balance sheet for the latest concluded financial year has not been finalized till date and that is why we are furnishing financial data for last five financial years ignoring the latest concluded financial year.

(# - Delete whichever is not applicable) \*\*.

8. We declare and certify that we have not made any misleading or false representation in the forms, statements and attachments in proof of the qualification requirements.
9. We declare that the information and documents submitted along with the bid by us are correct and we are fully responsible for the correctness of the information and documents, submitted by us.
10. We understand that in case we cease to fulfil the requirements of qualifying and eligibility criteria at any time after opening of bids and till finalization of bids, it will be our bounden duty to inform the Employer of our changed status immediately and in case of our failure to do so, our bid shall be rejected and bid security declaration form shall be forfeited. In case such failure comes to the notice of Employer at any time after award of the contract, it will lead to termination of the contract and forfeiture of Bid or Performance Security. We shall also be liable for Banning of Business dealings up to a period of five years.
11. We understand that if the contents of the affidavit are found to be false at any stage during bid evaluation, it will lead to rejection of our bid and forfeiture of the bid security. Further, we **[insert name of the bidder]** \*\* \_\_\_\_\_ and all our constituents understand that we shall be liable for banning of business dealings up to a period of five years.
12. We declare and certify that we have not made any misleading or false representation in the forms, statements and attachments in proof of the qualification requirements.
13. We also understand that our offer will be evaluated based on the documents/credentials submitted along with the offer and same shall be binding upon us.
14. We declare that the information and the document submitted along with the tender by us are correct and we are fully responsible for the correctness of the information and documents, submitted by us.
15. We undersigned that if the certificate regarding Eligibility Criteria submitted by us are found to be forged/false or incorrect at any time during process for evaluation of tenders, it shall lead to forfeiture of the tender EMD besides banning of business for five years in K-RIDE. Further, we (Insert name of the Tenderer)\*\* ..... and all our constituents understand that our offer shall be summarily rejected.
16. We also understand that if the certificate submitted by us are found to be false/forged or incorrect at any time after the award of contract, it will lead to termination of the contract, along with forfeiture of EMD/SD and performance guarantee besides any other action provided in the contract including banning of business for five year in K-RIDE.



Section 3: Qualification Information (Bidding Forms)

**(SEAL AND SIGNATURE OF THE BIDDER)**

**Verification:**

We above named tenderer do hereby solemnly affirm and verify that the contents of our above affidavit are true and correct. Nothing has been concealed and no part of it is false.

**(SEAL AND SIGNATURE OF THE BIDDER)**

\*Modify the contents wherever necessary, in terms of sub-clause 2 ITT.

\*\* The contents in Italics are only for guidance purpose and details as appropriate, are to be filled in suitably by Bidder.

Attestation before Magistrate/Public Notary

K-RIDE

**FORMAT OF BID SECURITY (BANK GUARANTEE)**

WHEREAS \_\_\_\_\_ having its registered office at \_\_\_\_\_  
\_\_\_\_\_ (hereinafter called the –Bidder) has submitted his bid dated \_\_\_\_\_ for the work of "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works" Hereinafter called "the Works") KNOW ALL PEOPLE by these presents that we, \_\_\_\_\_ having its registered office at \_\_\_\_\_ (hereinafter called the Bank) are bound unto the Managing Director, Rail Infrastructure Development Company Karnataka Ltd (K-RIDE), Bangalore. (hereinafter called "the Employer") in the sum of Rs. \_\_\_\_\_ (Rupees \_\_\_\_\_) for which payment well and truly to be made to the said Employer the Bank binds itself, his successors and assigns by these presents; SEALED with the Common Seal of the said Bank this day \_\_\_\_\_.

THE CONDITIONS OF THIS OBLIGATION ARE:

(1) If after Bid opening the Bidder withdraws his Bid during the period of Bids validity specified in the Form of Bid.

OR

(2) If the Bidder having been notified of the acceptance of his Bid by the Employer during the period of Bid Validity.

- a. Fails or confuses to execute the form of Agreement in accordance with the instructions to Bidders, if required; or
- b. Fails or refuse to furnish the Performance Security, in accordance with the instruction to Bidders; or
- c. Does not accept the correction of the Bid Price pursuant to clause 24

We undertake to pay to the Employer up to the above amount upon receipt of his first written demand, without the Employer having to substantiate his demand, provided that in his demand the Employer will note that the amount claimed by him is due to him owing to the conditions of one or both of the two conditions, specifying the occurred condition or conditions.

This Guarantee will remain in force up to and including the date 180 days plus 45 days after the deadline for submission of bids as such deadline is stated in the instructions to Bidders of as it may be extended by the Employer, notice of which extension(s) to the Bank is hereby waived. Any demand in respect of this Guarantee should reach the Bank not later than the above date

DATE \_\_\_\_\_ SIGNATURE OF THE BANK \_\_\_\_\_

WITNESS \_\_\_\_\_

SEAL \_\_\_\_\_

**PRO-FORMA LETTER OF PARTICIPATION FROM EACH PARTNER OF JOINT VENTURE (JV)/**

**CONSORTIUM**

(On each Firm's Letter Head)

No.....

Dated:.....

From,

.....  
.....

To,

The General Manager,  
Rail Infrastructure Development Company (Karnataka) Limited,  
"Samparka Soudha", 1st Floor,  
B.E.P Premises (Opp. Orion Mall),  
Rajajinagar 1st Block,  
Bangalore - 560 010.

Gentlemen,

Re: ... "[Insert name of work] ....."

Ref: Your notice for Invitation for Bid (IFB) .....

1. We wish to confirm that our company/firm (delete as appropriate) has formed a Joint Venture/ Consortium by name of ..... with for the purposes associated with IFB referred to above.  
(Members who are not the lead partner of the JV/ Consortium should add the following paragraph) \*.
2. 'The JV/ Consortium is led by ... whom we hereby authorize to act on our behalf for the purposes of submission of Bid for ..... and authorize to incur liabilities and receive instructions for and on behalf of any and all the partners or constituents of the Joint Venture/ Consortium.'

OR

(Member(s) being the lead member of the group should add the following paragraph) \*

2. 'In this group we act as leader and, for the purposes of applying for qualification, represent the Joint Venture/ Consortium'

Section 3: Qualification Information (Bidding Forms)

3. In the event of our group being awarded the contract, we agree to be jointly with..... (names of other members of our JV/ Consortium) ..... and severally liable to the (K-RIDE) Rail Infrastructure Development Company (Karnataka) Limited, Bangalore, its successors and assigns for all obligations, duties and responsibilities arising from or imposed by the contract subsequently entered into between Rail Infrastructure Development Company (Karnataka) Limited, Bangalore and our JV/ Consortium.
4. \*I/We, further agree that entire execution of the contract shall be carried out exclusively through the lead partner.

Yours faithfully,

(Signature)

(Name of Signatory) .....

(Capacity of Signatory) .....

Seal

\* Delete as applicable

K-RIDE

**FORMAT FOR POWER OF ATTORNEY FOR AUTHORISED  
SIGNATORY OF JOINT VENTURE (JV)/ CONSORTIUM PARTNERS**

**POWER OF ATTORNEY**

*(To be executed on non-judicial stamp paper of the appropriate value in accordance with relevant stamp Act.  
The stamp paper to be in the name of the company who is issuing the power of Attorney)*

Know all men by these presents, we ... do hereby constitute, appoint and authorize Mr/Ms. .... who is presently employed with us and holding the position of .....as our attorney, to do in our name and on our behalf, all such acts, deeds and things necessary in connection with or incidental to our bid for the work of ...Including signing and submission of all documents and providing information/responses to Rail Infrastructure Development Company (Karnataka) Limited, Bangalore, representing us in all matters, dealing with Rail Infrastructure Development Company (Karnataka) Limited, Bangalore, in all matters in connection with our bid for the said project and if successful, till the whole of the bid process.

We hereby agree to ratify all acts, deeds and things lawfully done by our said attorney pursuant to this Power of Attorney and that all acts, deeds and things done by our aforesaid attorney shall and shall always be deemed to have been done by us.

Dated this the ..... day of ..... 20..

(Signature of authorized Signatory)

.....

(Signature and Name in Block letters of Signatory)

Seal of Company

Witness

Witness 1:

Name:

Address:

Occupation:

Witness 2:

Name:

Address:

Occupation:

\*Notes:

- i. To be executed by all the partners individually, in case of a Joint Venture/ Consortium.
- ii. The mode of execution of the Power of Attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required the same should be under common seal affixed in accordance with the required procedure.
- iii. Also wherever required, the executants(s) should submit for verification the extract of the charter documents and documents such as resolution/ power of attorney in favour of the person executing this power of attorney for the designation of power hereunder on behalf of the bidder.

**FORMAT FOR POWER OF ATTORNEY TO  
LEAD PARTNER OF JOINT VENTURE (JV)/ CONSORTIUM**

*(To be executed on non-judicial stamp paper of the appropriate value in accordance with relevant stamp Act.  
The stamp paper to be in the name of the company who is issuing the power of Attorney)*

**POWER OF ATTORNEY**

Whereas Rail Infrastructure Development Company (Karnataka) Limited Bangalore, has invited Bids for the work of

Whereas, the members of the Joint Venture/ Consortium comprising of M/s. ...., M/s. ...., and M/s. .... are interested in submission of bid for the work of ... *[Insert name of work]* ... in accordance with the terms and conditions contained in the bidding documents.

Whereas, it is necessary for the members of the Joint Venture/ Consortium to designate one of them as the Lead Partner, with all necessary power and authority to do, for and on behalf of the Joint Venture/ Consortium, all acts, deeds and things as may be necessary in connection with the Joint Venture's/ Consortium's bid for the project, as may be necessary in connection the Joint Venture's/ Consortium's bid for the project.

NOW THIS POWER OF ATTORNEY WITNESSETH THAT:

We, M/s. ...., hereby designate M/s. ...., being one of the partners of the Joint Venture/ Consortium, as the lead partner of the Joint Venture/ Consortium, to do on behalf of the Joint Venture/ Consortium, all or any of the acts, deeds or things necessary or incidental to the Joint Venture's/ Consortium's bid for the contract, including submission of bid, participating in conferences, responding to queries, submission of information/ documents and generally to represent the Joint Venture/ Consortium in all its dealings with K-RIDE/ Railway or any other Government Agency or any person, in connection with the contract for the said work until culmination of the process of bidding till the contract agreement is entered into with the Rail Infrastructure Development Company (Karnataka) Limited, Bangalore and thereafter till the expiry of the contract agreement.

We hereby agree to ratify all acts, deeds and things lawfully done by lead member, our said attorney, pursuant to this power of attorney and that all acts deeds and things done by our aforesaid attorney shall and shall always be deemed to have been done by us/ Joint Venture/ Consortium.

Dated this the ..... Day of ..... 20..

.....

(Signature)

.....

(Name in Block letters of Executant)

Seal of Company

### Section 3: Qualification Information (Bidding Forms)

Witness 1:

Name:

Address:

Occupation:

Witness 2:

Name:

Address:

Occupation:

#### **Notes:**

1. To be executed by all the Partners of the JV/Consortium except the lead Partner.
2. The mode of execution of the Power of Attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required the same should be under common seal affixed in accordance with the required procedure.

K-RIDE

**DRAFT FORMAT OF JOINT VENTURE/CONSORTIUM AGREEMENT**

M/s ..... having its registered office at ..... (hereinafter referred to as .....)  
acting as the Lead Partner of the first part,

and

M/s ..... having its registered office at ..... (here in after referred to as  
.....) in the capacity of a Joint Partner of the other part.

The expressions of ..... and ..... shall wherever the context admit, mean and include their respective legal representatives, successors-in-interest and assigns and shall collectively be referred to as “the Parties” and individually as “the Party”

**WHEREAS:**

Rail Infrastructure Development Company (Karnataka) Limited (K-RIDE) [hereinafter referred to as “Employer”] has invited bids for ... “[Insert name of work] .....” Vide LOA No.....awarded contract.

**NOW, THEREFORE, THE PARTIES AGREE AS FOLLOWS:**

1. The following documents shall be deemed to form and be read and construed as an integral part of this AGREEMENT.
  - i. Notice for Bid, and
  - ii. Bidding document
  - iii. Any Addendum/Corrigendum issued by Rail Infrastructure Development Company (Karnataka) Limited
  - iv. The bid submitted on our behalf jointly by the Lead Partner.
  - v. Letter of Acceptance issued by Rail Infrastructure Development Company (Karnataka) Ltd.
2. The ‘Parties’ have studied the documents and LOA issued to enter into Joint Venture/ Consortium as under and have agreed to participate.
3. M/s .....shall be the lead member of the JV/ Consortium for all intents and purpose and shall represent the Joint Venture/ Consortium in its dealing with the Employer. For the purpose of execution, the parties agree to nominate ..... as the leader duly authorized to sign and submit all documents and enter into correspondence with the Employer.
4. The ‘Parties’ have resolved that the distribution of share and responsibilities between the JV/Consortium partners is as under
  - (a) Lead Partner Share ..... %

**Responsibilities**

(I) Key Activities and %age execution assigned

- i. ....



Section 3: Qualification Information (Bidding Forms)

(II) BOQ Schedule/Bill No. and %age execution assigned

- i. ....
- ii. ....
- iii. ....

(b) Joint Venture/ Consortium Partner Share.....%

**Responsibilities**

(I) Key Activities and %age execution assigned

- i. ....

(II) BOQ Schedule/Bill No. and %age execution assigned

- i. ....
- ii. ....
- iii. ....

(c) Joint Venture/ Consortium Partner Share.....%

**Responsibilities**

(I) Key Activities and %age execution assigned

- i. ....

(II) BOQ Schedule/Bill No. and %age execution assigned

- i. ....
- ii. ....
- iii. ....

**Note:** In case any Bill or items of a Bill are proposed to be executed by more than one JV/ Consortium partner then indicate the breakup of that Item/Bill no. for each JV/ Consortium partner.

**5. JOINT AND SEVERAL RESPONSIBILITIES**

The Parties undertake that they shall be jointly and severally liable to the Employer in the discharge of all the obligations and liabilities as per the contract with the Employer and for the performance of contract awarded to their JV/Consortium.

**6. ASSIGNMENT AND THIRD PARTIES**

*The parties shall co-operate throughout the entire period of this AGREEMENT on the basis of exclusivity and neither of the Parties shall make arrangement or enter into agreement either directly or indirectly with any other party or group of parties on matters relating to the Project except with prior written consent of the other party and the Employer.*

**7. EXECUTIVE AUTHORITY**

The said Joint Venture/ Consortium through its authorized representative shall receive instructions, payments from the Employer. The management structure for the project shall be prepared by mutual consultations to enable completion of project to quality requirements within permitted cost and time.

**8. GUARANTEES AND BONDS**

**Section 3: Qualification Information (Bidding Forms)**

*Performance Security and other Securities of a JV/ Consortium shall be in the name of the JV/ Consortium that submits the bid.*

**9. BID SUBMISSION**

*Each Party shall bear its own cost and expenses for preparation and submission of the bid and all costs until conclusion of a contract with the Employer for the Project. Common expenses shall be shared by both the parties in the ratio of their actual participation.*

**10. INDEMNITY**

*Each party hereto agrees to indemnify the other party against its respective parts in case of breach/default of the respective party of the contract works of any liabilities sustained by the Joint Venture/ Consortium.*

**11.** For the execution of the respective portions of works, the parties shall make their own arrangements to bring the required finance, plants and equipment, materials, manpower and other resources.

**12. DOCUMENTS & CONFIDENTIALITY**

Each Party shall maintain in confidence and not use for any purpose related to the Project all commercial and technical information received or generated in the course of preparation and submission of the bid.

**13. ARBITRATION**

*Any dispute, controversy or claim arising out of or relating to this agreement shall be settled in the first instance amicably between the parties. If an amicable settlement cannot be reached as above, it will be settled by arbitration in accordance with the Indian Arbitration and Conciliation Act 1996 or any amendments thereof. The venue of the arbitration shall be Bangalore.*

**14. VALIDITY**

*This Agreement shall remain in force till the defect liability period is over and Securities are released.*

**15.** This AGREEMENT is drawn in ..... number of copies with equal legal strength and status. One copy is held by M/s ..... and the other by M/s. & .....M/s ..... and a copy submitted with the Bid.

**16.** This AGREEMENT shall be construed under the laws of India.

**17. NOTICES BETWEEN JV/ CONSORTIUM PARTNERS**

Notices shall be given in writing by fax confirmed by registered mail or commercial courier to the following fax numbers and addresses:

Lead Partner

Other Partner

.....  
.....

.....  
.....

Section 3: Qualification Information (Bidding Forms)

(Name & Address)

(Name & Address)

IN WITNESS WHEREOF THE PARTIES, have executed this AGREEMENT the day, month and year first before written.

M/s.....

M/s.....

.....

.....

(Seal)

(Seal)

**Witness**

1.....(Name & Address)

2..... (Name & Address)

\*\*\*

K-RIDE

Section 3: Qualification Information (Bidding Forms)

**Bidders Qualification**

To establish its qualifications to perform the contract in accordance with Section 2 (Qualification Information) the Bidder shall provide the information requested in the corresponding Information Sheets included hereunder.

To establish its qualifications to perform the contract in accordance with Section 2 (Qualification Criteria) the Bidder shall provide the information requested in the corresponding Information Sheets included hereunder.

**Form ELI - 1: Bidder's Information Sheet**

<b>Bidder's Information</b>	
<b>Bidder's legal name</b>	
<b>Bidder's country of constitution</b>	
<b>Bidder's year of constitution</b>	
<b>Bidder's legal address in country of constitution</b>	
<b>Bidder's authorized representative</b> (Name, address, telephone numbers, fax numbers, e-mail address)	
<b>Bidder's Bank Details:</b> (a) Name of the Bank and branch: (b) Account Number: (c) IFSC code: (d) Bank's Contact Number and Fax Number: (e) PAN: (f) GST Registration No:	

### Section 3: Qualification Information (Bidding Forms)

**The bidder shall attach copies of the following original documents with the form:**

1. In case of single entity, articles of incorporation or constitution of the legal entity named above, in accordance with ITT clause 2.
2. Authorization to represent the firm or JV/ Consortium named in above, in accordance with ITT clause 14.
3. In case of JV/ Consortium, JV/ Consortium agreement, in accordance with ITT clause 2.

**Note:** Following needs to be submitted by the bidder;

- (a) Affidavit in case of Proprietary firm.
- (b) Partnership Deed in case of partnership firm.
- (c) Memorandum & Article of Association in case of Public/Private limited company.
- (d) Authorization/POA in favour of authorised signatory of bidder to sign the bid.
- (e) Board of resolution nominating particular director to authorize a signatory to sign the bid.
- (f) In case of JV partners, the above relevant documents as applicable needs to be submitted.

---

**SEAL AND SIGNATURE**

K-RIDE

Section 3: Qualification Information (Bidding Forms)

**Form ELI - 2: JV/ Consortium Information Sheet**

Each member of a JV/ Consortium must fill in this form separately

JV / Consortium Information	
<b>Bidder's legal name</b>	
<b>JV/ Consortium Partner's legal name</b>	
<b>JV/ Consortium Partner's country of constitution</b>	
<b>JV/ Consortium Partner's year of constitution</b>	
<b>JV/ Consortium Partner's legal address in country of constitution</b>	
<b>JV/ Consortium Partner's authorized representative information</b> (Name, address, telephone numbers, fax numbers, e-mail address)	
<b>Bidder's Bank Details:</b> (a) Name of the Bank and branch: (b) Account Number: (c) IFSC code: (d) Bank's Contact Number and Fax Number: (e) PAN: (f) GST Registration No:	

### Section 3: Qualification Information (Bidding Forms)

**The bidder shall attach copies of the following original documents with the form:**

1. Articles of incorporation or constitution of the legal entity named above, in accordance with ITT clause 2.
2. Authorization to represent the firm named above, in accordance with ITT clause 14.

**Note:** Following needs to be submitted by the bidder;

- (g) Affidavit in case of Proprietary firm.
- (h) Partnership Deed in case of partnership firm.
- (i) Memorandum & Article of Association in case of Public/Private limited company.
- (j) Authorization/POA in favour of authorised signatory of bidder to sign the bid.
- (k) Board of resolution nominating particular director to authorize a signatory to sign the bid.
- (l) In case of JV partners, the above relevant documents as applicable needs to be submitted.

---

**SEAL AND SIGNATURE**

K-RIDE

(Each Bidder or each member of a JV/Consortium must fill in this form separately)

**NAME OF BIDDER/JV/CONSORTIUM PARTNER**

	Financial Data for Last 5 Years [Indian National Rupees]				
	Year 1:	Year 2:	Year 3:	Year 4:	Year 5:
1. Total Assets					
2. Current Assets					
3. Total Liabilities					
Current Liabilities					
5. <b>Net Worth</b> [= 1 – 3]					
6. Working Capital [= 2 - 4]					
7. Profit Before Tax (PBT)					

**1. The bidder shall attach copies of the following original documents with the form**

Copies of the audited balance sheets, including all related notes, and income statements for the last five years, as indicated above, complying with the following conditions.

- i. All such documents reflect the financial situation of the Bidder or partner to a JV/ Consortium, and not sister or parent companies.
- ii. Historic financial statements must be audited by a certified accountant.
- iii. Historic financial statements must be complete, including all notes to the financial statements.
- iv. Historic financial statements must correspond to accounting periods already completed and audited (no statements for partial periods shall be requested or accepted).

**2. Contents of this form should be certified by a Statutory Auditor**

- i. In the event that the audited accounts for the latest Financial Year are not available, the Bidder shall furnish information pertaining to the last four financial years after ignoring the latest financial year. In case, the bidder submits audited financial information for the last six or more years, only the figures for the latest four years shall be considered for evaluation.
- ii. Financial data for last five financial years has to be submitted by the bidder along with audited balance sheets. The financial information of the Bidder must be certified either by the Independent Financial Auditor (statutory Auditor) of the company appointed under the companies' Act.



Section 3: Qualification Information (Bidding Forms)

- iii. In case any discrepancy in data is found between the balance sheet and the financial information submitted, the data as available in the balance sheet will be considered.
- iv. In case the audited balance sheet of the last financial year is not made available by the Bidder, he has to submit an affidavit certifying that 'The Balance Sheet has actually not been audited so far'. In such a case the financial data of previous '4' audited financial years will be taken into consideration for evaluation. If audited balance sheet of any year other than the last financial year is not submitted, then the bid will be considered as non-responsive
- v. In case the company's financial year is from Jan 19 to Dec 19, then it will be considered under financial year 2019 - 20 similar procedure will be applicable for other financial years also.

\_\_\_\_\_  
**SEAL AND SIGNATURE OF THE BIDDER**

Certified that all figures and facts submitted in this form have been furnished after full consideration of all observations/notes in Auditor's reports.

\_\_\_\_\_  
**(Signature of Statutory Auditor )**

**Name of Statutory Auditor :** \_\_\_\_\_

**Registration No:** \_\_\_\_\_

\_\_\_\_\_  
**(Seal)**

Section 3: Qualification Information (Bidding Forms)

**Form FIN-2: Annual Construction Turnover for the last 5 years**

Each Bidder or each member of a JV/ Consortium must fill in this form separately:

**NAME OF BIDDER/JV/CONSORTIUM PARTNER:**

Sl. No.	Year	Annual Turnover	Multiplying factor	Updated Annual turnover
		INR	INR	INR
1	2018-2019			
2	2019-2020			
3	2020-2021			
4	2021-2022			
5	2022-2023			

Annual Turnover Data for the Last 5 Years (Construction only)			
Year	Amount Currency	Exchange Rate	Indian National Rupees Equivalent
<b>Average Annual Construction Turnover for last 5 Financial Years</b>			

1. The information supplied shall be substantiated by data in the audited balance sheets and profit and loss accounts for the relevant years and submitted as attachments to form Fin-1 in respect of the bidder or all partners constituting the bidder.
2. Contents of this form should be certified by a Statutory Auditor.
3. In case the audited balance sheet of the last financial year is not made available by the Bidder, he has to submit an affidavit certifying that 'The Balance Sheet has actually not been audited so far'. In such a case the financial data of previous '4' audited financial years will be taken into consideration for evaluation. If audited balance sheet of any year other than the last financial year is not submitted, then the bid will be considered as non-responsive.

**Form FIN-3: Current Contract Commitments / Works in Progress**

Bidders and each partner to a JV/Consortium should provide information on their current commitments on all contract that have been awarded, or which a letter of intent or acceptance has been received, or for contracts approaching completion, but for which an unqualified, full completion certificate has yet to be issued.

**Contract Commitments**

Sl.No	Description of work	Contract No. & date	Name & address of Employer, Tel./Fax/ Email	Value of Contract in INR	Stipulated Period of completion	Value of Balance work	Anticipated date of Completion
1							
2							
3							
4							
5							
<b>Total</b>							

1. For calculation of "Updated contract value" in column 5 above, assume inflation as per multiplying Factors given in FIN-2.
2. Bidder should provide information on their current commitments or all contracts that have been awarded or for which a letter of intent or acceptance has been received or for contracts approaching completion but for which a completion certificate is yet to be issued.
3. Total Equivalent INR should be calculated using the selling exchange rate of Reserve Bank of India as on 28<sup>th</sup> day prior to the last date of submission of bids. In case publication is not available on 28<sup>th</sup> day, previous working day published exchange rate shall be considered for evaluation.

**Note:** Enclose Certificate(s) from Engineer(s) Incharge (not below the rank of Executive Engineer) for Value of outstanding work. In case it is not feasible to furnish certificate from all the units the bidder should record the following certificate on Fin 3:

"Certified that current commitments on all the contracts that have been awarded or for which a letter of intent or acceptance has been received or for the works in progress or the works approaching completion, value of outstanding work has been indicated in the above table correctly. It is further certified that if later on the

Section 3: Qualification Information (Bidding Forms)

*employer discovers that information provided in the table is incorrect then the employer will treat our bid invalid and it will be liable for rejection"*

---

**SEAL AND SIGNATURE**

K-RIDE

Section 3: Qualification Information (Bidding Forms)  
**FORM NO. 1**

**DELETED**

K-RIDE

**CHECKLIST FOR CLAUSES PERTAINING TO SUMMARY  
REJECTION OF BID**

We, the undersigned, declare that we have read and understood the content of ITT clauses section:2 mentioned below. We also understand that our bid shall be summarily rejected in case we fail to comply the requirements of undermentioned clauses:

ITT Clause No. Section 2	Reason for Summary Rejection
2.5	Non-submission of Affidavit- (Form PS-3)
11.5 & 22	Non-submission of immediate information to the Employer in case Bidder ceases to fulfill eligibility in terms of ITT clause 2
10.3	Letter of Technical Bid (Form PS-1)
11.5	Quoting more than one percentage for any schedule
11.5	Non-submission of the Letter of Price Bid (LB)
13	Bid not accompanied with EMD (BDF/1).
14	Bid not accompanied with power of attorney/General power of Attorney to sign on behalf of the bidders

**SEAL AND SIGNATURE OF THE BIDDER**

**FORMAT FOR CERTIFICATE TO BE SUBMITTED BY BIDDER ALONGWITH THE BID**  
*(On the letter head of the Firm)*

We/I, \_\_\_\_\_, having registered office at \_\_\_\_\_ do hereby certify that “I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India; I certify that this bidder is not from such country or, if from such a country, has been registered with the Competent Authority. I hereby certify that this bidder fulfils all requirements in this regard and is eligible to be considered. (Where applicable, evidence of valid registration by the competent Authority shall be attached.)”

Dated this \_\_\_\_\_ day of \_\_\_\_\_, 2023

For- \_\_\_\_\_

Authorized Signatory Signature \_\_\_\_\_

Full Name: \_\_\_\_\_

Place: \_\_\_\_\_

K-RIDE

**(SEAL AND SIGNATURE OF THE BIDDER)**

**FORMAT FOR CERTIFICATE TO BE SUBMITTED BY  
BIDDER ALONGWITH THE BID FOR SUB CONTRACTING**

*(On the letter head of the Firm)*

We/I, \_\_\_\_\_, having registered office at \_\_\_\_\_ do hereby certify that “I have read the clause regarding restrictions on procurement from a bidder of a country which shares a land border with India and on sub-contracting to contractors from such countries; I certify that this bidder is not from such a country or, if from such a country, has been registered with the competent Authority and will not sub-contractor any work to a contractor from such countries unless such contractor is registered with the competent Authority. I hereby certify that his bidder fulfils all requirements in this regard and is eligible to be considered. (Where applicable, evidence of valid registration the Competent Authority shall be attached.)”

Dated this \_\_\_\_\_ day of \_\_\_\_\_, 2023

For- \_\_\_\_\_

Authorized Signatory Signature \_\_\_\_\_

Full Name: \_\_\_\_\_

Place: \_\_\_\_\_

**(SEAL AND SIGNATURE OF THE BIDDER)**



**Key Personnel for the work****MINIMUM QUALIFICATION AND EXPERIENCE REQUIRED FOR KEY PERSONNEL TO BE DEPLOYED FOR THE WORK**

Sl. No.	Key Personnel	Qualifications & Total Experience	Particular Experience (Minimum requirement)	Minimum Number of Personnel Required	Name of the key personnel proposed	Qualification	Total number of years of experience	Number of Years in similar works experience
1	Sr. Engineer	Graduate in Electrical Engg. with minimum 5 Years of experience	Experience in similar nature of work	1				
3	Technicians/ Electricians	Diploma/ ITI in Electrical with 5 years of experience	Experience in similar nature of work	2				

**Note:** Further details to be updated as per clause 3.3 ( c) of section 2 ITT.

(Signature)

(Name of Signatory) .....

(Capacity of Signatory) .....

Seal.....

### Format of Curriculum Vitae (cv) for proposed key professional staff

Proposed Position:

Name of Firm:

Name of Staff:

Profession:

Date of Birth:

Years with Firm/Entity: Nationality:

Membership in Professional Societies:

Detailed Tasks Assigned:

Key Qualifications:

[Give an outline of staff member's experience and training most pertinent to tasks on assignment. Describe degree of responsibility held by staff member on relevant previous assignments and give dates and locations. ]

Education:

[Summarize college/university and other specialized education of staff member and degrees obtained.]

Employment Record:

[Starting with present position, list in reverse order every employment held. List all positions held by staff member since graduation, giving dates, names of employing organizations, titles of positions held, and locations of assignments. Also give types of activities performed and client references, where appropriate.]

Period	Name of Employing Organization	Name of the Project	Title / Position	Activity performed	Location of the Assignment

Languages:

[For each language, indicate proficiency: excellent, good, fair, or poor; in speaking, reading, and writing]

Certification:

I, the undersigned, certify that to the best of my knowledge and belief, these data correctly describe me, my qualifications, and my experience.

Date:

[Signature of staff member and authorized representative of the Firm] Day/Month/Year

Full name of staff member: \_\_\_\_\_

Full name of the authorized representative: \_\_\_\_\_

**UNDERTAKING FROM SPECIALIST SUB-CONTRACTOR**  
**(Refer Clause of EQC)**  
**(On the Letterhead of specialist sub-contractor)**

I/We,.....(Legal Name of Specialist Subcontractor) hereby confirm that we are associating with .....(Legal name of the bidder) for the work of .....(Name of work as stated in Invitation for Bids {IFB}), for the key activity stated in clause 3.2 ( c) of ITT (if applicable).

I/We hereby undertake that in case M/s.....(Legal name of the bidder) are awarded the work of .....(Name of work as stated in Invitation for Bids {IFB}),the key activity stated in clause 3.2 ( c) of ITT shall be undertaken by us as per bid conditions (if applicable).

**STAMP & SIGNATURE OF AUTHORISED  
SIGNATORY OF SPECIALIST SUB CONTRACTOR**

**STAMP & SIGNATURE OF AUTHORISED  
SIGNATORY OF BIDDER**

K-RIDE

**Availability of Financial Resources**  
**(Section-2, ITT clause 3.3 (b))**

Bidders must demonstrate sufficient financial resources, comprising of Working Capital supplemented by credit line statements or overdraft facilities to meet the Bidder's financial requirements for

- a) its current contract commitments, and
- b) the subject contract.

In case of a Joint Venture, each Joint Venture Partner must fill out this form separately and provide the Joint Venture Partner's name:

Joint Venture Partner: \_\_\_\_\_

Financial Resources		
No.	Source of financing	Amount (equivalent)
1	Working Capital	
2	Credit Line	
Total Available Financial Resources		

<sup>a</sup>To be considered, Credit Line must be substantiated by a letter from the bank issuing the line of credit, specific for the subject contract, as prescribed. Any letter or document not complying with this requirement shall not be considered as supplementary financial resources.

**Note:**

In case the financial statement data is other than Indian Rupees, the equivalent Indian Rupees with the exchange rates as defined in the Section-2, ITT.

**Evidence of Availability of Credit Line Financial Resources**

**(Section-2 ITT, Clause:3(b))**

*[Each Bidder to fill out this form in case of demonstrating financial resources comprising credit line statements or overdraft facilities from bank.]*

**Project Name:**

Bidding Package Name and Identification Number: ..... (to be filled in as indicated in ITT 1) ...

**BANK CERTIFICATE**

This is to certify that M/s ..... is a reputed company with a good financial standing.

If the contract for the work, namely..... is awarded to the above firm, we shall be able to provide overdraft / credit facilities to the extent of Rs ..... to meet their working capital requirements for executing the above contract.

\_\_\_ Sd. \_\_\_

Name of Bank: \_\_\_\_\_

Senior Bank Manager \_\_\_\_\_

Address of the Bank \_\_\_\_\_



[In case of Joint Venture, change the text as follows:]

This is to certify that M/s ..... who has formed a Joint Venture with M/s ..... and M/s ..... for participating in this bid, is a reputed company with a good financial standing.

If the contract for the work, namely..... is awarded to the above joint venture, we shall be able to provide overdraft / credit facilities to the extent of Rs..... to M/s ..... to meet their working capital requirements for executing the above contract.

**WORK EXPERIENCE CERTIFICATE**

To whom so ever it may concern  
(Issued for the purpose of Quoting in K-RIDE tenders)

M/s/Sri ..... (Name and address of the contractor) is a working contractor of this unit and was awarded the following work. The relevant details of the work are as under: -

Sl.No	Description	Details
1	Name of work	
2	Acceptance Letter No and Date	
3	Agreement Number, date and name of the agency	
4	Agreement value in Rupees (in words and figures)	
5	Due date of completion	
6	Actual date of completion of work	
7	Value of Final Bill if passed (in words)	
8	Work completed but Final measurements not recorded. a) Amount paid so far as in CC bill No.	
9	Work completed. Final measurements recorded with negative variation a) Amount so far paid as in CC bill No.	
10	Work completed. If Final measurements recorded with Positive variation which is not sanctioned yet. Original agreement value of Last sanctioned agreement value whichever is lower.	
11	Scope of work (Broad category of works i.e., the name of the work in the agreement on which work is	
12	Details of values of major components/ works executed in the completed work.	

Section:3 : Qualification Information (Bidding Forms)

Note:

The Certificate to satisfy similar work should be signed by an officer not lower than JAG officer in Railways and Executive Engineer rank or equivalent grade in other department of Govt. of India/State Government/PSUs of Government of India / State Undertaking and Competent Authority of Public Listed Company.

Signature : .....

Name of officer.....

Designation: .....

Address: .....

Office seal: .....

Phone/FAX No.: .....

Date : .....

K-RIDE  
--00--00--00--

# SECTION-4

**FORM OF TENDER, LETTER OF ACCEPTANCE,  
NOTICE TO PROCEED WITH THE WORK AND  
AGREEMENT FORM ETC.,**



Section-4: Forms of Tender

**FORM OF TENDER, LETTER OF ACCEPTANCE, NOTICE TO PROCEED WITH THE WORK AND AGREEMENT FORM ETC.,**

SL. NO.	TITLE	FORM NUMBER	PAGE NO.
1	LETTER OF ACCEPTANCE	FORM-1	95
2	ISSUE OF NOTICE TO PROCEED WITH THE WORK	FORM-2	96
3	AGREEMENT FORM	FORM-3	97

K-RIDE

Section-4: Forms of Tender

**FORM OF TENDER (DELETED)**

Please refer Form PS-1 of Section 3: Qualification Information/Bidding Forms.

**FORM-1**

**LETTER OF ACCEPTANCE**

(Letter head paper of the Employer)

\_\_\_\_\_ [date]

To: \_\_\_\_\_ [name and address of the Contractor]

Dear Sirs,

This is to notify you that your Tender dated \_\_\_\_\_ for execution of the "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works" Tender No: **KRIDE/2023-24/EL/WORK\_INDENT7**, Dated: **15.09.2023** for the Contract Price of Rupees \_\_\_\_\_ [amount in words and figures], as corrected and modified in accordance with the Instructions to Tenderers is hereby accepted by our Agency.

You are hereby requested to furnish Security deposit (Performance Security) plus additional security for unbalanced tenders in accordance with of Clause 25.5 of ITT, in the form detailed in Clause 29.1 of ITT and clause 43 of the conditions of contract for an amount of Rs. \_\_\_\_\_ (As defined in contract data) within 20 days of the receipt of this letter of acceptance valid up to 30 days from the date of expiry of Defects Liability Period i.e., up to ..... and sign the contract.

Yours faithfully,

Authorized Signature

Name and Title of Signatory

Name of Agency.

**ISSUE OF NOTICE TO PROCEED WITH THE WORK**

(Letter head of the Employer)

To

\_\_\_\_\_ (Date)

\_\_\_\_\_ (name and address of the Contractor)

\_\_\_\_\_

\_\_\_\_\_

Dear Sirs:

With reference to LOA, for the construction of "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

A Tender Price of Rs. \_\_\_\_\_, you are hereby instructed to proceed with the execution of the said works in accordance with the contract documents.

Yours faithfully,

(Signature, name and title of signatory authorized to sign  
on behalf of Employer)

## AGREEMENT FORM

### Agreement

This agreement, made the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, between \_\_\_\_\_ (Name and Address of Employer) (herein after called "the Employer") of \_\_\_\_\_ the \_\_\_\_\_ one part and \_\_\_\_\_ [name and address of contractor] (herein after called "the Contractor") of the other part.

Whereas the Employer is desirous that the Contractor execute "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

Tender No. **KRIDE/2023-24/EL/WORK\_INDENT7**, dated: **15.09.2023** (herein after called "The Works") and the Employer has accepted the Tender by the Contractor for the execution and completion of such Works and the remedying of any defects therein at a contract price of Rupees.....

NOW THIS AGREEMENT WITNESSETH as follows:

1. In this Agreement, words and expression shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to, and they shall be deemed to form and be read and construed as part of this Agreement.
2. In consideration of the payments to be made by the Employer to the Contractor as hereinafter mentioned, the Contractor hereby covenants with the Employer to execute and complete the Works and remedy any defects therein in conformity in all aspects with the provisions of the Contract.
3. The Employer hereby covenants to pay the Contractor in consideration of the execution and completion of the Works and the remedying the defects wherein the Contract Price or such other sum as may become payable under the provisions of the Contract at the times and in the manner prescribed by the Contract.
4. The following documents shall be deemed to form and be read and construed as part of this Agreement, viz:
  - i) Letter of Acceptance;
  - ii) Notice to proceed with the works;
  - iii) Contractor's Tender;
  - iv) Contract Data;
  - v) Conditions of contract (including Special Conditions of Contract and Particular Condition of Contract)
  - vi) Specifications;
  - vii) Drawings;
  - viii) Bill of Quantities; and
  - ix) Any other document listed in the Contract Data as forming part of the contract.

Section-4: Forms of Tender

In witness whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

The Common Seal of \_\_\_\_\_

was hereunto affixed in the presence of:

Signed, Sealed and Delivered by the said \_\_\_\_\_

\_\_\_\_\_ in the presence of:

Binding Signature of Employer \_\_\_\_\_

Binding Signature of Contractor \_\_\_\_\_

K-RIDE

## SECTION – 5

### CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)

**CONDITIONS OF CONTRACT****TABLE OF CONTENTS**

<b>SI NO.</b>	<b>DESCRIPTION</b>	<b>PAGE NO</b>
	<b>A. GENERAL</b>	
1	DEFINITIONS	101
2	INTERPRETATION	102
3	LAW GOVERNING CONTRACT	102
4	EMPLOYERS DECISIONS	102
5	DELEGATION	103
6	COMMUNICATIONS	103
7	SUB-CONTRACTING	103
8	OTHER CONTRACTORS	103
9	PERSONNEL	103
10	EMPLOYER'S & CONTRACTOR'S RISKS	103
11	EMPLOYER'S RISKS	103
12	CONTRACTOR'S RISKS	104
13	INSURANCE	104
14	SITE INVESTIGATION REPORTS	104
15	QUERIES ABOUT THE CONTRACT DATA	105
16	CONTRACTOR TO CONSTRUCT THE WORKS	105
17	THE WORKS TO BE COMPLETED BY THE INTENDED COMPLETION	105
18	APPROVALS BY THE EMPLOYER	105
19	SAFETY	105
20	DISCOVERIES	105
21	POSSESSION OF THE SITE	105
22	ACCESS TO SITE	106
23	INSTRUCTIONS	106
24	PROCEDURE FOR RESOLUTION OF DISPUTES	106
	<b>B. TIME CONTROL</b>	
25	PROGRAM	107
26	EXTENSION OF THE INTENDED COMPLETION DATE	107
27	DELAYS ORDERED BY THE EMPLOYER	107
28	MANAGEMENT MEETINGS	107
	<b>C. QUALITY CONTROL</b>	
29	IDENTIFYING DEFECTS	108
30	TESTS	108
31	CORRECTION OF DEFECTS	108
32	UNCORRECTED DEFECTS	108
	<b>D. COST CONTROL</b>	
33	BILL OF QUANTITIES	109
34	VARIATIONS	109
35	PAYMENTS FOR VARIATIONS	109
36	SUBMISSION OF BILLS FOR PAYMENT	109
37	PAYMENTS	110

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

38	COMPENSATION EVENTS	110
39	TAX	110
40	PRICE ADJUSTMENT	111
41	LIQUIDATED DAMAGES	111
42	ADVANCE PAYMENTS	111
43	SECURITIES	111
44	COST OF REPAIRS	111
	<b>E. FINISHING THE CONTRACT</b>	
45	COMPLETION	112
46	TAKING OVER	112
47	FINAL ACCOUNT	112
48	AS BUILT DRAWINGS / OPERATING AND MAINTENANCE MANUALS	112
49	TERMINATION	112
50	PAYMENT UPON TERMINATION	113
51	PROPERTY	114
52	RELEASE FROM PERFORMANCE	114
	<b>F. SPECIAL CONDITIONS OF CONTRACT</b>	
53	LABOUR	115
54	COMPLIANCE WITH LABOUR REGULATIONS	115
55	PROTECTION OF ENVIRONMENT	115
56	CLAIMS, DISPUTES AND ARBITRATION	115



## CONDITIONS OF CONTRACT

### A. GENERAL

#### 1. DEFINITIONS

- 1.1 Terms which are defined in the Contract Data are not also defined in the Conditions of Contract but keep their defined meanings. Bold letters are used to identify defined terms.

**Bill of Quantities** means the priced and completed Bill of Quantities forming part of the Tender.

**Compensation Events** are those defined in Clause 38 hereunder.

The **Completion Date** is the date of completion of the Works as certified by the Employer in accordance with Sub Clause 46.1.

The **Contract** is the contract between the Employer and the Contractor to execute, complete and maintain the Works. It consists of the documents listed in Clause 2.2 below.

The **Contract Data** defines the documents and other information which comprise the Contract.

The **Contractor** is a person or corporate body or Joint Venture whose Tender to carry out the Works has been accepted by the Employer.

The **Contractor's Tender** is the completed Tender document submitted by the Contractor to the Employer.

The **Contract Price** is the price stated in the Letter of Acceptance and thereafter as adjusted in accordance with the provisions of the Contract.

**Days** are calendar days; **months** are calendar months.

A **Defect** is any part of the Works not completed in accordance with the Contract.

The **Defects liability period** is the period named in the Contract Data and calculated from the Completion Date.

The **Employer** is the party who will employ the Contractor to carry out the Works.

**Equipment** is the Contractor's machinery and vehicles brought temporarily to the Site to construct the Works.

The **Initial Contract price** is the Contract Price listed in the Employer's Letter of Acceptance.

The **Intended Completion Date** is the date on which it is intended that the Contractor shall complete the Works. The Intended Completion Date is specified in the Contract Data. The Intended Completion Date may be revised only by the Employer by issuing an extension of time.

'**Joint Venture**' means an ad hoc association of firms that pool their resources and skills to undertake a large or complex contract in the role of "Contractor," with all firms (partners in the JV) being legally liable, jointly and severally, for the execution of the Contract in the event of a partner's withdrawal.

## SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)

**Materials** are all supplies, including consumables, used by the contractor for incorporation in the Works.

**Plant** is any integral part of the Works which is to have a mechanical, electrical, electronic or chemical or biological function.

The **Site** is the area defined as such in the Contract Data.

**Specification** means the Specification of the Works included in the Contract and any modification or addition made or approved by the Employer.

The **Start Date** is given in the Contract Data. It is the date when the Contractor shall commence execution of the works. It does not necessarily coincide with any of the Site Possession Dates.

**A Subcontractor** is a person or corporate body who has a Contract with the Contractor to carry out a part of the work in the Contract which includes work on the Site.

A **Variation** is an instruction given by the Employer which varies the Works.

The **Works** are what the Contract requires the Contractor to construct, install, and turn over to the Employer, as defined in the Contract Data.

### **2. INTERPRETATION**

2.1 In interpreting these Conditions of Contract, singular also means plural, male also means female or neuter, and the other way around. Headings have no significance. Words have their normal meaning under the language of the Contract unless specifically defined. The Employer will provide instructions clarifying queries about the Conditions of Contract.

2.2 The documents forming the Contract shall be interpreted in the following order of priority:

- (1) Agreement
- (2) Letter of Acceptance, notice to proceed with the works
- (3) Contractor's Tender
- (4) Contract Data
- (5) Conditions of Contract
- (6) Specifications
- (7) Drawings
- (8) Bill of quantities and
- (9) any other document listed in the Contract Data as forming part of the Contract.

### **3. LAW GOVERNING CONTRACT**

3.1 The law governing the Contract is the Laws of India supplanted by the Karnataka Local Acts.

### **4. EMPLOYER'S DECISIONS**

4.1 Except where otherwise specifically stated, the Employer will decide contractual matters between the Employer and the Contractor.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

**5. DELEGATION**

5.1 The Employer may delegate any of his duties and responsibilities to other people after notifying the Contractor and may cancel any delegation after notifying the Contractor.

**6. COMMUNICATIONS**

6.1 Communications between parties which are referred to in the conditions are effective only when in writing. A notice shall be effective only when it is delivered (in terms of Indian Contract Act).

**7. SUBCONTRACTING:**

7.1 The Contractor may subcontract with the approval of the Employer but may not assign the Contract without the approval of the Employer in writing. Subcontracting does not alter the Contractor's obligations.

**8. OTHER CONTRACTORS**

8.1 The Contractor shall cooperate and share the Site with other contractors, public authorities, utilities, and the Employer.

**9. PERSONNEL**

9.1 The Contractor shall employ the technical personnel (of number and qualifications) as may be stipulated by K-RIDE from time to time during the execution of the work. The technical staff so employed shall be available at site as may be stipulated by the Employer.

9.2 If the Employer asks the Contractor to remove a person who is a member of the Contractor's staff or his work force stating the reasons, the Contractor shall ensure that the person leaves the Site within seven days and has no further connection with the work in the Contract.

**10. EMPLOYER'S AND CONTRACTOR'S RISKS**

10.1 The Employer carries the risks which this Contract states are Employer's risks, and the Contractor carries the risks which this Contract states are Contractor's risks.

**11. EMPLOYER'S RISKS**

11.1 The Employer is responsible for the excepted risks which are:

- (a) Rebellion, riot commotion or disorder unless solely restricted to employees of the Contractor or his Sub Contractors arising from the conduct of the Works; or
- (b) a cause due solely to the design of the Works, other than the Contractor's design; or
  - (i) could not have reasonably foreseen; or
  - (ii) could reasonably have foreseen, but against which he could not reasonably have taken at least one of the following measures;

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

- (A) prevent loss or damage to physical property from occurring by taking appropriate measures or
- (B) insure against such loss or damage

**12. CONTRACTOR'S RISKS**

- 12.1 All risks of loss of or damage to physical property and of personal injury and death which arise during and in consequence of the performance of the Contract other than the excepted risks are the responsibility of the Contractor.

**13. INSURANCE:**

- 13.1 The Contractor shall prior to commencing the works, effect and thereafter maintain insurances, in the joint names of the Employer and the Contractor, (cover from the first working day after the Start Date to the end of Defects Liability Period), in the amounts stated in the Contract Data:
- (a) for loss of or damage to the Works, Plants and Materials and the Contractor's equipment;
  - (b) for liability of both Parties for loss, damage, death and injury to third parties or their property arising out of the Contractor's performance of the Contract including the Contractor's liability for damage to the Employer's property other than the Works and
  - (c) for liability of both Parties and of any Employer's representative for death and injury to the Contractor's personnel except to the extent that liability arises from the negligence of the Employer, any Employer's representative or their Employees.
- 13.2 Policies and certificates for insurance shall be delivered by the Contractor to the Employer for his approval before the Start Date. All such insurance shall provide for compensation to be payable to rectify the loss or damage incurred. All payments received from insurers relating to loss or damage shall be held jointly by the Parties and used for the repair of the loss or damage or as compensation for loss or damage that is not to be repaired.
- 13.3 If the Contractor fails to effect or keep in force any of the insurances referred to in the previous sub-clauses or fails to provide satisfactory evidence, policies or receipts, the Employer may without prejudice to any other right or remedy, effect insurance for the cover relevant to such default and pay the premiums due and recover the same as a deduction from any other monies due to the Contractor. If no payments is due, the payment of the premiums shall be a debt due.
- 13.4 Alterations to the terms of an insurance shall not be made without the approval of the Employer.
- 13.5 Both Parties shall comply with any conditions of the insurance policies.

**14. SITE INVESTIGATION REPORTS:**

- 14.1 The Contractor, in preparing the tender, shall rely on any site investigation reports referred to in the Contract data, supplemented by any information available to the Tenderer.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

**15. QUERIES ABOUT THE CONTRACT DATA**

15.1 The Employer will clarify queries on the Contract Data.

**16. CONTRACTOR TO CONSTRUCT THE WORKS**

16.1 The Contractor shall construct the Works in accordance with the Specification and Drawings.

**17. THE WORKS TO BE COMPLETED BY THE INTENDED COMPLETION DATE**

17.1 The Contractor may commence execution of the Works on the Start Date and shall carry out the Works in accordance with the program submitted by the Contractor, as updated with the approval of the Employer, and complete them by the Intended Completion Date.

**18. APPROVAL BY THE EMPLOYER:**

18.1 The Contractor shall submit Specification and drawings showing the proposed Temporary Works to the Employer, who is to approve them if they comply with the Specifications and Drawings.

18.2 The Contractor shall be responsible for the design of Temporary Works

18.3 The Employer's approval shall not alter the Contractor's responsibility for design of the Temporary Works.

18.4 The Contractor shall obtain approval of third parties to design of the temporary Works where required.

18.5 All Drawings prepared by the Contractor for the execution of the temporary or permanent Works, are subject to prior approval by the Employer before their use.

**19. SAFETY**

19.1 The Contractor shall be responsible for the safety of all activities on the Site.

**20. DISCOVERIES**

20.1 Anything of historical or other interest or of significant value unexpectedly discovered on the Site is the property of the Employer. The Contractor is to notify the Employer of such discoveries and carry out the Employer's instructions for dealing with them.

**21. POSSESSION OF THE SITE**

21.1 The Employer shall give possession of all parts of the Site to the Contractor progressively, If possession of a part is not given by the date stated in the Contract Data the Employer is deemed to have delayed the start of the relevant activities and this will be compensation event.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

**22 ACCESS TO THE SITE**

22.1 The Contractor shall allow the Employer and any person authorized by the Employer access to the Site, to any place where work in connection with the Contract is being carried out or is intended to be carried out and to any place where materials or plant are being manufactured / fabricated / assembled for the works.

**23 INSTRUCTIONS**

23.1 The Contractor shall carry out all instructions of the Employer which comply with the applicable laws where the Site is located.

**24 PROCEDURE FOR RESOLUTION OF DISPUTES:**

24.1 If the Contractor is not satisfied with the decision taken by the Employer, the dispute shall be referred by either party to Arbitration within 30 days of the notification of the Employer's decision.

24.2 If neither party refers the dispute to Arbitration within the above 30 days, the Employer's decision will be final and binding.

24.3 The Arbitration shall be conducted in accordance with the arbitration procedure stated in the Special Conditions of Contract.

K-RIDE

**B. TIME CONTROL**

**25. PROGRAM**

- 25.1 Within the time stated in the Contract Data the Contractor shall submit to the Employer for approval a Program showing the general methods, arrangements, order, and timing for all the activities in the Works.
- 25.2 The Employer's approval of the Program shall not alter the Contractor's obligations. The Contractor may revise the Program and submit it to the Employer again at any time. A revised Program is to show the effect of Variations and Compensation Events.

**26. EXTENSION OF THE INTENDED COMPLETION DATE**

- 26.1 The Employer shall extend the Intended Completion Date if a Compensation Event occurs or a Variation is issued which makes it impossible for Completion to be achieved by the Intended Completion Date.
- 26.2 The Employer shall decide whether and by how much to extend the Intended Completion Date within 21 days of the Contractor asking the Employer for a decision upon the effect of a Compensation Event or Variation and submitting full supporting information.

**27. DELAYS ORDERED BY THE EMPLOYER**

- 27.1 The Employer may instruct the Contractor to delay the start or progress of any activity within the Works.

**28. MANAGEMENT MEETINGS**

- 28.1 The Employer may require the Contractor to attend a management meeting. The business of a management meeting shall be to review the progress achieved and the plans for remaining work.
- 28.2 The responsibility of the parties for actions to be taken is to be decided by the Employer either at the management meeting or after the management meeting and stated in writing to be distributed to all who attended the meeting.

**C. QUALITY CONTROL**

**29. IDENTIFYING DEFECTS**

29.1 The Employer shall check the Contractor's work and notify the Contractor of any Defects that are found. Such checking shall not affect the Contractor's responsibilities. The Employer may instruct the Contractor to search for a Defect and to uncover and test any work that the Employer considers may have a Defect.

**30. TESTS**

30.1 If the Employer instructs the Contractor to carry out a test not specified in the Specification to check whether any work has a Defect and the test shows that it does, the Contractor shall pay for the test and any samples. If there is no Defect the test shall be a Compensation Event.

**31. CORRECTION OF DEFECTS**

31.1 The Employer shall give notice to the Contractor of any Defects before the end of the Defects Liability Period, which begins at Completion and is defined in the Contract Data. The Defects Liability Period shall be extended for as long as Defects remain to be corrected.

31.2 Every time notice of a Defect is given, the Contractor shall correct the notified Defect within the length of time specified by the Employer's notice.

**32. UNCORRECTED DEFECTS**

32.1 If the Contractor has not corrected a Defect within the time specified in the Employer's notice, the Employer will assess the cost of having the Defect corrected, and the Contractor will pay this amount.



**D. COST CONTROL**

**33. BILL OF QUANTITIES (BOQ)**

- 33.1 The BOQ shall contain items for the construction, installation, testing, and commissioning work to be done by the Contractor.
- 33.2 The BOQ is used to calculate the Contract Price. The Contractor is paid for the quantity of the work done at the rate in the BOQ for each item.

**34. VARIATIONS**

- 34.1 The Employer shall have power to order the Contractor to do any or all of the following as considered necessary or advisable during the progress of the work by him
- (a) Increase or decrease of any item of work included in the Bill of Quantities (BOQ);
  - (b) Omit any item of work;
  - (c) Change the character or quality or kind of any item of work;
  - (d) Change the levels, lines, positions and dimensions of any part of the work;
  - (e) Execute additional items of work of any kind necessary for the completion of the works; and
  - (f) Change in any specified sequence, methods or timing of construction of any part of the work.
- 34.2 The Contractor shall be bound to carry out the work in accordance with any instructions in this connection, which may be given to him in writing by the Employer and such alteration shall not vitiate or invalidate the contract.
- 34.3 Variations shall not be made by the Contractor without an order in writing by the Employer, provided that no order in writing shall be required for increase or decrease in the quantity of an item appearing in the BOQ so long as the work executed conforms to the approved drawings.
- 34.4 The contractor shall not make any alteration and/ or modification of the works unless and until the Engineer instructs or gives consent to a variation.
- 34.5 If the construction and/ or manufacture documents or works are not in accordance with the contract, the rectification shall not constitute a variation.

**35. PAYMENTS FOR VARIATION**

- 35.1 For the details of payments for variation, please refer clause 35/CC of Section 7.

**36. SUBMISSION OF BILLS FOR PAYMENT**

- 36.1 The Contractor shall submit to the Employer monthly bills of the value of the work completed less the cumulative amount paid previously.
- 36.2 The Employer shall check the Contractor's bill and determine the value of the work executed which shall comprise of (i) value of the quantities of the items in the BOQ completed and (ii) valuation of Variations and Compensation Events.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

36.3 The Employer may exclude any item paid in a previous bill or reduce the proportion of any item previously paid in the light of later information.

**37. PAYMENTS**

37.1 Payments shall be adjusted for deductions for advance payments other than recoveries in terms of contract and taxes, at source as applicable under law. The Employer shall pay the Contractor within 60 days of submission of bill. The Contractor shall be liable to pay liquidated damages for shortfall in progress.

37.2 Items of the Works for which no rate or price has been entered in will not be paid for by the Employer and shall be deemed covered by other rates and prices in the Contract.

**38. COMPENSATION EVENTS:**

38.1 The following are Compensation Events unless they are caused by the Contractor:

- (a) The Employer instructs the Contractor to uncover or to carry out additional tests upon work which is then found to have no Defects.
- (b) The Employer gives an instruction for dealing with an unforeseen condition, caused by the Employer, or additional work required for safety or other reasons.
- (c) The effect on the Contractor of any of the Employer's Risks.
- (d) Other Compensation Events listed in the Contract Data or mentioned in the Contract.

38.2 If a Compensation Event would cause additional cost or would prevent the work being completed before the Intended Completion Date, the Contract Price shall be increased and/or the Intended Completion Date is extended. The Employer shall decide whether and by how much the Contract Price shall be increased and whether and by how much the Intended Completion Date shall be extended.

38.3 As soon as information demonstrating the effect of each Compensation event upon the Contractor's forecast cost has been provided by the Contractor, it is to be assessed by the Employer and the Contract Price shall be adjusted accordingly. If the Contractor's forecast is deemed unreasonable, the Employer shall adjust the Contract Price based on Employer's own forecast. The Employer will assume that the Contractor will react competently and promptly to the event.

38.4 The Contractor shall not be entitled to compensation to the extent that the Employer's interests are adversely affected by the Contractor not having given early warning or not having cooperated with the Employer.

**39. TAX**

39.1 The rates quoted by the Contractor shall be deemed to be inclusive of the sales, GST and other taxes that the Contractor will have to pay for the performance of this Contract. The Employer will perform such duties in regard to the deduction of such taxes at source as per applicable law.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

**40. PRICE ADJUSTMENT: - DELETED**

**41. LIQUIDATED DAMAGES**

- 41.1 The Contractor shall pay liquidated damages to the Employer at the rate per day stated in the Contract Data for each day that the Completion Date is later than the Intended Completion Date (for the whole of the works or the milestone as stated in the Contract Data). The total amount of liquidated damages shall not exceed the amount defined in the Contract Data. The Employer may deduct liquidated damages from payments due to the Contractor. Payment of liquidated damages does not affect the Contractor's liabilities.
- 41.2 If the Intended Completion Date is extended after liquidated damages have been paid, the Employer shall correct any overpayment of liquidated damages by the Contractor by adjusting the next payment of bill.

**42. ADVANCE PAYMENTS:**

- 42.1 The Employer shall make payment to the Contractor of the amounts stated in the Contract Data by the date stated in the Contract Data, against provision by the Contractor of an unconditional bank guarantee in a form acceptable to the Employer issued by a Nationalized/Scheduled Bank in amounts equal to the advance payment. The guarantee shall remain effective until the advance payment has been repaid, but the amount of the guarantee shall be progressively reduced by the amounts repaid by the Contractor. The advance payments shall be repaid with prevailing bank interest.
- 42.2 The Contractor is to use the advance payment only to pay for Mobilization expenses required specifically for execution of the Works. The Contractor shall demonstrate that advance payment has been used in this way by supplying copies of invoices or other documents to the Employer
- 42.3 The advance payment shall be repaid by deducting proportionate amounts from payments otherwise due to the Contractor, following the schedule of completed percentages of the Works on a payment basis. No account shall be taken of the advance payment or its repayment in assessing valuation of the work done, variations, price adjustments, compensation events or liquidated damages

**43. SECURITIES:**

- 43.1 The Performance Security (including additional security for unbalanced tenders) shall be provided to the Employer no later than the date specified in the Letter of Acceptance and shall be issued in an amount and form and type of instrument acceptable to the Employer. The Performance Security as indicated in the contract data shall be valid until a date 30 days from the date of expiry of Defects Liability Period and the additional security for unbalanced tenders shall be valid until a date 30 days from the date of issue of the certificate of completion.

**44. COST OF REPAIRS:**

- 44.1 Loss or damage to the Works or Materials to be incorporated in the Works between the Start Date and the end of the Defects Correction periods shall be remedied by the Contractor at the Contractor's cost if the loss or damage arises from the Contractor's acts or omissions.

**E. FINISHING THE CONTRACT**

**45. COMPLETION**

45.1 The Contractor shall request the Employer to issue a Certificate of Completion of the Works and the Employer will do so upon deciding that the Work is completed.

**46. TAKING OVER**

46.1 The Employer shall take over the Site and the Works within seven days of issuing a certificate of Completion.

**47. FINAL ACCOUNT**

47.1 The Contractor shall supply to the Employer a detailed account of the total amount that the Contractor considers payable under the Contract before the end of the Defects Liability Period. The Employer shall issue a Defect Liability Certificate and certify any final payment that is due to the Contractor within 90 days of receiving the Contractor's account if it is correct and complete. If it is not, the Employer shall issue within 90 days a schedule that states the scope of the corrections or additions that are necessary. If the Final Account is still unsatisfactory after it has been resubmitted, the Employer shall decide on the amount payable to the Contractor and make payment within 60 days of receiving the Contractor's revised account.

**48. AS BUILT DRAWINGS AND /OR OPERATING AND MAINTENANCE MANUALS**

48.1 If "As Built Drawings" (Completion Drawing) and/or operating and maintenance manuals are required, the Contractor shall supply them by the dates stated in the Contract Data.

48.2 If the Contractor does not supply the Drawings by the dates stated in the Contract Data, or they do not receive the Employer's approval, the Employer shall withhold the amount stated in the Contract Data from payments due to the Contractor.

**49. TERMINATION**

49.1 The Employer may terminate the Contract if the other party causes a fundamental breach of the Contract.

49.2 Fundamental breaches of Contract include, but shall not be limited to the following:

- (a) the Contractor stops work for 45 days when no stoppage of work is shown on the current Program and the stoppage has not been authorized by the Employer;
- (b) - "DELETED"-
- (c) The Contractor becomes bankrupt or goes into liquidation other than for a reconstruction or amalgamation;
- (d) - "DELETED"-

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

- (e) the Employer gives Notice that failure to correct a particular Defect is a fundamental breach of Contract and the Contractor fails to correct it within a reasonable period of time determined by the Employer;
- (f) the Contractor does not maintain a security which is required;
- (g) the Contractor has delayed the completion of works by the number of days for which the maximum amount of liquidated damages can be paid as defined in the Contract data; and
- (h) if the Contractor, in the judgment of the Employer has engaged in corrupt or fraudulent practices in competing for or in the executing the Contract.

For the purpose of this paragraph: “corrupt practice” means the offering, giving, receiving or soliciting of anything of value to influence the action of a public official in the procurement process or in contract execution. “Fraudulent practice” means a misrepresentation of facts in order to influence a procurement process or the execution of a contract to the detriment of the Borrower, and includes collusive practice among Tenderers (prior to or after Tender submission) designed to establish Tender prices at artificial non-competitive levels and to deprive the Borrower of the benefits of free and open competition.”

- 49.3 When either party to the Contract gives notice of a breach of contract to the Employer for a cause other than those listed under Sub Clause 49.2 above, the Employer shall decide whether the breach is fundamental or not.
- 49.4 Notwithstanding the above, the Employer may terminate the Contract for convenience.
- 49.5 If the Contract is terminated the Contractor shall stop work immediately, make the Site safe and secure and leave the Site as soon as reasonably possible.

**50. PAYMENT UPON TERMINATION**

- 50.1 If the Contract is terminated because of a fundamental breach of Contract by the Contractor, the Employer shall prepare bill for the value of the work done less advance payments received up to the date of the bill, less other recoveries due in terms of the contract, less taxes due to be deducted at source as per applicable law and less the percentage to apply to the work not completed as indicated in the Contract Data. Additional Liquidated Damages shall not apply. If the total amount due to the Employer exceeds any payment due to the Contractor, the difference shall be a debt payable to the Employer.
- 50.2 If the Contract is terminated at the Employer's convenience, the Employer shall prepare bill for the value of the work done, the reasonable cost of removal of Equipment, repatriation of the Contractor's personnel employed solely on the Works, and the Contractor's costs of protecting and securing the Works and less advance payments received up to the date of the certificate, less other recoveries due in terms of the contract, and less taxes due to be deducted at source as per applicable law and make payment accordingly.

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

**51. PROPERTY**

51.1 All materials on the Site, Plant, Equipment, Temporary Works and Works are deemed to be the property of the Employer, if the Contract is terminated because of a contractor's default.

**52. RELEASE FROM PERFORMANCE**

52.1 If the Contract is frustrated by any event entirely outside the control of either the Employer or the Contractor the Employer shall certify that the Contract has been frustrated. The Contractor shall make the Site safe and stop work as quickly as possible after receiving this certificate and shall be paid for all work carried out before receiving it and for any work carried out afterwards to which commitment was made.

K-RIDE

## **F. SPECIAL CONDITIONS OF CONTRACT**

### **1. LABOUR:**

The Contractor shall, unless otherwise provided in the Contract, make his own arrangements for the engagement of all staff and labour, local or other, and for their payment, housing, feeding and transport.

The Contractor shall, if required by the Employer, deliver to the Employer a return in detail, in such form and at such intervals as the Employer may prescribe, showing the staff and the numbers of the several classes of labour from time to time employed by the Contractor on the Site and such other information as the Employer may require.

### **2. COMPLIANCE WITH LABOUR REGULATIONS:**

During continuance of the Contract, the Contractor and his sub-contractors shall abide at all times by all existing labour enactments and rules made there under, regulations, notifications and bye laws of the State or Central Government or local authority and any other labour law (including rules), regulations, bye laws that may be passed or notification that may be issued under any labour law in future either by the State or the Central Government or the local authority. The Contractor shall keep the Employer indemnified in case any action is taken against the Employer by the competent authority on account of contravention of any of the provisions of any Act or rules made there under, regulations or notifications including amendments. If the Employer is caused to pay or reimburse, such amounts as may be necessary to cause or observe, or for non-observance of the provisions stipulated in the notifications/bye laws/Acts/Rules/regulations including amendments, if any, on the part of the Contractor, Employer shall have the right to deduct any money due to the Contractor including his amount of security deposit. The Employer shall also have right to recover from the Contractor any sum required or estimated to be required for making good the loss or damage suffered by the Employer.

The employees of the Contractor and the Sub-Contractor in no case shall be treated as the employees of the Employer at any point of time.

### **3. PROTECTION OF ENVIRONMENT:**

The Contractor shall take all reasonable steps to protect the environment on and off the Site and to avoid damage or nuisance to persons or to property of the public or others resulting from pollution, noise or other causes arising as a consequence of his methods of operation. During continuance of the contract, the Contractor and his sub-contractors shall abide at all times by all existing enactments on environmental protection and rules made there under, regulations, notifications and bye-laws of the State or Central Government, or local authorities and any other law, bye-law, regulations that may be passed or notification that may be issued in this respect in future by the State or Central Government or the local authority.

### **4. CLAIMS, DISPUTES AND ARBITRATION**

#### **4.1 Contractor's Claims**

If the Contractor considers himself to be entitled to any extension of the Time for Completion and/or any additional payment, under any Clause of these Conditions or otherwise in connection

## SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)

with the Contract, the Contractor shall give notice to the Engineer, describing the event or circumstance giving rise to the claim. The notice shall be given as soon as practicable, and not later than 28 days after the Contractor became aware, or should have become aware, of the event or circumstance.

If the Contractor fails to give notice of a claim within such period of 28 days, the Time for Completion shall not be extended, the Contractor shall not be entitled to additional payment, and the Employer shall be discharged from all liability in connection with the claim. Otherwise, the following provisions of this Sub-Clause shall apply.

The Contractor shall also submit any other notices which are required by the Contract, and supporting particulars for the claim, all as relevant to such event or circumstance.

The Contractor shall keep such contemporary records as may be necessary to substantiate any claim, either on the Site or at another location acceptable to the Engineer. Without admitting the Employer's liability, the Engineer may, after receiving any notice under this Sub-Clause, monitor the record-keeping and/or instruct the Contractor to keep and provide further contemporary records. The Contractor shall permit the Engineer to inspect all these records, and shall (if instructed) submit copies to the Engineer.

Within 45 days after the Contractor became aware (or should have become aware) of the event or circumstance giving rise to the claim, or within such other period as may be proposed by the Contractor and approved by the Engineer, the Contractor shall send to the Engineer a fully detailed claim which includes full supporting particulars of the basis of the claim and of the extension of time and/or additional payment claimed. If the event or circumstance giving rise to the claim has a continuing effect:

- (a) this fully detailed claim shall be considered as interim;
- (b) the Contractor shall send further interim claims at monthly intervals, giving the accumulated delay and/or amount claimed, and such further particulars as the Engineer may reasonably require; and
- (c) the Contractor shall send a final claim within 28 days after the end of the effects resulting from the event or circumstance, or within such other period as may be proposed by the Contractor and approved by the Engineer.

Within 45 days after receiving a claim or any further particulars supporting a previous claim, or within such other period as may be proposed by the Engineer and approved by the Contractor, the Engineer shall respond with approval, or with disapproval and detailed comments. He may also request any necessary further particulars, but shall nevertheless give his response on the principles of the claim within such fixed period of time.

Each Payment Certificate shall include such amounts for any claim as have been reasonably substantiated as due under the relevant provision of the Contract. Unless and until the particulars supplied are sufficient to substantiate the whole of the claim, the Contractor shall only be entitled to payment for such part of the claim as he has been able to substantiate.

The Engineer shall proceed in accordance with Sub-Clause: [Determinations] to agree or determine (i) the extension (if any) of the Time for Completion (before or after its expiry) in accordance with Sub-Clause: [Extension of Time for Completion], and/or (ii) the additional payment (if any) to which the Contractor is entitled under the Contract.

The requirements of this Sub-Clause are in addition to those of any other Sub-Clause which may apply to a claim. If the Contractor fails to comply with this or another Sub-Clause in relation



## SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)

to any claim, any extension of time and/or additional payment shall take account of the extent (if any) to which the failure has prevented or prejudiced proper investigation of the claim, unless the claim is excluded under the second paragraph of this Sub-Clause.

### **4.2 Amicable Settlement**

In case any dispute between the Engineer and the Contractor for which claim has already been made by the contractor, remains unresolved, the Contractor shall, then, give notice of dissatisfaction and intention to commence arbitration to the Employer duly specifying the subject of the dispute or difference as also the amount of claim item wise. The Parties shall make attempts to settle the dispute amicably before the commencement of arbitration as per procedure set by K-RIDE. However, unless both Parties agree otherwise, demand for arbitration may be made by the Contractor after ninety days from the day on which a notice of dissatisfaction and intention to commence arbitration was given, even if no attempt at amicable settlement has been made.

#### **Procedure for Amicable Settlement in contracts**

1. Amicable Settlement Committee at senior management level shall make an attempt to resolve the issues/disputes within 90 days of request by the Contractor.
2. The committee shall comprise of the following: -
  - (i) AGM /K-RIDE directly in-charge of the project;
  - (ii) Concerned finance officer, and
  - (iii) AGM /K-RIDE (in the same order) directly in-charge of the project of other discipline(s) in case the issues involve other discipline(s) of the engineering
3. Whenever the Contractor submits a request for amicable settlement, MD/K-RIDE should forward the same to concerned AGM /K-RIDE (in the same order) directly in-charge of the project. AGM /K-RIDE on receipt of the same shall issue a note to the concerned finance officer and concerned AGM/K-RIDE of other discipline in case the issues involved other discipline(s) of engineering, about the request for amicable settlement to be dealt by them and fix a date in consultation with them for a hearing. The date should then be communicated to the MD/K-RIDE, AGM/ /K-RIDE of other department (if the issues involved their department) and Contractor for presenting their case before the Amicable Settlement Committee.
4. This being an additional workload like arbitration, the Committee members shall be paid fee by K-RIDE at the rates payable to the Arbitrators of K-RIDE.

### **4.3 Arbitration**

Any dispute, in respect of which amicable settlement has not been reached, arising between the Employer and the Domestic or Foreign Contractor related to any matter arising out of or connected with this contract, then the contractor shall be entitled to demand in writing that the dispute or difference be referred to arbitration.

Only such dispute(s) or difference(s) in respect of which the demand had been made for amicable settlement under GCC 4.2 but could not be settled, shall be referred to arbitration subject to the condition that cumulative amount of claims in the Contract is not exceeding 20% of the Contract

## **SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

price. In case the cumulative amount of claims exceeds 20% of the Contract price, arbitration clause will not be applicable.

The Arbitration proceedings shall commence from the day, a written and duly quantified demand for arbitration is received by Managing Director, Rail Infrastructure Development Company (Karnataka) Limited, Bangalore /K-RIDE).

The disputes so referred to arbitration shall be settled in accordance with the Indian Arbitration & Conciliation Act, 1996 and any statutory modification or re-enactment thereof.

Any dispute or difference or claim arising out of, or in connection with, or relating to the present contract or the breach, termination or invalidity thereof shall be referred and settled under the Arbitration Centre – Karnataka (Domestic and International) Rules 2012, by one or more arbitrators appointed in accordance with its rules.

Further, it is agreed between the Parties as under.

### **4.3.1 Number of Arbitrators: The arbitral tribunal shall consist of three arbitrators.**

### **4.3.2 Procedure for Appointment of Arbitrators: The arbitrators shall be appointed as per following procedure:**

- (a) The Contractor, while invoking demand for arbitration, shall submit to MD/K-RIDE, claims duly quantified along with name and contact details of his nominee arbitrator. Thereafter, the Employer will nominate his nominee arbitrator within a period of 30 days from receipt of such demand from the Contractor and will issue letter of appointment to both the arbitrators appointed by the Parties with a copy of the same given to the Contractor.
- (b) The third Arbitrator shall be chosen by the two Arbitrators so appointed by the Parties and shall act as Presiding Arbitrator. In case of failure of the two Arbitrators appointed by the Parties to reach a consensus within a period of 30 days from the appointment of the said Arbitrators, then, upon the request of either or both Parties, the Presiding Arbitrator shall be appointed by the Managing Director, Rail Infrastructure Development Company (Karnataka) Limited, Bangalore.
- (c) If one or more of the arbitrators appointed as above refuses to act as arbitrator, withdraws from his office as arbitrator, or vacates his/their office/offices or is/are unable or unwilling to perform his functions as arbitrator for any reason whatsoever or dies or in the opinion of the concerned AGM/K-RIDE fails to act without undue delay, the MD/K-RIDE shall appoint new arbitrator/arbitrators to act in his/their place except in case of new Presiding Arbitrator who shall be chosen following the same procedure as mentioned in para (b) above. Such re-constituted Tribunal may, at its discretion, proceed with the reference from the stage at which it was left by the previous arbitrator(s).

### **4.3.3 Qualification and Experience of Arbitrators (to be appointed as per sub-clause 4.3.2 above):** The contract being of specialized nature requiring knowledge and experience of dealing with construction contracts, the arbitrators to be appointed shall have minimum qualification and experience as under:

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

Arbitrator shall be;

a working/retired officer (not below E-9 grade and above in a PSU with which K-RIDE has no business relationship) of any discipline of Engineering or Accounts/Finance department, having experience in Contract Management of construction contracts; or

a retired officer (retired not below the HAG level) of any Engineering/Accounts Services of Central Government, having experience in Contract Management of construction contracts; or a retired officer who should have retired more than 3 years previously from the date of appointment as Arbitrator (retired not below E-9 grade in K-RIDE or a PSU with which K-RIDE has a business relationship) of any Engineering discipline or Accounts department, having experience in Contract Management of construction contracts.

- 4.3.4** No person other than the persons appointed as per above procedure and having above qualification and experience shall act as Arbitrator. In case any person having the qualification and experience other than that mentioned above is nominated as arbitrator, the arbitration clause shall cease to exist and shall not be applicable.

No new claim, except as otherwise mutually agreed by the Parties, shall be added during proceedings by either Party. However, a Party may amend or supplement the original claim or defence thereof during the course of arbitration proceedings subject to acceptance by Tribunal having due regard to the delay in making it.

- 4.3.5** Neither Party shall be limited in the proceedings before such arbitrators to the evidence nor the arguments previously put before during amicable settlement.
- 4.3.6** The reference to arbitration may proceed, notwithstanding that the Works shall not then be or be alleged to be complete, provided always that the obligations of the Employer, the Engineer and the Contractor shall not be altered by the reason of the arbitration being conducted during the progress of the Works. Neither Party shall be entitled to suspend the Works, nor shall payment to the Contractor be withheld on account of such proceedings
- 4.3.7** If the contractor(s) does/do not prefer his/their specific and final claims in writing, within a period of 90 days of receiving the intimation from the Employer/Engineer that the final bill is ready for signature of the Contractor(s), he/they will be deemed to have waived his/their claim(s) and the Employer shall be discharged and released of all liabilities under the contract in respect of these claims.
- 4.3.8** Arbitration proceedings shall be held at Bangalore, India or at a place where AGM(Ele)/K-RIDE's (dealing the contract) office is located, and the language of the arbitration proceedings and that of all documents and communications between the Parties shall be in English.
- 4.3.9** The Arbitral Tribunal should record day to day proceedings. The proceedings shall normally be conducted on the basis of documents and written statements.

All arbitration awards shall be in writing and shall state item wise, the sum and detailed reasons upon which it is based.

## SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)

**4.3.10** Any ruling on award shall be made by a majority of members of Arbitral Tribunal. In the absence of such a majority, the views of the Presiding Arbitrator shall prevail.

A Party may apply for correction of any computational errors, any typographical or clerical errors or any other error of similar nature occurring in the award of a tribunal and interpretation of specific point of award to tribunal within 60 days of the receipt of award.

A Party may apply to Arbitral tribunal within 60 days of receipt of award to make an additional award as to claims presented in the arbitral proceedings but omitted from the arbitral award.

**4.3.11** Where the Arbitral award is for the payment of money, no interest shall be payable on whole or any part of the money for any period till the date on which the award is made.

**4.3.12** The fees and other charges of the conciliator/arbitrators shall be as per the fee structure fixed by the Employer as amended from time to time irrespective of the fact whether the Arbitrator(s) is/are appointed by the Parties or by the Court of law unless specifically directed by Hon'ble Court otherwise on the matter, and shall be shared equally by the Employer and the Contractor. However, the expenses incurred by each Party in connection with the preparation, presentation will be borne by itself.

**4.3.13** Performance under the contract shall continue during the arbitration proceedings and payments due the Contractor by the Employer shall not be withheld, unless they are the subject matter of the arbitration proceeding.

**4.3.14 Excepted matters:**

The following are the list of excepted matters in arbitration.

- a. Assistance by Employer for the Stores to be obtained by the Contractor.
- b. Illegal Gratification.
- c. Meaning and intent of specifications and Drawings.
- d. Rates for Non-tendered items of works.
- e. Signing of "No claim Certificate"
- f. Measurement of works.
- g. Provisions of Payment of Wages Act 1936.
- h. Provisions of Contract Labour (Regulation and Abolition) Act, 1970.
- i. Provisions of Employees Compensation Act 1923.
- j. Provisions of Mines Act 1952.
- k. Right of Employer to determine the Contract
- l. Payment on determination of Contract by Employer.

## **5. JURISDICTION OF COURTS**

The Contract Agreement shall be subject to exclusive jurisdiction of Courts as indicated in the Contract Data. **The Jurisdiction of Courts is Bengaluru, Karnataka**

**SECTION – 5: CONDITIONS OF CONTRACT(CC) AND SPECIAL CONDITIONS OF CONTRACT (SCC)**

6. If K-RIDE wishes to engage third party consultants for quality control assessment, apart from the K-RIDE quality control and field tests, the Contractor should co-operate with both Quality control authorities and the third party.
7. Defect liability period will be ONE Year from the date of satisfactory completion of work.
8. Royalty Charges shall be recovered as per the prevailing rates by the Department of Mines & Geology, if not paid by the Contractor.
9. As per GO No. CD/300/ LET/ 2006: Dated 18-12-2007, 1% cess will be deducted from the bill as per labour welfare act.
10. All the works are to be carried out as per the Standard specification Issued from time to time.

K-RIDE

# SECTION – 6 CONTRACT DATA

## **INDEX**

### **Table of Contents**

<b>SL NO.</b>	<b>DESCRIPTION</b>	<b>PAGE NO.</b>
1	MILE STONE DATES	125
2	INSURANCE REQUIREMENT	125
3	PRICE ADJUSTMENT	125

K-RIDE

## **SECTION 6: CONTRACT DATA**

**Items marked "N/A" do not apply in this Contract.**

The following documents are also part of the Contract:

**Clause Reference**

- The Methodology and Program of Construction (25 of GCC)
- Site Investigation Reports (14 of GCC)
- The Schedule of Key and Critical Equipment to be deployed on the work as per agreed program of construction. (3.3 of ITT, 25 GCC)

The Employer is:

Name: Rail Infrastructure Development Company (Karnataka) Limited (1.1 of GCC)  
Address: # 8, 1st Floor, Samparka Soudha, Dr. Rajkumar Road, Opposite Orion Mall,  
Rajajinagar 1st Block, Bengaluru-560010

Name of authorized Representative: K-RIDE

The name and identification number of the Contract: "BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

Tender No: **KRIDE/2023-24/EL/WORK\_INDENT7, Dated:15.09.2023**

### **Description of Work:**

The tendered work is part of the Track Doubling Work between Baiyyappanahalli – Hosur. It is proposed to Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works

The start date shall be the date of issue of notice to proceed with the work. [1.1 of GCC]

The Intended Completion Date for the whole of the Works is  
12 MONTHS INCLUDING MONSOON with the following milestones - [17, 26 of GCC]



**SECTION – 6: CONTRACT DATA**

**MILESTONE DATES:**

**Physical works to be completed as per Milestones**

Key Dates No. (Mile stone)	Description of stage (Physical works to be completed)	Timeline
KD 1	Joint inspections of site/locations along with KRIDE/ Railway officials	7 days from the date of issue of notice to proceed.
KD 2	Start of work	Within 7 days after site access.
KD-3	Completion of work	Before CRS commissioning or as advised by the employer.
KD 4	Testing and Commissioning of work	Before CRS commissioning or as advised by the employer.
KD 5	Arranging EIG inspection wherever required, obtaining EIG Approval.	Before CRS commissioning or as advised by the employer.

The work front/ Possession of site will be provided progressively.

The site is located in Bangalore and the alignment is from Baiyyappanahalli to Hosur.

**The Defect Liability period is One year.**

**The insurance requirement is as below.**

SI No.	Type of Cover	Minimum cover for Insurance <sup>36</sup>
(i)	Works and Plant and materials	Not Applicable
(ii)	Loss or damage to equipment	Full replacement cost
(iii)	Loss or damage to property of Third Party	Full replacement cost
(iv)	Personal injury or death insurance	In accordance with the statutory requirements applicable to Karnataka.
	(a) for Third Party	
	(b) for Contractor's employees or labour	In accordance with the statutory requirements applicable to Karnataka.

**PRICE ADJUSTMENT:**

**CHANGE IN COSTS - PRICE ADJUSTMENT**

**PRICE ADJUSTMENT CLAUSE FOR WORKS CONTRACTS -DELETED**

**The liquidated damages for the whole of the works are**

The liquidity damages for each Key dates/milestone have been indicated at Annexure-1 of Works/Employers requirement section for not achieving the Key Date/ Milestone for each Day. The maximum amount of liquidated damages for the whole of the works is Ten percent of final contract price: [GCC 41]

**SECTION – 6: CONTRACT DATA**

For the purpose of this clause, the contract value of the works shall be taken as value of work as per contract agreement including any supplementary work order/contract agreement issued. Provided also. that the total amount of liquidated damages under this condition shall not exceed 10% of the contract value or of the total value of the item or groups of items of work for which a separated distinct completion period is specified in the contract.

Sl. no	Damage & Delay	Rate of penalty
1	For delay in achieving physical/Financial target as per the agreed programme	0.01% of contract value for each week or part of the week.

Sl. no	Duration of extension of time under Clause 41 of GCC	Rate of Penalty
1	Up to Twenty percent of original period of completion including period of extension of DOC granted under Section 41 of GCC	As decided by Engineer, between 0.01% to 0.10% of contract value for each week or part of the week
2	Above Twenty percent but upto Thirty percent of original period of completion including period of extension of DOC granted under Section 41 of GCC	0.20% of contract value for each week or part of the week
3	Above Thirty percent but upto Forty percent of original period of completion including period of extension of DOC granted under Section 41 of GCC	0.30% of contract value for each week or part of the week
4	Above Forty percent of original period of completion including period of extension of DOC granted under Section 41 of GCC	0.50% of contract value for each week or part of the week

Provided further, that if the employer is not satisfied that the works can be completed by the Contractor and in the event of failure on the part of the contractor to complete the work within further extension of time allowed as aforesaid, the employer shall be entitled without prejudice to any other right or remedy available in that behalf.

The amounts of the advance payment are:

[GCC 42]

Nature of Advance	Amount Rs.	Conditions to be fulfilled
Mobilization	5% of the contract price (In Two Installments)	On submission of unconditional bank guarantee (further details are in Particular conditions of contract)

(The advance payment will be paid to the contractor no later than 30 days after fulfillment of the above condition.)

## **SECTION – 6: CONTRACT DATA**

### **Repayment of advance payment for mobilization:**

The recovery of the Mobilization and Plant and Machinery Advances shall be made from each bill in equal monthly instalments commencing after 15% of contract value is billed and recovery to be completed within 85% of the contract value and the recovery shall be made at the rate 10% of the amount the Interim payment certificate until such time as loan has been repaid, always provided that the loan shall be completely repaid prior to the expiry of the original time for completion pursuant to Clauses 17 and 26.

The date by which “as-erected” drawings (in suitable scale) in 5 sets are required is within 30 days of issue of certificate of completion of Whole or Section of the Work as the case may be. [GCC 48]

### **The amount to be withheld for failing to supply “as erected” drawings Rs. 25,000 for each location**

The following events shall also be fundamental breach of the contract: [GCC 49.2]

The contractor has contravened Sub-clause 7.1 and Clause 9 of Condition of contract.

The percentage to apply to the value of the work not completed representing the Employer's **30%** [GCC 50.1]

### **Jurisdiction of Courts:**

Jurisdiction of Courts is Bengaluru, Karnataka

K-RIDE

# SECTION-7

## PARTICULAR CONDITIONS OF CONTRACT (PCC)

INDEX

BLANK PAGE

K-RIDE

## PARTICULAR CONDITIONS OF CONTRACT (PCC)

The following Particular Conditions of Contract (PCC) shall supplement the Conditions of Contract (CC)/GCC/SCC/Contract Data. Whenever there is a conflict, the provisions herein shall prevail over those in the CC/GCC/SCC/Contract Data. The conditions indicated in PCC will be on priority as compared to the conditions of CC/GCC/SCC/Contract Data.

CC/SCC REFERENCE CLAUSE	DESCRIPTION
Clause-1/CC Definitions	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>“Contract Agreement”</b> The Parties shall enter into a Contract Agreement within 28 days after the Contractor receives the Letter of Acceptance, unless they agree otherwise.</p> <p><b>“Letter of Acceptance”</b> means the letter of formal acceptance, signed by the Employer, of the Letter of Bid, including any annexed memoranda comprising agreements between and signed by both Parties. If there is no such letter of acceptance, the expression “Letter of Acceptance” means the Contract Agreement and the date of issuing or receiving the Letter of Acceptance means the date of signing the Contract Agreement.</p> <p><b>“Letter of Bid”</b> means the document entitled letter of bid, which was completed by the Contractor and includes the signed offer to the Employer for the Works.</p> <p><b>“Drawings”</b> means the drawings of the Works, as included in the <b>Contract</b>, and any additional and modified drawings issued by (or on behalf of) the Employer in accordance with the Contract.</p> <p><b>“Schedules”</b> means the document(s) entitled schedules, completed by the Contractor and submitted with the Letter of Bid, as included in the Contract. Such document may include the Bill of Quantities, data, lists, and schedules of rates and/or prices.</p> <p><b>“Bid/Tender”</b> means the Letter of Technical Bid <b>and</b> Letter of Price Bid and all other documents which the Contractor submitted with the Letter of Technical Bid and Letter of Price Bid, as included in the Contract.</p> <p><b>“Employer’s Requirements”</b> means the document entitled ‘Employer’s Requirements’ as part of Works Requirements and as included in the Contract, and any additions and modifications to such document in accordance with the Contract. Such document specifies the purpose, scope, and/or design and/or other technical criteria, for the works.</p> <p><b>Parties and Persons</b></p> <p><b>“Party”</b> means the Employer or the Contractor, as the context requires.</p> <p><b>“Engineer”</b> means the person nominated by the Employer to act as the Engineer for the purposes of the Contract and named in the Contract Data, or other person appointed from time to time by the Employer and notified to the Contractor under New-Clause 3.4 [Replacement of the Engineer]. The person nominated to act as an engineer may be an employee of Rail Infrastructure Development Company (Karnataka) Ltd (K-RIDE) or an employee of a Project Management Consultancy firm engaged by K-RIDE for project management as per the discretion of the Employer.</p> <p><b>“Contractor’s Representative”</b> means the person named by the Contractor in the Contract or appointed from time to time by the Contractor under New-Clause 4.3 [Contractor’s Representative], who acts on behalf of the Contractor.</p>

**“Employer’s Representative”** means the person named by the Employer in the Contract or appointed from time to time by the Employer who acts on behalf of the Employer.

**“Employer’s Personnel”** means the Engineer, the assistants referred to in New-Clause 3.2 [Delegation by the Engineer] and all other staff, labour and other employees of the Engineer and of the Employer; and any other personnel notified to the Contractor, by the Employer or the Engineer, as Employer’s Personnel.

**“Contractor’s Personnel”** means the Contractor’s Representative and all personnel whom the Contractor utilises on Site, who may include the staff, labour and other employees of the Contractor and of each Subcontractor; and any other personnel assisting the Contractor in the execution of the Works.

**“Base Date”** means the date 28 days prior to the deadline for submission of bids.

**“Tests on Completion”** means the tests which are specified in the Contract or agreed by both Parties or instructed as a Variation, and which are carried out under Clause 30 [Tests on Completion] before the Works or a Section (as the case may be) are taken over by the Employer.

**“Day”** means any (working or non-working) calendar day from 00:00 hrs. to 24:00 hrs.

**“Time Periods”** Any reference to time period commencing “from” the specified day or date “till” or “until” a specified day shall include both such days.

Any reference to **“Time”** shall be according to Indian Standard Time (IST).

### **Money and Payments**

**“Accepted Contract Amount”** means the amount accepted in the Letter of Acceptance for the execution and completion of the Works and the remedying of any defects. In the Letter of Acceptance, the Accepted Contract Amount shall have two components i.e. (i) the base amount excluding GST (ii) GST component (calculated at the rate for works contract service as per GST Laws).

**“Cost”** means all expenditure reasonably incurred (or to be incurred) by the Contractor, whether on or off the Site, including overhead and similar charges, but does not include profit.

**“Final Statement”** means the statement defined in Sub-Clause 37.12 [Application for Final Payment Certificate].

**“Foreign Currency”** means a currency in which part (or all) of the Contract Price is payable, but not the Local Currency.

**“Local Currency”** means the currency in Indian Rupees.

**“Statement”** means a statement submitted by the Contractor as part of an application, under Clause 37 and 40 [Contract Price and Payment], for a payment certificate

### **Works and Goods**

**“Contractor’s Equipment”** means all apparatus, machinery, vehicles and other things required for the execution and completion of the Works and the remedying of any defects. However, Contractor’s Equipment excludes Temporary Works, Employer’s Equipment (if any), Plant, Materials and any other things intended to form or forming part of the Permanent Works.

**“Goods”** means Contractor’s Equipment, Materials, Plant and Temporary Works, or any of them as appropriate.

	<p><b>“Permanent Works”</b> means the BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works.</p> <p><b>“Section”</b> means a part of the Works specified in the Contract Data as a Section (if any).</p> <p><b>“Temporary Works”</b> means all temporary works of every kind (other than Contractor’s Equipment) required on Site for the execution and completion of the shifting and modification works in the existing system and the remedying of any defects.</p> <p><b>Other Definitions</b></p> <p><b>“Contractor’s Documents”</b> means the calculations, computer programs and other software, drawings, manuals, models and other documents of a technical nature (if any) supplied by the Contractor under the Contract.</p> <p><b>“Country”</b> means India, the country in which the Site (or most of it) is located, where the Permanent Works are to be executed.</p> <p><b>“Employer’s Equipment”</b> means the apparatus, machinery and vehicles (if any) made available by the Employer for the use of the Contractor in the execution of the Works, as stated in the Specification; but does not include Plant which has not been taken over by the Employer.</p> <p><b>“Laws”</b> means all national (or state) legislation, statutes, ordinances and other laws, and regulations and by-laws of any legally constituted public authority.</p> <p><b>“Site”</b> means the places where the Utility Shifting Works are to be executed and to which Plant and Materials are to be delivered, and any other places as may be specified in the Contract as forming part of the Site.</p> <p><b>“Unforeseeable”</b> means not reasonably foreseeable and against which adequate preventive precautions could not reasonably be taken by an experienced contractor by the date for submission of the Bid.</p> <p><b>“Railway”</b> means a railway, or any portion of a railway for public carriage of passengers and goods as defined in the Railways ACT 1989. Any reference to railway means the Indian Railways and the respective Zonal Railway</p>
<p><b>Clause-1/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>Employers Name and Address:</b>  K-RIDE (Rail Infrastructure Development Company (Karnataka) Limited)  (A Joint venture of GoK and MoR)  #8 , 1<sup>st</sup> Floor, Samparka Soudha,  Dr. Rajkumar Road, Opposite Orion Mall  Rajaji Nagar 1<sup>st</sup> Block  Bangalore – 560010  Tele: +91 9036572939</p> <p><b>Employers Representative and address:</b>  Addl. General Manager/Electrical K-RIDE,  K-RIDE (Rail Infrastructure Development Company (Karnataka) Limited)  #8, 1<sup>st</sup> Floor, Samparka Soudha,  Dr. Rajkumar Road, Opposite Orion Mall</p>



	<p>Rajaji Nagar 1<sup>st</sup> Block  Bangalore – 560010  Tele: +91 9036572939  E – Mail: <a href="mailto:electrical.kride@gmail.com">electrical.kride@gmail.com</a>, <a href="mailto:jgmelec@kride.in">jgmelec@kride.in</a></p>
<b>Clause -2.1/CC Interpretation.</b>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p>(a) provisions including the word “agree,” “agreed” or “agreement” require the agreement to be recorded in writing;</p> <p>(b) “written” or “in writing” means hand-written, type-written, printed or electronically made, and resulting in a permanent record; and</p> <p>(c) the word “tender” is synonymous with “bid”, and “tenderer” with “bidder” and the words “tender documents” with “bidding documents”</p>
<b>Clause-2.2/CC. Priority of Documents</b>	<p><b>Replace the existing sub clause 2.2 of CC</b></p> <p>The documents forming the Contract are to be taken as mutually explanatory of one another. For the purposes of interpretation, the priority of the documents shall be in accordance with the following sequence:</p> <ol style="list-style-type: none"> <li>1. Contract Agreement (if any),</li> <li>2. Letter of Acceptance, notice to proceed to works,</li> <li>3. Letter of bid/Contractor tender,</li> <li>4. Addendum/Corrigendum including Reply to pre bid queries,</li> <li>5. Schedules (including Priced Bill of Quantities),</li> <li>6. Particular Conditions of Contract,</li> <li>7. Conditions of Contract/SCC and Contract Data</li> <li>8. Works/Employer’s Requirements,</li> <li>9. Technical Specifications,</li> <li>10. Drawings,</li> <li>11. any other documents forming part of the Contract.</li> </ol> <p>If an ambiguity or discrepancy is found in the documents, the Engineer shall issue necessary clarification or instruction.</p>
<b>Clause-6.1/CC, Communications</b>	<p><b>The following para is added to the existing CC clause:</b></p> <p>Wherever these Conditions provide for the giving or issuing of approvals, certificates, consents, determinations, notices, requests and discharges, these communications shall be: in writing and delivered by hand (against receipt), sent by mail or courier, or transmitted using any of the agreed systems of electronic transmission as stated in the Contract Data; and delivered, sent or transmitted to the address for the recipient’s communications as stated in the Contract Data.</p>
<b>Clause- 7/CC</b>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>7.1 Definition of nominated Subcontractor</b></p> <p>In the Contract, “nominated Subcontractor” means a Subcontractor:</p> <p>(a) who is stated in the Contract as being a nominated Subcontractor, or</p>

- (b) whom the Engineer, under Clause 7/CC [Sub-contracting], instructs the Contractor to employ as a Subcontractor.

### **Sub-contractors**

The Contractor shall not subcontract the whole of the Works. The Contractor shall be responsible for the acts or defaults of any Subcontractor, his agents or employees, as if they were the acts or defaults of the Contractor.

Unless otherwise stated in the Conditions of Contract:

- (a) The Contractor shall not be required to obtain consent to suppliers solely of Materials, or to a subcontract for which the Subcontractor is named in the Contract or as specifically provided in the Contract data or value of any sub-contract for Works, provided that such works are not for the key activities.
- (b) The prior consent of the Engineer shall be obtained to other proposed Subcontractors and/or suppliers. While submitting his proposal in this regard, the Contractor shall ensure that;
- (i) Total value of Works requiring such consent for subcontracting shall not be more than 50% (fifty per cent) of the Contract Price;
  - (ii) The proposed subcontractor must have executed works of 40% of value of the proposed subcontract through a single contract during last seven years; and
  - (iii) No banning/blacklisting/declaration as poor performer by K-RIDE is in force on the proposed subcontractor (on the date of grant of consent by the Engineer);
  - (iv) No contract of the proposed subcontractor has been terminated by K-RIDE during the last two years (to be reckoned from the date of grant of consent by the Engineer);
  - (v) The Contractor shall submit the proposal for subcontracting with the name, particulars and the relevant experience of the proposed subcontractor.
- (c) The Contractor shall give the Engineer not less than 28 days' notice of the intended date of the commencement of each Subcontractor's work, and of the commencement of such work on the Site;
- (d) Each subcontract shall include provisions which would entitle the Employer to require the subcontract to be assigned to the Employer under New-Clause 4.23/PCC [Assignment of Benefit of Subcontract] (if or when applicable) or in the event of termination under Sub-Clause 49.7/PCC. [Termination by Employer]; and
- (e) On getting consent from the Engineer, the Contractor shall provide to the Engineer copy of the agreement entered with such subcontractor.

The Contractor shall ensure that the requirements imposed on the Contractor by New-Clause 1.6/PCC [Confidential Details] apply equally to each Subcontractor.

Where practicable, the Contractor shall give fair and reasonable opportunity for contractors from the Country to be appointed as Subcontractors.

The Contractor shall endeavor to resolve all matters and payments amicably and speedily with the sub-contractors.

The Contractor shall indemnify and hold the Employer harmless against and from any claim of subcontractors or suppliers of the materials.

The Contractor shall release payment to the Sub-contractors/Suppliers promptly and shall endeavor to resolve all issues amicably and speedily with the Sub-contractors/Suppliers, so that the execution of work is not affected in any manner whatsoever.

In case a Sub-contractor/Supplier represents to the Engineer in writing with supporting documents, stating that he has not received payment due as per the agreement/work or purchase order for the works executed by such Sub-contractor or supplies made by such Supplier, which have been covered in previous Payment Certificates and the Engineer finds such representation having merit, the Engineer, before issuing next Payment Certificate, may forward a copy of the representation to the Contractor requesting the Contractor to supply reasonable evidence that the amount stated to be outstanding by the Sub-contractor/Supplier for the works executed or supplies made, which have been covered in previous Payment Certificates has been paid and if not, why the same is not payable. The Engineer may recommend to make payment to the Sub-contractor/Supplier unless the Contractor submits reasonable evidence to the Engineer:

- (i) that the amount claimed has been paid, or
- (ii) satisfying the Engineer in writing that the Contractor is entitled to withhold or that the amount is not payable.

On the recommendation of the Engineer, the Employer may (at his sole discretion) directly pay to the Sub-contractor/Supplier the amount due for and on behalf of the Contractor, part or all of such amounts previously certified (less applicable deductions) as are found due to the Sub-contractor/Supplier by the Engineer. The Employer shall adjust the amount paid directly to the Sub-contractor/Supplier from any amount due by it to the Contractor. The Contractor shall repay the amount, in case no amount is found due by the Employer to the Contractor.

That the payment by Employer, on behalf of the Contractor to its Sub-contractor/Supplier, shall not alter any terms of agreement between the Employer and the Contractor and nor the same shall result in any privity of contract between the Employer and the Sub-contractor/Supplier.

Assignment of Contractor's and Sub-contractor's Obligations:

The Contractor shall not assign a right or benefit under the Contract without first obtaining Employer's prior written consent, otherwise than by:

- A. a charge in favor of the Contractor's bankers of any money due or to become due under the Contract, or
- B. assignment to the Contractor's insurers (in cases where the insurers have discharged the Contractor's loss or liability) of the Contractor's right to obtain relief against any other party liable.

If a Subcontractor's obligations extend beyond the expiry date of Defects Liability Period, then the Contractor shall assign the benefits of such obligations to the Employer.

In the event that a sub-contractor of any tier provides to the Contractor or any other sub-contractor a warranty in respect of Plant, Materials or services supplied in connection with the Works, or undertakes a continuing obligation of any nature whatsoever in relation to such Plant, Materials or services (including without limitation an obligation to maintain stocks of spare parts) extending for a period exceeding that of the Defects Liability Period or where there is more than one Defects Liability Period exceeding that of the latest Defects Liability Period, and if the Engineer so directs in writing within 21 days of the expiry of the Defects Liability Period or the

latest Defects Liability Period (as the case may be), the Contractor shall immediately assign or obtain the assignment of the benefit of such warranty or obligation to the Employer or at the direction of the Employer, to any third party.

#### **Specialist Subcontracting**

If an Applicant intends to subcontract any highly specialized elements of the Works to specialist subcontractors, such elements and the proposed subcontractors shall be clearly identified, and the experience and capacity of the subcontractors shall be described in the relevant Information Forms.

#### **Acceptable Substitutes**

With reference to subcontracting & specialist subcontracting, the Employer may require Applicants to provide more information about their proposals. If any proposed subcontractor is found ineligible or unsuitable to carry out an assigned task, the Employer may request the Applicant to propose an acceptable substitute, and may conditionally pre-qualify the Applicant accordingly, before issuing an invitation to tender.

### **7.2 Objection to Nomination**

The Contractor shall not be under any obligation to employ a nominated Subcontractor against whom the Contractor raises reasonable objection by notice to the Engineer as soon as practicable, with supporting particulars. An objection shall be deemed reasonable if it arises from (among other things) any of the following matters, unless the Employer agrees to indemnify the Contractor against and from the consequences of the matter:

- (a) there are reasons to believe that the Subcontractor does not have sufficient competence, resources or financial strength;
- (b) the subcontract does not specify that the nominated Subcontractor shall indemnify the Contractor against and from any negligence or misuse of Goods by the nominated Subcontractor, his agents and employees; or
- (c) the subcontract does not specify that, for the subcontracted work (including design, if any), the nominated Subcontractor shall:
  - (i) undertake to the Contractor such obligations and liabilities as will enable the Contractor to discharge his obligations and liabilities under the Contract, and
  - (ii) Indemnify the Contractor against and from all obligations and liabilities arising under or in connection with the Contract and from the consequences of any failure by the Subcontractor to perform these obligations or to fulfil these liabilities.

### **7.3 Payments to nominated Subcontractors**

The Contractor shall pay to the nominated Subcontractor the amounts which the Engineer certifies to be due in accordance with the subcontract. These amounts plus other charges shall be included in the Contract Price in accordance with sub-paragraph (b) of Sub-Clause 34.5/PCC [Provisional Sums], except as stated in Sub-Clause 7.4/PCC [Evidence of Payments].

### **7.4 Evidence of Payments**

Before issuing a Payment, Certificate which includes an amount payable to a nominated Subcontractor, the Engineer may request the Contractor to supply reasonable evidence that the nominated Subcontractor has received (Within 7 days of receipt of previous payment by

	<p>the contractor) all amounts due in accordance with previous Payment Certificates, less applicable deductions for retention or otherwise. Unless the Contractor, submits this reasonable evidence to the Engineer, or</p> <ul style="list-style-type: none"> <li>(i) satisfies the Engineer in writing that the Contractor is reasonably entitled to withhold or refuse to pay these amounts, and</li> <li>(ii) submits to the Engineer reasonable evidence that the nominated Subcontractor has been notified of the Contractor's entitlement,</li> </ul> <p>then the Employer may (at his sole discretion) pay, direct to the nominated Subcontractor, part or all of such amounts previously certified (less applicable deductions) as are due to the nominated Subcontractor and for which the Contractor has failed to submit the evidence described in sub-paragraphs (a) or (b) above. The Contractor shall then repay, to the Employer, the amount which the nominated Subcontractor was directly paid by the Employer.</p> <p><b>7.5 Assignment of Benefit of Subcontract</b></p> <p>If a Subcontractor's obligations extend beyond the expiry date of the relevant Defects Notification Period and the Engineer, prior to this date, instructs the Contractor to assign the benefit of such obligations to the Employer, then the Contractor shall do so. Unless otherwise stated in the assignment, the Contractor shall have no liability to the Employer for the work carried out by the Subcontractor after the assignment takes effect.</p>
<p><b>Clause11/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>Risk and Responsibility</b></p> <p><b>11.1 Indemnities</b></p> <p>The Contractor shall indemnify and hold harmless the Employer, the Employer's Personnel, Employers Representative and their respective agents, against and from all claims, damages, losses and expenses (including legal fees and expenses) in respect of:</p> <ul style="list-style-type: none"> <li>(a) bodily injury, sickness, disease or death, of any person including railway user whatsoever arising out of or in the course of or by reason of the Contractor's design (if any), the execution and completion of the Works and the remedying of any defects, unless attributable to any negligence, wilful act or breach of the Contract by the Employer, the Employer's Personnel, or any of their respective agents, and</li> <li>(b) damage to or loss of any property, real or personal (other than the Works), to the extent that such damage or loss arises out of or in the course of or by reason of the Contractor's design (if any), the execution and completion of the Works and the remedying of any defects, unless and to the extent that any such damage or loss is attributable to any negligence, wilful act or breach of the Contract by the Employer, the Employer's Personnel,, their respective agents, or anyone directly or indirectly employed by any of them.</li> </ul> <p>The Employer shall indemnify and hold harmless the Contractor, the Contractor's Personnel, and their respective agents, against and from all claims, damages, losses and expenses (including legal fees and expenses) in respect of (1) bodily injury, sickness, disease or death, which is attributable to any negligence, wilful act or breach of the Contract by the Employer, the Employer's Personnel, or any of their respective agents, and (2) the matters for which liability may be excluded from insurance cover, as described in sub-paragraphs (d)(i), (ii) and (iii) of Sub-Clause 13.8/PCC [Insurance Against Injury to Persons and Damage to Property].</p>

### 11.2 Contractor's Care of the Works

The Contractor shall take full responsibility for the care of the Works and Goods from the Commencement Date until the Taking-Over Certificate is issued (or is deemed to be issued under Sub-Clause 46.1/PCC [Taking Over of the Works and Sections]) for the Works, when responsibility for the care of the Works shall pass to the Employer. If a Taking-Over Certificate is issued (or is so deemed to be issued) for any Section or part of the Works, responsibility for the care of the Section or part shall then pass to the Employer.

After responsibility has accordingly passed to the Employer, the Contractor shall take responsibility for the care of any work which is outstanding on the date stated in a Taking-Over Certificate, until this outstanding work has been completed.

If any loss or damage happens to the Works, Goods or Contractor's Documents during the period when the Contractor is responsible for their care, from any cause not listed in Sub-Clause 11.3/PCC [Employer's Risks], the Contractor shall rectify the loss or damage at the Contractor's risk and cost, so that the Works, Goods and Contractor's Documents conform with the Contract.

The Contractor shall be liable for any loss or damage caused by any actions performed by the Contractor after a Taking-Over Certificate has been issued. The Contractor shall also be liable for any loss or damage which occurs after a Taking-Over Certificate has been issued and which arose from a previous event for which the Contractor was liable.

### 11.3 Employer's Risks

**Clause 11 of CC and clause 38 of CC are substituted with clause 11.3 of PCC as below:**

The risks referred to herein below, in so far as they directly affect the execution of the works in the Country, are:

- (a) war, hostilities (whether war be declared or not), invasion, act of foreign enemies,
- (b) rebellion, terrorism, sabotage by persons other than the Contractor's Personnel, revolution, insurrection, military or usurped power, or civil war, within the Country,
- (c) riot, commotion or disorder within the Country by persons other than the Contractor's Personnel,
- (d) munitions of war, explosive materials, ionising radiation or contamination by radio-activity, within the Country, except as may be attributable to the Contractor's use of such munitions, explosives, radiation or radio-activity,
- (e) pressure waves caused by aircraft or other aerial devices travelling at sonic or supersonic speeds,
- (f) use or occupation by the Employer of any part of the utility shifting/modification Works, except as may be specified in the Contract, and
- (g) design of any part of the Works by the Employer's Personnel or by others for whom the Employer is responsible.

### 11.4 Consequences of Employer's Risks:

If and to the extent that any of the risks listed in Sub-Clause 11.3/PCC above results in loss or damage to the Works, Goods or Contractor's Documents, the Contractor shall promptly give notice to the Engineer and shall rectify this loss or damage to the extent required by the Engineer.

If the Contractor suffers delay and/or incurs Cost from rectifying this loss or damage, the Contractor shall give a further notice to the Engineer and shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:

- (a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause [Extension of Time for Completion], and
- (b) In the case of sub-paragraphs (f) and (g) of Sub-Clause 11.3/PCC [Employer's Risks], Cost shall be payable.

After receiving this further notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these matters.

### **11.5 Intellectual and Industrial Property Rights**

In this Sub-Clause, "infringement" means an infringement (or alleged infringement) of any patent, registered design, copyright, trade mark, trade name, trade secret or other intellectual or industrial property right relating to the Works; and "claim" means a claim (or proceedings pursuing a claim) alleging an infringement.

Whenever a Party does not give notice to the other Party of any claim within 28 days of receiving the claim, the first Party shall be deemed to have waived any right to indemnity under this Sub-Clause.

The Employer shall indemnify and hold the Contractor harmless against and from any claim alleging an infringement which is or was:

- (a) an unavoidable result of the Contractor's compliance with the Contract, or
- (b) a result of any Works being used by the Employer:
  - (i) for a purpose other than that indicated by, or reasonably to be inferred from, the Contract, or
  - (ii) in conjunction with anything not supplied by the Contractor, unless such use was disclosed to the Contractor prior to the Base Date or is stated in the Contract.

The Contractor shall indemnify and hold the Employer harmless against and from any other claim which arises out of or in relation to (i) the manufacture, use, sale or import of any Goods, or (ii) any design for which the Contractor is responsible.

If a Party is entitled to be indemnified under this Sub-Clause, the indemnifying Party may (at its cost) conduct negotiations for the settlement of the claim, and any litigation or arbitration which may arise from it. The other Party shall, at the request and cost of the indemnifying Party, assist in contesting the claim. This other Party (and its Personnel) shall not make any admission which might be prejudicial to the indemnifying Party, unless the indemnifying Party failed to take over the conduct of any negotiations, litigation or arbitration upon being requested to do so by such other Party.

	<p><b>11.6 Limitation of Liability</b></p> <p>Neither Party shall be liable to the other Party for loss of use of any Works, loss of profit, loss of any contract or for any indirect or consequential loss or damage which may be suffered by the other Party in connection with the Contract, provided that this exclusion shall not apply to any obligation of the Contractor to pay Delay Damages to the Employer under Sub-Clause 26.6/PCC [Delay Damages].</p> <p>The total liability of the Contractor to the Employer, under or in connection with the Contract other than under New-Clause 4.37/PCC [Electricity, Water and Gas], New Clause 4.38/PCC [Employer's Equipment and Free-Issue Material], Sub-Clause 11.1/PCC [Indemnities] and Sub-Clause 11.5/PCC [Intellectual and Industrial Property Rights], shall not exceed the sum as specified in the Contract Data or if nothing is specified in the Contract Data, the accepted Contract Amount.</p> <p>This Sub-Clause shall not limit liability in any case of fraud, deliberate default or reckless misconduct by the defaulting Party.</p> <p>Maximum total liability of Contractor is accepted contract amount.</p> <p><b>11.7 Use of Employer's Accommodation/ Facilities</b></p> <p>The Contractor shall take full responsibility for the care of the Employer provided accommodation and facilities, if any, as detailed in the Specification, from the respective dates of hand-over to the Contractor until cessation of occupation (where hand-over or cessation of occupation may take place after the date stated in the Taking-Over Certificate for the Works).</p> <p>If any loss or damage happens to any of the above items while the Contractor is responsible for their care arising from any cause whatsoever other than those for which the Employer is liable, the Contractor shall, at his own cost, rectify the loss or damage to the satisfaction of the Engineer.</p>
<p><b>Clause 13/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>INSURANCE</b></p> <p><b>13.6 General Requirements for Insurances</b></p> <p>In this Clause, "insuring Party" means, for each type of insurance, the Party responsible for effecting and maintaining the insurance specified in the relevant Sub-Clause.</p> <p>Wherever the Contractor is the insuring Party, each insurance shall be effected with insurers and in terms approved by the Employer. These terms shall be consistent with any terms agreed by both Parties before the date of the Letter of Acceptance. This agreement of terms shall take precedence over the provisions of this Clause.</p> <p>If a policy is required to indemnify joint insured, the cover shall apply separately to each insured as though a separate policy had been issued for each of the joint insured. If a policy indemnifies additional joint insured, namely in addition to the insured specified in this Clause, (i) the Contractor shall act under the policy on behalf of these additional joint insured except that the Employer shall act for Employer's Personnel, (ii) additional joint insured shall not be entitled to receive payments directly from the insurer or to have any</p>



other direct dealings with the insurer, and (iii) the insuring Party shall require all additional joint insured to comply with the conditions stipulated in the policy.

**Periods for submission of insurance:**

- a) evidence of insurance: Before start date of work.
- b) relevant policies: Before start date of work.

Each policy insuring against loss or damage shall provide for payments to be made in the currencies required to rectify the loss or damage. Payments received from insurers shall be used for the rectification of the loss or damage.

The relevant insuring Party shall, within the respective periods stated in the Contract Data (calculated from the Commencement Date), submit to the other Party:

- (a) evidence that the insurances described in this Clause have been effected, and
- (b) copies of the policies for the insurances described in Sub-Clause 13.7/PCC [Insurance for Works and Contractor's Equipment] and Sub-Clause 13.8/PCC [Insurance against Injury to Persons and Damage to Property].
- (c) If the contractor fails to submit evidence and copies of the policies as mentioned in (a) & (b) above to prove that the policies have been obtained within the period specified in the contract data, and submits the same later on and from the submitted evidence it is found that the policies have not been obtained within the period specified, the Employer shall recover double the cost of the premium for the period the policies have been delayed.

When each premium is paid, the insuring Party shall submit evidence of payment to the other Party. Whenever evidence or policies are submitted, the insuring Party shall also give notice to the Engineer.

Each Party shall comply with the conditions stipulated in each of the insurance policies. The insuring Party shall keep the insurers informed of any relevant changes to the execution of the Works and ensure that insurance is maintained in accordance with this Clause.

Neither Party shall make any material alteration to the terms of any insurance without the prior approval of the other Party. If an insurer makes (or attempts to make) any alteration, the Party first notified by the insurer shall promptly give notice to the other Party.

If the insuring Party fails to effect and keep in force any of the insurances it is required to effect and maintain under the Contract, or fails to provide satisfactory evidence and copies of policies in accordance with this Sub-Clause, the other Party may (at its option and without prejudice to any other right or remedy) effect insurance for the relevant coverage and pay the premiums due. The insuring Party shall pay double the amount of these premiums to the other Party, and the Contract Price shall be adjusted accordingly.

Nothing in this Clause limits the obligations, liabilities or responsibilities of the Contractor or the Employer, under the other terms of the Contract or otherwise. Any amounts not insured or not recovered from the insurers shall be borne by the Contractor and/or the Employer in accordance with these obligations, liabilities or responsibilities. However, if the insuring Party fails to effect and keep in force an insurance which is available and which it is required to effect and maintain under the Contract, and the other Party neither approves

the omission nor effects insurance for the coverage relevant to this default, any moneys which should have been recoverable under this insurance shall be paid by the insuring Party.

Payments by one Party to the other Party shall be subject to New-Clause 2.4/PCC [Employer's Claims] or Sub-Clause 4.1/SCC [Contractor's Claims], as applicable.

The Contractor shall be entitled to place all insurance relating to the Contract (including, but not limited to the insurance referred to Clause 13/CC/PCC with insurers from any eligible source country.

### **13.7 Insurance for Works and Contractor's Equipment**

The Contractor shall insure the Works, Plant, Materials, including those issued by the Employer and Contractor's Documents for not less than the full reinstatement cost including the costs of demolition, removal of debris and professional fees and profit, subject to a maximum value indicated in Contract Data. This insurance shall be effective from the date by which the evidence is to be submitted under sub-paragraph (a) of Sub-Clause 13.6/PCC [General Requirements for Insurances], until the date of issue of the Taking-Over Certificate for the Works.

The insuring Party shall maintain this insurance to provide cover until the date of issue of the Performance Certificate, for loss or damage for which the Contractor is liable arising from a cause occurring prior to the issue of the Taking-Over Certificate, and for loss or damage caused by the Contractor in the course of any other operations (including those under New-Clause 6/PCC [Defects Liability]).

The insuring Party shall insure the Contractor's Equipment for not less than the full replacement value, including delivery to Site. For each item of Contractor's Equipment, the insurance shall be effective while it is being transported to the Site and until it is no longer required as Contractor's Equipment.

Unless otherwise stated in the Conditions of Contract/SCC, insurances under this Sub-Clause:

- (a) shall be effected and maintained by the Contractor as insuring Party,
- (b) shall be in the joint names of the Parties, who shall be jointly entitled to receive payments from the insurers, payments being held or allocated between the Parties for the sole purpose of rectifying the loss or damage,
- (c) shall cover all loss and damage from any cause not listed in Sub-Clause 11.3/PCC [Employer's Risks],
- (d) shall also cover loss or damage to a part of the Works which is attributable to the use or occupation by the Employer of another part of the Works, and loss or damage from the risks listed in sub-paragraphs (c), (g) and (h) of Sub-Clause 11.3/PCC [Employer's Risks], excluding (in each case) risks which are not insurable at commercially reasonable terms, with deductibles per occurrence of not more than the amount stated in the Contract Data (if an amount is not so stated, this sub-paragraph (d) shall not apply), and
- (e) may however exclude loss of, damage to, and reinstatement of:
  - i) part of the Works which is in a defective condition due to a defect in its design, materials or workmanship (but cover shall include any other parts which are lost or

damaged as a direct result of this defective condition and not as described in sub-paragraph (ii) below),

- ii) a part of the Works which is lost or damaged in order to reinstate any other part of the Works if this other part is in a defective condition due to a defect in its design, materials or workmanship,
- iii) a part of the Works which has been taken over by the Employer, except to the extent that the Contractor is liable for the loss or damage, and
- iv) [DELETED]

If, more than one year after the Base Date, the cover described in sub-paragraph (d) above ceases to be available at commercially reasonable terms, the Contractor shall (as insuring Party) give notice to the Employer, with supporting particulars. The Employer shall then (i) be entitled subject to New-Clause 2.4/PCC [Employer's Claims] to payment of an amount equivalent to such commercially reasonable terms as the Contractor should have expected to have paid for such cover, and (ii) be deemed, unless he obtains the cover at commercially reasonable terms, to have approved the omission under Sub-Clause 13.6/PCC [General Requirements for Insurances].

### **13.8 Insurance against injury to Persons and Damage to Property**

The insuring Party shall insure against each Party's liability for any loss, damage, death or bodily injury which may occur to any physical property (except things insured under Sub-Clause 13.7/PCC [Insurance for Works and Contractor's Equipment]) or to any person (except persons insured under Sub-Clause 13.9/PCC [Insurance for Contractor's Personnel]), which may arise out of the Contractor's performance of the Contract and occurring before the issue of the Performance Certificate.

This insurance shall be for a limit per occurrence of not less than the amount stated in the Contract Data, with no limit on the number of occurrences. If an amount is not stated in the Contract Data, this Sub-Clause shall not apply.

Unless otherwise stated in the Special Conditions of Contract, the insurances specified in this Sub-Clause:

- (a) shall be effected and maintained by the Contractor as insuring Party,
- (b) shall be in the joint names of the Parties,
- (c) shall be extended to cover liability for all loss and damage to the Employer's property including Railways Property (except things insured under Sub-Clause 13.7/PCC) arising out of the Contractor's performance of the Contract, and
- (d) may however exclude liability to the extent that it arises from:
  - (i) the Employer's right to have the Permanent Works executed on, over, under, in or through any land, and to occupy this land for the Permanent Works,
  - (ii) damage which is an unavoidable result of the Contractor's obligations to execute the Works and remedy any defects, and
  - (iii) a cause listed in Sub-Clause 11.3/PCC [Employer's Risks], except to the extent that cover is available at commercially reasonable terms.

### **13.9 Insurance for Contractor's Personnel**

The Contractor shall abide by the provisions of ESIC Act, 1948 (extended from time to time) to take care of insurance against liability for claims, damages, losses and expenses

	<p>(including legal fees and expenses) arising from injury, sickness or disease. In addition, the contractor shall also maintain insurance against liability for claim of death of any person employed by the Contractor or any other of the Contractor's Personnel.</p> <p>The Employer and the Engineer shall also be indemnified under the policy of insurance, except that this insurance may exclude losses and claims to the extent that they arise from any act or neglect of the Employer or of the Employer's Personnel.</p> <p>The insurance shall be maintained in full force and effect during the whole time that these personnel are assisting in the execution of the Works. For a Subcontractor's employees, the insurance may be effected by the Subcontractor, but the Contractor shall be responsible for compliance with this Clause.</p> <p>Maximum number of deductibles for insurance of Employer's risks: Nil</p>
<p><b>Clause- 22/CC. Right of Access to the Site</b></p>	<p><b>The following para is added to the existing CC clause:</b></p> <p>The Employer shall give the Contractor right of access to, and possession of, all parts of the Site within the time (or times) stated in the Contract Data. The right and possession may not be exclusive to the Contractor. If, under the Contract, the Employer is required to give (to the Contractor) possession of any foundation, structure, plant or means of access, the Employer shall do so in the time and manner stated in the Specification. However, the Employer may withhold any such right or possession until the Performance Security has been received.</p> <p>If no such time is stated in the Contract Data, the Employer shall give the Contractor right of access to, and possession of, the Site within such times as may be required to enable the Contractor to proceed in accordance with the programme submitted under Sub-Clause 25.3/PCC [Programme].</p> <p>If the Contractor suffers delay as a result of a failure by the Employer to give any such right or possession within such time, the Contractor shall give notice to the Engineer and shall be entitled to:</p> <p>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</p> <p>After receiving this notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these matters.</p> <p>However, if and to the extent that the Employer's failure was caused by any error or delay by the Contractor, including an error in, or delay in the submission of, any of the Contractor's Documents, the Contractor shall not be entitled to such extension of time or new rates.</p> <p>Right of access to the work site will be provided to the successful Contractor. A minimum corridor of 9m will be available. The Contractor to note this while making Launching plans. The Contractor shall prepare, at his cost, approach roads to the site of work and this cost will not be reimbursed by the Employer. The Employer reserves the right to make use of these service roads for themselves or other Contractors working on the project, as and when necessary, without any payment to the Contractor. The barricading to the extent feasible subject to a maximum of 9m width (LHS+RHS) shall be permitted for carrying out the works and suitable barricading width for off-road structures in stages as per the approved sequence of construction. The employer shall grant the contractor right of access to, and/ or possession of the site progressively for the completion of works. The contractor</p>

	will draw/ modify the schedule for completion of work according to progressive possession/ right of such sites.
<b>Clause 25 of CC</b>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>25.3 Programme</b></p> <p>The Contractor shall submit a detailed time programme to the Engineer within 28 days after receiving the notice under Sub-Clause 26.3/PCC [Commencement of Works]. The program shall include the physical and Financial Progress vis-à-vis program and forecast cash flow adopting Project Management Software Primavera/Sure Track/MS Project or as mutually agreed. The program must identify the milestones, interface requirements and program reporting elements. The Contractor shall supply, free of cost one set of authorized software to the Engineer and the soft copy of structured program for the project. This shall be updated every month. The Contractor shall also submit a revised programme whenever the previous programme is inconsistent with actual progress or with the Contractor's obligations. Each programme shall include:</p> <ul style="list-style-type: none"> <li>(a) the order in which the Contractor intends to carry out the Works, including the anticipated timing of each stage of design (if any), Contractor's Documents, procurement, manufacture of Plant, delivery to Site, construction, erection and testing,</li> <li>(b) each of these stages for work by each nominated Subcontractor (as defined in Clause 7/PCC [Nominated Subcontractors]),</li> <li>(c) the sequence and timing of inspections and tests specified in the Contract, and</li> <li>(d) a supporting report which includes: <ul style="list-style-type: none"> <li>(i) a general description of the methods which the Contractor intends to adopt, and of the major stages, in the execution of the Works, and</li> <li>(ii) details showing the Contractor's reasonable estimate of the number of each class of Contractor's Personnel and of each type of Contractor's Equipment, required on the Site for each major stage.</li> </ul> </li> </ul> <p>Unless the Engineer, within 21 days after receiving a programme, gives notice to the Contractor stating the extent to which it does not comply with the Contract, the Contractor shall proceed in accordance with the programme, subject to his other obligations under the Contract. The Employer's Personnel shall be entitled to rely upon the programme when planning their activities.</p> <p>The Contractor shall promptly give notice to the Engineer of specific probable future events or circumstances which may adversely affect the work, increase the Contract Price or delay the execution of the Works. The Engineer may require the Contractor to submit an estimate of the anticipated effect of the future event or circumstances, and/or a proposal under Sub-Clause 34.3/PCC [Variation Procedure].</p> <p>If, at any time, the Engineer gives notice to the Contractor that a programme fails (to the extent stated) to comply with the Contract or to be consistent with actual progress and the Contractor's stated intentions, the Contractor shall submit a revised programme to the Engineer within 15 days in accordance with this Sub-Clause.</p>

<b>Clause 26 of CC</b>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>26.3 Commencement of Works</b></p> <p>The Engineer shall give the Contractor not less than 7 days' notice of the Commencement of work. Unless otherwise stated in the Special Conditions of Contract, the Commencement of work shall be within the number of days after the Contractor receives the Letter of Acceptance as specified in Contract Data.</p> <p>The Contractor shall commence the execution of the Works as soon as is reasonably practicable after the Commencement Date, and shall then proceed with the Works with due expedition and without delay.</p> <p><b>26.4 Time for Completion</b></p> <p>The Contractor shall complete the whole of the Works, and each Section (if any), within the Time for Completion for the Works or Section (as the case may be), including:</p> <ol style="list-style-type: none"> <li>(a) achieving the passing of the Tests on Completion, and</li> <li>(b) completing all work which is stated in the Contract as being required for whole of the Works or Section(s) to be considered to be completed for the purposes of taking-over under Sub-Clause 46.1/PCC [Taking Over of the Works and Sections].</li> </ol> <p><b>26.5 Extension of Time for Completion</b></p> <p>The Contractor shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to an extension of the Time for Completion if and to the extent that completion for the purposes of Sub-Clause 46.1/PCC [Taking-Over of the Works and Sections] is or will be delayed by any of the following causes:</p> <ol style="list-style-type: none"> <li>a) a Variation (unless an adjustment to the Time for Completion has been agreed under Sub-Clause 34.3/PCC [Variation Procedure]) or other substantial change in the quantity of an item of work included in the Contract,</li> <li>b) a cause of delay giving an entitlement to extension of time under a Sub-Clause of these Conditions,</li> <li>c) exceptionally adverse climatic conditions,</li> <li>d) Unforeseeable shortages in the availability of personnel or Goods caused by epidemic or governmental actions, or</li> <li>e) any delay, impediment or prevention caused by or attributable to the Employer, the Employer's Personnel, or the Employer's other contractors.</li> </ol> <p>If the Contractor considers himself to be entitled to an extension of the Time for Completion, the Contractor shall give notice to the Engineer in accordance with Sub-Clause 4.1/SCC [Contractor's Claims]. When determining each extension of time under Sub-Clause 4.1/SCC the Engineer shall review previous determinations and may increase, but shall not decrease, the total extension of time.</p> <p><b>26.6 Delays Caused by Authorities</b></p> <p>If the following conditions apply, namely:</p>
------------------------	--

- (a) the Contractor has diligently followed the procedures laid down by the relevant legally constituted public authorities in the Country,
- (b) these authorities delay or disrupt the Contractor's work, and
- (c) the delay or disruption was Unforeseeable,
- then this delay or disruption will be considered as a cause of delay under sub-paragraph (b) of Sub-Clause 26.5/PCC [Extension of Time for Completion].

### 26.7 Rate of Progress

If, at any time:

- (a) actual progress is too slow to complete within the Time for Completion, and/or
- (b) progress has fallen (or will fall) behind the current programme under Sub-Clause 25.3/PCC [Programme],

other than as a result of a cause listed in Sub-Clause 26.5/PCC [Extension of Time for Completion], then the Engineer may instruct the Contractor to submit, under Sub-Clause 25.3/PCC [Programme], a revised programme and supporting report describing the revised methods which the Contractor proposes to adopt in order to expedite progress and complete within the Time for Completion.

Unless the Engineer notifies otherwise, the Contractor shall adopt these revised methods, which may require increases in the working hours and/or in the numbers of Contractor's Personnel and/or Goods, at the risk and cost of the Contractor. If these revised methods cause the Employer to incur additional costs, the Contractor shall subject to New-Clause 2.4/PCC [Employer's Claims] pay these costs to the Employer, in addition to delay damages (if any) under Sub-Clause 26.8/PCC below

### 26.8 Extension of Time for Completion with Delay Damages

If the Contractor fails to comply with Sub-Clause 26.4/PCC [Time for Completion for entire work or for specified section wise completion period], and he is not entitled to an extension of time under sub clause 26.5/PCC then the employer may grant extension of time with delay damage in such case, the Contractor shall subject to New-Clause 2.4/PCC [Employer's Claims] pay delay damages to the Employer for this default. These delay damages shall be the sum stated in the Contract Data, which shall be paid for every day which shall elapse between the relevant Time for Completion and the date stated in the Taking-Over Certificate. However, the total amount due under this Sub-Clause shall not exceed the maximum amount of delay damages (if any) stated in the Contract Data.

Further, if the contractor fails to achieve physical/financial targets as per the agreed programme for a consecutive period of 3 months without any valid reasons, other than attributable to the contractor, a provisional recovery of delay damages shall be made from the next interim payment certificate @ 1/10th of the sum of delay damages stated in the contract data, for the entire period of 3 months. Such recovery shall continue from the further interim payment certificates till the contractor is able to make good the shortfall and achieve the cumulative targets as per agreed programme. On achieving the cumulative progress targets as per agreed programme, the entire amount recovered till that month, shall be refunded to the contractor in the next interim payment certificate. In case the contractor is unable to make good the shortfall and achieve the cumulative targets resulting

in delay in completion of the project, then the provisional recoveries made shall be adjusted against the delay damages to be finally imposed on the contractor.

These delay damages shall be the only damages due from the Contractor for such default, other than in the event of termination under Sub-Clause 49.7/PCC [Termination by Employer] prior to completion of the Works. These damages shall not relieve the Contractor from his obligation to complete the Works, or from any other duties, obligations or responsibilities which he may have under the Contract.

#### **26.9 Suspension of Work**

The Engineer may at any time instruct the Contractor to suspend progress of part or all of the Works. During such suspension, the Contractor shall protect, store and secure such part or the Works against any deterioration, loss or damage.

The Engineer may also notify the cause for the suspension. If and to the extent that the cause is notified and is the responsibility of the Contractor, the following Sub-Clauses 26.10, 26.11 and 26.12 of PCC shall not apply.

#### **26.10 Consequences of Suspension -DELETED**

#### **26.11 Payment for Plant and Materials in Event of Suspension -DELETED**

#### **26.12 Prolonged Suspension**

If the suspension under Sub-Clause 26.9/PCC [Suspension of Work] has continued for more than 84 days, the Contractor may request the Engineer's permission to proceed. If the Engineer does not give permission within 28 days after being requested to do so, the Contractor may, by giving notice to the Engineer, treat the suspension as an omission under Clause 34/PCC [Variations and Adjustments] of the affected part of the Works. If the suspension affects the whole of the Works, the Contractor may give notice.

#### **26.13 Resumption of Work**

After the permission or instruction to proceed is given, the Contractor and the Engineer shall jointly examine the Works and the Plant and Materials affected by the suspension. The Contractor shall make good any deterioration or defect in or loss of the Works or Plant or Materials, which has occurred during the suspension

#### **26.14 Bonus for early completion:**

If the Contractor achieves completion of the whole of the Works or any section(s) prior to the intended Completion Date prescribed in Contract data (Extension of time pursuant to Clause 26.5/PCC or any other clause of these conditions will not be considered), the Employer shall pay to the Contractor a sum stated in the Contract data as bonus for early completion, for every calendar month which shall elapse between the date of completion of all items of works as stipulated in the contract, including variations ordered by the Engineer and the time prescribed in Clause 26.4.

For the purpose of calculating bonus payments, the time given in the Bid for completion of the whole works or any section(s) is fixed and unless otherwise agreed, no adjustment of the time by reasons of granting an extension of time pursuant to clause 26.5/PCC or any other clause of these conditions will be allowed. Any period falling short of completed month shall be ignored for the purpose of computing the period relevant for the payment of bonus.



	<p><b>Amount of bonus for early completion</b> 1% of initial Contract Price per month (part of the month to be excluded) for substantial completion of work.</p> <p><b>Maximum limit of bonus</b> 3% of Contract Price.</p> <p>(For earlier completion of the work as a whole from the stipulated original date of completion, a bonus payment of as above shall be paid to the contractor. The engineer's decision is final and binding on the contractor so far as bonus payment to the contractor is concerned. if bonus payment is made, earlier penalties levied for delay caused to various intermediate Key Dates will be refunded.)</p>
<p><b>Clause-30/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>30.2 Contractor's Obligations</b></p> <p>The Contractor shall carry out the Tests on Completion in accordance with this Clause and New-Clause 5.4/PCC [Testing], after providing the documents in accordance with sub-paragraph (d) of New--Clause 4.1/PCC [Contractor's General Obligations].</p> <p>The Contractor shall give to the Engineer not less than 21 days' notice of the date after which the Contractor will be ready to carry out each of the Tests on Completion. Unless otherwise agreed, Tests on Completion shall be carried out within 14 days after this date, on such day or days as the Engineer shall instruct.</p> <p>In considering the results of the Tests on Completion, the Engineer shall make allowances for the effect of any use of the Works by the Employer on the performance or other characteristics of the Works. As soon as the Works, or a Section, have passed any Tests on Completion, the Contractor shall submit a certified report of the results of these Tests to the Engineer.</p> <p><u>Contractor's Obligations:</u> The Contractor shall carry out the Tests on Completion at his own cost in accordance with the Contract and shall provide the documents in accordance with New-Clauses 3.1/PCC and the Contractor shall give, to the Engineer, 21days' notice of the date after which the Contractor will be ready to carry out the Tests on Completion. Unless otherwise agreed, such Tests shall be carried out within 14 days after this date, on such day or days as the Engineer shall instruct.</p> <p>Unless otherwise stated in Conditions of Contract/SCC, the Tests on Completion shall be carried out in the following sequence</p> <ol style="list-style-type: none"> <li>(a) pre-commissioning test, which shall include appropriate instructions and ("dry" or "cold") functional tests to demonstrate that each item of the Plant and Work can safely undertake the next stage</li> <li>(b) Commissioning Test shall include the specified operational tests to demonstrate Works or Sections can be operated safely and as specified under all available operating condition</li> <li>(c) trial operation which shall demonstrate that the Works or Section perform reliably and in accordance with the Contract</li> </ol> <p>The Contractor at his own cost shall arrange all tools, equipment, gadgets, facilities or as deemed necessary by the Engineer for such tests, in considering the results of the Tests on Completion, the Engineer shall make allowances for the effect of any use of the Works by the Employer on the performance or other characteristics of the Works. As soon as the</p>

Works, or a Section, have passed the Tests on Completion described in sub-paragraphs (a) (b) or (c), the Contractor shall provide the Engineer and the Employer with a certified report of the results of all such Tests

### 30.3 Delayed Tests

If the Tests on Completion are being unduly delayed by the Employer, New-Clause 5.4/PCC [Testing] (fifth paragraph) and/or Sub-Clause 46.3/PCC [Interference with Tests on Completion] shall be applicable.

If the Tests on Completion are being unduly delayed by the Contractor, the Engineer may by notice require the Contractor to carry out the Tests within 21 days after receiving the notice. The Contractor shall carry out the Tests on such day or days within that period as the Contractor may fix and of which he shall give notice to the Engineer.

If the Contractor fails to carry out the Tests on Completion within the period of 21 days, the Employer's Personnel may proceed with the Tests at the risk and cost of the Contractor. The Tests on Completion shall then be deemed to have been carried out in the presence of the Contractor and the results of the Tests shall be accepted as accurate.

### 30.4 Retesting

If the Works, or a Section, fail to pass the Tests on Completion, New-Clause 5.5/PCC [Rejection] shall apply, and the Engineer or the Contractor may require the failed Tests, and Tests on Completion on any related work, to be repeated under the same terms and conditions

### 30.5 Failure to Pass Tests on Completion

If the Works, or a Section, fail to pass the Tests on Completion repeated under Sub-Clause 30.4/PCC [Retesting], the Engineer shall be entitled to:

- (a) order further repetition of Tests on Completion under Sub-Clause 30.4;
- (b) if the failure deprives the Employer of substantially the whole benefit of the Works or Section, reject the Works or Section (as the case may be), in which event the Employer shall have the same remedies as are provided in sub-paragraph (c) of New-Clause 6.4/PCC [Failure to Remedy Defects]; or
- (c) issue a Taking-Over Certificate, if the Employer so requests.

In the event of sub-paragraph (c), the Contractor shall proceed in accordance with all other obligations under the Contract, and the Contract Price shall be reduced by such amount as shall be appropriate to cover the reduced value to the Employer as a result of this failure. Unless the relevant reduction for this failure is stated (or its method of calculation is defined) in the Contract, the Employer may require the reduction to be (i) agreed by both Parties (in full satisfaction of this failure only) and paid before this Taking-Over Certificate is issued, or (ii) determined and paid under New-Clause 2.4 [Employer's Claims] and New-Clause 3.5 [Determinations].

### 30.6 Contractor's obligations

Notwithstanding the provisions of New-clauses 4.1/PCC, clause 30.2 to 30.5/PCC the provisions in subsequent sub-clauses shall apply for works of Permanent Way, signalling and telecommunication and railway electrification excluding General Electrical Services.

- (a) The Contractor shall be responsible for the execution of temporary and/or permanent works which may require the prior sanction/approval of EIG/Commissioner of Railway Safety (CRS) in accordance with extant rules for "The Railways opening for Public

	<p>Carriage of Passengers” was amended from time to time. And applicable as and when the works are undertaken. The Contractor shall initiate the process for approval at least <b>63</b> (sixty-three) days prior to undertaking such works which require the approval of Commissioner of Railway Safety (CRS) and furnish draft documentation to the Engineer.</p> <p>(b) The Contractor shall ensure that existing services and operations for public carriage of passengers or goods, are not affected except those, which are essentially required to be regulated for execution of works. Such items of works shall be planned and coordinated through the Engineer.</p> <p>(i) Prior to the commencement of commercial operations of passenger traffic, the Employer may permit freight train operations to Railway after certification by the authorized person of Zonal Railway. The Contractor shall be responsible for maintaining the facilities ensuring safety of operations as per specifications.</p>
<p><b>Clause 34/CC</b></p>	<p><b>The following paras are replaced to the Existing CC Clause 34.</b></p> <p><b>VARIATIONS AND ADJUSTMENTS.</b></p> <p><b>34.1 Right to Vary</b></p> <p>Variations may be initiated by the Employer at any time prior to issuing the Taking-Over Certificate for the Works, either by an instruction or by making a request to the Contractor to submit a proposal.</p> <p><b>The Contractor shall execute and be bound by each variation till the price does not exceed 50% of the agreement value as specified in LOA/Original agreement.</b> For variation beyond the above the contractor shall be bound to execute, unless the Contractor promptly gives notice to the Engineer stating (with supporting particulars) that the Contractor cannot readily obtain the Goods required for the Variation. Upon receiving this notice, the Engineer shall cancel, confirm or vary the instruction.</p> <p>Each Variation may include:</p> <p>(a) changes to the quantities of any item of work included in the Contract,</p> <p>(b) changes to the quality and other characteristics of any item of work,</p> <p>(c) changes to the levels, positions and/or dimensions of any part of the Works,</p> <p>(d) omission of any work unless it is to be carried out by others,</p> <p>(e) any additional work, Plant, Materials or services necessary for the Permanent Works, including any associated Tests on Completion, boreholes and other testing and exploratory work, or</p> <p>(f) changes to the sequence or timing of the execution of the Works.</p> <p>The Contractor shall not make any alteration and/or modification of the Permanent Works, unless and until the Engineer instructs or approves a Variation</p> <p><b>34.2 Value Engineering</b></p> <p>The Contractor may, at any time, submit to the Engineer a written proposal which (in the Contractor’s opinion) will, if adopted, (i) accelerate completion, (ii) reduce the cost to the Employer of executing, maintaining or operating the Works, (iii) improve the efficiency or value to the Employer of the completed Works, or (iv) otherwise be of benefit to the Employer.</p>

The proposal shall be prepared at the cost of the Contractor and shall include the items listed in Sub-Clause 34.3/PCC [Variation Procedure].

If a proposal, which is approved by the Engineer, includes a change in the design of part of the Permanent Works, then unless otherwise agreed by both Parties:

- (a) the Contractor shall design this part,
- (b) sub-paragraphs (a) to (d) of New-Clause 4.1/PCC [Contractor's General Obligations] shall apply, and
- (c) if this change results in a reduction in the contract value of this part, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine a fee, which shall be included in the Contract Price. This fee shall be half (50%) of the difference between the following amounts:
  - (i) such reduction in contract value, resulting from the change, excluding adjustments under Sub-Clause 34.7/PCC [Adjustments for Changes in Legislation] and Sub-Clause PVC/Contract Data [Adjustments for Changes in Cost], and
  - (ii) the reduction (if any) in the value to the Employer of the varied works, taking account of any reductions in quality, anticipated life or operational efficiencies.

However, if amount (i) is less than amount (ii), there shall not be a fee.

### **34.3 Variation Procedure**

If the Engineer requests a proposal, prior to instructing a Variation, the Contractor shall respond in writing as soon as practicable, either by giving reasons why he cannot comply (if this is the case) or by submitting:

- (a) a description of the proposed work to be performed and a programme for its execution,
- (b) the Contractor's proposal for any necessary modifications to the programme according to Sub-Clause 25.3/PCC [Programme] and to the Time for Completion, and
- (c) the evaluation of the Variation shall be as specified in New-Clause 35/PCC [Payment for Variation].

The Engineer shall, as soon as practicable after receiving such proposal (under Sub-Clause 34.2/PCC [Value Engineering] or otherwise), respond with approval, disapproval or comments. The Contractor shall not delay any work whilst awaiting a response.

Each instruction to execute a Variation, with any requirements for the recording of Costs, shall be issued by the Engineer to the Contractor, who shall acknowledge receipt.

Each Variation shall be evaluated in accordance with New-Clause 7 [Measurement and Evaluation], unless the Engineer instructs or approves otherwise in accordance with this Clause.

### **34.4 Payment in Applicable Currencies**

If the Contract provides for payment of the Contract Price in more than one currency, then whenever an adjustment is agreed, approved or determined as stated above, the amount payable in each of the applicable currencies shall be specified. For this purpose, reference shall be made to the actual or expected currency proportions of the Cost of the varied work, and to the proportions of various currencies specified for payment of the Contract Price.

### 34.5 Provisional Sums

Each Provisional Sum shall only be used, in whole or in part, in accordance with the Engineer's instructions, and the Contract Price shall be adjusted accordingly. The total sum paid to the Contractor shall include only such amounts, for the work, supplies or services to which the Provisional Sum relates, as the Engineer shall have instructed. For each Provisional Sum, the Engineer may instruct:

- (a) work to be executed (including Plant, Materials or services to be supplied) by the Contractor and valued under Sub-Clause 34.3/PCC [Variation Procedure]; and/or
- (b) Plant, Materials or services to be purchased by the Contractor, from a nominated Subcontractor (as defined in Clause 7 [Nominated Subcontractors]) or otherwise; and for which these shall be included in the Contract Price:
  - (i) the actual amounts paid (or due to be paid) by the Contractor, and
  - (ii) a sum for overhead charges and profit, calculated as a percentage of these actual amounts by applying the relevant percentage rate (if any) stated in the appropriate Schedule. If there is no such rate, the percentage rate stated in the Contract Data shall be applied.

The Contractor shall, when required by the Engineer, produce quotations, invoices, vouchers and accounts or receipts in substantiation

### 34.6 Day work

For work of a minor or incidental nature, the Engineer may instruct that a Variation shall be executed on a daywork basis. The work shall then be valued in accordance with the Daywork Schedule included in the Contract, and the following procedure shall apply. If a Daywork Schedule is not included in the Contract, this Sub-Clause shall not apply.

Before ordering Goods for the work, the Contractor shall submit quotations to the Engineer. When applying for payment, the Contractor shall submit invoices, vouchers and accounts or receipts for any Goods.

Except for any items for which the Daywork Schedule specifies that payment is not due, the Contractor shall deliver each day to the Engineer accurate statements in duplicate which shall include the following details of the resources used in executing the previous day's work:

- (a) the names, occupations and time of Contractor's Personnel,
- (b) the identification, type and time of Contractor's Equipment and Temporary Works, and
- (c) the quantities and types of Plant and Materials used.

One copy of each statement will, if correct, or when agreed, be signed by the Engineer and returned to the Contractor. The Contractor shall then submit priced statements of these resources to the Engineer, prior to their inclusion in the next Statement under Sub-Clause 37.1/PCC [Application for Interim Payment Certificates]

### 34.7 Adjustments for Changes in Legislation

Contract Price shall be adjusted to take account of any increase or decrease in Cost resulting from a change in the Laws of the Country (including the introduction of new Laws and the repeal or modification of existing Laws) or in the judicial or official governmental interpretation of such Laws, made after the Base Date, which affect the Contractor in the performance of obligations under the Contract.

	<p>If the Contractor suffers (or will suffer) delay and/or incurs (or will incur) additional Cost as a result of these changes in the Laws or in such interpretations, made after the Base Date, the Contractor shall give notice to the Engineer and shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:</p> <p>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</p> <p>(b) payment of any such Cost, which shall be included in the Contract Price.</p> <p>After receiving this notice, the Engineer shall proceed in accordance with New-Clause 3.5 [Determinations] to agree or determine these matters.</p> <p>In case there is a decrease in cost as a result of changes of Law by Legislation after the Base Date, the Engineer shall proceed in accordance with New-Clause 3.5 (determination) to agree or determine these matters without waiting for Contractor's / Employer's Notice.</p> <p>Notwithstanding the foregoing, the Contractor shall not be entitled to such an extension of time if the same shall already have been taken into account in determining an extension and such Cost shall not be separately paid if the same shall already have been taken into account in the indexing of any inputs to the table of adjustment data in accordance with the provisions of Sub-Clause PVC/Contract Data.</p>
<p><b>Clause 35/CC</b></p>	<p><b>The clause 35 of CC is substituted with following paras.</b></p> <p><b>1. Payment for Variations/New Items.</b></p> <p><b>1.1. Variation in the Bill of Quantities</b></p> <p>i) The quantities of items shown in the Bill of Quantities are approximate, and liable to vary during the actual execution of the work. Some items/group of items may have to be altered, added or omitted. The Contractor shall be bound to carry out and complete the stipulated work as instructed by the Engineer, irrespective of the magnitude of variations including additions, alterations or omissions in the Bill of Quantities, individual items or group of items, specified in the Bill of Quantities.</p> <p>Such variations shall be paid as follows:</p> <p>1.2 Payment for the increase in the quantities of an item in the BOQ up to 25 % of that provided in the Bill of Quantities shall be made at the rates quoted by the Contractor, except in the case of foundation.</p> <p>1.3 In case of foundation work, no variation limit applies and Contractor shall carryout the Work, at rates stipulated in the Contract irrespective of any variation.</p> <p>1.4 For quantities in excess of 125% of the tendered quantity of an item as given in the BOQ, the Contractor shall be paid at the reasonable rate derived from the details mentioned in para no. 3 (applicable for the area of work and current at the time of variations), plus-minus the overall percentage of the original tendered rates over the current schedule of rates prevalent at the time of contract.</p> <p>1.5 If there is no rate for the additional, substituted, or altered item of the work in the BOQ, efforts would be made to derive the rates from those given in the BOQ or the Schedule of Rates (applicable for the area of the work and current at the time of award of Contract) and if found feasible the payment would be made at the derived rate for the item plus or minus the overall percentage of the original</p>

tendered rates over the current Schedule of Rates prevalent at the time of award of Contract.

- 1.6 If the rates for additional, substituted, or altered items of work cannot be determined either as at 1.2, 1.4, or 1.5 above, the Contractor shall be requested to submit his quotation for the items supported by analysis of the rate or rates claimed, within 7 days.
- 1.7 If the Contractor's quotation is determined unreasonable, the Employer may order the Variation and make a change to the Contract Price which shall be based on the Employer's own forecast of the effects of the Variation on the Contractor's costs.
- 1.8 Under no circumstances the Contractor shall suspend the work on the plea of non-settlement of rates for items falling under this Clause.

## **2. Procedure for the operation of new items/ variations**

The following procedure is to be followed in dealing with the proposal for variation in contractual quantity and/or new items

- 2.1 If any item of work that is not provided for in the BOQ or in case of variation in BOQ Quantity is to be operated, the contractor shall take the instructions in writing from the Engineer as per the relevant Clause specified in the conditions of the contract on Variations.
- 2.2 The contractor on receipt of the instructions shall submit a proposal with the details as specified in the Contract including the proposed rates for the items and proper analysis for the same. (New items and Beyond 125 % of individual items in case of variation)

## **3. Rate for variation and new items**

General principle to be adopted shall be, in case of relevant LAR is available it should be considered. In the absence of relevant LAR, SOR rates/ analysis mentioned as per SOR to be followed.

In case of General Electrical works and utility shifting works policy letter issued from time to time by government of Karnataka shall be followed.

The rate for new items or variations beyond 125% may be derived from the latest reasonable rates of following sequence:

KRIDE LAR  
 SWR LAR  
 BMRCL LAR  
 SOR of KPWD/KPTCL  
 USSOR Railways  
 SOR of CPWD

In the absence/conflict of above (LAR/ SOR) rate may be derived as below.

	<p>a. Cost of Materials at current market price, as may be actually utilized in the final finished Permanent Works, including a reasonable percentage for wastage and transportation.</p> <p>b. Cost of enabling works, if any, (unless provided for separately) worked out on the above basis but with less stringent quality. Specifications minus the salvage value of serviceable material released after completion of work and cost of material released as scrap.</p> <p>c. Cost of labor actually used at the site of work at rates under Payment of Minimum Wages Act for the area of work for each category of workers, further enhanced by a percentage of 10o/o of the aforesaid rates to account for labor not directly utilized at the Site and other ancillary and incidental expenses on labor.</p> <p>d. Hire charges for Plant and Machinery, scaffolding, shuttering, forms, etc. required to be used at the site of the work. The tools used by the various trades shall not be counted as Plant &amp; Machinery for this purpose.</p> <p>e. An amount of 10% of items a, b, c &amp; d above to allow for the Contractor's overheads and profit. This percentage shall also apply to the estimated cost of Materials supplied free to the contractor.</p> <p>f. All taxes as applicable on above.</p>
<p><b>Clause 37/CC</b></p>	<p><b>The clause 37 of CC is replaced with the following.</b></p> <p><b>Payments.</b></p> <p><b>37.1 Application for Interim Payment Certificates</b></p> <p>Payments shall be adjusted for deductions for advance payments other than recoveries in terms of contract and taxes, at source as applicable under law. The Contractor shall be liable to pay liquidated damages for shortfall in progress. Items of the Works for which no rate or price has been entered in will not be paid for by the Employer and shall be deemed covered by other rates and prices in the Contract.</p> <p>The Contractor shall submit a Statement in six copies to the Engineer in accordance with the payment procedure specified by the Engineer, after the end of each month, in a form approved by the Engineer, showing in detail the amounts to which the Contractor considers himself to be entitled, together with supporting documents which shall include the report on the progress during this month in accordance with New-Clause 4.39/PCC [Progress Reports] and Record Measurement Sheets.</p> <p>The Statement shall include the following items, as applicable, which shall be expressed in the various currencies in which the Contract Price is payable, in the sequence listed:</p> <p>(a) the estimated contract value of the Works executed and the Contractor's Documents produced up to the end of the month (including Variations but excluding items described in sub-paragraphs (b) to (g) below);</p> <p>(b) any amounts to be added and deducted for changes in legislation and changes in cost, in accordance with Sub-Clause 34.7/PCC [Adjustments for Changes in Legislation] and Sub-Clause PVC/Contract Data [Adjustments for Changes in Cost];</p>



- (c) any amount to be deducted for retention, calculated by applying the percentage of retention stated in the Contract Data to the total of the above amounts, until the amount so retained by the Employer reaches the limit of Retention Money (if any) stated in the Contract Data;
- (d) Any amounts to be added and deducted for the advance payments and repayments in accordance with sub clause 42.0/PCC [Advance Payment];
- (e) any amounts to be added and deducted for Materials in accordance with New-Clause 13/PCC [Materials intended for the Works];
- (f) any other additions or deductions which may have become due under the Contract or otherwise, including those under Clause 4.1/SCC [Claims, Disputes and Arbitration]; and
- (g) the deduction of amounts certified in all previous Payment Certificates.
- (h) for invoicing as per GST Laws, the estimated contract value of the Works executed in terms of (a) above and any amounts added or deducted as per (b), (e) to (g) above is to be broken up in two components i.e. (i) the base amount excluding GST (ii) GST component (calculated at the rate for works contract service as per GST Laws).
- (i) Statement of interim payments certificates should be submitted by the Contractor to the Engineer by the 7th day of each month for the work executed upto the end of the previous month.
- (j) An amount to be deducted for the payments to be made to different Departments towards payments liable to be made by the Contractor

### 37.2 Schedule of Payments

If the Contract includes a schedule of payments specifying the installments in which the Contract Price will be paid, then unless otherwise stated in this schedule:

- (a) the installments quoted in this schedule of payments shall be the estimated contract values for the purposes of sub-paragraph (a) of Sub-Clause 37.1/PCC [Application for Interim Payment Certificates];
- (b) New-Clause 13/PCC [Provisional payment against material at site] shall not apply; and
- (c) if these installments are not defined by reference to the actual progress achieved in executing the Works, and if actual progress is found to be less than that on which this schedule of payments was based, then the Engineer may proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine revised installments, which shall take account of the extent to which progress is less than that on which the installments were previously based.

If the Contract does not include a schedule of payments, the Contractor shall submit non-binding estimates of the payments which he expects to become due during each quarterly period. The first estimate shall be submitted within 42 days after the Commencement Date. Revised estimates shall be submitted at quarterly intervals, until the Taking-Over Certificate has been issued for the Works.

### 37.3 Issue of Interim Payment Certificates

No amount will be certified or paid until the employer has received and approved the performance security. Thereafter, the Engineer shall within two days after receiving a statement and supporting documents (including Contractor's certificate in terms of Sub-Clause 1.22/SCC, issue to the Employer a provisional interim payment certificate which shall state the amount which the Engineer determines to be due after preliminary check as per K-RIDE's procedure order. After this the Engineer shall, within 28 days after receiving a statement and supporting documents, issue to the employer an Interim Payment Certificate which shall state the amount which the Engineer fairly determines to be due, with supporting particulars.

However, prior to issuing the Taking-Over Certificate for the Works, the Engineer shall not be bound to issue the Interim Payment Certificate in an amount which would (after retention and other deductions) be less than the minimum amount of Interim Payment Certificates (if any) stated in the Contract Data. In this event, the Engineer shall give notice to the Contractor accordingly.

An Interim Payment Certificate shall not be withheld for any other reason, although:

- (a) if anything supplied or work done by the Contractor is not in accordance with the Contract, the cost of rectification or replacement may be withheld until rectification or replacement has been completed; and/or
- (b) if the Contractor was or is failing to perform any work or obligation in accordance with the Contract, and had been so notified by the Engineer, the value of this work or obligation may be withheld until the work or obligation has been performed.

The Engineer may in any Payment Certificate make any correction or modification that should properly be made to any previous Payment Certificate. A Payment Certificate shall not be deemed to indicate the Engineer's acceptance, approval, consent or satisfaction.

### **37.4 Payment**

The Employer shall pay to the Contractor:

- (a) the first installment of the advance payment within 42 days after issuing the Letter of Acceptance or within 21 days after receiving the documents in accordance with New-Clause 4.19/PCC [Performance Security] and Sub-Clause 42.0/PCC [Advance Payment], whichever is later;
- (b) **DELETED**
- (c) the amount certified in the Final Payment Certificate within 56 days after the Employer receives this Payment Certificate or, the undisputed amount shown in the Final Statement, within 56 days after the date of notification of the suspension.

Payment of the amount due, unless specified in the Contract Data, shall be made in INR into the bank account, nominated by the Contractor.

However, in case of JV, direct payment to individual JV partners shall be made on joint certification (about the net amounts payable to individual partners) by the authorized representative of the JV and concerned respective authorized representative of individual JV partners, after making requisite recoveries/deductions from the gross payment. In case of any dispute regarding the net amounts payable to individual partners, the Engineer shall decide the same on the basis of the execution of items of works under Schedules/Bills indicated in the JV agreement as the responsibility of execution of each JV partner. Payment to individual JV partners shall be treated as payment made to the JV. The said payment shall not alter any obligation of the JV and

its individual Partners under the Agreement and their obligations under the agreement shall remain joint and several.

A foreign company (either single entity or JV partner), shall have to submit proof of having opened their project office in India before any payment (including advance payment) is released to such a company. The required proof here shall be a copy of the report containing information as per format prescribed by Reserve Bank of India submitted to the Director General of Police (DGP) of the state concerned in which project office has been established.

**37.5 DELETED**

**37.6 Delayed Payment-**

If the Contractor does not receive payment in accordance with Sub-Clause 37.4/PCC [Payment], the Contractor shall be entitled to receive interest compounded monthly on the amount unpaid during the period of delay. This period shall be deemed to commence on the date for payment specified in Sub-Clause 37.4/PCC [Payment], irrespective (in the case of its sub-paragraph (b)) of the date on which any Interim Payment Certificate is issued.

Unless otherwise stated in the Special Conditions of Contract, the interest amount be calculated at the annual rate of 7% (seven percent).

The Contractor shall be entitled to this payment without formal notice or certification, and without prejudice to any other right or remedy, if the Contractor submits the complied (Fulfilled) documents.

**37.7 DELETED**

**37.8 DELETED**

**37.9 DELETED**

**37.10 DELETED**

**37.11 Statement at Completion**

Within 84 days after receiving the Taking-Over Certificate for the Works, the Contractor shall submit to the Engineer six copies of a Statement at completion with supporting documents, in accordance with Sub-Clause 37.7/PCC [Application for Interim Payment Certificates], showing:

- (a) the value of all work done in accordance with the Contract up to the date stated in the Taking- Over Certificate for the Works,
- (b) any further sums which the Contractor considers to be due, and
- (c) an estimate of any other amounts which the Contractor considers will become due to him under the Contract. Estimated amounts shall be shown separately in this Statement at completion.

The Engineer shall then certify in accordance with Sub-Clause 37.3/PCC [Issue of Interim Payment Certificates].

Within 56 days after receiving the Performance Certificate, the Contractor shall submit, to the Engineer, six copies of a draft final statement as per procedure prescribed by the Engineer, with supporting documents showing in detail in a form approved by the Engineer:

### 37.12 Application for Final Payment Certificate

Within 56 days after receiving the Performance Certificate, the Contractor shall submit, to the Engineer, six copies of a draft final statement as per procedure prescribed by the Engineer, with supporting documents (including Contractor's certificate in terms of Sub-Clause 1.22/SCC showing in detail in a form approved by the Engineer:

- (a) the value of all work done in accordance with the Contract, and
- (b) any further sums which the Contractor considers to be due to him under the Contract or otherwise.

If the Engineer disagrees with or cannot verify any part of the draft final statement, as per procedure prescribed by the Engineer the Contractor shall submit such further information as the Engineer may reasonably require and shall make such changes in the draft as may be agreed between them. The Contractor shall then prepare and submit to the Engineer the final statement as agreed. This agreed statement is referred to in these Conditions as the "Final Statement".

However, if, following discussions between the Engineer and the Contractor and any changes to the draft final statement which are agreed, it becomes evident that a dispute exists, the Engineer shall deliver to the Employer (with a copy to the Contractor) an Interim Payment Certificate for the agreed parts of the draft final statement. Thereafter, if the dispute is finally resolved under Sub-Clause 4.SCC [Obtaining Dispute Board's Decision] or Sub-Clause 4.2/SCC [Amicable Settlement], the Contractor shall then prepare and submit to the Employer (with a copy to the Engineer) a Final Statement.

### 37.13 Discharge

When submitting the Final Statement, the Contractor shall submit a discharge which confirms that the total of the Final Statement represents full and final settlement of all moneys due to the Contractor under or in connection with the Contract. This discharge may state that it becomes effective when the Contractor has received the Performance Security and the outstanding balance of this total, in which event the discharge shall be effective on such date

### 37.14 Issue of Final Payment Certificate

Within 28 days after receiving the Final Statement and discharge in accordance with Sub-Clause 37.12/PCC [Application for Final Payment Certificate] and Sub-Clause 37.13/PCC [Discharge], the Engineer shall issue, to the Employer, the Final Payment Certificate which shall state:

- (a) the amount which he fairly determines is finally due, and
- (b) after giving credit to the Employer for all amounts previously paid by the Employer and for all sums to which the Employer is entitled, the balance (if any) due from the Employer to the Contractor or from the Contractor to the Employer, as the case may be.

If the Contractor has not applied for a Final Payment Certificate in accordance with Sub-Clause 37.12/PCC [Application for Final Payment Certificate] and Sub-Clause 37.13/PCC [Discharge], the Engineer shall request the Contractor to do so. If the Contractor fails to submit an application within a period of 28 days, the Engineer shall issue the Final Payment Certificate for such amount as he fairly determines to be due.

**37.15 Cessation of Employer's Liability**

The Employer shall not be liable to the Contractor for any matter or thing under or in connection with the Contract or execution of the Works, except to the extent that the Contractor shall have included an amount expressly for it:

- (a) in the Final Statement and also
- (b) (except for matters or things arising after the issue of the Taking-Over Certificate for the Works) in the Statement at completion described in Sub-Clause 37.11/PCC [Statement at Completion].

However, this Sub-Clause shall not limit the Employer's liability under his indemnification obligations, or the Employer's liability in any case of fraud, deliberate default or reckless misconduct by the Employer

**37.16 Currencies of Payment**

- a) The Contract Price shall be paid in Indian Rupees (INR).

**37.17 Tax Deduction at Source:** Tax deductions will be made at source as per statutory requirement from every payment made to the Contractor at rates notified from time to time.

- i. **Income tax deduction:** Income Tax deduction shall be as per law.
- ii. **Labour Cess & Royalties:** The labour Cess & Royalties will be deducted as per norms of applicable law from each IPCs and remitted to the respective Authorities

**37.18 Production of Vouchers**

- a. The Contractor shall, whenever required by the Engineer, produce or cause to be produced for examination by the Engineer, any quotation, invoice, cost or other account books, vouchers, receipts, letters, memoranda or any copy of or extract from any such documents and also furnish information and returns, as may be required, relating to the execution of this Contract or relevant for verifying or ascertaining the cost of execution of this Contract or ascertaining the Materials supplied by the Contractor are in accordance with the Specifications laid down in the Contract. The Engineer's decision on the question of relevancy of any documents, information or returns shall be final and binding on the parties
- b. If any part or item of the Work is allowed to be carried out by a Sub-Contractor, assignee or any subsidiary or allied firm, the Engineer shall have power to secure the books of such Sub-Contractor, assignee or any subsidiary or allied firm through the Contractor, and shall have power to examine and inspect the same. The above obligations are without prejudice to the obligations of the Contractor under any statute, rules or orders.

**37.19 Withholding and Lien For Sums Claimed**

- (i) The Employer shall have lien on and over all materials of every description, tools, tackles, plant, equipment or any amount due and/or that may become due and payable to the Contractor under the Contract, and / or on and over the deposit of Performance Security or other amount or amounts made under the Contract and which may become payable to the Contractor. Employer may exercise a general lien also.
- (ii) And further, unless the Contractor pays and clears immediately on demand any claim of the Employer, the Employer shall at all times be entitled to deduct the amount of the

	<p>said claim from the amount, securities and / or deposits which may have become or will become payable to the Contractor under the existing contract, or under any other Contract or transaction whatsoever between the Employer and the Contractor even if the matter stands referred to Arbitration. The Contractor shall have no claim for any interest or damage whatsoever in respect of any amounts withheld or treated as withheld under the lien referred to above and duly notified as such to the Contractor</p> <p><b>37.20 Signature on Receipts for Payments</b></p> <p>Every receipt of payment to Contractor including refund of the Performance Security shall be signed by the person authorized to do so on his behalf. In the event of death of any of the Contractor's partners in case the Contractor is a partnership firm, during the currency of the Contract, it is hereby expressly agreed that every receipt by any one of surviving Contractor's partners, shall, if so signed as aforesaid, be a good and sufficient discharge as aforesaid, provided that nothing in this Clause shall be deemed to prejudice or affect any claim, which the Employer may hereafter have against the legal representatives of any Contractor's partner so dying, for or in respect of breach of any of the conditions of the Contract. Provided also that nothing contained in this clause shall be deemed to prejudice or affect the respective rights and obligations of the Contractor's partners, or of the legal heirs / representatives of any deceased Contractor / partner interest</p> <p><b>37.21 Post Payment Audit</b></p> <p>It is an agreed term of the Contract, that the Employer reserves to himself the right to carry out a post payment audit and / or technical examination of the Works, and the Final bill including all supporting vouchers, abstracts, etc., and to make a claim on the Contractor for the refund of any excess amount paid to him, if as a result of such examination, any over-payment to him is discovered to have been made in respect of any work done or alleged to have been done by the Contractor, under the Contract. If any under-payment is discovered, the same shall be paid by the Employer to the Contractor. Such payments or recoveries, however, shall not carry any interest.</p> <p><b>37.22 Recovery of money due to the Employer</b></p> <p>All damages (including, without limitation, liquidated damages), costs, charges, expenses, debts, or sums for which the Contractor is liable to the Employer under any provision of the Contract may be deducted by the Employer from amount due to the Contractor under the Contract including, without limitation, and the Employer shall have the power to recover any balance not so deducted from amount due to the Contractor under any other contract between the Employer and the Contractor</p> <p>When the Contractor has assigned to a third party the right to receive amount due, or, to become due, under the Contract to the Contractor or charged such amount in favour of a third party, the Employer's right to deduct damages (including without limitation liquidated damages), costs, charges, expenses, debts or sums for which the Contractor is liable to the Employer from amount due to the Contractor under the Contract shall be limited to the right expressed above.</p>
<p><b>Clause-38/CC</b></p>	<p><b>The clause 38 of CC is substituted with the following para.</b></p> <p><b>38.1 Compensation Event:</b></p> <p>The risks referred to in Sub-Clause 11.4/PCC below, in so far as they directly affect the execution of the works in the Country, are:</p> <p>(a) war, hostilities (whether war be declared or not), invasion, act of foreign enemies,</p>

	<ul style="list-style-type: none"> <li>(b) rebellion, terrorism, sabotage by persons other than the Contractor's Personnel, revolution, insurrection, military or usurped power, or civil war, within the Country,</li> <li>(c) riot, commotion or disorder within the Country by persons other than the Contractor's Personnel,</li> <li>(d) munitions of war, explosive materials, ionising radiation or contamination by radio-activity, within the Country, except as may be attributable to the Contractor's use of such munitions, explosives, radiation or radio-activity,</li> <li>(e) pressure waves caused by aircraft or other aerial devices travelling at sonic or supersonic speeds,</li> <li>(f) use or occupation by the Employer of any part of the Permanent Works, except as may be specified in the Contract,</li> <li>(g) design of any part of the Works by the Employer's Personnel or by others for whom the Employer is responsible.</li> </ul>
<p><b>Clause-40/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>CONTRACT PRICE</b></p> <p><b>40.1 The Contract Price</b></p> <p>Unless otherwise stated in the Special Conditions of Contract:</p> <ul style="list-style-type: none"> <li>(a) the Contract Price shall be agreed or determined under Clause 35/PCC [Payment for Variation] and be subject to adjustments in accordance with the Contract;</li> <li>(b) the Contractor shall pay all taxes, duties and fees required to be paid by him under the Contract, and the Contract Price shall not be adjusted for any of these costs except as stated in Sub-Clause 34.7/PCC [Adjustments for Changes in Legislation];</li> <li>(c) any quantities which may be set out in the Bill of Quantities or other Schedule are estimated quantities and are not to be taken as the actual and final quantities: <ul style="list-style-type: none"> <li>(i) of the Works which the Contractor is required to execute, or</li> <li>(ii) for the purposes of New-Clause 7/PCC [Measurement and Evaluation]; and</li> </ul> </li> <li>(d) the Contractor shall submit to the Engineer, within 28 days after the Commencement Date, a proposed breakdown of each lump sum price in the Schedules, if applicable. The Engineer may take account of the breakdown when preparing Payment Certificates, but shall not be bound by it.</li> <li>(e) It may be noted that in the event of the Contractor not making the due payments stated in sub-clause (b) above, and the concerned party puts up a claim with the Employer / Engineer, then the Employer / Engineer may make such payments and deduct the same from the sums due to the Contractor.</li> </ul> <p><b>Change in Law</b></p> <p>Change in Law means the occurrence or coming into force of the following, at any time after the last Date of submission of tender:</p> <p>Any new Central and State Taxes, duties, cess, levies, which is imposed or any existing Central and State Taxes, duties, cess, levies &amp; royalties are withdrawn after the due date of submission of tender and which impacts the performance of the contractor with increased cost or which results in extra financial gains to the contractor due to decreased cost in execution of contract. Such additional or reduced cost shall be certified by the Engineer after</p>

	<p>examining records provided by the contractor and shall be paid by or credited to the employer.</p> <p>However, change in the rate of any existing Central &amp; State taxes (except GST), duties, cess, levies will not be considered as change in Law. Any risk of change in rate of existing Central and State Taxes (except GST), duties, cess, levies lies with and shall be borne by the Contractor.</p>				
<p><b>Clause 42/CC</b></p>	<p><b>The following paras are added to the Existing CC Clauses.</b></p> <p><b>Advance Payment:</b></p> <p><b>42.1 Mobilization Advance</b></p> <p>The Employer shall make payment, as an Interest bearing advance for mobilization, when the Contractor submits a guarantee in accordance with this Sub-Clause. The total advance payment, the number and timing of instalments (if more than one), and the applicable currencies and proportions, shall be as stated in the Contract Data.</p> <p>Unless and until the Employer receives this guarantee, or if the total advance payment is not stated in the Contract Data, this Sub-Clause shall not apply.</p> <p>The Engineer shall issue an interim payment certificate for the first installment of mobilisation advance after receiving an application for advance payment (under sub clause 37.1/PCC [Application for Interim Payment Certificates]) and after the Employer receives (i) the Performance Security in accordance with New-Clause 4.19/PCC [Performance Security] and (ii) a guarantee in amounts and currencies equal to the advance payment plus 10%. The next installment shall be released only when the contractor submits statement of having utilized the previous installment of mobilization advance and the Employer is satisfied that the utilization has been done in purposeful manner.</p> <p>Mobilization advance payment: Comprises of the percentage of Accepted Contract Amount payable in the currencies and proportions in which the Accepted Contract Amount is payable and in installments as mentioned below;</p> <table border="1" data-bbox="427 1305 1476 1485"> <thead> <tr> <th data-bbox="427 1305 1058 1361">Mobilisation Advance</th> <th data-bbox="1061 1305 1476 1361">Installments</th> </tr> </thead> <tbody> <tr> <td data-bbox="427 1364 1058 1485">As per request of the Contractor subject to a maximum of 5%</td> <td data-bbox="1061 1364 1476 1485">Two Equal</td> </tr> </tbody> </table> <p>Timing of Mobilization Advance Payment: First Installment within 21 (Twenty-one) days from the date of receipt of Bank guarantee acceptable to Employer.</p> <p>Second Installment shall be released only when the contractor submits statement of having utilized the First Installment of mobilization Advance and the Employer is satisfied that the utilization has been done in purposeful manner. This shall be released within 21 days from the date of receipt of Bank guarantee acceptable to the Employer.</p> <p>Interest on Advance Payment: At the rate of SBI MCLR+2% simple interest per annum on reducing balances</p> <p><b>42.2 Advance against Plant and Machinery</b></p> <p>This advance is payable in Indian Rupees/respective currencies as quoted in the Tender and accepted by the Employer against plant, equipment and machinery, provided the same have reached the site, or in the case of new items meant specifically for the works,</p>	Mobilisation Advance	Installments	As per request of the Contractor subject to a maximum of 5%	Two Equal
Mobilisation Advance	Installments				
As per request of the Contractor subject to a maximum of 5%	Two Equal				



firm purchase order has been placed and the invoices received. The plant and machinery shall be valued by the Engineer as follows:

(a) New items: 80% of purchase price

(b) Used items in working order: 80% of the depreciated value as assessed by the Engineer

(c) Items valued at less than Rs. 1,000,000 (Rs. One million) per unit: Not to be considered

The total advance for Plant and Machinery shall be limited to 5% of the Contract Price and will carry an interest rate of SBI MCLR +2% simple interest per annum on reducing balances. It will be paid against submission of Bank Guarantees for 110% of advance value for each stage of advance to be given by each member of the consortium/JV in proportion to their participation as per format given in section 10: Formats, from an Indian Schedule bank (excluding Cooperative Banks) or from a schedule Foreign Bank as defined in Section 2(e) of RBI Act 1934 read with Second Schedule. All bank Guarantees should be payable in Bangalore at the designated branch.

The Contractor should give an Undertaking that "No advance/loan has been taken against the subject plant & machinery from any other individual/financial institution/ organisation etc." If a wrong/false undertaking is given, all the BGs can be forfeited and the contract is liable for termination under clause 49 of CC/PCC.

The Advance against Plant and Machinery will be paid within 30 days after receipt of the Contractor's written request by the Employer which is recommended by the Engineer and submission of Bank Guarantees for procurement of plant and machinery.

Wherever Bank Guarantee or any other instrument is to be extended or fresh BG to be obtained, the cost towards getting extension of BG or fresh BG and other incidental charges will be on Contractor's account

The Contractor;

(i) Shall submit the invoice and RC book (wherever applicable) in original, at the time of obtaining advance amount.

(ii) Shall furnish all four Bank Guarantees one time as per Condition of Contract.

(iii) Shall execute an Indemnity bond in favour of an Employer as against Third Party claim.

(iv) Shall not seek the possession of machinery brought to the site till the Advance obtained from Employer is fully settled.

The contractor should ensure that in the case of "Machinery and Equipment Advance" insurance and hypothecation in favour of the Employer should be done. The contractor should submit the proof of document related to Insurance and Hypothecation to the Engineer who will certify that the insurance and hypothecation to the Employer has been done in proper manner.

Employer shall be the sole custodian of the entire plant and machinery whenever the advance amount is given to the contractor and the same shall remain in the custody of Employer, till the Advance obtained from Employer, is fully settled.

The machinery and equipment brought to the site shall be exclusively intended for the execution of the work of Employer and shall not be removed without the consent of the Engineer.

The Contractor shall indemnify and hold harmless, the Employer against all actions, suits, proceedings, claims, damages, losses, expenses, demands pertaining to Advance amount towards plant and machinery.

The Contractor shall not remove any Equipment or Machinery from the site without the prior permission of the Engineer.

The contractor;

a) Shall not mortgage/create charge/hypothecate/encumber, in any way the machineries and equipment brought to site from the amounts advanced by Employer and shall give an undertaking in writing to that effect in favour of Employer.

b) Shall not sell or alienate any part/portion of machinery and equipment without the consent of Employer.

c) In the event of any such sale/alienation of any portion or part of machinery, Employer shall hold First Charge and the proceeds of such sale or alienation shall be appropriated towards the loan/ credit/ advance in respect of plant and machinery brought to the site by contractor.

### 42.3 Guarantees

Advances as mentioned in sub-clauses 42.1/PCC above, shall be payable against acceptable Bank Guarantees from banks as specified in New-clause 4.19/PCC. The guarantees shall be in the form as given in Section 10 (Contract Forms) or in another form approved by the Employer. The Contractor shall ensure that the guarantees are valid and enforceable until the advance amount paid as has been repaid, but its amount may be progressively reduced by the amount repaid by the Contractor as indicated in the Payment Certificates. If the terms of the guarantee specify its expiry date, and the advance payment has not been repaid by the date 28 days prior to the expiry date, the Contractor shall extend the validity of the guarantee until the advance payment has been repaid.

### 42.4 Recovery of Advances

Unless stated otherwise in the Contract Data, the advance payment shall be repaid through percentage deductions from the interim payments determined by the Engineer in accordance with Sub-Clause 37.3/PCC [Issue of Interim Payment Certificates], as follows:

- (a) deductions shall commence in the next interim Payment Certificate following that in which the total of all certified interim payments (excluding the advance payment) exceeds 15 percent of the Accepted Contract Amount Less Provisional Sums or passage of six months from the date of release of first advance payment, whichever is earlier; and

	<p>(b) deductions shall be made for accrued interest on the advance up to the month and advance at the rate stated in the Contract Data of the amount of each Interim Payment Certificate (excluding the advance payment and deductions and repayments of retention) in the currencies and proportions of the advance payment until such time as the advance payment and accrued interest has been repaid; provided that the advance payment and accrued interest shall be completely repaid prior to the time when 85 percent of the Accepted Contract Amount has been certified for payment. If the amount of interim payment certificate is not sufficient for recovery of accrued interest or in the opinion of the Employer satisfactory progress is not being achieved by the contractor, then the contractor will have to deposit the accrued interest and return the mobilisation advance in part or in full as demanded by the Employer, failing which Employer shall have the right to encash the Bank Guarantee(s)</p> <p>The contractor shall always have the option to start repayment earlier and/or to complete the repayment earlier than the due date.</p> <p>If the advance payment has not been repaid prior to the issue of the Taking-Over Certificate for the Works or prior to termination under Clause 49.0/PCC [Termination by Employer] or New-Clause 8/PCC [Force Majeure] (as the case may be), the whole of the balance then outstanding shall immediately become due and payable by the Contractor to the Employer.</p> <p><b>42.5 Repayment rate of Advance payment:</b> 10% (Ten percent) of the amount of each running account bill payment.</p> <p><b>42.6 Advances to be Used only for this Work</b></p> <p>The advances shall be used by the Contractor strictly for the purpose of the Contract, and for the purpose for which they are paid. Under no circumstances, shall the advances be diverted for other purposes. Any such diversion shall be construed as a breach of the Contract and the Contractor shall be asked to return the advance at once and pay interest at 15% per annum till the advance is recovered back from him. The Contractor shall return the advance and pay the interest in one go without demur.</p> <p>Employer retains the right for any other remedy prescribed for breach of Contract in this regard.</p> <p>The Contractor, if required by the Engineer shall provide the details of utilisation of Mobilisation advance.</p>
<p><b>Clause 46/CC</b></p>	<p><b>The clause 46 of CC replaced with the following paras.</b></p> <p><b>Employer Taking Over</b></p> <p><b>46.1 Taking Over of the Works and Sections</b></p> <p>The Employer shall take over the Site and the Works within after issuing a certificate of Completion. Except as stated in Sub-Clause 30.5/PCC [Failure to Pass Tests on Completion], the Works shall be taken over by the Employer/Railway when (i) the Works have been completed in accordance with the Contract, including the matters described in Sub-Clause 26.4/PCC [Time for Completion] and except as allowed in sub-paragraph (a) below, and (ii) a Taking-Over Certificate for the Works has been issued, or is deemed to have been issued in accordance with this Sub-Clause.</p> <p>The Contractor may apply by notice to the Engineer for a Taking-Over Certificate not earlier than 14 days before the Works will, in the Contractor's opinion, be complete and ready for</p>

taking over. If the Works are divided into Sections, the Contractor may similarly apply for a Taking-Over Certificate for each Section.

In case the works are to be taken over in accordance with sub-clause 30.6/PCC, the completed works shall be taken over by the Zonal Railway with the procedure specified by the Engineer.

The Engineer shall, within 28 days after receiving the Contractor's application:

- (a) issue the Taking-Over Certificate to the Contractor, stating the date on which the Works or Section were completed in accordance with the Contract, except for any minor outstanding work and defects which will not substantially affect the use of the Works or Section for their intended purpose (either until or whilst this work is completed and these defects are remedied); or
- (b) reject the application, giving reasons and specifying the work required to be done by the Contractor to enable the Taking-Over Certificate to be issued. The Contractor shall then complete this work before issuing a further notice under this Sub-Clause.

If the Engineer fails either to issue the Taking-Over Certificate or to reject the Contractor's application within the period of 28 days, and if the Works or Section (as the case may be) are substantially in accordance with the Contract, the Taking-Over Certificate shall be deemed to have been issued on the last day of that period.

#### **46.2 Taking Over of Parts of the Works**

The Engineer may, at the sole discretion of the Employer, issue a Taking-Over Certificate for any part of the Permanent Works.

The Employer shall not use any part of the Works (other than as a temporary measure which is either specified in the Contract or agreed by both Parties) unless and until the Engineer has issued a Taking-Over Certificate for this part. However, if the Employer does use any part of the Works before the Taking-Over Certificate is issued:

- (a) the part which is used shall be deemed to have been taken over as from the date on which it is used,
- (b) the Contractor shall cease to be liable for the care of such part as from this date, when responsibility shall pass to the Employer, and
- (c) if requested by the Contractor, the Engineer shall issue a Taking-Over Certificate for this part.

After the Engineer has issued a Taking-Over Certificate for a part of the Works, the Contractor shall be given the earliest opportunity to take such steps as may be necessary to carry out any outstanding Tests on Completion. The Contractor shall carry out these Tests on Completion as soon as practicable before the expiry date of the relevant Defects Notification Period.

If the Contractor incurs Cost as a result of the Employer taking over and/or using a part of the Works, other than such use as is specified in the Contract or agreed by the Contractor, the Contractor shall (i) give notice to the Engineer and (ii) be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to payment of any such Cost, which shall be included in the Contract Price. After receiving this notice, the Engineer shall proceed in accordance with New—Clause 3.5/PCC [Determinations] to agree or determine this Cost and profit.

If a Taking-Over Certificate has been issued for a part of the Works (other than a Section), the delay damages thereafter for completion of the remainder of the Works shall be

	<p>reduced. Similarly, the delay damages for the remainder of the Section (if any) in which this part is included shall also be reduced. For any period of delay after the date stated in this Taking-Over Certificate, the proportional reduction in these delay damages shall be calculated as the proportion which the value of the part so certified bears to the value of the Works or Section (as the case may be) as a whole. The Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these proportions. The provisions of this paragraph shall only apply to the daily rate of delay damages under Sub-Clause 26.8/PCC [Delay Damages], and shall not affect the maximum amount of these damages</p> <p><b>46.3 Interference with Tests on Completion</b></p> <p>If the Contractor is prevented, for more than 14 days, from carrying out the Tests on Completion by a cause for which the Employer/Engineer/other Contractors of the Employer, are responsible, the Employer shall be deemed to have taken over the Works or Section (as the case may be) on the date when the Tests on Completion would otherwise have been completed.</p> <p>The Engineer shall then issue a Taking-Over Certificate accordingly, and the Contractor shall carry out the Tests on Completion as soon as practicable, before the expiry date of the Defects Notification Period. The Engineer shall require the Tests on Completion to be carried out by giving 14 days' notice and in accordance with the relevant provisions of the Contract.</p> <p>If the Contractor suffers delay and/or incurs Cost as a result of this delay in carrying out the Tests on Completion, the Contractor shall give notice to the Engineer and shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:</p> <ul style="list-style-type: none"> <li>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</li> <li>(b) payment of any such Cost, which shall be included in the Contract Price.</li> </ul> <p>After receiving this notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these matters.</p> <p><b>46.4 Surfaces Requiring Reinstatement</b></p> <p>Except as otherwise stated in a Taking-Over Certificate, a certificate for a Section or part of the Works shall not be deemed to certify completion of any ground or other surfaces requiring reinstatement.</p>
<p><b>Clause-49/CC</b></p>	<p><b>The following paras are added to the existing CC Clauses.</b></p> <p><b>TERMINATION BY EMPLOYER</b></p> <p><b>49.6 Notice to Correct</b></p> <p>If the Contractor fails to carry out any obligation under the Contract as mentioned below, but not limited to the obligations mentioned herein below, the Engineer/ Employer may serve the contractor with a 14 days' notice in writing calling upon the Contractor to make good the failure and to remedy it. If the Contractor;</p> <ul style="list-style-type: none"> <li>(a) fails to comply with New-Clause 4.19/PCC [Performance Security],</li> <li>(b) abandons the Works or otherwise plainly demonstrates the intention not to continue performance of his obligations under the Contract,</li> </ul>

	<p>(c) without reasonable excuse fails to:</p> <ul style="list-style-type: none"> <li>(i) proceed with the Works in accordance with Clause 26/CC/PCC [Commencement, Delays and Suspension], or</li> <li>(ii) comply with a notice issued under New-Clause 5.5 [Rejection] or New-Clause 5.6/PCC [Remedial Work], within 28 days after receiving it, or</li> <li>(iii) adhere to the agreed programme of work / activity on the critical path, by a margin of 10% of the stipulated period, or</li> <li>(iv) take steps to deploy competent and adequate number of personnel, and equipment to achieve progress as per agreed programme or</li> <li>(v) adhere to the instructions of Engineers/Employer persistently or</li> <li>(vi) comply any provision of the contract or</li> <li>(vii) provide the Engineer/Employer or their representative proper facilities for inspecting the works or any part thereof as required, under New-Clause 5.3/PCC (Inspection) and New-clause 5.4/PCC (Testing).</li> </ul> <p>(d) subcontracts the whole or major part of the Works or assigns the Contract without prior written consent of the Employer.,</p> <p>If the Contractor does not, within 14 days of receipt of notice under this sub-clause, proceed to make good his default in so far as the same is capable of being made good and carry on the work of complying with such direction as contained in the notice under sub clause 49.6/PCC to the entire satisfaction of the Engineer/Employer, the Employer shall be entitled to take action under sub-clause 49.6/PCC, 49.7/PCC below,</p> <p>In case of Contractor's repeated failure to adhere to the agreed program, and whereas the contractor has been served with a Notice to Correct under Clause 49.6 of PCC, if the Contractor approaches K-RIDE with a revised program with specific monthly physical and financial targets along with the proposal to deploy matching inputs in the form of manpower and other resources to the satisfaction of the Employer, then the Employer may consider whether to proceed with termination of the contract under Clause 49.7/PCC or to continue with the contract. However, the request to continue with the contract shall only be considered if the Contractor supports his earnestness to adhere to the revised program by submitting additional Performance Security in the form of Bank Guarantee(s) of specified number and value as decided by the Employer (total value of which will not exceed 10% of the contract price). The encashment of these additional Bank Guarantee(s) shall be linked with the non-achievement of agreed physical/financial targets agreed upon by the Contractor and the Employer.</p> <p>In case the Contractor's failure is limited to only some of the works, and in response to Notice to Correct under Clause 49.6 of PCC, the contractor approaches the Employer that such works may be offloaded from him and got executed through another agency and additional cost incurred, if any, should be recovered from his dues, the Employer, on being convinced that the anticipated additional cost for such works will not be substantial and can be recovered from the dues of the contractor and that such offloading will help in improving the overall progress of the project, may</p> <p>agree to such offloading without any repercussion on the performance security and/or additional bank guarantees, if any, submitted by the contractor. However, the Employer will</p>
--	---

not be under any compulsion to agree to such a request. The Contractor shall be informed of the LOA issued to other agency(ies) for such works.

In case the Contractor does not approach the employer for offloading but the Employer is convinced that:

- (i) offloading of some works will help in improving the progress of the project;
- (ii) termination/part termination of the contract at this stage will not be in the interest of the project;
- (iii) the anticipated additional cost for such works will not be substantial and can be recovered from the dues of the Contractor;

The Employer may issue 7 days' notice to the Contractor stating the resources required to be deployed against each work. If the Contractor fails to deploy the required resources as indicated in the notice, the employer shall offload such works and proceed with getting the works executed through other agency(ies). The Contractor shall be informed of the LOA issued to other agency(ies) for such works.

Offloading under the sub clause 49.6/PCC shall be without any repercussion on the performance security and/or additional bank guarantees, if any, submitted by the contractor. The Contractor would have no future claim on this account and the extra expenditure so incurred, if any, by the Employer in getting the offloaded work done, shall be recovered from subsequent payment certificates or any other dues of the Contractor

#### **49.7 Termination by Employer**

The Employer shall be entitled to terminate the Contract as a whole or any part or parts (as may be specified in the Notice of Termination under any of the above Sub-Clause issue) if the Contractor:

- (a) fails to comply with the directions contained in the notice under Sub-Clause 49.6/PCC [Notice to Correct],
- (b) becomes bankrupt or insolvent, goes into liquidation, has a receiving or administration order made against it by Court or Statutory Authority him, compounds with his creditors, or carries on business under a receiver, trustee or manager for the benefit of his creditors, or if any act is done or event occurs which (under applicable Laws) has a similar effect to any of these acts or events, or
- (c) gives or offers to give (directly or indirectly) to any person any bribe, gift, gratuity, commission or other thing of value, as an inducement or reward:
  - (i) for doing or forbearing to do any action in relation to the Contract, or
  - (ii) for showing or forbearing to show favour or disfavour to any person in relation to the Contract,

or if any of the Contractor's Personnel, agents or Subcontractors gives or offers to give (directly or indirectly) to any person any such inducement or reward as is described in this sub-paragraph (c). However, lawful inducements and rewards to Contractor's Personnel shall not entitle termination

In any of these events or circumstances, the Employer may, by Notice Terminate the contract with immediate effect.

The Employer's election to terminate the Contract shall not prejudice any other rights of the Employer, under the Contract or otherwise.

The Contractor shall remove all his plants and machinery from the site then leave the Site and deliver any required Goods, all Contractors' Documents, and other design documents made by or for him, to the Engineer within 7 days from the issue of Notice of Termination, failing which Delay Damages as prescribed for delay in completion of works shall be imposed as per provision of clause 26.8/PCC However, the Contractor shall use his best efforts to comply immediately with any reasonable instructions included in the notice of Termination (i) for the assignment of any subcontract, and (ii) for the protection of life or property or for the safety of the Works.

After termination, the Employer may complete the Works and/or arrange for any other entities to do so. The Employer and these entities may then use any Goods, Contractor's Documents and other design documents made by or on behalf of the Contractor for completing the work.

#### **49.8 Valuation at Date of Termination**

As soon as practicable after a notice of termination under Sub-Clause 49.7/PCC [Termination by Employer] has taken effect, the Engineer shall proceed in accordance with Sub-Clause 3.5/PCC [Determinations] to agree or determine the value of the Works, Goods and Contractor's Documents, and any other sums due to the Contractor for work executed in accordance with the Contract. For this purpose, the contractor shall be notified the date for witnessing of measurements and handing over of the materials for which contractor has already been paid. In case the contractor fails to attend or send a representative even after such notice, the Engineer shall ex parte proceed with measurements of the works executed and taking over of plants and materials etc. for which payment has already been made to the contractor, which shall be treated as final.

#### **49.9 Payment after Termination**

After a notice of termination under Sub-Clause 49.7/PCC [Termination by Employer] has taken effect, the Employer may:

- (a) proceed in accordance with New-Clause 2.4/PCC [Employer's Claims],
- (b) encash the Performance Guarantee and forfeit the Performance Security:
  - i. In full including additional Performance Guarantee amount if any taken in terms of ITT and not due for release on the date of issue of termination letter, in case of termination of the contract as a whole; or
  - ii. in part/parts proportionate to the contract price of the bill/schedule to which the terminated part of work belongs i.e.

$P = (A \times B) \div C$  where,

P = Proportionate Bank Guarantee Amount

A = Contract Price of the particular bill/schedule to which the terminated part of work belongs

B = Performance Guarantee amount in terms of CC New- clause 4.19/PCC

C = Total Contract Price

Plus, additional Performance Guarantee amount if any taken in terms of ITT and not due for release on the date of issue of termination letter against that particular



bill/Schedule to which the terminated part of the work belongs in case of termination in part/parts.

- (c) release any payment due to the contractor for works executed prior to termination and evaluation under clause 49.8/PCC (valuation at date of termination, however, if by this time the Contractor has failed to make a payment due to the Employer, the same will be deducted from the payment due and any balance remaining shall then be paid to the Contractor.)

#### **49.10 Employer's Entitlement to Termination for Convenience**

The Employer shall be entitled to terminate the Contract, at any time for the Employer's convenience, by giving notice of such termination to the Contractor. The termination shall take effect 28 days after the later of the dates on which the Contractor receives this notice or the Employer returns the Performance Security. The Employer shall not terminate the Contract under this Sub-Clause in order to execute the Works himself or to arrange for the Works to be executed by another contractor or to avoid a termination of the Contract by the Contractor.

After this termination, the Contractor shall proceed in accordance with the relevant clause and shall be paid in accordance with New-Clause 8/PCC [Payment and Release in case of Optional Termination].

#### **49.11 Payment on Termination**

After termination under Sub-Clause-49.7/PCC the Employer shall return the Performance Security, and shall pay the Contractor an amount calculated and certified in accordance with the following conditions:

- A. The value of approved materials actually brought to the site and reasonably required to execute the works during next three months, as per approved programme, and
- B. Value of work completed up to date by the Contractor at rates specified in the Contract, after taking into account any deductions, retentions, and setoff.

#### **C. DELETED**

The payment as above are full compensation for termination under this clause and the Contractor has no claim for damages or other entitlements whether under the contract or otherwise.

In case of termination/ foreclosure of the Contract under whatsoever circumstances, any remaining tools, plants, equipment's and surplus materials of the Employer with the Contractor will be returned to the Employer at Employer's depot at the Contractor's cost. In case of the failure of the Contractor to do so, the Employer will be entitled to recover their cost from the Contractor from the amount becoming due to the Contractor or from any other amount due in any other contracts.

The decision of the Engineer of the amount to be recovered will be final decision and full credit at rates initially charged to the Contractor shall be allowed for such materials. Similarly, the Employer shall be entitled to recover the cost of the unreturned material, plants, equipment and tools from the Contractor, where such material have been supplied free of cost and plants, equipment and tools, free of cost or on lease basis to the Contractor as stipulated in the Contract.

#### **49.12 Survival**

Termination of this Contract

	<p>a. shall not relieve the Contractor or the Employer of any obligations already incurred hereunder which expressly or by implication survives Termination hereof and</p> <p>b. except as otherwise provided in any provision of this Contract expressly limiting the liability of either party, shall not relieve either party of any obligations or liabilities for loss or damage to the other Party arising out of or caused by acts or omissions of such Party prior to the effectiveness of such Termination or arising out of such Termination</p> <p><b>49.13 Corrupt or Fraudulent Practices</b></p> <p>If the Employer determines that the Contractor has engaged in corrupt, fraudulent, collusive or coercive practices, in competing for or in executing the Contract, then the Employer may, after giving 14 days' notice to the Contractor, terminate the Contractor's employment under the Contract and expel him from the Site, and the provisions of Clause 49 CC/PCC shall apply as if such expulsion had been made under Sub-Clause 49.7/PCC.</p> <p>For the purposes of this Sub-Clause:</p> <p>(a) "corrupt practice" means the offering, giving, receiving or soliciting of anything of "value to influence the action of a public official in the procurement process or in the Contract execution.</p> <p>(b) "fraudulent practice" means a misrepresentation of facts in order to influence a procurement process or the execution of the Contract to the detriment of the Employer, and includes collusive practice among Bidders (prior to or after bid submission) designed to establish bid prices at artificial non-competitive levels and to deprive the Employer of the benefits of free and open competition</p> <p>(c) "collusive practice" means a scheme or arrangement between two or more bidders, with or without the knowledge of the Employer, designed to establish bid prices at artificial, non-competitive levels.</p> <p>(d) "coercive practice" means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the procurement process or affect the execution of a contract.</p>
<p><b>Clause 1/SCC</b></p>	<p><b>The following New-paras are added to the Existing SCC Clauses.</b></p> <p><b>1.1 Engagement of Staff and Labour</b></p> <p>Except as otherwise stated in the Specification, the Contractor shall make arrangements for the engagement of all staff and labour, local or otherwise, and for their payment, housing, feeding and transport.</p> <p>The Contractor is encouraged, to the extent practicable and reasonable, to employ staff and labor with appropriate qualifications and experience from sources within the Country.</p> <p><b>1.2 Rates of Wages and Conditions of Labour</b></p> <p>The Contractor shall pay rates of wages, and observe conditions of labour, which are not lower than those established for the trade or industry where the work is carried out. If no established rates or conditions are applicable, the Contractor shall pay rates of wages and observe conditions which are not lower than the general level of wages and conditions observed locally by employers whose trade or industry is similar to that of the Contractor.</p> <p>If the Employer is obliged to provide amenities or arrange payment of wages to contract labour employed by the contractor either directly or through sub-contractor under the contract on account of failures on the part the contractor to provide the amenities and / or arrange payment of wages to the contract labour as required of him under the provision of</p>

the applicable acts / rules made there under, the Engineer/Employer shall be at liberty without prejudice to the rights of Engineer/Employer under Section 20(2) and 21(4) of the Contract Labour (Regulation and Abolition) Act 1970 to recover the whole or part of the expenditure so incurred on the wages so paid by the Engineer/Employer/Railway from the security deposit and/or from any sum or sums due to the Contractor whether under this contract or any other contract.

The Contractor shall inform the Contractor's Personnel about their liability to pay personal income taxes in the Country in respect of such of their salaries, wages, allowances, and any benefits as are subject to taxes under the Laws of the Country for the time being in force, and the Contractor shall perform such duties in regard to such deductions thereof as may be imposed on him by such Laws.

The Contractor shall keep the Employer indemnified in case any action is taken against the Employer by the competent authority on account of contravention of any of the provisions of any Act or rules made there-under, regulation or notifications including amendment. If the Employer is caused to pay or reimburse, such amounts as may be necessary to cause or observe, or for non-observance of the provisions stipulated in the notifications/bye laws/Acts/Rules/ regulations including amendments, if any, on the part of the Contractor, the Engineer/Employer shall have the right to deduct any money due to the contractor including his amount of performance security. The Employer/Engineer shall also have right to recover from the Contractor any sum required or estimated to be required for making good the loss or damage suffered by the Employer.

The employees of the Contractor and the Sub-Contractor in no case shall be treated as the employees of the Employer at any point of time.

The Contractor shall duly comply with the provisions of the Apprentices Act 1961 (III of 1961), the rules made there under and the orders that may be issued from time to time under the said Act and the said Rules and on his failure or neglect to do so he shall be subject to all liabilities provide by the said Act and said Rules.

The Contractor and his Sub Contractors shall comply with all applicable Labour Laws, and should not employ Child Labour for construction and maintenance activities. The Contractor shall provide appropriate facilities for children in Construction Camp sites.

The Contractors shall not differentiate wages between men and women for work of equal value

### **1.3 Persons in the Service of Employer**

The Contractor shall not recruit, or attempt to recruit, staff and labour from amongst persons in the service of the Employer or the Engineer

### **1.4 Labour Laws**

The Contractor shall comply with all the relevant Labour Laws applicable to the Contractor's Personnel, including Laws relating to their employment, health, safety, welfare, immigration, and emigration, and shall allow them all their legal rights. The Contractor and his sub-contractors shall be responsible to ensure at his own cost, compliance to all laws, bye-laws, rules and regulations for the time being in force pertaining to the employment of local or imported labour and shall take all necessary precautions to ensure and preserve the health and safety of all staff employed directly or through sub-contractors or petty contractors on the works which shall include all the acts listed in Appendix – 1 but not limited to the same.

The Contractor shall require his employees to obey all applicable Laws, including those concerning safety at work.

During continuance of the Contract, the Contractor and his Sub-Contractors shall abide at all times by all existing labor enactments and rules made thereunder, regulations, notifications and bye laws of the State or Central government or local authority and any other labor laws (including rules), regulations, bye laws that may be passed or notification that may be issued under any labor law in future either by the State or the Central Government or the local authority. Salient features of some of the major labor laws that are applicable to construction industry are given in Appendix 1 to these Conditions of Contract

### 1.5 Working Hours

No work shall be carried out on the Site on locally recognized days of rest, or outside the normal working hours stated in the Contract Data, unless:

- (a) otherwise stated in the Contract,
- (b) the Engineer gives consent, or
- (c) the work is unavoidable, or necessary for the protection of life or property or for the safety of the Works, in which case the Contractor shall immediately advise the Engineer.
- (d) The Contractor, generally will have to carry out work during night hours also and in shifts unless specifically provided otherwise in the Contract. No increase in rates or extra payments shall be admissible for night work. Wherever night working is carried out by Contractor, temporary lighting arrangements as per approved layout shall be provided, installed, maintained for the duration of the contract and removed after completion of work. Flashing lights to warn the traffic on roads shall be used at all times on all obstructions. No extra payment will be made for the provision of temporary lighting, flashing lights and for maintenance. It is to be noted that the works are being undertaken in an urban area.
- (e) Should there be complaints received by members of the public regarding excessive noise or vibration, etc. especially at night, and if such complaints are valid, then the contractor shall take remedial measures to prevent such nuisance. No extra payment will be made to the contractor for the provision of such measures.
- (f) Working hours during the Defect liability period will be curtailed when certain system become operational

### 1.6 Facilities for Staff and Labour

Except as otherwise stated in the Specification, the Contractor shall provide and maintain all necessary accommodation and welfare facilities for the Contractor's Personnel. The Contractor shall also provide facilities for the Employer's Personnel as stated in the Specification.

The Contractor shall not permit any of the Contractor's Personnel to maintain any temporary or permanent living quarters within the structures forming part of the Permanent Works.

### 1.7 Health and Safety

The Contractor shall at all times take all reasonable precautions to maintain the health and safety of the Contractor's Personnel. In collaboration with local health authorities, the

Contractor shall ensure that medical staff, first aid facilities, sick bay and a standing arrangement for ambulance service are available at a phone call at all times at the Site and at any accommodation for Contractor's and Employer's Personnel, and that suitable arrangements are made for all necessary welfare and hygiene requirements and for the prevention of epidemics.

In the event of any outbreak of illness of an epidemic nature, the Contractor shall comply with and carry out such regulations, orders and requirements as may be made by the Government or the local medical or sanitary authorities, for the purpose of dealing with and overcoming the same. The Contractor shall appoint an accident prevention officer at the Site, responsible for maintaining safety and protection against accidents. This person shall be qualified for this responsibility, and shall have the authority to issue instructions and take protective measures to prevent accidents. Throughout the execution of the Works, the Contractor shall provide whatever is required by this person to exercise this responsibility and authority.

The Contractor shall send, to the Engineer, details of any accident as soon as practicable after its occurrence.

**HIV-AIDS Prevention.** The Contractor shall conduct an HIV-AIDS awareness programme via an approved service provider, and shall undertake such other measures as are specified in this Contract to reduce the risk of the transfer of the HIV virus between and among the Contractor's Personnel and the local community, to promote early diagnosis and to assist affected individuals

#### **Epidemics**

In the event of any outbreak of illness of an epidemic nature, the Contractor shall comply with and carry out such regulations, orders and requirements as may be made by the Government or the local medical or sanitary authorities, for the purpose of dealing with and overcoming the same.

#### **Records of Safety and Health**

The Contractor shall maintain such records and make such reports concerning safety, health and welfare of persons and damage to property as the Engineer may from time to time prescribe.

#### **Submission of Returns**

The contractor shall be responsible for timely submission of all returns and statements to the concerned authorities in full compliance of all rules, bye-laws and regulations for the time being in force.

The Contractor shall throughout the contract (including the Defects Notification Period): (i) conduct Information, Education and Consultation Communication (IEC) campaigns, at least every other month, addressed to all the Site staff and labor (including all the Contractor's employees, all Sub-Contractors and Consultants' employees, and all truck drivers and crew making deliveries to Site for construction activities) and to the immediate local communities, concerning the risks, dangers and impact, and appropriate avoidance behavior with respect to of Sexually Transmitted Diseases (STD)—or Sexually Transmitted Infections (STI) in general and HIV/AIDS in particular; (ii) provide male or female condoms for all Site staff and labor as appropriate; and (iii) provide for STI and HIV/AIDS screening, diagnosis, counseling and referral to a dedicated national STI and HIV/AIDS program, (unless otherwise agreed) of all Site staff and labor.

The Contractor shall include in the program to be submitted for the execution of the Works under Sub-Clause 25.3 an alleviation program for Site staff and labour and their families in respect of Sexually Transmitted Infections (STI) and Sexually Transmitted Diseases (STD) including HIV/AIDS. The STI, STD and HIV/AIDS alleviation program shall indicate when, how and at what cost the Contractor plans to satisfy the requirements of this Sub-Clause and the related specification. For each component, the program shall detail the resources to be provided or utilized and any related sub-contracting proposed. The program shall also include provision of a detailed cost estimate with supporting documentation. Payment to the Contractor for preparation and implementation this program shall not exceed the Provisional Sum dedicated for this purpose.

### **1.8 Contractor's Superintendence**

Throughout the execution of the Works, and as long thereafter as is necessary to fulfil the Contractor's obligations, the Contractor shall provide all necessary superintendence to plan, arrange, direct, manage, inspect and test the work.

Superintendence shall be given by a sufficient number of persons having adequate knowledge of the language for communications (defined in Sub-Clause 3/CC [Law and Language]) and of the operations to be carried out (including the methods and techniques required, the hazards likely to be encountered and methods of preventing accidents), for the satisfactory and safe execution of the Works.

The Contractor shall employ the key personnel named in the Schedule of Personnel as referred to in the Contract Data to carry out the functions stated in the Schedule or other personnel approved by the Engineer. The Engineer will approve any proposed replacement of key personnel only if their qualifications, abilities and relevant experience are substantially equal to or better than those of the personnel listed in the Schedule.

The Contractor shall not employ any retired government Gazetted officer, who has either not completed one year after the date of retirement, or has not obtained permission to employment with the Contractor

### **1.9 Contractor's Personnel**

The Contractor's Personnel shall be appropriately qualified, skilled and experienced in their respective trades or occupations. The Engineer may require the Contractor to remove (or cause to be removed) any person employed on the Site or Works, including the Contractor's Representative if applicable, who:

- (a) persists in any misconduct or lack of care,
- (b) carries out duties incompetently or negligently,
- (c) fails to conform with any provisions of the Contract, or
- (d) persists in any conduct which is prejudicial to safety, health, or the protection of the environment.

If the Engineer asks the Contractor to remove a person who is a member of the Contractor's staff or his work force stating the reasons, the Contractor shall ensure that the person leaves the Site within seven (7) days and has no further connection with the work in the Contract. The replacement person shall be appointed within fourteen (14) days of the notification by the Engineer.

A reasonable proportion of the Contractor's Superintending Staff shall have a working knowledge of the English language or the Contractor shall have available on site at all times a sufficient number of competent interpreters to ensure the proper transmission of instructions and information. If appropriate, the Contractor shall then appoint (or cause to be appointed) a suitable replacement person

#### **1.10 Records of Contractor's Personnel and Equipment**

The Contractor shall submit, to the Engineer, details showing the number of each class of Contractor's Personnel and of each type of Contractor's Equipment on the Site. Details shall be submitted each calendar month, in a form approved by the Engineer, until the Contractor has completed all work which is known to be outstanding at the completion date stated in the Taking-Over Certificate for the Works

#### **1.11 Disorderly Conduct**

The Contractor shall at all times take all reasonable precautions to prevent any unlawful, riotous or disorderly conduct by or amongst the Contractor's Personnel, and to preserve peace and protection of persons and property on and near the Site

#### **1.12 Foreign Personnel**

The Contractor may bring in to the country any foreign personnel who are necessary for the execution of the Works to the extent allowed by the applicable Laws. The Contractor shall ensure that these personnel are provided with the required residence visas and work permits. The Employer will, without any financial liability, if requested by the Contractor, use his best endeavours in a timely and expeditious manner to assist the Contractor in obtaining any local, state, national, or government permission required for bringing in the Contractor's personnel.

The Contractor shall be responsible for the return of these personnel to the place where they were recruited or to their domicile. In the event of the death in the Country of any of these personnel or members of their families, the Contractor shall similarly be responsible for making the appropriate arrangements for their return or burial. Contractor shall also be responsible for any legal liabilities during their stay.

#### **1.13 Supply of Foodstuffs**

The Contractor shall arrange for the provision of a sufficient supply of suitable food as may be stated in the Specification at reasonable prices for the Contractor's Personnel for the purposes of or in connection with the Contract

#### **1.14 Supply of Water**

The Contractor shall, having regard to local conditions, provide on the Site an adequate supply of drinking and other water for the use of the Contractor's Personnel

#### **1.15 Measures against Insect and Pest Nuisance**

The Contractor shall at all times take the necessary precautions to protect the Contractor's Personnel employed on the Site from insect and pest nuisance, and to reduce their danger to health. The Contractor shall comply with all the regulations of the local health authorities, including use of appropriate insecticide

The Contractor shall provide his staff and labour with suitable prophylactics for the prevention of malaria, and take steps to prevent the formation of stagnant pools of water. He shall comply with all the regulations of the local health authorities in these respects and shall in particular arrange to spray thoroughly with approved insecticides all buildings

erected on the site such treatment shall be carried out at least once a year or as instructed by the Engineer. The Contractor shall warn his staff and labour of the dangers of diseases like Malaria, Filariasis and other contagious diseases etc. and also regarding, Scorpions, Snakes, Wild animals etc. and preventive actions required to be taken by the labour and staff.

#### **1.16 Alcoholic Liquor or Drugs**

The Contractor shall not, otherwise than in accordance with the Laws of the Country, import, sell, give barter or otherwise dispose of any alcoholic liquor or drugs, or permit or allow importation, sale, gift barter or disposal thereto by Contractor's Personnel.

#### **1.17 Arms and Ammunition**

The Contractor shall not give, barter, or otherwise dispose of, to any person, any arms or ammunition of any kind, or allow Contractor's Personnel to do so.

#### **1.18 Festivals and Religious Customs**

The Contractor shall respect the Country's recognized festivals, days of rest and religious or other customs

#### **1.19 Funeral Arrangements**

The Contractor shall be responsible, to the extent required by local regulations, for making any funeral arrangements for any of his local employees who may die while engaged upon the Works.

#### **1.20 Prohibition of Forced or Compulsory Labour**

The contractor shall not employ "forced or compulsory labour" in any form. "Forced or compulsory labour" consists of all work or service, not voluntarily performed, that is extracted from an individual under threat of force or penalty.

#### **1.21 Prohibition of Harmful Child Labour**

The Contractor shall not employ any child to perform any work that is economically exploitative, or is likely to be hazardous to, or to interfere with, the child's education, or to be harmful to the child's health or physical, mental, spiritual, moral, or social development.

#### **1.22 Employment Records of Workers**

The Contractor shall keep complete and accurate records of the employment of labour at the Site. The records shall include the names, ages, genders, hours worked and wages paid to all workers. These records shall be summarized on a monthly basis and shall be available for inspection by the Engineer during normal working hours. These records shall be included in the details to be submitted by the Contractor under Sub-Clause 1.10/SCC of PCC [Records of Contractor's Personnel and Equipment].

In addition to the above, the Contractor shall register his firm/company etc. on website 'www.shramikkalyan.indianrailways.gov.in' and upload requisite details of labour and their payment in this portal. These details shall be available in public domain. The Registration/ updation on Portal shall be done as under:

- (a) Contractor shall apply for onetime registration of his company/firm etc. in the Shramikkalyan portal with requisite details subsequent to issue of Letter of



	<p>Acceptance. Employer/Engineer shall approve the contractor's registration in the portal within 7 days of receipt of such request.</p> <p>(b) Contractor once approved by any Employer/Engineer, can create password with login ID (PAN No.) for subsequent use of portal for all LoAs issued in his favour.</p> <p>(c) The contractor once registered on the portal, shall provide details of his Letter of Acceptances (LoA) / Contract Agreements on shramikkalyan portal within 15 days of issue of any LoA for approval of concerned Employer/Engineer. Employer/Engineer shall update (if required) and approve the details of LoA filled by contractor within 7 days of receipt of such request.</p> <p>(d) After approval of LoA by Employer/Engineer, contractor shall fill the salient details of contract labours engaged in the contract and ensure updating of each wage payment to them on shramikkalyan portal on monthly basis.</p> <p>(e) It shall be mandatory upon the contractor to ensure correct and prompt uploading of all salient details of engaged contractual labour &amp; payments made thereof after each wage period.</p> <p>While processing payment of any 'Interim Payment Certificate' or 'Final Payment Certificate' or release of 'Advances' or 'Performance Guarantee / Security deposit', contractor shall submit a certificate to the Engineer or Engineer's representatives that "I have uploaded the correct details of contract labours engaged in connection with this contract and payments made to them during the wage period in Railway's Shramikkalyan portal at 'www.shramikkalyan.indianrailways.gov.in' till ____Month, ____Year."</p>
<b>Clause Price adjustment/ Contract data</b>	<p><b><u>REPLACE THE SUB-CLAUSE OF PRICE ADJUSTMENT IN CONTRACT DATA WITH THE FOLLOWING:</u></b></p> <p><b>PRICE VARIATION CLAUSE (PVC) - DELETED</b></p>
<b>New Clause-1.1</b>	<p><b>Assignment</b></p> <p>Neither Party shall assign the whole or any part of the Contract or any benefit or interest in or under the Contract. However, either Party:</p> <ol style="list-style-type: none"> <li>i. may assign the whole or any part with the prior agreement of the other Party, at the sole discretion of such other Party, and</li> <li>ii. may, as security in favour of a bank or financial institution, assign its right to any moneys due, or to become due, under the Contract.</li> </ol>
<b>New Clause -1.2</b>	<p><b>Care and Supply of Documents</b></p> <p>The Specification and Drawings shall be in the custody and care of the Employer. Unless otherwise stated in the Contract, two copies of the Contract and of each subsequent Drawing shall be supplied to the Contractor, who may make or request further copies at the cost of the Contractor.</p> <p>Each of the Contractor's Documents shall be in the custody and care of the Contractor, unless and until taken over by the Employer. Unless otherwise stated in the Contract, the Contractor shall supply to the Engineer six copies of each of the Contractor's Documents.</p> <p>The Contractor shall keep, on the Site, a copy of the Contract, publications named in the Specification, the Contractor's Documents (if any), the Drawings and Variations and other</p>

	<p>communications given under the Contract. The Employer's Personnel shall have the right of access to all these documents at all reasonable times.</p> <p>If a Party becomes aware of an error or defect in a document which was prepared for use in executing the Works, the Party shall promptly give notice to the other Party of such error or defect.</p>
<b>New Clause-1.3</b>	<p><b>Delayed Drawings or Instructions</b></p> <p>The Contractor shall give notice to the Engineer whenever the Works are likely to be delayed or disrupted if any necessary drawing or instruction is not issued to the Contractor within a particular time, which shall be reasonable. The notice shall include details of the necessary drawing or instruction, details of why and by when it should be issued, and details of the nature and amount of the delay or disruption likely to be suffered if it is late. If the Contractor suffers delay and/or incurs Cost as a result of a failure of the Engineer to issue the notified drawing or instruction within a time which is reasonable and is specified in the notice with supporting details, the Contractor shall give a further notice to the Engineer and shall be entitled subject to Clause 4.1/SCC of contract conditions [Contractor's Claims] to:</p> <ul style="list-style-type: none"> <li>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</li> <li>(b) payment of any such Cost, which shall be included in the Contract Price.</li> </ul> <p>After receiving this further notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these matters.</p> <p>However, if and to the extent that the Engineer's failure was caused by any error or delay by the Contractor, including an error in, or delay in the submission of, any of the Contractor's Documents, the Contractor shall not be entitled to such extension of time, Cost or profit.</p>
<b>New Clause-1.4</b>	<p><b>Employer's Use of Contractor's Documents</b></p> <p>As between the Parties, the Contractor shall retain the copyright and other intellectual property rights in the Contractor's Documents and other design documents made by (or on behalf of) the Contractor.</p> <p>The Contractor shall be deemed (by signing the Contract) to give to the Employer a non-terminable transferable non-exclusive royalty-free licence to copy, use and communicate the Contractor's Documents, including making and using modifications of them. This licence shall:</p> <ul style="list-style-type: none"> <li>(a) apply throughout the actual or intended working life (whichever is longer) of the relevant parts of the Works,</li> <li>(b) entitle any person in proper possession of the relevant part of the Works to copy, use and communicate the Contractor's Documents for the purposes of completing, operating, maintaining, altering, adjusting, repairing and demolishing the Works, and</li> <li>(c) in the case of Contractor's Documents which are in the form of computer programs and other software, permit their use on any computer on the Site and other places as envisaged by the Contract, including replacements of any computers supplied by the Contractor.</li> </ul> <p>The Contractor's Documents and other design documents made by (or on behalf of) the Contractor shall not, without the Contractor's consent, be used, copied or communicated to a third party by (or on behalf of) the Employer for purposes other than those permitted under this Sub-Clause.</p>

<b>New Clause-1.5</b>	<p><b>Contractor's Use of Employer's Documents</b></p> <p>As between the Parties, the Employer shall retain the copyright and other intellectual property rights in the Specification, the Drawings and other documents made by (or on behalf of) the Employer. The Contractor may, at his cost, copy, use, and obtain communication of these documents for the purposes of the Contract. They shall not, without the Employer's consent, be copied, used or communicated to a third party by the Contractor, except as necessary for the purposes of the Contract.</p>
<b>New Clause-1.6</b>	<p><b>Confidential Details</b></p> <p>The Contractor shall disclose all such confidential and other information as the Engineer may reasonably require in order to verify the Contractor's compliance with the Contract.</p> <p>The Contractor shall treat the details of the Contract as private and confidential, except to the extent necessary to carry out the Contractor's obligations under the Contract or to comply with applicable Laws. The Contractor shall not publish or disclose any particulars of the Works without the previous agreement of the Employer. However, the Contractor shall be permitted to disclose any publicly available information, or information otherwise required to establish his qualifications to compete for other projects.</p>
<b>New Clause-1.7</b>	<p><b>Compliance with Laws</b></p> <p>The Contractor shall, in performing the Contract, comply with applicable Laws. Unless otherwise stated in the Special Conditions of Contract:</p> <p>(a) the Employer shall have obtained (or shall obtain) the planning, zoning or similar permission for the Permanent Works, and any other permissions described in the Specification as having been (or being) obtained by the Employer; and the Employer shall indemnify and hold the Contractor harmless against and from the consequences of any failure to do so; and</p> <p>(b) the Contractor shall give all notices, pay all taxes, duties and fees, and obtain all permits, licences and approvals, as required by the Laws in relation to the execution and completion of the Works and the remedying of any defects; and the Contractor shall indemnify and hold the Employer harmless against and from the consequences of any failure to do so.</p>
<b>New Clause-1.8</b>	<p><b>Joint Venture - Joint and Several Liability</b></p> <p>If the Contractor constitutes (under applicable Laws) a joint venture of two or more persons/firms:</p> <p>(a) these persons shall be deemed to be jointly and severally liable to the Employer for the performance of the Contract;</p> <p>(b) these persons shall notify the Employer of their leader who shall have authority to bind the Contractor and each of these persons; and</p> <p>(c) the Contractor shall not alter its composition or legal status without the prior consent of the Employer.</p> <p>(d) In the event of default by any partner of joint venture, on or after achieving 25% of the financial progress (excluding advance if any) the lead partner or remaining partner(s), in case the defaulting partner is the lead partner, shall notify the Employer within twenty eight (28) days of the occurrence and within Fifty six (56) days of the said notification, the lead partner or remaining partner(s), who are not the defaulting partner, shall assign the works of the defaulting partner, to equally competent party with prior consent of the Employer. For this purpose the term "equally competent party" shall mean as under:</p>

	<p>“The new JV partner replacing the defaulting partner should meet the EQC requirement of package/combination of packages which was met by the defaulting partner on the basis of which the original tender was awarded.”</p> <p>The replacement of any defaulting partner, with the new partner shall be subject to the condition that the new partner has to submit additional performance security equal to 10% of balance cost of work of the JV partner being replaced. The performance security submitted by the defaulting partner shall also continue with K-RIDE till satisfactory completion of the work.</p> <p>(e) Notwithstanding the consent of the Employer for change in composition or legal status of the joint venture the partners shall continue to be jointly and severally liable to the Employer.</p> <p>(f) The joint venture shall enter into a joint venture agreement incorporating the provisions of sub-paras (a) to (e) based upon the form annexed to the Conditions of Contract. The JV agreement shall indicate precisely the specific role of all members of the JV in respect of planning, design, construction equipment, key personnel, work execution, and financing of the project. The authority to sign the agreement shall be evidenced by approved legal instruments.</p> <p>Notwithstanding the contents of the sub-clauses above, if the performance of any JV partner is not found satisfactory by the Employer, in respect of the responsibilities assigned to him as per JV agreement which is a part of this agreement, the Employer may issue notice of such default to the said JV partner or the JV (depending upon reasons of default) and declare the said JV partner or the JV as Poor Performer. The issue of such notice shall automatically debar the JV partner or JV as the case may be from participating in any K-RIDE tender from the date of issue of notice of default.</p>
<p><b>New Clause-1.9</b></p>	<p><b>Inspections by the Employer</b></p> <p>The Contractor shall permit the Employer and/or persons appointed by the Employer to inspect the Site and/or the Contractor’s records relating to the performance of the Contract.</p>
<p><b>New Clause-1.10</b></p>	<p><b>Bidder’s Credentials:</b></p> <p>The bidder shall submit an affidavit on a stamp paper to the effect that all the documents submitted by her along with her bid are true. This shall be mandatory all bids. The bid shall be summarily rejected if the bidder fails to submit this undertaking along with the bid.</p> <p>After opening the financial bid, the tender committee shall verify the credentials of the bidder who is declared as the lowest bidder (L1) for their authenticity. In case the credentials of L1 are not found to be in order, the bid shall be treated as technically unresponsive and thus invalid. The process shall be repeated for the next higher bidder till the valid L1 is established. If any document (or copy thereof) submitted by a bidder is found to be false/forged:</p> <p>a) The bidder/each partner/member of the bidding firm shall be liable to legal actions apart from punitive actions, as decided by competent authority of K-RIDE. In such an eventuality. The bid shall also be summarily rejected.</p> <p>b) If the contract has already been awarded, or Letter of Acceptance (LoA) has been issued and in the event of any failure to comply with the above, the contract shall be terminated, irrespective of the stage of progress in execution of the work. In such an eventuality,</p>

	<p>Security Deposit (SD), performance Guarantee (PG) and partial/full payments otherwise due to the contractor, in respect of the partial/full work executed by the contractor, shall be forfeited by the K-RIDE.</p> <p>c) Other punitive actions, like banning the bidder and partners/members of the bidding firm for future dealings with K-RIDE/Government of India/ Government of Karnataka may also be taken.</p>
	<b>2. THE EMPLOYER</b>
<b>New Clause-2.1</b>	<p><b>Permits, Licenses or Approvals</b></p> <p>The Employer shall (where he is in a position to do so) provide reasonable assistance to the Contractor at the request of the Contractor:</p> <p>(a) by obtaining copies of the Laws of the Country which are relevant to the Contract but are not readily available, and</p> <p>(b) for the Contractor's applications for any permits, licences or approvals required by the Laws of the Country:</p> <p>(i) which the Contractor is required to obtain under New-Clause 1.7/PCC [Compliance with Laws],</p> <p>(ii) for the delivery of Goods, including clearance through customs, and</p> <p>(iii) for the export of Contractor's Equipment when it is removed from the Site.</p>
<b>New Clause -2.2</b>	<p><b>Employer's Personnel</b></p> <p>The Employer shall be responsible for ensuring that the Employer's Personnel and the Employer's other contractors on the Site:</p> <p>(a) co-operate with the Contractor's efforts under New-Clause 4.24/PCC [Co-operation], and</p> <p>(b) take actions similar to those which the Contractor is required to take under sub-paragraphs (a), (b) and (c) of New-Clause 4.26/PCC [Safety Procedures] and under New-Clause 4.36/PCC [Protection of the Environment].</p>
<b>New Clause-2.3</b>	<p><b>Employer's Financial Arrangements</b></p> <p>The Employer has sourced the funds to finance the project</p> <p><b>Assignment by the Employer</b></p> <p>The Employer shall be fully entitled without the consent of the Contractor, to assign the benefit of the Contract or any part thereof and any interest therein or there under to any third party.</p>
<b>New Clause-2.4</b>	<p><b>Employer's Claims</b></p> <p>If the Employer considers himself to be entitled to any payment under any Clause of these Conditions or otherwise in connection with the Contract, and/or to any extension of the Defects Notification Period, the Employer or the Engineer shall give notice and particulars to the Contractor. However, notice is not required for payments due under New-Clause 4.37/PCC [Electricity, Water and Gas], under New-Clause 4.38/PCC [Employer's Equipment and Free-Issue Material], or for other services requested by the Contractor.</p> <p>The notice shall be given as soon as practicable after the Employer became aware, or should have become aware, of the event or circumstances giving rise to the claim. A notice relating to any extension of the Defects Notification Period shall be given before the expiry of such period.</p>

	<p>The particulars shall specify the Clause or other basis of the claim, and shall include substantiation of the amount and/or extension to which the Employer considers himself to be entitled in connection with the Contract. The Engineer shall then proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine (i) the amount (if any) which the Employer is entitled to be paid by the Contractor, and/or (ii) the extension (if any) of the Defects Notification Period in accordance with New-Clause 6.3/[PCC Extension of Defects Notification Period].</p> <p>This amount may be included as a deduction in the Contract Price and Payment Certificates. The Employer shall only be entitled to set off against or make any deduction from an amount certified in a Payment Certificate, or to otherwise claim against the Contractor, in accordance with this Sub-Clause.</p>
	<p><b>3.THE ENGINEER</b></p>
<p><b>New Clause-3.1</b></p>	<p><b>Engineer's Duties and Authority</b></p> <p>The Employer shall appoint the Engineer who shall carry out the duties assigned to him in the Contract. The Engineer's staff shall include suitably qualified engineers and other professionals who are competent to carry out these duties.</p> <p>The Engineer shall have no authority to amend the Contract.</p> <p>The Engineer may exercise the authority attributable to the Engineer as specified in or necessarily to be implied from the Contract.</p> <p>However, the Engineer shall obtain the specific approval of the Employer before taking action under the-following Sub-Clauses of these Conditions:</p> <ol style="list-style-type: none"> <li>a) New-Clause 4.30/PCC [Unforeseeable Physical Conditions] Agreeing or determining an extension of time and/or additional cost.</li> <li>b) Sub-Clause 26.5/PCC [Extension of Time for Completion] Agreeing or determining extension of time.</li> <li>c) New-Clause 6.9/PCC [Performance Certificate] Issue of Performance Certificate.</li> <li>d) Sub-Clause 34. Except,       <ol style="list-style-type: none"> <li>i) in an emergency situation as determined by the Engineer and as amplified in sub-paras (h) and (i) below, or</li> <li>ii) DELETED</li> </ol> </li> <li>e) Sub-Clause 34.3 -Variation Procedure: Approving a proposal for Variation submitted by the Contractor in accordance with Sub Clause 34.1 or 34.2.</li> <li>f) Sub-Clause 34.4 -Payment in applicable Currencies: Specifying the amount payable in each of the applicable currencies for a Variation.</li> <li>g) Clause 4.1/SCC: Contractor Claims for extension of time and/or additional payment.</li> <li>h) DELETED</li> <li>i) DELETED</li> </ol> <p>Notwithstanding the obligation, as set out above, to obtain approval, if, in the opinion of the Engineer, an emergency occurs affecting the safety of life or of the Works or of adjoining property, he may, without relieving the Contractor of any of his duties and responsibility under the Contract, instruct the Contractor to execute all such work or to do all such things as may, in</p>

	<p>the opinion of the Engineer, be necessary to abate or reduce the risk. The Contractor shall forthwith comply, despite the absence of approval of the Employer, with any such instruction of the Engineer. The Engineer shall determine an addition to the Contract Price, in respect of such instruction, in accordance with Clause 34/PCC and shall notify the Contractor accordingly, with a copy to the Employer.</p> <p>i) In case the emergency mentioned in above Sub-para occurs on account of failure of Contractor, by way of not adhering to the approved scheme of work or not taking adequate safety precautions or by any other reason attributable to the contractor, then no additional amounts shall be paid to the Contractor for attending to such emergencies and the Contractor shall be liable for Employer's claims.</p> <p>j) Clause 7/PCC regarding deployment of Sub-Contractors.</p>
<p><b>New Clause-3.2</b></p>	<p><b>Delegation by the Engineer</b></p> <p>The Engineer may from time to time assign duties and delegate authority to assistants, and may also revoke such assignment or delegation. These assistants may include a resident engineer, and/or independent inspectors appointed to inspect and/or test items of Plant and/or Materials. The assignment, delegation or revocation shall be in writing and shall not take effect until copies have been received by both Parties.</p> <p>However, unless otherwise agreed by both Parties, the Engineer shall not delegate the authority to determine any matter in accordance with New-Clause 3.5/PCC [Determinations].</p> <p>Assistants shall be suitably qualified persons, who are competent to carry out these duties and exercise this authority, and who are fluent in the language for communications defined in Sub-Clause 3/CC [Law and Language].</p> <p>Each assistant, to whom duties have been assigned or authority has been delegated, shall only be authorised to issue instructions to the Contractor to the extent defined by the delegation. Any approval, check, certificate, consent, examination, inspection, instruction, notice, proposal, request, test, or similar act by an assistant, in accordance with the delegation, shall have the same effect as though the act had been an act of the Engineer. However:</p> <p>(a) any failure to disapprove any work, Plant or Materials shall not constitute approval, and shall therefore not prejudice the right of the Engineer to reject the work, Plant or Materials;</p> <p>(b) if the Contractor questions any determination or instruction of an assistant, the Contractor may refer the matter to the Engineer, who shall promptly confirm, reverse or vary the determination or instruction.</p>
<p><b>New Clause-3.3</b></p>	<p><b>Instructions of the Engineer</b></p> <p>The Engineer may issue to the Contractor (at any time) instructions and additional or modified Drawings which may be necessary for the execution of the Works and the remedying of any defects, all in accordance with the Contract. The Contractor shall only take instructions from the Engineer, or from an assistant to whom the appropriate authority has been delegated under this Clause. If an instruction constitutes a Variation, Clause 34/PCC [Variations and Adjustments] shall apply.</p> <p>The Contractor shall comply with the instructions given by the Engineer or delegated assistant, on any matter related to the Contract. Whenever practicable, their instructions shall be given in writing. If the Engineer or a delegated assistant,</p> <p>(a) gives an oral instruction and</p>

	<p>(b) receives a written confirmation of the instruction, from (or on behalf of) the Contractor, within two working days after giving the instruction, and</p> <p>(c) does not reply by issuing a written rejection and/or instruction within two working days after receiving the confirmation,</p> <p>(d) then the confirmation shall constitute the written instruction of the Engineer or delegated assistant (as the case may be).</p>
<b>New Clause-3.4</b>	<p><b>Replacement of the Engineer</b></p> <p>Notwithstanding New-Clause 3.1/PCC, if the Employer intends to replace the Engineer, the Employer shall, not less than 21 days before the intended date of replacement, give notice to the Contractor of the name, address and relevant experience of the replacement Engineer.</p>
<b>New Clause-3.5</b>	<p><b>Determinations</b></p> <p>Whenever these Conditions provide that the Engineer shall proceed in accordance with this New-Clause 3.5/PCC to agree or determine any matter, the Engineer shall consult with each Party in an endeavour to reach agreement. If agreement is not achieved, the Engineer shall make a fair determination in accordance with the Contract, taking due regard of all relevant circumstances.</p> <p>The Engineer shall give notice to both Parties of each agreement or determination, with supporting particulars. Each Party shall give effect to each agreement or determination unless and until revised under Clause 4/SCC [Claims, Disputes and Arbitration].</p>
	<p><b>4.THE CONTRACTOR</b></p>
<b>New Clause-4.1</b>	<p><b>Contractor's General Obligations</b></p> <p>The Contractor shall design (to the extent specified in the Contract), execute and complete the Works in accordance with the Contract and with the Engineer's instructions, and shall remedy any defects in the Works.</p> <p>The Contractor shall provide the Plant and Contractor's Documents specified in the Contract, and all Contractor's Personnel, Goods, consumables and other things and services, whether of a temporary or permanent nature, required in and for this design, execution, completion and remedying of defects.</p> <p>All equipment, and material, to be incorporated in or required for the Works shall be procured from approved sources as stipulated in the Contract.</p> <ol style="list-style-type: none"> <li>i. All plants / equipment to be deployed on the work shall carry designated authority certificate. Where not specified, it shall have third party safety certificate for the safe working of the equipment and shall be renewed after every 3 months. This certificate shall be produced to the Engineer as and when required.</li> <li>ii. All the construction plant shall be provided with the experienced operators having valid license issued by the competent authority.</li> <li>iii. Any material or equipment not meeting the approval of the Engineer shall be removed from the site immediately.</li> <li>iv. All Contractor's Equipment and Temporary Works provided by the Contractor shall, when brought on to the site, be deemed to be exclusively intended for execution of the Works</li> </ol>



	<p>and not be removed without the consent in writing of the Engineer. Such consent shall not be unreasonably withheld or delayed.</p> <p>The Contractor shall be responsible for the adequacy, stability and safety of all Site operations and of all methods of construction. Except to the extent specified in the Contract, the Contractor (i) shall be responsible for all Contractors' Documents, Temporary Works, and such design of each item of Plant and Materials as is required for the item to be in accordance with the Contract, and (ii) shall not otherwise be responsible for the design or specification of the Permanent Works.</p> <p>The Contractor shall throughout the execution of the Works including the carrying out of any testing, commissioning or remedying of any defect:</p> <ol style="list-style-type: none"> <li>i. provides and maintain all lights, guards, fences and warning signs and watchmen when and where necessary or required by the Engineer or by laws or by any relevant authority for the protection of the Works and for the safety and convenience of the public and all persons on or in the vicinity of the Site; and</li> <li>ii. Contractor is required to take note of all the necessary provisions in Employer's Safety, Health and Environment Manual (SHE Manual) and the Contractor's price shall be inclusive of all the necessary costs to meet the prescribed safety standards as specified in the Special Conditions of Contract. In the case, the Contractor fails in the above; the Employer may provide the necessary arrangements and recover the costs from the Contractor</li> </ol>
<b>New Clause-4.2</b>	<p><b>Tools, Plants and Equipment Supplied by the Employer</b></p> <ol style="list-style-type: none"> <li>i. Except for any specific item mentioned in the Special Conditions of Contract or in Employer's Requirements, the Contractor shall provide all tools, plants and Equipment for the Works. In respect of such exceptional tools, plants or Equipment committed to be provided by the Employer under terms and conditions specified in the Special Conditions of Contract, the Contractor shall take all reasonable care and shall be responsible for all damages or loss caused by him, his representatives, sub-contractors or his workmen or others while they are in his charge.</li> <li>ii. No tools, plant and equipment shall be supplied by the Employer. Unless specifically incorporated in special conditions, the Contractor has to arrange all tools, plant, equipment required for the work.</li> <li>iii. On completion of the Works, the Contractor shall hand over the unused balance of the tools, plants and Equipment supplied by the Employer to the Employer back in good order and repair, fair wear and tear expected, and shall be responsible for any failure to account for the same or any damage done thereto.</li> <li>iv. The decision of the Engineer as to the amount recoverable from the Contractor on this account shall be final and binding.</li> </ol>
<b>New Clause-4.3</b>	<p><b>Employer's Materials</b></p> <p>Except for items mentioned in the Special Conditions of Contract, the Contractor shall provide all materials for the Works. Material if any, to be provided by Employer will be done only in a phased manner as per pre-approved program, against a Bank Guarantee for the value of the Material and at terms and conditions for issue, upkeep, usage, return and recovery of such Materials as specified in Special Conditions of Contract.</p>
<b>New Clause-4.4</b>	<p><b>Sheds, Stores, Yards</b></p> <p>It shall be the responsibility of the Contractor to provide at his own expense the required sheds, store houses, and yards for both Permanent and Temporary Works and provide free access to</p>

	the Engineer and the Engineer's Representative who will have right of inspection including that of instructing the Contractor to remove a particular material from the stores and not to use the same on the Works.
<b>New Clause-4.5</b>	<p><b>Temporary Works</b></p> <p>The Contractor's proposals for erection of all ancillary and temporary works shall be in conformity with the proposals submitted along with the Tender and modifications thereto as approved by Engineer.</p> <p>The Contractor shall submit drawings, supporting design calculations of Temporary works, where called for by the Engineer and other relevant details of all such works to the Engineer for approval at least one month before he desires to commence such works. Approval by the Engineer of any such proposal shall not relieve the Contractor of his responsibility for sufficiency of such works.</p> <p>All temporary works necessary for the proper execution of the Works shall be provided and maintained by the Contractor at his cost (unless otherwise provided in tender document) and subject to the consent of the Engineer shall be removed by Contractor at his own expense when they are no longer required and in such manner as the Engineer shall direct. In case the Contractor fails to remove the temporary works on completion the Engineer is authorized to get the same removed and recover the cost thereof from the Contractor.</p>
<b>New Clause-4.6</b>	<p><b>Access for Engineer</b></p> <p>The Contractor shall allow at all times the Engineer or the Engineer's assistant or any other person authorised by the Engineer access to the Site and to any place where work in connection with the Contract is being carried out or is intended to be carried out and to any place where materials or plant are being manufactured, fabricated and/or assembled for the Works. The Contractor shall ensure that sub contracts if any shall contain provisions entitling the Engineer or any person authorised by him to have such access.</p>
<b>New Clause-4.7</b>	<p><b>Access Road and Way Leave</b></p> <ol style="list-style-type: none"> <li>I. Providing access roads/ way leaves to the site will be Contractor's responsibility.</li> <li>II. The Contractor shall pay the statutory vehicle license and permit fees for use of public roads. The Contractor's heavy construction or tracked equipment shall not travel on any public road or bridge, unless the Contractor has made arrangements with the authority concerned and has obtained the approval of the Engineer to such arrangements.</li> <li>III. The Contractor shall repair any damage to the road or bear the cost thereof due to movement of contractor's plants and equipment, vehicles etc. to the specifications and satisfaction of road authorities as well as of Engineer.</li> <li>IV. The Contractor shall plan transportation of construction materials to work site in accordance with traffic regulations enforced by local traffic authorities from time to time and in such a way that congestion on the roads and road accidents are avoided. The Contractor should study this aspect thoroughly before quoting for the work.</li> </ol>
<b>New Clause-4.8</b>	<p><b>Contractor to keep Site Clear</b></p> <ol style="list-style-type: none"> <li>i. During the execution of the Works, the Contractor shall keep the Site free from all unnecessary obstruction, and shall store or dispose of any Contractor's Equipment or surplus materials. The Contractor shall clear away and remove from the Site any wreckage, rubbish or Temporary Works no longer required.</li> <li>ii. On completion of the works, the Contractor shall clear away and remove from site all Constructional Plant, surplus material and Temporary Works. He should leave the whole of the site and Works in a clean, tidy and workman like condition to the satisfaction of the Engineer.</li> </ol>

	<ul style="list-style-type: none"> <li>iii. On completion of Work the Contractor shall also clear away the labour camps, hutments and other related installations and restore the land to its original condition to the satisfaction of the Engineer within 45 days of the physical completion of Work. The cost on account of delay in return of land and reinstatement of original condition within the stipulated time as determined by Engineer will be recovered from the Contractor's dues.</li> <li>iv. All garbage shall be removed from site daily or as they accumulate. All surface and sub-soil drains shall be maintained in a clean, sound and satisfactory state of performance. No extra payment shall be made on this account.</li> <li>v. No final payment in settlement of the accounts for Works shall be made till, in addition to any other condition necessary for such final payment, site clearance and clearances of labour camps etc. shall have been effected by him. Such clearance may be made by the Engineer through any other agency at the expense of the Contractor in the event of the Contractor's failure to comply with this provision within 7 days after receiving notice to that effect from the Engineer. All expenses on such removal / clearance shall be debit able to the Contractor as loans due from the Contractor to the Employer, and the Employer shall be competent to recover the same from Contractor's on-account or final bills, or from Performance Security amount or from any other amount payable to the Contractor in any other Contract.</li> </ul>
<b>New Clause-4.9</b>	<b>Security of the Site</b> <ul style="list-style-type: none"> <li>I. The Contractor shall take all measures necessary to ensure security, including exercising control over all persons and vehicles which are employed or engaged on the Site or in connection with the Works or the other works comprising the Project and with the security arrangements applicable to any other site within the Project.</li> <li>II. The Contractor shall arrange the issue of passes for the admission of all persons and vehicles to the Site or to any part thereof and may refuse admission to or remove from the Site any person or vehicle failing to show an appropriate pass on demand to any duly authorized person.</li> <li>III. If required by the Engineer, the Contractor shall submit a list identifying all persons to whom passes have been issued together with two photographs of each person and all entities to which a pass has been issued in respect of any vehicle and shall satisfy the Engineer of the bonafides of any such person or entity.</li> <li>IV. The Contractor shall not, without the written permission of the Engineer or otherwise in accordance with the Contract, allow access to the Site to any person unless the presence on Site of such person is necessary in connection with the execution of the Works or with the discharge of the duties of any relevant authority.</li> <li>V. The Contractor shall be wholly responsible for security of site and Works. The Contractor shall follow relevant Safety and Security instructions issued by the concerned Authorities from time to time and shall work in close coordination with the concerned Authorities.</li> </ul>
<b>New Clause-4.10</b>	<b>Contractor's Operations on Site</b> <ul style="list-style-type: none"> <li>I. The Contractor shall confine his operations to the Site, and to any additional area which may be provided to the Contractor and agreed by the Engineer as working areas. The Contractor shall take all necessary precautions to keep his personnel and equipment</li> </ul>

	<p>within the Site and such additional areas, and to keep and prohibit them from encroaching on adjacent land.</p> <p>II. The Contractor, after obtaining any necessary consent from any relevant authority, shall submit to the Engineer proposals showing the layout of pedestrian routes, lighting, signs, and guarding any road opening or traffic diversion which may be required in connection with the execution of the Works and which the Contractor intends to construct. Any consent given by the Engineer to such proposals shall not relieve the Contractor of any obligation under the Contract or absolve the Contractor from any liability for or arising from such proposals or the implementation thereof.</p> <p>III. All lights provided by the Contractor shall be so placed or screened as not to interfere with signs, signals or lights. The Contractor shall not in any way obscure or affect signs, signals or lights, in use by any relevant authority. In the event that the Contractor does so, the Contractor shall pay all costs associated with the re-fitting, re-instating or provision of alternatives for any sign, signal or light, obscured or affected.</p> <p>IV. For the purposes of this Clause only, "Site" shall include off-Site places of manufacture or storage and the Contractor's Work Areas and shall include, areas provided to the Contractor by others.</p>
<b>New Clause-4.11</b>	<p><b>Publicity</b></p> <p>The Contractor shall not publish or otherwise circulate alone or in conjunction with any other person, any articles, photographs or other materials relating to the Contract, the Site, the Works, the Project or any part thereof, nor impart to the press, or any radio or television network any information relating thereto, nor allow any representative of the media access to the Site, Contractor's Works Areas, or off-Site place of manufacture, or storage except with the permission, in writing, of the Employer. The Contractor shall ensure that his sub-contractors of any tier shall be bound by a like obligation and shall, if so required by the Employer, enforce the same at his own expense. The provisions of this Sub-Clause shall not exempt the Contractor from complying with any statutory provision in regard to the taking and publication of photographs.</p>
<b>New Clause-4.12</b>	<p><b>Disclosure of Relationship</b></p> <p>If the Contractor or any partner of the Contractor or Director of the Contractor's company is closely related to any of the Officers of the Employer or the Engineer, or alternatively, if any close relative of an officer of the Employer or the Engineer has financial interest / stake in the Contractor's firm, the same shall be disclosed by the Contractor at the time of filing his tender. Any failure to disclose the interest involved, shall entitle the Employer to rescind the Contract, without payment of any compensation to the Contractor. The Contractor shall note that he is prohibited from developing such interest during the Contract period.</p>
<b>New Clause-4.13</b>	<p><b>Use Of Explosives</b></p> <p>Explosives if required on the Work shall be used by Contractor only with prior Approval of the Engineer and in the manner and to the extent permitted by him. The explosives shall be handled, stored in a special magazine to be provided at the cost of the Contractor and used under the strict supervision of persons licensed for this purpose under the requisite statutory rules and regulations. The Contractor shall take all precautions in transporting and using the explosives and avoid damage to nearby structures and utilities. The Contractor shall be responsible for taking all the precautions in the usage of the explosives at Contractor's cost, sole risk and responsibility. The Contractor shall hold the Employer harmless and indemnify for the above.</p>

<b>New Clause-4.14</b>	<p><b>In pursuance with this policy, the Employer</b></p> <p>a. Will reject the Tender for the Work or rescind the Contract, if the Employer determines that the Tenderer/Contractor has engaged in corrupt or fraudulent practices.</p> <p>b. Will declare a Tenderer/Contractor ineligible, either indefinitely or for a minimum period of 2 years from the date of identification of such prohibited conduct, to be awarded a Contract/s if the Employer at any time determines that the Contractor has engaged in corrupt or fraudulent practices in competing for, or in executing the Contract.</p>
<b>New Clause-4.15</b>	<p><b>Compensation to Contractor on rescission of Contract under this clause</b></p> <p>In the event of rescission of Contract, the Contractor shall not be entitled to any compensation whatsoever, except for the work done up to the date of rescission.</p>
<b>New Clause-4.16</b>	<p><b>Quality Assurance</b></p> <p>Unless otherwise stated in Special Conditions of Contract and/or Employer's Requirement, the Contractor shall institute a quality assurance system to demonstrate compliance with the requirements of the Contract. Such system shall be in accordance with the details stated in the Contract. Compliance with the quality assurance system shall not relieve the Contractor of his duties, obligations or responsibilities.</p> <p>Details of all procedure and compliance documents shall be submitted to the Engineer for his consent before each execution stage is commenced</p>
<b>New Clause-4.17</b>	<p><b>Work by Persons Other than Contactor</b></p> <p>I. If the Contractor shall fail to carry out any work required under the Contract or refuse to comply with any instruction or order given by the Engineer in accordance with the Contract within a reasonable time, the Engineer may give the Contractor 14 days' notice in writing to carry out such work or comply with such instruction.</p> <p>II. If the Contractor fails to comply with such notice, the Employer shall be entitled to carry out such work or instruction by his own workmen or by other contractors in whatever manner the Engineer decides, be it single Tender or limited Tender or open Tender or on entrustment basis without any right of appeal by the contractor.</p> <p>III. However, in case of emergencies/urgencies/affecting safety the period of 14 days' notice shall be 24hours notice in writing. The Classification of work as emergencies/urgencies/affecting safety is the prerogative of Engineer and his decision is final and binding on the contractor. Without prejudice to any other right or remedy, all additional expenditure properly incurred by the Employer in having such work or instruction carried out shall be recoverable by the Employer from the Contractor.</p> <p>IV. If by reason of any accident or failure or other event occurring to, in, or in connection with the Works any remedial or other work shall, in the opinion of the Engineer, be urgently necessary and the Contractor is unable or unwilling at once to do such remedial or other work, the Engineer may authorize the carrying out of such remedial or other work by a person other than the Contractor.</p> <p>V. If the remedial or other work so authorized by the Engineer is work, which, in the Engineer's opinion, the Contractor was liable to do under the Contract; all expenses properly incurred in carrying out the same shall be recoverable by the Employer from the Contractor. Provided that the Engineer shall, as soon after the occurrence of any such emergency as may be reasonably practicable, notify the Contractor thereof in writing.</p>
<b>New Clause-4.18</b>	<p><b>Confidentiality of Information</b></p> <p>I. The Contractor shall not use or divulge, except for the purpose of the Contract or with the written permission of the Employer, any information relating to the Works or the Project provided in the Contract or otherwise provided by the Employer, or the Engineer.</p>

	<p>The Contractor shall ensure that his sub-contractors of any tier shall be bound by a like confidentiality undertaking.</p> <p>II. The Employer, Engineer and any third party to whom an assignment has been made in accordance with New-clause 2.3/PCC may use any information provided by the Contractor in accordance with the Contract. The Employer shall use reasonable endeavours to ensure that the Engineer and any third party referred to in aforesaid New-clause 2.3/PCC shall not; divulge such information except for any purpose connected with the Contract.</p> <p>On completion of the works, the contractor shall arrange to furnish to the Employer two (2) bound sets of all “As Built” drawings for every component of the Works at his own cost, all such copies being on Polyester film of quality to be approved by the Engineer or his Representative. The Taking – over Certificate of the Works, as per the provisions of Clause 46.1/PCC herein, shall not be issued by the Engineer in the event of the Contractor’s failure to furnish the aforesaid “As Built” drawings for the entire works.</p> <p>If the Contract specifies that the Contractor shall design any part of the Permanent Works, then unless otherwise stated in the Special Conditions of Contract:</p> <p>(a) the Contractor shall submit to the Engineer the Contractor’s Documents for this part in accordance with the procedures specified in the Contract;</p> <p>(b) these Contractor’s Documents shall be in accordance with the Specification and Drawings, shall be written in the language for communications defined in Sub-Clause 3/CC [Law and Language], and shall include additional information required by the Engineer to add to the Drawings for co-ordination of each Party’s designs;</p> <p>(c) the Contractor shall be responsible for this part and it shall, when the Works are completed, be fit for such purposes for which the part is intended as are specified in the Contract; and</p> <p>(d) prior to the commencement of the Tests on Completion, the Contractor shall submit to the Engineer the “as-built” documents and operation and maintenance manuals in accordance with the Specification and in sufficient detail for the Employer to operate, maintain, dismantle, reassemble, adjust and repair this part of the Works. Such part shall not be considered to be completed for the purposes of taking-over under Sub-Clause 46.1/PCC [Taking Over of the Works and Sections] until these documents and manuals have been submitted to the Engineer.</p>
<p><b>New Clause-4.19</b></p>	<p><b>Performance Security:</b></p> <p>The Contractor shall obtain (at his cost) a Performance Security and an additional Performance Security, if any in terms of ITT 25.5, for proper performance of the contract, for the amount, currencies and validity period for Performance Security stated in the Contract Data. If an amount is not stated in the Contract Data, this Sub-Clause shall not apply. The Contractor shall deliver the Performance Security and additional Performance Security, if any, to the Employer within 20 days after receiving the Letter of Acceptance, and shall send a copy to the Engineer. The Performance Security/additional Performance Security shall be issued by an entity and from within a country (or other jurisdiction) approved by the Employer and shall be in the form as given in Section 10 (Formats) or in another form specifically approved by the Employer. The procedure</p>

for obtaining Performance Guarantee is outlined below: The successful bidder shall have to submit a Performance Guarantee (PG) within 20 (Twenty) days from the date of issue of Letter of Acceptance (LOA). Extension of time for submission of PG beyond 20 (Twenty) days and upto 60 days from the date of issue of LOA may be given by the Authority who is competent to sign the contract agreement. However, a penal interest of 12% per annum shall be charged for the delay beyond 20 (Twenty) days, i.e. from 21st day after the date of issue of LOA. Further, if the 60th day happens to be a declared holiday in the concerned office of the Railway, submission of PG can be accepted on the next working day. In all other cases, if the Contractor fails to submit the requisite PG even after 60 days from the date of issue of LOA, the contract is liable to be terminated. In case contract is terminated railway shall be entitled to forfeit Earnest Money Deposit and other dues payable against that contract. In case a tenderer has not submitted Earnest Money Deposit on the strength of their registration as a Startup recognized by Department for promotion of industry and internal trade (DPIIT) under Ministry of Commerce and Industry, DPIIT shall be informed to this effect. The failed Contractor shall be debarred from participating in re-tender for that work.

The Performance Security/additional Performance Security shall be, at the Contractor's option, in any of the following forms:

- (i) An unconditional Bank Guarantee in the prescribed format
- (ii) A Pay Order / Demand Draft drawn on a Scheduled / Nationalized Bank in India in favour of "Rail Infrastructure Development Company (Karnataka) Ltd" payable at Bangalore.
- (iii) FDR in favour of "Rail Infrastructure Development Company (Karnataka) Ltd." (free from any encumbrance).
- (iv) A online bank transfer to K-RIDE account.

The Bank Guarantee shall be from a bank having minimum net-worth of over INR 500 million from the specified banks as under:

- (i) a Schedule Bank in India, or
- (ii) a Foreign Bank having their operations in India, or
- (iii) a Foreign Bank which does not have operations in India is required to provide a counter-guarantee by State Bank of India,

The Scheduled Bank issuing the Bank Guarantee must be on "Structured Financial Messaging System (SFMS)" platform. A separate advice of the BG shall be invariably be sent by the issuing bank to the Employer's Bank through SFMS and only after this the BG shall become operative and acceptable to the Employer.

The Issuing Bank shall send the SFMS to:

Beneficiary: Rail Infrastructure Development Company (Karnataka) Ltd. (K-RIDE)  
 Bank Name: Canara Bank  
 Branch: Prime Corporate Branch  
 Account No. 0430201012110  
 IFSC Code: CNRB0002636.

In case the contractor is a JV;" the Performance Security/additional Performance Security, if any in terms of ITT 25.5, shall be submitted by each JV Partner separately on behalf of the JV in favour of K-RIDE in proportion of their respective percentage share specified in the JV Agreement. The additional Performance Security shall be submitted by the partner(s) responsible for execution of schedule(s) (as per JV agreement) against which additional Performance Security is required to be submitted in terms of ITT 25.5.

However, Submission of Performance Guarantee Security by individual partners on behalf of the JV shall in no way dilute their Joint & Several responsibility. The Employer shall be entitled to recover the amount of Bank Guarantees individually and / or from all the Partners jointly at its discretion."

The Contractor shall ensure that the Performance Security/additional Performance Security is valid and enforceable until the Contractor has executed and completed the Works and remedied defects, if any. If the contractor does not complete the work for any reasons whatsoever, the terms of the Performance Security/ additional Performance Security specify its expiry date, and the Contractor has not become entitled to receive the Performance Certificate by the date 28 days prior to the expiry date, the Contractor shall be bound to extend the validity of the Performance Security/additional Performance Security until the Works have been completed and any defects have been remedied.

Failure of the successful Tenderer to furnish the required Performance Security shall be a ground for the annulment of the award of Contract and execution of the Tender Securing Declaration.

Release of performance security:

- i. The whole or such portion of the Performance Security amount shall be liable to be forfeited by the Employer at the discretion of the Employer, in the event of any breach of Contract on the part of the Contractor.
- ii. After completion of the entire Work, the Performance Security shall be released to the Contractor, on issue of last Taking Over Certificate if more than one Certificate exist, by the Engineer, the release of Performance Security shall not relieve the Contractor from his obligations and liabilities, to make good that may be detected during the Defects Liability Period.

The Guarantees shall be unconditional and irrevocable. The Employer shall return the Performance Security to the Contractor within 21 days after receiving a copy of the Performance Certificate or passing of the Final Payment Certificate whichever is later. However, on completion of specified section(s) and successful passage of defect liability period for such section(s) along with execution of any leftover works at the time of completion of such section(s), the contractor shall be entitled for release of 90% of the proportionate Performance Security calculated as specified in Contract Data subject to the condition that Engineer certifies that no recoveries are pending in the contract. In case Engineer points out amount to be recovered then the contractor



shall be entitled for release of 90% of the proportionate Performance Security calculated as specified in Contract Data minus the amount to be recovered.

The Employer shall return additional Performance Security submitted in terms of ITT 25.5 as per the following;

(a) If the Contractor submits an application stating that all the works against the particular schedule(s)/bill(s) for which additional Performance Security was submitted in terms of ITT 25.5 have been completed in all respect, then the Employer, on being satisfied with the claim of the Contractor, shall return the full additional Performance Security against the particular schedule(s). Decision of the Employer regarding completion of works against a particular schedule/bill shall be final and binding on the Contractor.

(b) If the Contractor submits an application stating that majority of the works (physical progress being not less than 90%) against the particular schedule(s)/bill(s) for which additional Performance Security was submitted in terms of ITT 25.5 have been completed and execution of balance works is held up for reasons not attributable to the Contractor, then the Employer, on being satisfied with the claim of the Contractor, shall return 75% of the amount of additional Performance Security against the particular schedule(s). The balance amount of additional Performance Security shall however be returned only after completion of the works against the particular schedule(s)/bill(s) for which additional Performance Security was submitted in terms of ITT 25.5, in all respects to the satisfaction of the Employer. Decision of the Employer regarding completion of works against a particular schedule/bill shall be final and binding on the Contractor.

Without limitation to the provisions of the rest of this Sub Clause, whenever the Engineer determines an addition or a reduction to the Contract Price as a result of a change in cost and/or legislation or as a result of a Variation amounting to more than 25 percent of the portion of the Contract Price payable in a specific currency, the Contractor shall at the Engineer's request promptly submit Performance Guarantee @ 10% of the increased amount over the original contract price in a specific currency. On the other hand if the value of contract price decreases by more than 25% of the original contract price payable in a specific currency, Performance Guarantee @ 10% of the decrease in contract price from the original contract price in a specific currency shall be returned to the contractor, on his request.

Wherever the contract is terminated under Clause 49.7/PCC, the Performance Guarantee shall be encashed by the Employer:

- i) in full including additional Performance Guarantee amount, if any, taken in terms of clause 25.5 and 29 of ITT and not due for release on the date of issue of termination letter in terms of this clause, in case of termination of the contract as a whole; or
- ii) at the discretion of the Employer it may be encashed in part/parts proportionate to the Contract price of the bill/schedule to which the terminated part of work belongs  
i.e  
 $P = (A \times B) \div C$  where  
P=Proportionate Bank Guarantee Amount.  
A=Contract price of the particular bill/schedule to which the terminated part of work belongs.

	<p>B=Performance Guarantee amount in terms of CC New-clause 4.19/PCC C=Total Contract price.</p> <p>Plus additional performance Guarantee amount, if any, taken in terms of sub clause 25.5 and 29 of ITT and not due for release on the date of issue of termination letter in terms of this clause against this particular bill/schedule to which the terminated part of the work belongs, in case of termination in part/parts.</p> <p>The balance work should be got done separately, and independently by K-RIDE without risk and cost of the original contractor. The original contractor shall be debarred from participating in the tender for executing the balance work. If the failed contractor is a JV or a partnership firm, then every member/partner of such a firm would be debarred from participating in the tender for the balance work either in his/her individual capacity or as a partner of any other JV/partnership firm.</p> <p>In case the Contractor fails to perform the Contract or any JV partner fails to perform its obligations under the JV agreement, which is a part of this agreement, the Employer may issue notice of such default to the said JV partner or the JV (depending upon reasons of default) and declare the said JV partner or the JV as Poor Performer. The issue of such notice shall automatically debar the JV partner or JV, as the case may be, from participating in any K-RIDE tender from the date of issue of notice of default. The relevant performance security including additional performance security, if any, in terms of sub clauses 25.5 and 29 of ITT submitted by the Contractor or submitted on behalf of JV partner to the extent not due for release at the time of contemplation of such action shall be encashed and forfeited either fully or in proportion of the percentage share of that partner in the JV agreement, as the case may be.</p>
<p><b>New Clause-4.20</b></p>	<p><b>Security Deposit:</b> The Security Deposit shall be 5% of the contract value. Security Deposit may be deposited by the Contractor before release of first on account bill in cash or Term Deposit Receipt issued from Scheduled Bank, or may be recovered at the rate defined in this section PCC, the bill amount till the full Security Deposit is recovered. Provided also that in case of defaulting Contractor, the Employer may retain any amount due for payment to the Contractor on the pending "on account bills" so that the amounts so retained (including amount guaranteed through Performance Security) may not exceed 10% of the total value of the contract. The security deposit may be recovered at the rate 6% of bill amount till the security deposit is recovered.</p> <p>Further, in case of contracts having value equal to or more than ₹ 50 crore (Rs Fifty crore) the Security Deposit may be deposited as Bank Guarantee Bond also, issued by a scheduled bank after execution of contract documents, but before payment of 1st on account bill. Provided further that the validity of Bank Guarantee Bond shall be extended from time to time, depending upon extension of contract granted in terms Clause No 26 of PCC.</p> <p>Further, in case Security Deposit has been submitted as Term Deposit Receipt/Bank Guarantee Bond in full amount, the Bid security by Contractor with his tender will be returned by K-RIDE.</p> <p>Note: After the work is physically completed as certified by competent authority, Security Deposit recovered from the running bills of a Contractor can be returned to him, if he so desires, in lieu of Term Deposit Receipt/irrevocable Bank Guarantee for equivalent amount from Scheduled Bank, to be submitted by him.</p>

	<p>4.2.b(i) Refund of Security Deposit: Security Deposit mentioned in clause above shall be returned to the Contractor along with or after, the following:</p> <ul style="list-style-type: none"> <li>(a) Final Payment of the Contract and</li> <li>(b) Execution of Final Supplementary Agreement or Certification by Engineer that K-RIDE has No Claim on Contractor and</li> <li>(a) Maintenance Certificate issued, on expiry of the maintenance period.</li> </ul> <p>4.2.b(ii) Forfeiture of Security Deposit: Whenever the contract is rescinded as a whole under clause 49 of CC/PCC, the Security Deposit already with K-RIDE under the contract shall be forfeited. However, in case the contract is rescinded in part or parts under clause 49 of CC/PCC, the Security Deposit shall not be forfeited.</p> <p>4.2.(c) No interest shall be payable upon the Bid Security and Security Deposit or amounts payable to the Contractor under the Contract, but Government Securities deposited in terms of New-Clause 4.19/PCC of this clause will be payable with interest accrued thereon.</p>
<p><b>New Clause -4.21</b></p>	<p><b>Contractor Representative:</b></p> <p>The Contractor shall depute his Representative to attend all the review meetings notified by the Engineer.</p> <p>Facilities for and Co-ordination with Others</p> <p>The Contractor shall not impede and shall afford all necessary facilities, access and/or services to the Employer, Engineer, Designated Contractors, utility undertakings, other relevant authorities and other contractors (whether employed by the Employer or not) who are carrying out on, or in the vicinity of, the Site, works not included in the Contract but forming part of the Project:</p> <ul style="list-style-type: none"> <li>A. The Contractor shall take all reasonable steps to ensure that the Works are co-ordinated and integrated with the Design, manufacture, installation execution and testing of such other works and shall in particular (but without limitation): <ul style="list-style-type: none"> <li>(i) comply with any direction which the Engineer may give for the integration of the Design with the design of any other part of the Project;</li> <li>(ii) consult, liaise and co-operate with those responsible for carrying out such other works, including where necessary, in the preparation of the respective designs, the preparation of co-ordinated programmes, method statements, co-ordination drawings and specifications together with arrangements of service priorities and zoning;</li> </ul> </li> <li>B. The Contractor shall undertake Design co-ordination with other contractors who are carrying out works forming part of the Project as described in the Employer's Requirements. At the end of each such co-ordination period, the Contractor and the other contractor with whose works the interface period refers shall jointly state in writing that their design co-ordination activities are complete and that their respective designs are integrated and can be finalised without interference with each other's designs or the designs with which their designs have already been integrated.</li> </ul> <p>A copy of this joint written statement shall be provided to the Engineer within 7 days of the end of the said design co-ordination period. Unless and until copies of all relevant and</p>

necessary design co-ordination statements have been submitted to the Engineer, the Engineer shall be entitled to suspend any review or further review of the Contractor's or the other contractor's design submissions. Such suspension shall not be grounds for the Contractor to claim nor shall be entitled to receive an extension of time or additional payments.

- C. The Contractor shall share within the Site, staging, storage and unloading areas for the use of Designated Contractors, if any, who are undertaking civil work, fare collection system, supply, testing and commissioning of Rolling Stock, escalators, lifts, signalling and telecommunications and traction power installation works, etc. Separate locations shall be provided for each such contractor. The exact size and location of these staging, storage and unloading areas, and the commencement date shall be co-ordinated and agreed during the design interface period with each Designated Contractor.
- D. Any other contract which depends for its execution on the Contract or upon which the Contract is dependent for its own execution shall be identified by the Engineer as a "Designated Contract". The Contractor shall provide attendance on Designated Contractors in accordance with the Employer's Requirements and as instructed by the Engineer. The identity of the contractor for a Designated Contract may not be known before the execution of the Contract but this shall not be a ground for the Contractor to object to the subsequent appointment of a Designated Contractor
- E. The Contractor shall in accordance with the requirements of the Engineer co-ordinate his own Works with that of Designated Contractors through Co-ordinated Installation Programme (CIP) stated in the Employer's Requirements, or as the Engineer may require, and shall afford the Designated Contractors all reasonable opportunities for carrying out their works.
- F. The Contractor shall afford all reasonable opportunities, for carrying out their work, to other contractors employed by the Employer and their workmen respectively and the workmen of the Employer who may be engaged on or near the Site of any work, ancillary to the Works, but, not included in the Contract and shall not cause them inconvenience.
- G. If the Contractor shall suffer delay by reason of failure by any Designated Contractor to meet the specified installation interfacing and co-ordination, completion dates, which delay shall be caused otherwise than by fault of the Contractor, or, if compliance with sub-clause (f) herein shall involve the Contractor in delay beyond that which could be reasonably foreseen by an experienced contractor at the time of tender, then the Engineer shall take such delay into account in determining any extension of time to which the Contractor is entitled under the Contract.
- H. It shall be the responsibility of the Contractor to ensure that the full extent of the Works under the Contract and the works to be carried out by Designated Contractors within the Works or, in, on, under, through and over the Site are co-ordinated and integrated in their design, manufacture, installation and construction. Such responsibility shall neither be mitigated nor in any other way affected by virtue of similar responsibilities being placed on other contractors.

The Contractor shall be deemed to have made adequate allowance in the Contract Price and in the Works Programme in respect of these obligations.

If any act or omission of the Contractor whether directly or indirectly results in the delay in the execution of the works of a Designated Contractor, the Contractor, in addition to his liability in respect of liquidated damages if they become due, shall pay to the Employer, or the Engineer

	may deduct from Interim Payment Certificates such amount as the Engineer shall have certified in respect of additional payments or costs to the Designated Contractor in respect of such delay.
<b>New Clause-4.22</b>	DELETED
<b>New Clause-4.23</b>	DELETED
<b>New Clause-4.24</b>	<p><b>Co-operation</b></p> <p>The Contractor shall, as specified in the Contract or as instructed by the Engineer, allow appropriate opportunities for carrying out work to:</p> <ul style="list-style-type: none"> <li>(a) the Employer's Personnel,</li> <li>(b) any other contractors employed by the Employer, and</li> <li>(c) the personnel of any legally constituted public authorities,</li> </ul> <p>who may be employed in the execution on or near the Site of any work not included in the Contract.</p> <p>Any such instruction shall constitute a Variation if and to the extent that it causes the Contractor to incur Unforeseeable Cost. Services for these personnel and other contractors may include the use of Contractor's Equipment, Temporary Works or access arrangements which are the responsibility of the Contractor.</p> <p>If, under the Contract, the Employer is required to give to the Contractor possession of any foundation, structure, plant or means of access in accordance with Contractor's Documents, the Contractor shall submit such documents to the Engineer in the time and manner stated in the Specification.</p>
<b>New Clause-4.25</b>	<p><b>Setting Out</b></p> <p>The Contractor shall set out the Works in relation to original points, lines and levels of reference specified in the Contract or notified by the Engineer. The Contractor shall be responsible for the correct positioning of all parts of the Works, and shall rectify any error in the positions, levels, dimensions or alignment of the works, notifying the Engineer within 28 days of the date of commencement</p> <p>In the event of such discrepancy arising during the course of the work, for which Employer's documents are handed over after the date of commencement, the contractor shall seek clarifications within 14 days of receipt of such documents</p> <p>The Employer shall be responsible for any errors in these specified or notified items of reference, but the Contractor shall use reasonable efforts to verify their accuracy before they are used.</p> <p>Contractor shall promptly notify the Employer and the Engineer of any error, omission, fault, or any other defect in the design, drawing or specifications for the works, which he discovers when reviewing the Contract Documents, and in the process of execution of the Works. The contractor shall be responsible to ensure correlation in various drawings and bill of quantities, before commencement and execution of work. In case of any discrepancy the contractor shall bring it to notice of the Engineer for clarification within 28 days of the issue of Letter of Acceptance. In the event of such discrepancy arising during the course of the work, for which drawings are given after the date of issue of Letter of Acceptance, the contractor shall seek clarifications within 14 days of receipt of such drawings.</p> <p>Notwithstanding with any other provision, the Contractor shall have to pay penalty for damage to Railway cable in terms of clause C 15 of the JPO as given in para 1.2 of Chapter 1. (Safety and Security) of Section 8 and shall also indemnify the Employer against any losses, damages to property or life in terms of para 1.11 and 1.12 of the chapter 1. (Safety and Security) of Section 8.</p>

<b>New Clause-4.26</b>	<p><b>Safety Procedures-</b></p> <p>The Contractor shall follow the provisions laid down in Chapter 1. (Safety and Security) of Section 8 and shall:</p> <ol style="list-style-type: none"> <li>(a) comply with all applicable safety regulations,</li> <li>(b) take care for the safety of all persons entitled to be on the Site,</li> <li>(c) use reasonable efforts to keep the Site and Works clear of unnecessary obstruction so as to avoid danger to these persons,</li> <li>(d) provide fencing, lighting, guarding and watching of the Works until completion and taking over under Clause 46/PCC [Employer's Taking Over], and</li> <li>(e) provide any Temporary Works (including roadways, footways, guards and fences) which may be necessary, because of the execution of the Works, for the use and protection of the public and of owners and occupiers of adjacent land.</li> </ol> <p>Additional Safety Precautions</p> <ol style="list-style-type: none"> <li>(1) The Contractor shall comply with all the precautions as required for the safety of the workmen by the I.L.O Convention No.62 as far as they are applicable to the Contract. The Contractor shall provide all necessary safety appliances; such as safety goggles, helmets, masks, etc to the workmen and the staff.</li> <li>(2) Suitable scaffolds shall be provided for workmen for all work that cannot safely be done from the ground, or from solid construction except for such short period work as can be done safely from ladders. When a ladder is used, an extra labourer shall be engaged for holding the ladder and if the ladder is used for carrying materials as well, suitable foot-holds and hand-holds shall be provided on the ladder, which shall be given an inclination not steeper than 1/4 to 1 (1/4 horizontal in 1 vertical).</li> <li>(3) <b>DELETED</b></li> <li>(4) <b>DELETED</b></li> <li>(5) Every opening in the floor of a structure or in a working platform shall be provided with suitable means to prevent fall of persons or materials by providing suitable fencing or railing with a minimum height of one metre.</li> <li>(6) Safe means of access and egress shall be provided to all working platforms and other working places. Every ladder shall be securely fixed. No portable single ladder shall be over 9 metres in length. The width between side rails in a rung ladder shall in no case be less than 30 cm for ladders up to and including 3 metres in length. For longer ladders the width shall be increased at least 6 mm for each additional 30 cm of length. Spacing of steps shall be uniform and shall not exceed 30 cm.</li> <li>(7) Adequate precautions shall be taken to prevent danger from electrical equipment. Adequate safety measures shall be taken when any work is undertaken near any live highly charged electric wire. Necessary shutdown may be arranged, where and whenever essential. All rules in force in this connection shall be fully complied with. The Contractor shall ensure all precautions to prevent any accidents due to electrocution or otherwise.</li> </ol>
------------------------	---

(8) No materials on any of the sites shall be so stacked or placed as to cause danger or inconvenience to any person or the public. The Contractor shall provide all necessary fencing and lights to protect the public from accidents and shall be bound to bear the expenses of defending every suit, action or other proceedings at law that may be brought by any person for injury sustained owing to neglect of the above precautions and to pay any damages and costs which may be awarded in any such suit, action or proceedings to any such person or which may with the consent of the Contractor be paid to compromise any claim by any such person.

(9) **DELETED**

(10) Demolition : Before any demolition work is commenced and also during the process of the work :

- (a) All roads and open areas adjacent to the work site shall either be closed or suitably protected.
- (b) No electric cable or apparatus, which is liable to be a source of danger other than a cable or apparatus used by operators, shall remain electrically charged:
- (c) All practical steps shall be taken to prevent danger to persons employed by the Employer, from risk of fire or explosion, or flooding. No floor, roof or other part of a building shall be so overloaded with debris or materials as to render it unsafe.

(11) All necessary personal safety equipment as considered adequate by the Engineer shall be available for use of persons employed on the site and maintained in a condition suitable for immediate use; and the Contractor shall take adequate steps to ensure proper use of such equipment by those concerned.

- (a) Workers employed on mixing asphaltic materials, cement, lime mortars, concrete etc. shall be provided with protective footwear and protective goggles.
- (b) Those engaged in handling any material, which is injurious to the eyes, shall be provided with protective goggles.
- (c) Those engaged in welding works shall be provided with welder's protective eye-shield.
- (d) Stone breakers shall be provided with protective goggles and protective clothing and seated at sufficiently safe intervals.

(e) **DELETED**

(12) The Contractor shall not employ men below the age of 18 years and women, on the work of painting with products containing lead in any form. Whenever men above the age of 18 years are employed on the work of lead painting, the following precautions shall be taken

- (a) No paint containing lead or lead products shall be used except in the form of paste or readymade paint.

	<p>(b) Suitable face masks shall be supplied for use by workers when paint is applied in the form of spray or a surface having lead paint dry rubbed and scrapped.</p> <p>(c) Overalls shall be supplied by the Contractor to workmen and adequate facilities shall be provided to enable workers to wash during and at the close of any day's work.</p> <p>13) When work is performed near any place where there is risk of drowning all necessary equipment shall be provided and kept ready for use and all necessary steps taken for prompt first aid treatment of all injuries likely to be sustained during the course of the work.</p> <p>(14) Use of hoisting machines and tackle including their attachments, anchorage and supports shall conform to the following:</p> <p>(i) These shall be of good mechanical construction, sound material and adequate strength and free from patent defects and shall be kept in good working order, be regularly inspected and properly maintained.</p> <p>(ii) Every rope used in hoisting or lowering materials or as a means of suspension shall be of durable quality and adequate strength, and free from defects</p> <p>a) Every crane driver or hoisting appliance operator shall be properly qualified and no person under the age of 21 shall be in charge of any hoisting machine including scaffold equipment. Only trained men over the age of 21 shall be permitted to give signals to such plant and appliance operators.</p> <p>For every hoisting machine and every chain hook, shackle, swivel and pulley block used in hoisting, lowering or as means of suspension, safe working load shall be ascertained by adequate means. Every hoisting machine and all gear referred to above shall be plainly marked with safe working load. In case of a hoisting machine or a variable safe working load, each safe working load and conditions under which it is applicable shall be clearly indicated. No part of any machine or any gear referred to in the paragraph above shall be loaded beyond safe working load except for the purpose of testing.</p> <p>b) In case of the Employer's machine, safe working load shall be notified by the Engineer or his Representative. As regards Contractor's machines, the Contractor shall notify safe working load of each machine to the Engineer or his Representative, whenever he brings it to the site of work and get it verified by him.</p> <p>(15) Motors, gearing, transmission, electric wiring and other dangerous parts of hoisting appliances shall be provided with efficient safeguards; hoisting appliances shall be provided with such means as will reduce the risk of accident during descent of load to the minimum. Adequate precautions shall be taken to reduce to the minimum risk of any part of a suspended load becoming accidentally displaced. When workers are employed on electrical installations, which are already energised, insulating mats, working apparel such as gloves, sleeves and boots, as may be necessary, shall be provided. Workers shall not wear any rings, watches and carry keys or other materials which are good conductor of electricity.</p>
--	---



	<p>(16) All scaffolds, ladders and other safety devices mentioned or described herein shall be maintained in a safe condition and no scaffold, ladder or equipment shall be altered or removed while it is in use. Adequate washing facilities shall be provided at or near places of work.</p> <p>(17) These safety provisions shall be brought to the notice of all concerned by displaying on a notice board at a prominent place at the work location. Persons responsible for ensuring compliance with the Safety Code shall be named therein by the Contractor.</p> <p>(18) To ensure effective enforcement of the rules and regulations relating to safety precautions, arrangements made by the contractor shall be open to inspection by the Engineer or his Representative.</p> <p>(19) Notwithstanding anything contained in conditions (1) to (17) above, the Contractor shall at its own costs, remain liable to comply with the provisions of all acts, rules, regulations, and bylaws for the time being in force in India and applicable in this matter.</p> <p>(20) For work carried out in the vicinity of any wharf or quay, the Contractor shall abide by all the provisions of the Dock Workers (Safety, Health and Welfare) Scheme, 1961.</p> <p>(21) The Contractor shall at his own expense provide protective safety Equipment like gloves and footwear for all labour engaged on concrete mixing work and all other types of working involving the use of tar, cement, etc. to the satisfaction of the Engineer or his Representative, and on his failure to do so, the employer shall be entitled to provide the same and recover the cost from the Contractor.</p> <p>The Contractor shall be responsible for observance, by the sub-contractors, of the foregoing provisions.</p> <p>(23) All construction labour at all-time shall use personal protective equipment like, safety shoes, helmets and reflective jackets in all activities at site. This shall be ensured without fail on each work site. Failing to comply with this, provision shall attract penalty of Rs. 500/- per occasion per staff.</p> <p>Notwithstanding with any other provision, the Contractor shall have to pay penalty for damage to Railway cable in terms of clause C 15 of the JPO as given in para 1.2 of Chapter 1. (Safety and Security) of Section 8 and shall also indemnify the Employer against any losses, damages to property or life in terms of para 1.11 and 1.12 of the chapter 1. (Safety and Security) of Section 8).</p>
<p><b>New Clause-4.27</b></p>	<p><b>Quality Assurance</b></p> <p>The Contractor shall institute a quality assurance system to demonstrate compliance with the requirements of the Contract. The system shall be in accordance with the details stated in the Contract. The Engineer shall be entitled to audit any aspect of the system.</p> <p>Details of all procedures and compliance documents shall be submitted to the Engineer for information before each design and execution stage is commenced. When any document of a technical nature is issued to the Engineer, evidence of the prior approval by the Contractor himself shall be apparent on the document itself.</p> <p>Compliance with the quality assurance system shall not relieve the Contractor of any of his duties, obligations or responsibilities under the Contract.</p> <p><b>Quality Control</b></p> <p>Within 28 days of the issue of the Letter of acceptance, the Contractor shall submit to the</p>

	<p>Engineer, for his consent, his proposed Site Quality Plan based on the Outline Quality Plan and the Employer's Requirements. The quality manual should address the quality system as required by ISO 9001-1991. Any supplement to the Site Quality Plan shall be submitted at least 14 days before commencement of the relevant work.</p> <p>Upon the Engineer notifying his consent to the Site Quality Plan, or any supplement thereto, the Contractor shall, adhere to the principles and procedures contained in such document, except where the Engineer gives his consent to any amended or varied version thereof. The Contractor shall cause any sub-contractors to adhere to this Plan.</p> <p>The Contractor shall appoint a suitably qualified and experienced person, not otherwise engaged in the performance of the Contract, to act as manager of the quality assurance system and shall provide such other personnel and resources as required to ensure effective operation of the quality assurance system. The said manager shall carry out audits of the application of the quality assurance system, and ensure effective quality control and delivery of quality assurance.</p> <p>The Contractor shall provide all necessary access, assistance and facilities to enable the Engineer to carry out surveillance visits both on and off the Site to verify that the quality assurance system is being properly and fully implemented. No extra payment shall be made in this regard and the cost of the Work under this element shall be deemed to be included in the Contract Price.</p>
<p><b>New Clause-4.28</b></p>	<p><b>Site Data</b></p> <p>The Employer shall have made available to the Contractor for his information, prior to the Base Date, all relevant data in the Employer's possession on sub-surface and hydrological conditions at the Site, including environmental aspects. The Employer shall similarly make available to the Contractor all such data which come into the Employer's possession after the Base Date. The Contractor shall be responsible for interpreting all such data.</p> <p>To the extent which was practicable (taking account of cost and time), the Contractor shall be deemed to have obtained all necessary information as to risks, contingencies and other circumstances which may influence or affect the Bid or Works. To the same extent, the Contractor shall be deemed to have inspected and examined the Site, its surroundings, the above data and other available information, and to have been satisfied before submitting the Bid as to all relevant matters, including (without limitation):</p> <ul style="list-style-type: none"> <li>(a) the form and nature of the Site, including sub-surface conditions,</li> <li>(b) the hydrological and climatic conditions,</li> <li>(c) the extent and nature of the work and Goods necessary for the execution and completion of the Works and the remedying of any defects,</li> <li>(d) the Laws, procedures and labour practices of the Country, and</li> <li>(e) the Contractor's requirements for access, accommodation, facilities, personnel, power, transport, water and other services.</li> <li>(f) Data made available by the Employer in accordance with the preceding paragraph shall be deemed to include data listed elsewhere in the contract as open for inspection at the address stipulated in the Contract.</li> </ul>
<p><b>New Clause-4.29</b></p>	<p><b>Sufficiency of the Accepted Contract Amount</b></p> <p>The Contractor shall be deemed to:</p>

	<p>a) have satisfied himself as to the correctness and sufficiency of the Accepted Contract Amount, and</p> <p>b) have based the Accepted Contract Amount on the data, interpretations, necessary information, inspections, examinations and satisfaction as to all relevant matters referred to in New-Clause 4.28/PCC [Site Data].</p> <p>Unless otherwise stated in the Contract, the Accepted Contract Amount covers all the Contractor's obligations under the Contract (including those under Provisional Sums, if any) and all things necessary for the proper execution and completion of the Works and the remedying of any defects.</p>
<p><b>New Clause-4.30</b></p>	<p><b>Unforeseeable Physical Conditions</b></p> <p>In this Sub-Clause, "physical conditions" means natural physical conditions and man-made and other physical obstructions and pollutants, which the Contractor encounters at the Site when executing the Works, including sub-surface and hydrological conditions but excluding climatic conditions.</p> <p>If the Contractor encounters adverse physical conditions which he considers to have been Unforeseeable, the Contractor shall give notice to the Engineer as soon as practicable.</p> <p>This notice shall describe the physical conditions, so that they can be inspected by the Engineer, and shall set out the reasons why the Contractor considers them to be Unforeseeable. The Contractor shall continue executing the Works, using such proper and reasonable measures as are appropriate for the physical conditions, and shall comply with any instructions which the Engineer may give. If an instruction constitutes a Variation, Clause 34/PCC [Variations and Adjustments] shall apply.</p> <p>If and to the extent that the Contractor encounters physical conditions which are Unforeseeable, gives such a notice, and suffers delay and/or incurs Cost due to these conditions, the Contractor shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:</p> <ul style="list-style-type: none"> <li>(a) An extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</li> <li>(b) Payment of any such Cost, which shall be included in the Contract Price.</li> </ul> <p>After receiving such notice and inspecting and/or investigating these physical conditions, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine (i) whether and (if so) to what extent these physical conditions were Unforeseeable, and (ii) the matters described in sub-paragraphs (a) and (b) above related to this extent.</p> <p>However, before additional Cost is finally agreed or determined under sub-paragraph (ii), the Engineer may also review whether other physical conditions in similar parts of the Works (if any) were more favourable than could reasonably have been foreseen when the Contractor submitted the Bid. If and to the extent that these more favourable conditions were encountered, the Engineer may proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine the reductions in Cost which were due to these conditions, which may be included (as deductions) in the Contract Price and Payment Certificates. However, the net effect of all adjustments under sub-paragraph (b) and all these reductions, for all the physical conditions encountered in similar parts of the Works, shall not result in a net reduction in the Contract Price.</p>

	<p>The Engineer may take account of any evidence of the physical conditions foreseen by the Contractor when submitting the Bid, which may be made available by the Contractor, but shall not be bound by any such evidence.</p>
<b>New Clause-4.31</b>	<p><b>Rights of Way and Facilities</b></p> <p>The Contractor shall bear all costs and charges for special and/or temporary rights-of-way which he may require, including those for access to the Site. The Contractor shall also obtain, at his risk and cost, any additional facilities outside the Site which he may require for the purposes of the Works.</p> <p>In case any operation connected with traffic necessitates diversion, obstruction or closure of any road, railway or any other right of way, the approval of the Engineer and the concerned authorities shall be obtained well in advance by the Contractor.</p> <p>Provided that if it is found necessary for the Contractor to move one or more loads of heavy constructional plants and equipment, materials or pre-constructed units or parts of units of work over roads, highways, bridges on which such oversized and overweight items that are not normally to be moved, the contractor shall obtain prior permission from the concerned authorities.</p> <p>Payments for complying with the requirements, if any, for protection or strengthening of the roads, highways or bridges shall be made by the contractor and such expenses shall be deemed to be included in his quoted contract price.</p>
<b>New Clause-4.32</b>	<p><b>Avoidance of Interference</b></p> <p>The Contractor shall not interfere unnecessarily or improperly with:</p> <ol style="list-style-type: none"> <li>the convenience of the public, or</li> <li>the access to and use and occupation of all roads and footpaths, irrespective of whether they are public or in the possession of the Employer or of others or</li> <li>Passenger amenities at stations and station platforms.</li> </ol> <p>The Contractor shall indemnify and hold the Employer harmless against and from all damages, losses and expenses (including legal fees and expenses) resulting from any such unnecessary or improper interference.</p>
<b>New Clause-4.33</b>	<p><b>Access Route</b></p> <p>The Contractor shall be deemed to have been satisfied as to the suitability and availability of access routes to the Site. The Contractor shall use reasonable efforts to prevent any road or bridge from being damaged by the Contractor's traffic or by the Contractor's Personnel. These efforts shall include the proper use of appropriate vehicles and routes.</p> <p>Except as otherwise stated in these Conditions:</p> <ol style="list-style-type: none"> <li>the Contractor shall (as between the Parties) be responsible for any maintenance which may be required for his use of access routes;</li> <li>the Contractor shall provide all necessary signs or directions along access routes, and shall obtain any permission which may be required from the relevant authorities for his use of routes, signs and directions;</li> <li>the Employer shall not be responsible for any claims which may arise from the use or otherwise of any access route;</li> </ol>

	<p>(d) the Employer does not guarantee the suitability or availability of particular access routes; and</p> <p>(e) Costs due to non-suitability or non-availability, for the use required by the Contractor, of access routes shall be borne by the Contractor.</p>
<p><b>New Clause-4.34</b></p>	<p><b>Transport of Goods</b></p> <p>Unless otherwise stated in the Special Conditions of Contract:</p> <p>(a) the Contractor shall give the Engineer not less than 21 days' notice of the date on which any Plant or a major item of other Goods will be delivered to the Site;</p> <p>(b) the Contractor shall be responsible for packing, loading, transporting, receiving, unloading, storing and protecting all Goods and other things required for the Works; and</p> <p>(c) the Contractor shall indemnify and hold the Employer harmless against and from all damages, losses and expenses (including legal fees and expenses) resulting from the transport of Goods, and shall negotiate and pay all claims arising from their transport.</p>
<p><b>New Clause-4.35</b></p>	<p><b>Contractor's Equipment</b></p> <p>The Contractor shall be responsible for all Contractors' Equipment. When brought on to the Site, Contractor's Equipment shall be deemed to be exclusively intended for the execution of the Works. The Contractor shall not remove from the Site any major items of Contractor's Equipment without the consent of the Engineer. However, consent shall not be required for vehicles transporting Goods or Contractor's Personnel off Site</p> <p>In the event of Contractor imports any equipment the following shall apply”</p> <p>A. <b>Custom Clearance:</b> The Employer will assist the contractor, when required by furnishing letters of recommendation for obtaining expeditious clearance through customs of constructional plants, material and other things required for the works and then for re-export, if any. The following publications, may be referred to by the contractor for guidance about custom regulations etc :</p> <ol style="list-style-type: none"> <li>i. Import &amp; export policy, together with amendments, if any, published by Govt. of India, Ministry of Commerce..</li> <li>ii. Hand Book of Procedures, together with amendments, if any, Volume 1 and 2 published by Ministry of Commerce.</li> <li>iii. Customs Tariff, together with amendments, if any published by Central Customs.</li> </ol> <p>The Contractor shall be responsible to follow the latest rules and regulations without any liability of the Employer.</p> <p>B. <b>Re-export of contractors equipment:</b> The contractor shall obtain all the relevant information regarding procedure for the import and subsequent re-export of his equipment and materials from the Chief Controller of Imports and Exports, Bangalore, and shall inform himself and keep himself informed on the details of custom charges and draw-back regulations as applicable to the items of Constructional plant. The contractor shall provide the necessary guarantee/bonds where these are required by the customs notwithstanding that import licenses may be granted in the name of Employer.</p> <p>C. Notwithstanding the provisions mentioned above, Contractor's Equipment, including essential spare parts therefore, imported by the Contractor for the sole purpose of executing the Contract shall be temporarily exempt from the payment of import duties and taxes upon initial importation, provided the Contractor shall post with the customs authorities at the port of entry an approved export bond or bank guarantee, valid until the Time for Completion</p>

	<p>plus six months, in an amount equal to the full import duties and taxes which would be payable on the assessed imported value of such Contractor's Equipment and spare parts, and <b>callable</b> in the event the Contractor's Equipment is not exported from the Country on completion of the Contract. A copy of the <b>bond</b> or bank guarantee endorsed by the custom authorities shall be provided by the Contractor to the Employer upon the importation of individual items of Contractor's Equipment and spare parts. Upon export of individual items of Contractor's Equipment or spare parts, or upon the completion of the Contract, Contractor shall prepare for approval by the customs authority the authorities, an assessment of the residual value of the Contractor's Equipment and spare parts to be exported based on the depreciation scale(s) and other criteria used by the customs authorities for such purposes under the provisions of the applicable Laws. Import duties and taxes shall be due and payable to the customs authorities by the Contractor on (a) the difference between the initial imported value and the residual value of the contractor's equipment and spare parts to be exported and (b) on the initial imported value that contractor's equipment and spare parts remaining in the Country after completion of the Contract. Upon payment of such dues within 28 days of being invoiced, the bond or bank guarantee shall be reduced or released accordingly; otherwise the security shall be called in the full amount remaining in the Country.</p> <p>D. Conditions of hire of the contractor's equipment: A certified copy of the agreement in respect of any item of Equipment held by contractor under any agreement for hire or hire purchase thereof, shall be supplied to the Engineer/Employer."</p>
<p><b>New Clause-4.36</b></p>	<p><b>Protection of the Environment</b></p> <p>The Contractor shall take all reasonable steps to protect the environment (both on and off the Site) and to limit damage and nuisance to people and property resulting from pollution, noise and other results of his operations.</p> <p>The Contractor shall ensure that emissions, surface discharges and effluent from the Contractor's activities shall not exceed the values stated in the Specification or prescribed by applicable Laws.</p>
<p><b>New Clause-4.37</b></p>	<p><b>Electricity, Water and Gas</b></p> <p>The Contractor shall, except as stated below, be responsible for the provision of all power, water and other services he may require.</p> <p>The Contractor shall be entitled to use for the purposes of the Works such supplies of electricity, water, gas and other services as may be available on the Site and of which details and prices are given in the Specification. The Contractor shall, at his risk and cost, provide any apparatus necessary for his use of these services and for measuring the quantities consumed.</p> <p>The quantities consumed and the amounts due (at these prices) for such services shall be agreed or determined by the Engineer in accordance with New-Clause 2.4/PCC [Employer's Claims] and New-Clause 3.5/PCC [Determinations]. The Contractor shall pay these amounts to the Employer.</p>
<p><b>New Clause-4.38</b></p>	<p><b>Employer's, Equipment and Free-Issue Material</b></p> <p>The Employer shall make the Employer's Equipment (if any) available for the use of the Contractor in the execution of the Works in accordance with the details, arrangements and prices stated in the Specification. Unless otherwise stated in the Specification:</p> <p>(a) the Employer shall be responsible for the Employer's Equipment, except that</p>

	<p>(b) the Contractor shall be responsible for each item of Employer's Equipment whilst any of the Contractor's Personnel is operating it, driving it, directing it or in possession or control of it.</p> <p>The appropriate quantities and the amounts due (at such stated prices) for the use of Employer's Equipment shall be agreed or determined by the Engineer in accordance with New-Clause 2.4/PCC [Employer's Claims] and New-Clause 3.5/PCC [Determinations]. The Contractor shall pay these amounts to the Employer.</p> <p>The Employer shall supply, free of charge, the "free-issue materials" (if any) in accordance with the details stated in the Contract data.</p> <p>The Employer shall, at his risk and cost, provide these materials at the time and place specified in the Contract. The Contractor shall then visually inspect them, and shall promptly give notice to the Engineer of any shortage, defect or default in these materials. Unless otherwise agreed by both Parties, the Employer shall immediately rectify the notified shortage, defect or default.</p> <p>In case materials are handed over, in accordance with the procedure prescribed by the Engineer, after proper measurement and accounted for, the contractor shall be solely liable for any shortage, damage, defect or default in such material, and shall indemnify the Employer until the final account of materials is made by the Contractor on completion of the work.</p>
<p><b>New Clause-4.39</b></p>	<p><b>Progress Reports</b></p> <p>Unless otherwise stated in the Special Conditions of Contract, monthly progress reports shall be prepared by the Contractor and submitted to the Engineer in six copies. The first report shall cover the period up to the end of the first calendar month following the Commencement Date. Reports shall be submitted monthly thereafter, each within 7 days after the last day of the period to which it relates.</p> <p>Reporting shall continue until the Contractor has completed all work which is known to be outstanding at the completion date stated in the Taking-Over Certificate for the Works.</p> <p>Each report shall include:</p> <p>Charts and detailed descriptions of progress, including each stage of design (if any), Contractor's Documents, procurement, manufacture, delivery to Site, construction, erection and testing; and including these stages for work by each nominated Subcontractor (as defined in Clause 7/PCC (Nominated Subcontractors)),</p> <p>photographs showing the status of manufacture and of progress on the Site; for the manufacture of each main item of Plant and Materials, the name of the manufacturer, manufacture location, percentage progress, and the actual or expected dates of:</p> <ul style="list-style-type: none"> <li>(i) commencement of manufacture,</li> <li>(ii) Contractor's inspections,</li> <li>(iii) tests, and</li> <li>(iv) shipment and arrival at the Site;</li> </ul> <p>the details described in Sub-Clause 1.10/SCC of PCC [Records of Contractor's Personnel and Equipment];</p> <ul style="list-style-type: none"> <li>a) copies of quality assurance documents, test results and certificates of Materials;</li> <li>b) list of notices given under New-Clause 2.4/PCC [Employer's Claims] and notices given under Sub-Clause 4.1/SCC [Contractor's Claims];</li> </ul>

	<p>c) safety statistics, including details of any hazardous incidents and activities relating to environmental aspects and public relations; and</p> <p>d) Comparisons of actual and planned progress of all activities, with details of any events or circumstances which may jeopardise the completion in accordance with the Contract, and the measures being (or to be) adopted to overcome delays.</p>
<b>New Clause-4.40</b>	<p><b>Security of the Site</b></p> <p>Unless otherwise stated in the Special Conditions of Contract:</p> <p>(a) the Contractor shall be responsible for keeping unauthorised persons off the Site, and</p> <p>(b) authorised persons shall be limited to the Contractor's Personnel and the Employer's Personnel; and to any other personnel notified to the Contractor, by the Employer or the Engineer, as authorised personnel of the Employer's other contractors on the Site.</p>
<b>New Clause-4.41</b>	<p><b>Contractor's Operations on Site</b></p> <p>The Contractor shall confine his operations to the Site, and to any additional areas which may be obtained by the Contractor and agreed by the Engineer as working areas. The Contractor shall take all necessary precautions to keep Contractor's Equipment and Contractor's Personnel within the Site and these additional areas, and to keep them off adjacent land.</p> <p>During the execution of the Works, the Contractor shall keep the Site free from all unnecessary obstruction, and shall store or dispose of any Contractor's Equipment or surplus materials. The Contractor shall clear away and remove from the Site any wreckage, rubbish and Temporary Works which are no longer required.</p> <p>Upon the issue of a Taking-Over Certificate, the Contractor shall clear away and remove, from that part of the Site and Works to which the Taking-Over Certificate refers, all Contractor's Equipment, surplus material, wreckage, rubbish and Temporary Works. The Contractor shall leave that part of the Site and the Works in a clean and safe condition.</p> <p>However, the Contractor may retain on Site, during the Defects Notification Period, such Goods as are required for the Contractor to fulfill obligations under the Contract.</p>
<b>New Clause-4.42</b>	<p><b>Design – General Obligations:</b></p> <p><b>Drawings for Permanent works: - DELETED</b></p> <p><b>Design, Drawings and Specifications:</b></p> <p>The Contractor shall Design the proposed track crossing, shifting/modification of LT/HT OH line etc., required to perform their work and shall get the same and related working drawings approved by the Engineer. The Contractor would supply 2 sets of these drawings to the Engineer for the latter's use. The contractor would supply 5 sets of As Erected drawings to the Engineer after final adjustment.</p> <p><b>Shop Drawings - DELETED</b></p>
<b>New Clause-4.43</b>	<p><b>Fossils</b></p> <p>All fossils, coins, articles of value or antiquity, and structures and other remains or items of geological or archaeological interest found on the Site shall be placed under the care and authority of the Employer. The Contractor shall take reasonable precautions to prevent Contractor's Personnel or other persons from removing or damaging any of these findings.</p> <p>The Contractor shall, upon discovery of any such finding, promptly give notice to the Engineer, who shall issue instructions for dealing with it. If the Contractor suffers delay and/or incurs Cost</p>



	<p>from complying with the instructions, the Contractor shall give a further notice to the Engineer and shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:</p> <p>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</p> <p>(b) payment of any such Cost, which shall be included in the Contract Price.</p> <p>After receiving this further notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine these matters.</p>
	<b>5. PLANT, MATERIALS AND WORKMANSHIP.</b>
<b>New Clause-5.1</b>	<p><b>Manner of Execution</b></p> <p>The Contractor shall carry out the manufacture of Plant, the production and manufacture of Materials, and all other execution of the Works:</p> <p>(a) in the manner (if any) specified in the Contract,</p> <p>(b) in a proper workmanlike and careful manner, in accordance with recognised good practice, and</p> <p>(c) with properly equipped facilities and non-hazardous Materials, except as otherwise specified in the Contract.</p>
<b>New Clause-5.2</b>	<p><b>Samples</b></p> <p>The Contractor shall submit the following samples of Materials, and relevant information, to the Engineer for consent prior to using the Materials in or for the Works:</p> <p>(a) manufacturer's standard samples of Materials and samples specified in the Contract, all at the Contractor's cost, and</p> <p>(b) additional samples instructed by the Engineer as a Variation.</p> <p>Each sample shall be labelled as to origin and intended use in the Works.</p>
<b>New Clause-5.3</b>	<p><b>Inspection</b></p> <p>The Employer's Personnel shall at all reasonable times:</p> <p>(a) have full access to all parts of the Site and to all places from which natural Materials are being obtained, and</p> <p>(b) during production, manufacture and construction (at the Site and elsewhere), be entitled to examine, inspect, measure and test the materials and workmanship, and to check the progress of manufacture of Plant and production and manufacture of Materials.</p> <p>The Contractor shall give the Employer's Personnel full opportunity to carry out these activities, including providing access, facilities, permissions and safety equipment. No such activity shall relieve the Contractor from any obligation or responsibility.</p> <p>The Contractor shall give notice to the Engineer whenever any work is ready and before it is covered up, put out of sight, or packaged for storage or transport. The Engineer shall then either carry out the examination, inspection, measurement or testing without unreasonable delay, or promptly give notice to the Contractor that the Engineer does not require to do so. If the Contractor fails to give the notice, he shall, if and when required by the Engineer, uncover the work and thereafter reinstate and make good, all at the Contractor's cost.</p>
<b>New Clause-5.4</b>	<b>Testing</b>

	<p>This Sub-Clause shall apply to all tests specified in the Contract, other than the Tests after Completion (if any).</p> <p>The Contractor shall provide all apparatus, assistance, documents and other information, electricity, equipment, fuel, consumables, instruments, labour, materials, and suitably qualified and experienced staff, as are necessary to carry out the specified tests efficiently. The Contractor shall agree, with the Engineer, the time and place for the specified testing of any Plant, Materials and other parts of the Works.</p> <p>The Engineer may, under Clause 34/PCC [Variations and Adjustments], vary the location or details of specified tests, or instruct the Contractor to carry out additional tests. If these varied or additional tests show that the tested Plant, Materials or workmanship is not in accordance with the Contract, the cost of carrying out this Variation shall be borne by the Contractor, notwithstanding other provisions of the Contract.</p> <p>The Engineer shall give the Contractor not less than 24 hours' notice of the Engineer's intention to attend the tests. If the Engineer does not attend at the time and place agreed, the Contractor may proceed with the tests, unless otherwise instructed by the Engineer, and the tests shall then be deemed to have been made in the Engineer's presence.</p> <p>If the Contractor suffers delay and/or incurs Cost from complying with these instructions or as a result of a delay for which the Employer is responsible, the Contractor shall give notice to the Engineer and shall be entitled subject to Sub-Clause 4.1/SCC [Contractor's Claims] to:</p> <ul style="list-style-type: none"> <li>(a) an extension of time for any such delay, if completion is or will be delayed, under Sub-Clause 26.5/PCC [Extension of Time for Completion], and</li> <li>(b) payment of any such Cost, which shall be included in the Contract Price.</li> </ul> <p>After receiving this notice, the Engineer shall proceed in accordance with New--Clause 3.5/PCC [Determinations] to agree or determine these matters.</p> <p>The Contractor shall promptly forward to the Engineer duly certified reports of the tests. When the specified tests have been passed, the Engineer shall endorse the Contractor's test certificate, or issue a certificate to him, to that effect. If the Engineer has not attended the tests, he shall be deemed to have accepted the readings as accurate.</p>
<p><b>New Clause-5.5</b></p>	<p><b>Rejection</b></p> <p>If, as a result of an examination, inspection, measurement or testing, any Plant, Materials or workmanship is found to be defective or otherwise not in accordance with the Contract, the Engineer may reject the Plant, Materials or workmanship by giving notice to the Contractor, with reasons. The Contractor shall then promptly make good the defect and ensure that the rejected item complies with the Contract.</p> <p>If the Engineer requires this Plant, Materials or workmanship to be retested, the tests shall be repeated under the same terms and conditions. If the rejection and retesting cause the Employer to incur additional costs, the Contractor shall subject to New-Clause 2.4/PCC [Employer's Claims] pay these costs to the Employer.</p>
<p><b>New Clause-5.6</b></p>	<p><b>Remedial Work</b></p> <p>Notwithstanding any previous test or certification, the Engineer may instruct the Contractor to:</p>

	<p>(a) remove from the Site and replace any Plant or Materials which is not in accordance with the Contract,</p> <p>(b) remove and re-execute any other work which is not in accordance with the Contract, and</p> <p>(c) Execute any work which is urgently required for the safety of the Works, whether because of an accident, unforeseeable event or otherwise.</p> <p>The Contractor shall comply with the instruction within a reasonable time, which shall be the time (if any) specified in the instruction, or immediately if urgency is specified under sub-paragraph (c).</p> <p>If the Contractor fails to comply with the instruction, the Employer shall be entitled to employ and pay other persons to carry out the work. Except to the extent that the Contractor would have been entitled to payment for the work, the Contractor shall subject to New-Clause 2.4/PCC [Employer's Claims] pay to the Employer all costs arising from this failure.</p>
<b>New Clause-5.7</b>	<p><b>Ownership of Plant and Materials</b></p> <p>Each item of Plant and Materials shall, to the extent consistent with the Laws of the Country, become the property of the Employer at whichever is the earlier of the following times, free from liens and other encumbrances:</p> <p>(i) when it is delivered to the Site;</p> <p>(ii) when the Contractor is entitled to payment of the value of the Plant and Materials under Sub-Clause 26.11/PCC [Payment for Plant and Materials in Event of Suspension].</p> <p>Unless otherwise stated in the Specification, the Contractor shall pay all royalties, rents and other payments for:</p> <p>a) natural Materials obtained from outside the Site, and</p> <p>b) the disposal of material from demolitions and excavations and of other surplus material (whether natural or man-made), except to the extent that disposal areas within the Site are specified in the Contract.</p>
	<p><b>6. Defect Liability</b></p>
<b>New Clause-6.1</b>	<p><b>Completion of Outstanding Work and Remedying Defects</b></p> <p>In order that the Works and Contractor's Documents, and each Section, shall be in the condition required by the Contract (fair wear and tear excepted) by the expiry date of the relevant Defects Notification Period or as soon as practicable thereafter, the Contractor shall:</p> <p>(a) complete any work which is outstanding on the date stated in a Taking-Over Certificate, within such reasonable time as is instructed by the Engineer, and</p> <p>(b) execute all work required to remedy defects or damage, as may be notified by (or on behalf of) the Employer on or before the expiry date of the Defects Notification Period for the Works or Section (as the case may be).</p> <p>If a defect appears or damage occurs, the Contractor shall be notified accordingly, by (or on behalf of) the Employer.</p>
<b>New Clause-6.2</b>	<p><b>Cost of Remedying Defects</b></p>

	<p>All work referred to in sub-paragraph (b) of New-Clause 6.1/PCC [Completion of Outstanding Work and Remedying Defects] shall be executed at the risk and cost of the Contractor, if and to the extent that the work is attributable to:</p> <p>(a) any design for which the Contractor is responsible,</p> <p>(b) Plant, Materials or workmanship not being in accordance with the Contract, or</p> <p>(c) failure by the Contractor to comply with any other obligation.</p> <p>If and to the extent that such work is attributable to any other cause, the Contractor shall be notified promptly by (or on behalf of) the Employer, and Sub-Clause 34.1/PCC [Variation Procedure] shall apply</p>
<b>New Clause-6.3</b>	<p><b>Extension of Defects Notification Period</b></p> <p>The Employer shall be entitled subject to New-Clause 2.4/PCC [Employer's Claims] to an extension of the Defects Notification Period for the Works or a Section if and to the extent that the Works, Section or a major item of Plant (as the case may be, and after taking over) cannot be used for the purposes for which they are intended by reason of a defect or damage. However, a Defects Notification Period shall not be extended by more than two years.</p> <p>If delivery and/or erection of Plant and/or Materials was suspended under Sub-Clause 26.9/PCC [Suspension of Work] the Contractor's obligations under this Clause shall not apply to any defects or damage occurring more than two years after the Defects Notification Period for the Plant and/or Materials would otherwise have expired.</p>
<b>New Clause-6.4</b>	<p><b>Failure to Remedy Defects</b></p> <p>If the Contractor fails to remedy any defect or damage within a reasonable time, a date may be fixed by (or on behalf of) the Employer, on or by which the defect or damage is to be remedied. The Contractor shall be given reasonable notice of this date.</p> <p>If the Contractor fails to remedy the defect or damage by this notified date and this remedial work was to be executed at the cost of the Contractor under New-Clause 6.2/PCC [Cost of Remedying Defects], the Employer may (at his option):</p> <p>(a) Carry out the work himself or by others, in a reasonable manner and at the Contractor's cost, but the Contractor shall have no responsibility for this work; and the Contractor shall subject to New-Clause 2.4/PCC [Employer's Claims] pay to the Employer the costs reasonably incurred by the Employer in remedying the defect or damage;</p> <p>(b) require the Engineer to agree or determine a reasonable reduction in the Contract Price in accordance with New-Clause 3.5/PCC [Determinations]; or</p> <p>(c) if the defect or damage deprives the Employer of substantially the whole benefit of the Works or any major part of the Works, terminate the Contract as a whole, or in respect of such major part which cannot be put to the intended use. Without prejudice to any other rights, under the Contract or otherwise, the Employer shall then be entitled to recover all sums paid for the Works or for such part (as the case may be), plus financing costs and the cost of dismantling the same, clearing the Site and returning Plant and Materials to the Contractor.</p>
<b>New Clause-6.5</b>	<p><b>Removal of Defective Work</b></p> <p>If the defect or damage cannot be remedied expeditiously on the Site and the Employer gives consent, the Contractor may remove from the Site for the purposes of repair such items of Plant as are defective or damaged. This consent may require the Contractor to increase the amount</p>

	of the Performance Security by the full replacement cost of these items, or to provide other appropriate security.
<b>New Clause-6.6</b>	<p><b>Further Tests</b></p> <p>If the work of remedying of any defect or damage may affect the performance of the Works, the Engineer may require the repetition of any of the tests described in the Contract. The requirement shall be made by notice within 28 days after the defect or damage is remedied.</p> <p>These tests shall be carried out in accordance with the terms applicable to the previous tests, except that they shall be carried out at the risk and cost of the Party liable, under New-Clause 6.2/PCC [Cost of Remedying Defects], for the cost of the remedial work.</p>
<b>New Clause-6.7</b>	<p><b>Right of Access</b></p> <p>Until the Performance Certificate has been issued, the Contractor shall have such right of access to the Works as is reasonably required in order to comply with this Clause, except as may be inconsistent with the Employer's reasonable security restrictions.</p>
<b>New Clause-6.8</b>	<p><b>Contractor to Search</b></p> <p>The Contractor shall, if required by the Engineer, search for the cause of any defect, under the direction of the Engineer. Unless the defect is to be remedied at the cost of the Contractor under New-Clause 6.2/PCC [Cost of Remedying Defects], the Cost of the search shall be agreed or determined by the Engineer in accordance with New-Clause 3.5/PCC [Determinations] and shall be included in the Contract Price.</p>
<b>New Clause-6.9</b>	<p><b>Performance Certificate</b></p> <p>Performance of the Contractor's obligations shall not be considered to have been completed until the Employer has issued the Performance Certificate to the Contractor, stating the date on which the Contractor completed his obligations under the Contract.</p> <p>The Employer shall issue the Performance Certificate within 28 days after the latest of the expiry dates of the Defects Notification Periods, or as soon thereafter as the Contractor has supplied all the Contractor's Documents and completed and tested all the Works, including remedying any defects.</p> <p>Only the Performance Certificate shall be deemed to constitute acceptance of the Works.</p>
<b>New Clause-6.10</b>	<p><b>Unfulfilled Obligations</b></p> <p>After the Performance Certificate has been issued, each Party shall remain liable for the fulfilment of any obligation which remains unperformed at that time. For the purposes of determining the nature and extent of unperformed obligations, the Contract shall be deemed to remain in force.</p> <p><b>Emergency defect rectification</b></p> <p>If any defect or damage is one requiring immediate attention from safety, environmental or operational viewpoint, the Engineer has the authority to proceed with rectification in any manner suitable and deduct such sums from the Contract Price</p>
<b>New Clause-6.11</b>	<p><b>Clearance of Site</b></p> <p>Upon receiving the Performance Certificate, the Contractor shall remove any remaining Contractor's Equipment, surplus material, wreckage, rubbish and Temporary Works from the Site.</p>

	<p>If all these items have not been removed within 28 days after the Employer receives a copy of the Performance Certificate, the Employer may sell or otherwise dispose of any remaining items. The Employer shall be entitled to be paid the costs incurred in connection with, or attributable to, such sale or disposal and restoring the Site.</p> <p>Any balance of the moneys from the sale shall be paid to the Contractor. If these moneys are less than the Employer's costs, the Contractor shall pay the outstanding balance to the Employer.</p>
	<b>7.MEASUREMENT AND EVALUATION</b>
<b>New Clause 7.1</b>	<p><b>Works to be Measured</b></p> <p>The Works shall be measured, and valued for payment, in accordance with this Clause.</p> <p>Whenever the Engineer requires any part of the Works to be measured, reasonable notice shall be given to the Contractor's Representative, who shall:</p> <ul style="list-style-type: none"> <li>(a) promptly either attend or send another qualified representative to assist the Engineer in making the measurement, and</li> <li>(b) supply any particulars requested by the Engineer.</li> </ul> <p>If the Contractor fails to attend or send a representative, the measurement made by (or on behalf of) the Engineer shall be accepted as accurate.</p> <p>Except as otherwise stated in the Contract, wherever any Permanent Works are to be measured from records, these shall be prepared by the Engineer. The Contractor shall, as and when requested, attend to examine and agree the records with the Engineer, and shall sign the same when agreed. If the Contractor does not attend, the records shall be accepted as accurate.</p> <p>If the Contractor examines and disagrees the records, and/or does not sign them as agreed, then the Contractor shall give notice to the Engineer of the respects in which the records are asserted to be inaccurate. After receiving this notice, the Engineer shall review the records and either confirm or vary them. If the Contractor does not so give notice to the Engineer within 14 days after being requested to examine the records, they shall be accepted as accurate.</p>
<b>New Clause 7.2</b>	<p><b>Method of Measurement</b></p> <p>Except as otherwise stated in the Contract and notwithstanding local practice:</p> <ul style="list-style-type: none"> <li>(a) measurement shall be made of the net actual quantity of each item of the Permanent Works, and</li> <li>(b) the method of measurement shall be in accordance with the Bill of Quantities or other applicable Schedules.</li> </ul>
<b>New Clause 7.3</b>	<p><b>Omissions</b></p> <p>Whenever the omission of any work form's part (or all) of a Variation, the value of which has not been agreed, if:</p> <ul style="list-style-type: none"> <li>a) the Contractor will incur (or has incurred) cost which, if the work had not been omitted, would have been deemed to be covered by a sum forming part of the Accepted Contract Amount;</li> <li>b) the omission of the work will result (or has resulted) in this sum not forming part of the Contract Price; and</li> <li>c) this cost is not deemed to be included in the evaluation of any substituted work;</li> </ul>

	then the Contractor shall give notice to the Engineer accordingly, with supporting particulars. Upon receiving this notice, the Engineer shall proceed in accordance with New-Clause 3.5/PCC [Determinations] to agree or determine this cost, which shall be included in the Contract Price.
<b>New Clause 8</b>	<p><b>FORCE MAJEURE</b></p> <p>If at any time, during the continuance of this contract, the performance in whole or in part by either party of any obligation under this contract shall be prevented or delayed by reason of any war, hostility, acts of public enemy, civil commotion, sabotage, serious loss or damage by fire, explosions, epidemics, pandemics, strikes, lockouts or acts of God (hereinafter referred to 'events') provided, notice of the happening of any such event is given by either party to the other within 14 days from the date of occurrence thereof, neither party shall by reason of such event, be entitled to terminate this contract nor shall either party have any claim for damages against the other in respect of such non-performance or delay in performance, and works under the contract shall be resumed as soon as practicable after such event has come to an end or ceased to exist, and decision of the Engineer as to whether the works have been so resumed or not shall be final and conclusive, PROVIDED FURTHER that if the performance in whole or in part of any obligation under this contract is prevented or delayed by reason of any such event for a continuous period exceeding 84 days, either party may at its option terminate the contract by giving notice to the other party.</p> <p><b>Payment and Release in case of Optional Termination</b></p> <p>Upon such termination, the Engineer shall determine the value of the work done and issue a Payment Certificate which shall include:</p> <ol style="list-style-type: none"> <li>The amounts payable for any work carried out for which a price is stated in the contract;</li> <li>The Cost of Plant and Materials ordered for the Works which have been delivered to the Contractor, or of which the contractor is liable to accept delivery; this Plant and materials shall become the property of (and be at the risk of) the Employer when paid for by the Employer, the Contractor shall place the same at the Employer's disposal;</li> <li>Other Costs or liabilities supported by necessary documentary evidence which in the circumstances were reasonably and necessarily incurred by the Contractor in the expectation of completing the Works as per mutually agreed programme.</li> <li>the Cost of removal of Temporary Works and Contractor's Equipment from the Site and the return of these items to the Contractor's works in his country (or to any other destination at no greater cost).</li> </ol>
<b>New Clause-9</b>	Defect liability period: 365 Days
<b>New Clause-10</b>	<p><b>Integrated testing and system commissioning</b></p> <p><b>Integrated Testing:</b> Tests on Completion shall also include Integrated Testing. The Contractor shall, following satisfactory completion of tests on his works, equipment, sub-systems or system, perform, at the direction of the Engineer, programme of tests to verify and confirm the compatibility and complete performance of his works, equipment, sub-systems or system with the works, equipment, sub-systems or system provided by others.</p>

	<p><b>Compilation of Test Results:</b> The results of the Integrated Testing and Commissioning shall be compiled and evaluated by the Engineer and the Contractor</p> <p><b>Retesting:</b> If the Works, or a part thereof, or a Section, fail to pass the Integrated Testing and Commissioning, the Engineer may order such failed tests to be repeated with the same terms and conditions. If such failure and retesting result from a default of the Contractor and cause the Employer to incur costs, the same shall be recoverable from the Contractor by the Employer, and may be deducted by the Employer from any amount due, or to become due, to the Contractor.</p> <p><b>Failure to Pass Test:</b> If the Works, or a part thereof, or a Section, fail to pass Integrated Testing and Commissioning and the Contractor in consequence proposes to make any adjustment or modification to the Works or a part thereof, or a section, the Engineer may, with the approval of the Employer, instruct the Contractor to carry out such adjustment or modification, at his own cost and to satisfy the requirements of Integrated Testing and Commissioning within such time as the Employer / Engineer may deem to be reasonable.</p> <p><b>Statutory Requirements:</b> The Contractor shall carry out all statutory tests and trials, under the supervision of the Engineer, necessary for obtaining sanction of the competent authority for opening the system for public carriage of passengers as mentioned in the Special Conditions of Contract.</p>
<p><b>New clause-11</b></p>	<p><b>Conflict of Interest:</b></p> <p>The Contractor shall carry out all statutory tests and trials, under the supervision of the Engineer, necessary for obtaining sanction of the competent authority for opening the system for public carriage of passengers as mentioned in the Special Conditions of Contract.</p> <p><b>Conflict of Interest</b> The remuneration of the Tenderer shall constitute the Tenderer's sole remuneration in connection with this Contract or the Services and, the Tenderers shall not accept for their own benefit any trade commission, discount or similar payment in connection with activities pursuant to this Contract or to the Services or in the discharge of their obligations hereunder, and the Tenderers shall use their best efforts to ensure that any Personnel either of them, similarly shall not receive any such additional remuneration Neither the Tenderer nor the Personnel of either of them shall engage, either directly or indirectly, in any of the following activities:</p> <p>(a) during the term of this Contract, any business or professional activities in India which would conflict with the activities assigned to them under this Contract</p> <p>The tenderer shall not be one of the following:</p> <p>(i) A firm which has been engaged by the Employer to provide consulting services for the preparation related to procurement for or implementation of this project.</p> <p>(ii) Any association/affiliation (inclusive of parent firms) of a firm or an organization mentioned in para (i) above.</p> <p>(iii) A Tenderer who lends, or temporarily seconds its personnel to firms or organizations which were engaged in consulting services for the preparation related to procurement for or implementation of the project, if the personnel would be involved in any capacity on the same project.</p> <p>Jurisdiction of Court in case of dispute or differences arising on account of this tender: Any suit or application, arising out of any dispute or differences on account of this tender shall be filed in</p>



	a competent court at Bangalore, Karnataka only and no other court or any other district of the country shall have any jurisdiction in the matter.
<b>New Clause-12</b>	<p><b>Special/Acceleration Advance</b></p> <p>Employer at his sole discretion, may provide Interest bearing Special/Acceleration Advance based on the recommendation of the Engineer to expedite works or to bring forward the completion date(s) and on account of immediate additional mobilization to complete balance works as targeted. The maximum cumulative Special/Acceleration Advance shall be 10% of the Accepted contract amount, which shall be released in stages as and when deemed appropriate as decided by the Engineer/Employer. The advance released at a time shall not exceed 2.5% of the Accepted contract amount.</p>
<b>New Clause-13</b>	<p><b>Provisional Payment Against Material at Site. -DELETED</b></p> <p>A provisional payment on account of main construction materials required for the Permanent Works shall be paid in INR only on request of the Contractor after these materials are brought to Site, against the Bank Guarantee and Insurance. The payment shall be limited to 80% of the actual value or assessed value of these materials on the basis of invoice and the total of such provisional payment on account of construction materials at a time shall be limited to three percent of original contract value or likely average consumption of such materials for three months, whichever is less and at any time the total outstanding provisional payment against material at site shall not exceed four percent of the original contract value. The valuation of the average consumption of such main construction materials shall be approved by the Engineer, whose decision shall be final. Materials which are of perishable nature should be adequately insured. Advances and provisional payments as admissible, shall be payable only on Contractor's written request to the Employer/Engineer.</p>
<b>New Clause-14</b>	<b>Ruling Language- English</b>
<b>New Clause-15</b>	<b>Language for communications- English</b>
<b>New Clause-16</b>	<p><b>Time for access to Site</b> (after the date of commencement)</p> <p>Starting from the Date of Commencement, the section will be progressively handed over in 180 days.</p>
<b>New clause-17</b>	<p><b>Employers' Bank details for Letter of Credit</b></p> <p>(a) <b>Nodal Branch</b> Canara Bank, MG Road, Bangalore 560001 IFSC Code – CNRB0002636 A/c No - 0430201012110</p> <p>(b) <b>Issuance/ reimbursing branch for LC</b> Shall be indicated later.</p>

**SALIENT FEATURES OF SOME MAJOR LABOUR LAWS APPLICABLE TO ESTABLISHMENTS ENGAGED IN BUILDING AND OTHER CONSTRUCTION WORK**

(The laws as current on the date of bid opening will apply)

- a) **Employees Compensation Act 1923:** The Act provides for compensation in case of injury by accident arising out of and during the course of employment.
- b) **Payment of Gratuity Act 1972:** Gratuity is payable to an employee under the Act on satisfaction of certain conditions on separation if an employee has completed 5 years' service or more or on death the rate of 15 days wages for every completed year of service. The Act is applicable to all establishments employing 10 or more employees.
- c) **Employees Provident Fund and Miscellaneous Provisions Act 1952 (since amended):** The Act Provides for monthly contributions by the employer plus workers @ 10% or 8.33%. The benefits payable under the Act are:
  - (i) Pension or family pension on retirement or death, as the case may be.
  - (ii) Deposit linked insurance on the death in harness of the worker.
  - (iii) payment of P.F. accumulation on retirement/death etc.
- d) **Maternity Benefit Act 1951:** The Act provides for leave and some other benefits to women employees in case of confinement or miscarriage etc.
- e) **Contract Labour (Regulation & Abolition) Act 1970:** The Act provides for certain welfare measures to be provided by the Contractor to contract labour and in case the Contractor fails to provide, the same are required to be provided, by the Principal Employer by Law. The Principal Employer is required to take Certificate of Registration and the Contractor is required to take license from the designated Officer. The Act is applicable to the establishments or Contractor of Principal Employer if they employ 20 or more contract labour.
- f) **Minimum Wages Act 1948:** The Employer is supposed to pay not less than the Minimum Wages fixed by appropriate Government as per provisions of the Act if the employment is a scheduled employment. Construction of Buildings, Roads, Runways are scheduled employments.
- g) **Payment of Wages Act 1936:** It lays down as to by what date the wages are to be paid, when it will be paid and what deductions can be made from the wages of the workers.
- h) **Equal Remuneration Act 1979:** The Act provides for payment of equal wages for work of equal nature to Male and Female workers and for not making discrimination against Female employees in the matters of transfers, training and promotions etc.
- i) **Payment of Bonus Act 1965:** The Act is applicable to all establishments employing 20 or more employees. The Act provides for payments of annual bonus subject to a minimum of 8.33% of wages and maximum of 20% of wages to employees drawing Rs.7000/-per month or the minimum wage as fixed by the appropriate government whichever is higher. The Act does not apply to certain

establishments. The newly set-up establishments are exempted for five years in certain circumstances. Some of the State Governments have reduced the employment size from 20 to 10 for the purpose of applicability of this Act.

- j) **Industrial Disputes Act 1947:** The Act lays down the machinery and procedure for resolution of Industrial disputes, in what situations a strike or lock-out becomes illegal and what are the requirements for laying off or retrenching the employees or closing down the establishment.
- k) **Industrial Employment (Standing Orders) Act 1946:** It is applicable to all establishments employing 100 or more workmen (employment size reduced by some of the States and Central Government to 50). The Act provides for laying down rules governing the conditions of employment by the Employer on matters provided in the Act and get the same certified by the designated Authority.
- l) **Trade Unions Act 1926:** The Act lays down the procedure for registration of trade unions of workmen and employers. The Trade Unions registered under the Act have been given certain immunities from civil and criminal liabilities.
- m) **Child and Adolescent Labour (Prohibition & Regulation) Act 1986:** The Act prohibits employment of children below 14 years of age in certain occupations and processes and provides for regulation of employment of children in all other occupations and processes. Employment of Child Labour is prohibited in Building and Construction Industry.
- n) **Inter-State Migrant Workmen's (Regulation of Employment & Conditions of Service) Act 1979:** The Act is applicable to an establishment which employs 5 or more inter-state migrant workmen through an intermediary (who has recruited workmen in one state for employment in the establishment situated in another state). The Inter-State migrant workmen, in an establishment to which this Act becomes applicable, are required to be provided certain facilities such as housing, medical aid, travelling expenses from home up to the establishment and back, etc.
- o) **The Building and Other Construction Workers (Regulation of Employment and Conditions of Service) Act 1996 and the Cess Act of 1996:** All the establishments who carry on any building or other construction work and employs 10 or more workers are covered under this Act. All such establishments are required to pay cess at the rate not exceeding 2% of the cost of construction as may be modified by the Government. The Employer of the establishment is required to provide safety measures at the building or construction work and other welfare measures, such as Canteens, First-Aid facilities, Ambulance, Housing accommodations for workers near the work place etc. The Employer to whom the Act applies has to obtain a registration certificate from the Registering Officer appointed by the Government.

As per Central Government's Notification No.S.O.2899 dated 26.09.1996 under this act, the cess shall be levied @1% of cost of construction works which shall be deducted from each bill of the payment due to the contractor.

- p) **Factories Act 1948:** The Act lays down the procedure for approval at plans before setting up a factory, health and safety provisions, welfare provisions, working hours, annual earned leave and rendering information regarding accidents or dangerous occurrences to designated authorities. It

SECTION-7: PARTICULAR CONDITIONS OF CONTRACT (PCC)

is applicable to premises employing 10 persons or more with aid of power or 20 or more persons without the aid of power engaged in manufacturing process.

- q) **The Employees State Insurance Act, 1948 (Act No. 34 of 1948) (Provisions as extended from time to time):** An Act to provide for certain benefits to employees in case of sickness, maternity and 'employment injury' and to make provision for certain other matters in relation thereto.

--00--00--00--

K-RIDE

# **SECTION 8A**

## **EMPLOYER'S REQUIREMENT – GENERAL INFORMATION AND SCOPE OF WORK**

# INDEX

## Table of Contents

SI No	Description	Page No
1	OBJECTIVE	228
2	RELEVANT DOCUMENTS	228
3	GENERAL	228
4	OBTAINING CLEARANCES/CERTIFICATES FROM AUTHORITIES	231
5	INTER COMMUNICATION FACILITIES	231
6	SITE INFORMATION	231
7	RESTRICTIONS IN WORKING	231
8	GENERAL CLIMATIC CONDITIONS	232
9	WORK CONTENT	232
10	DAMAGE TO PROPERTY	239
11	DRAWINGS	240
12	TRAFFIC MANAGEMENT	241
13	LIGHTING AND FIRE PREVENTION	241
14	UTILITIES	242
15	BARRICADING OF SITE AND WORK AREAS	242
16	INTERFACE WORKS	242
17	RESPONSIBILITIES OF CONTRACTOR	243
18	ASSOCIATED WORKS DEEMED INCLUDED IN ITEM RATES OF PERMANENT WORKS	243
19	PENALTY FOR NON-COMPLIANCE	244
20	APPENDIX – 01	245
21	APPENDIX – 02	246
22	APPENDIX – 03	247
23	APPENDIX – 04	249
24	APPENDIX – 05	251
25	APPENDIX – 06	252
26	APPENDIX – 07	253
27	ANNEXURE	254

## **Section 8A**

### **WORKS/EMPLOYER'S REQUIREMENTS**

#### **1. GENERAL INFORMATION & SCOPE OF WORK**

### **Brief Scope**

#### **Name of work:**

"BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

The tendered work is part of the Track Doubling Work between Baiyyappanahalli to Hosur. It is proposed to Arrange Power Supply for New Station Buildings and Electrification and its associated work's such as Lighting of Circulating area, Platform lighting etc.

The brief scope of work of this tender is Power Supply arrangement and Electrification of New Station Building, Platform and Circulating Area Lighting in Baiyyappanahalli to Hosur section under proposed Track Doubling Work at Belandur Road, Huskur, Heelalige, Anekal, Maranayakanahalli comes under **BENGALURU DIVISION OF SOUTH WESTERN RAILWAY.**

## EMPLOYERS REQUIREMENT - SCOPE OF WORK

### 1. OBJECTIVE

The brief scope of work of this tender is Power Supply arrangement and Electrification of New Station Building, Platform and Circulating Area Lighting in Baiyyappanahalli to Hosur section under proposed Track Doubling Work at Belandur Road, Huskur, Heelalige, Anekal, Maranayakanahalli which comes under **BENGALURU DIVISION OF SOUTH WESTERN RAILWAY**.

The objective of the contract is to arrange Power Supply and Electrify the newly Constructed Stations and Service Buildings and its associated works, related to Track Doubling work between Baiyyappanahalli to Hosur as stipulated in the contract. In full recognition of this objective, and with full acceptance of the obligations, liabilities and risks which may be involved, the Contractor shall undertake the execution of the Works. The general and specific requirements of the employer are detailed out in this document for understanding of the bidders and for mandatory compliance by the successful bidder/contractor. The Employer's requirements have been divided into different sections / sub-heads for convenience only. They do not restrict any cross-references. The Contractor shall take into account inter-relations between various parts of works. No claim shall be entertained on account of compartmental interpretations.

### 2. RELEVANT DOCUMENTS

The Engineer shall issue drawings to Contractor for the execution of works in accordance with the agreed terms and conditions of the Contract Agreement.

The following Documents shall be referred in conjunction with each other by the Contractor for construction work as these are mutually complimentary to each other:

- a) Drawings issued by the Engineer
- b) Employer's Requirements as part of Contract
- c) Technical Specifications and explanatory notes to the BOQ, as part of Contract
- d) Bill of Quantities as part of Contract
- e) Indian and International Standards referenced therein.
- f) The schedules and any other documents forming part of the Contract.

The Contractor shall always seek advice from the Engineer in the event of conflicts among above cited documents. In case of conflict, Engineer's decision shall be final and binding.

### 3. GENERAL

The project site is located in and around Bengaluru City. The tendered work is associated with Track Doubling Project between Baiyyappanahalli to Hosur.

The scope of work includes Electrification of New Buildings, Platform, Circulation & Approach Road Lighting of Track Doubling Project between Baiyyappanahalli to Hosur

**Availability of Land: DELETED**



Bidders should inspect the alignment before submission of bid and assess the scope and its associated work. It is the responsibility of the contractor to thoroughly examine the site of work and all constraints before submitting the bid(s).

- i. Before carrying out the work at site, necessary permissions from various local agencies / Railway authorities / road authorities such as SWR, BBMP, BESCOM, PWD, GAIL, Traffic Police etc., shall be required to be obtained by the contractor. The Employer shall assist only by way of issue of necessary support letters.
- ii. Any services affected by the works must be temporarily supported by the contractor. The work of temporarily supporting and protecting the public utility, services during execution of the works shall be deemed to be part of the contract.
- iii. The contractor shall take all precautions for safeguarding the environment during the course of the construction of the works. He shall abide by all laws, rules and regulations in force governing pollution and environmental protection that are applicable in the area where the works are situated. The contractor must take all necessary steps to fix specially dust nuisance during the construction of the works.
- iv. The levels, measurements and other information concerning the existing site as shown on the drawings are believed to be correct, but the contractor should verify them for himself and also examine the nature of the ground as no claim or allowance whatsoever will be entertained on account of any error or omission in the levels or strata turning out different during execution from what is shown on the drawings.
- v. **DELETED**
- vi. The preliminary works such as site clearance, barricading, trail trenching etc., wherever required, shall be taken up simultaneously along with mobilization activities.
- vii. **DELETED**
- viii. The contractor shall at all-time carryout the work on either side of existing IR tracks/ highway/road/service road in a manner creating least interference to the flow of traffic. The contractor shall take prior approval of the Engineer and traffic police regarding traffic arrangements and diversion of traffic during construction.
- ix. All temporary traffic diversion works, which will be required for the smooth flow of running traffic in order to carry out the works without any interruption including all safety precautions, signage, barricading, emergency lighting, traffic marshals, look-out men / watchmen etc.; shall be carried out. The permanent traffic diversions shall be carried out in consultation with traffic police. Contractor has to provide traffic diversion proposals, traffic marshals, cones, traffic diversion boards etc., as desired by Traffic Police.
- x. **DELETED**
- xi. **DELETED**

- xii. **DELETED**
- xiii. Restoration of Road and allied works immediately after completion of work up to road level or as per instructions of Engineer.
- xiv. **DELETED**
- xv. **DELETED**
- xvi. **DELETED**
- xvii. **DELETED**
- xviii. The CONSTRUCTION PROGRAMME AND PROJECT MONITORING is to be given as mentioned in General Conditions of Contract.
- xix. **DELETED**
- xx. Maintaining and keeping the Existing Railway banks, structures and adjacent roads clean in the area of work and where construction machineries ply.
- xxi. Measures to minimize water, air and noise pollution;
- xxii. All aspects of quality assurance, including testing of materials and other components of the work, as specified and as directed;
- xxiii. **DELETED**
- xxiv. Clearing of site and handing over of all the Works, as specified or as directed
- xxv. Maintenance of the completed Work during the maintenance period as directed;
- xxvi. Submission of completion (i.e., 'As-Built') drawings and other related documents as specified; and
- xxvii. The contractor shall not display any name-board for the works without the written permission of the engineer.
- xxviii. No labor camp shall be allowed at work site or any unauthorized place.

#### 4. OBTAINING CLEARANCES/CERTIFICATES FROM AUTHORITIES

The contractor shall arrange well in advance stage wise as may be required, submission of all the required documents and drawings for approval from other authorities and installation of the works and their inspection and obtain approval/completion certificates with respect to his work as required for use and connection of the utilities and occupation from the Statutory Authorities. The Contractor shall obtain and deliver to the Engineer, on completion of the works, the final Inspection Report and approval from the Authorities.

## 5. INTER COMMUNICATION FACILITIES

Telephone and fax services are available at Bengaluru. Should the Contractor wish to use Radio communication on the site, the Employer will recommend to the appropriate authority the application for allocation of radio frequencies to the Contractor.

## 6. SITE INFORMATION-

The project site is located in and around Bengaluru City. Bengaluru is well connected to other parts of the country by Road, Rail and Air. It has an international Airport.

## 7. RESTRICTIONS IN WORKING

It has to be noted by the Bidder that,

- a. The various items of construction work have to be carried out in narrow roads / streets of Bengaluru city/Beside/ across/ Parallel to the existing railway line where there are buildings adjacent to the road/track and railway traffic may be heavy.
- b. There are restrictions for movement of trucks and heavy vehicles (ex: trailers) carrying construction materials, cleaning during the day hours on some roads.
- c. There are some one-way roads where traffic can't move in both directions.
- d. Generally, at least two lanes of traffic in both directions have to be kept while the works are on, including foundation works.
- e. Execution of works will have to be planned in such a manner that they do not obstruct or interfere with the existing roads; railways tracks and other utilities.
- f. Where work is required to be carried out at locations adjacent to such Existing IR tracks, roads, utilities, structures, monuments, religious structures, etc., suitable safety and protection arrangements will have to be ensured. Nothing extra will be payable on these accounts. It should also be ensured that no damage is caused to any such element and Engineer/ Employer shall be indemnified against such damage at no extra cost.

## 8. GENERAL CLIMATIC CONDITIONS

Bengaluru is located in meridians of 12° N latitude and 77°3' E Longitude, spread over an area of 531 sqm km. located at an altitude of 900m, Bengaluru boasts of delightful weather around the year registering maximum temperature of 34° centigrade in summer and minimum temperature of 14° centigrade in winter. Bengaluru receives both the Southwest and Northeast Monsoons, getting an annual average rainfall of 760 mm, generally during the months of May to September/October. Bengaluru falls in Seismic Zone II

## 9. WORK CONTENT

### 9.1 Brief Scope

BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works

- i. Works to be performed shall also include all general works and works of any kind necessary for the due and satisfactory construction, completion and maintenance of the works to the intent and meaning of the drawings adopted and technical specifications, to best Engineering standards and orders that may be issued by the Engineer from time to time, compliance by the agency with all as per Contract document.
- ii. Supply of all materials, apparatus, plant, equipment, tools, fuel, water, transport, offices, stores, workshop, staff, labor and the provision of proper and sufficient protective works, diversion, temporary fencing, lighting and watching required for the safety of the public and protection of works on adjoining land; first-aid equipment, accommodation and sanitation for the staff and workmen, effecting and maintenance of all insurances, the payment of all wages, salaries, provident fund, fees, royalties, duties or the other charges arising out of the erection of works and the regular clearance of rubbish, clearing up, leaving the site perfect and tidy on completion.
- iii. The work to be constructed and maintained as per BOQ, Technical Specification, relevant Codes, and specifications of I.E Rules 1956 IS, CPWD, KPWD, BESCO, drawings, best engineering practices and/or as directed by the Engineer.

### 9.2 The Scope of Civil & Structural works - DELETED

### 9.3 Civil Formation- DELETED

### 9.4 Special stipulations/features Civil Work - DELETED

#### 9.4.6 Power & Traffic Block

- (i) Track occupation may be granted at any time during day or night to suit convenience of traffic operations and will ordinarily be granted over a distance covered by one or two consecutive block sections. Work trains will normally be allowed to take advantage of block shadows. Normally the total duration of block on any section will be maximum of 1.5 to 2.5 hours at a stretch in a day, once or more than once. Block provided may be utilized for one or more work trains or track Lorries or ladder trolleys to suit convenience of work.
- (ii) Blocks will not ordinarily be given for laying the feeders except where crossing of track is involved, which will have to be laid manually in general.

- (iii) Any traffic / power blocks, temporary speed restrictions and caution orders required in connection with execution of works by the contractor, shall be got sanctioned from the Railway authorities well in advance, through the Engineer. The Railways may sanction the same for specific sites within the overall recovery time available in the Railway time table. The contractor shall have to schedule his programme according to the convenience of the Railways. No claim from the contractor for any delay / inconvenience / loss on this account shall be entertained by the Employer / Engineer.
- (iv) The contractor shall undertake the work involving Railway track, Railway Electrification installations in co-ordination with the Engineer and Railways in accordance with the programme of work. Where traffic / power blocks are involved, the Contractor shall ensure that interruption to Railway operations, if any, is kept to the bare minimum level.
- (v) In order to minimize blocking of the track for work/material trains, the contractor shall consider the working conditions on the section and assess use of alternative method of construction on a part or whole of the work. He should submit clear proposal along with financial implication if any to the purchaser for such special method of saving of blocks that could be obtained along with reduction / redundancy of the facilities being provided by the Railway / K RIDE.
- (vi) The protection required for block working i.e., flagmen, flags etc. shall be provided by the contractor. Competency for the above shall, however, be given by the Railway authority. Protection of track by banner flags etc. shall be done in accordance with General Rules of Indian Railway and Subsidiary Rules of the concerned zonal Railway where work is being carried out. Contractor shall provide Safety helmet, Safety belt and Safety Shoes to their staff while working at site.
- (vii) In case of theft/breakdown, the contractor shall restore the traffic in minimum possible time. Failure to do so shall attract suitable penalty.

#### 9.4.7 Provisional Acceptance

- i) Immediately after completion of works/such part of works, the Contractor shall certify and advise the Engineer in writing that the works are (i) complete (ii) ready for satisfactory commercial service and (iii) ready to be handed over. He will also place at the disposal of the Engineer the required staff for checking it and putting it into operation.
- ii) The test or tests as stipulated in approved Technical Specifications shall be carried out jointly by the Railway / Engineer and the contractor within a month after the receipt of the Contractor's notification as stated in sub-Para above.
- iii) The provisions contained in the relevant GCC clause shall be followed for taking over of the installations.

#### 9.4.8 Use of Rejected/Sub Standard Items/ Equipment

In the event of such rejection as aforesaid, the Engineer shall, without prejudice to his other rights and remedies and in particular without prejudice to his rights under the clause just preceding, be entitled to the use of the rejected/substandard equipment/item for a time reasonably sufficient to

enable him to obtain other replacement. During such period, if the rejected/substandard equipment/item is used commercially the Contractor shall not be entitled to the payment on energization until such rejected equipment is rectified and/or replaced, but the Engineer shall not be entitled to claim any damages arising out of rejected/ substandard equipment/item in respect of such period.

#### 9.4.9 Guarantee

- (i) The Contractor shall guarantee satisfactory working of the installations erected by him, for a period of 12 (Twelve) months from the date of commercial operation or from the date of Provisional Acceptance by the Engineer whichever is earlier. The guarantee for spares (if any) should be coincident with the guarantee for erected equipment. The provisions contained in the relevant GCC clause shall be followed for rectification of defects.
- (ii) During the defect liability period the Contractor shall keep available an experienced engineer and necessary equipment to attend to any defective installations resulting from defective erection and / or defects in the equipment supplied by the Contractor. The Contractor shall bear the cost of all modifications, additions or substitutions that may be considered necessary due to faulty materials, design or workmanship for the satisfactory working of the equipment. The final decision shall rest with the Engineer/Employer.
- (iii) During the defect liability period the Contractor shall be liable for the replacement at site of any parts which may be found defective in the equipment whether such equipment be of his own manufacture or those of his sub-contractor whether arising from faulty design, materials, workmanship or negligence in any manner on the part of the Contractor provided always that such defective parts as are not repairable at site are promptly returned to the contractor if so required by him at his (Contractor's) own expenses. In case of type defects in Contractor's equipment and components detected during guarantee period, Contractor should replace all such items irrespective of the fact whether all such items have failed or not. The contractor shall bear the cost of repairs carried out on his behalf by the Engineer at site. In such a case, the Contractor shall be informed about the works proposed to be carried out by the Engineer/Employer.
- (iv) If it becomes necessary for the Contractor to replace or renew any defective portion of the equipment under the Para aforesaid then the provision of the said Para shall also apply to the portions of the equipment so replaced or renewed until the expiration of six months from the date of such replacement or renewal or until the end of the above-mentioned period whichever is later. Such extension shall not apply in case of defects of a minor nature, the decision of the Engineer or his nominee being final in the matter. If any defect be not remedied within a reasonable time during the aforesaid period, the Engineer may proceed to do work at the Contractor's risk and expense, but without prejudice to any other rights and remedies which the Engineer may have against the Contractor in respect of such defects or faults.
- (v) The repaired or renewed parts shall be delivered and erected on site free of charge to the satisfaction of Engineer/Employer.

#### 9.4.10 Accountably and disposal of released materials

- (i) The Contractor shall liaison with the Engineer to finalize the procedure for taking over of the whole or part of the section and for disposal of the released materials.
- (ii) All released materials shall be handed over to the authorized Railway Representative through the Engineer at the nearest OHE/PSI depot or places nominated by Railway/K RIDE.
- (iii) The material released on account of modifications/alterations shall be accounted by the contractor in the presence of the Engineer and the Railway Representative, except for the material permitted to be re-used by the Engineer. For this material, only erection cost shall be paid, under the appropriate item of the Schedule.
- (iv) If there are any shortages during final reconciliation, their cost will be recovered by the Purchaser from the Contractor at the prices inclusive of all charges as specified in note below: -

If any shortfall of material is noticed at the time of completion of the work, the contractor shall be liable to pay for the shortfall as per book rate or the last purchase rate or the prevailing market rate, whichever is higher, plus 2% on account of incidental charges together with supervision charges at 12.5% of the total cost inclusive of material freight and incidental charges. Freight between the Purchaser's source of supply and the Contractor's depot. The same shall be recovered from the bill of the contractor as per the extant policy of K RIDE.

#### 9.5 Codes and specifications

The works shall be carried out as per Standard Specifications of Indian Railways/South Western Railway, which can be obtained on payment. Wherever reference is made in the Contract to specific standards and codes to be met by the goods and materials to be furnished and work performed or tested the provisions of the latest current edition or revision of the relevant standards and codes in effect shall apply, unless otherwise expressly stated in the Contract. Where such standards and codes are national or relate to a particular country or region, other authoritative standards which ensure an equal or higher quality than the standards and codes specified will be accepted subject to the Engineer's prior review and written approval. Differences between the standards specified and the proposed alternative standards must be fully described in writing by the Contractor and submitted to the Engineer at least 14 days prior to the date when the Contractor desires the Engineer's approval. In the event the Engineer determines that such proposed deviations do not ensure equal or higher quality, the Contractor shall comply with the standards specified in the documents.

All goods and materials to be incorporated in the goods be new, unused, and of the most recent or current models, and that they incorporate all recent improvements in design and materials unless provided for otherwise in the contract.

- (a) The Standard Specifications of Indian Railways/South Western Railway/K RIDE and the list of codes and manuals given in the annexure thereof shall be prime governing.
- (b) Where there is conflict between provisions in IRS & IS specifications, provisions in IRS specifications shall prevail.
- (c) Where there is no provision of specifications in IRS, provisions in IS specifications should be adopted. Where there are no provisions in IRS and IS Specifications, provisions should be followed.

- (d) For items not covered in IRS/IS specifications, BS-5400 Part 1 to 10 may also be considered.
- (e) The decision of Engineer shall be final and binding in the interpretation of the clause of the codes of practice and specifications of this tender and no claim whatsoever shall be entertained on this account from the Contractor.

## 9.6 Survey and fixing working bench marks and alignment markers - DELETED

### 9.7 Bench marks

- 9.9.1 All along the length of the proposed double line benchmarks have been set up by the Employer at intervals of about a kilometer. The details of these bench marks along with their reduced levels have been marked on the design drawings indicating the plan and 'L' section which form a part of the tender. The contractor along with the Engineer should verify the details of these bench marks in the first instance, soon after taking possession of the site. If any mistakes are detected in these details of these bench marks the same should be indicated to the Engineer. The mistakes detected should be corrected in consultation with the Engineer. These corrections should be got approved by the Engineer before starting of any other work.
- 9.9.2 The contractor shall then in presence of the Engineer establish working bench marks at short intervals, adequately connecting them to the reference bench marks set up by the Employer in the Project length. The working bench mark levels should be got approved from the Engineer. An up-to-date record of all bench marks including approved corrections if any, shall be maintained by the contractor and also the Engineer.
- 9.9.3 All levels taken for making out the longitudinal section and cross section should be related only to these working bench marks.
- 9.9.4 While doing the above-mentioned work, the fact that similar work will have to be done once again on the completed earth work in formation for fixing up the longitudinal levels of the installed P. Way should be kept in view.

### 9.8 Alignment

- 9.8.1 All along the length of the proposed double line at an interval of about half a kilometer, alignment reference pillars have been set up the Employer; in addition, five reference pillars have been erected for each of the curves to indicate the start & end of the overall length of the curve and its circular portion and apex, by the Employer. In the design drawings showing the plan and 'L' section, which forms part of the tender, the co-ordinates for these pillars have also been given. This has been done to facilitate setting of the alignment of the proposed line. The contractor along with the Engineer should verify the details of these alignment pillars, soon after taking possession of the site. If any mistakes are detected in these details, the same should be indicated to the Engineer before starting any other work. These detected mistakes should be corrected by the Contractor in consultation with the Engineer. These corrections should be got approved from the Engineer.
- 9.8.2 The contractor shall then, in presence of the Engineer, establish working alignment reference markers at shorter intervals, adequately connecting them to the reference pillars set up by the Employer in the Project length. The location of these subsidiary alignment markers should be got approved from the Engineer.



An up-to-date record of all alignment pillars, and corrections, if any done, shall be maintained by the contractor and also the Engineer.

- 9.8.3 The alignment for the double line should be related only to these working bench marks.
- 9.8.4 While doing the above-mentioned work, the fact that similar work will have to be done once again on the completed earth work in formation for fixing up the alignment of the installed P. Way should be kept in view.
- 9.8.5 After the formation has been constructed, the center line of track both in Block Sections and Yards should be re-fixed taking guidance from already set up alignment references. Similarly, the rail levels of track both in the block sections and the yards should also be fixed with reference markers. These will be used for installation of track.

### 9.9 Responsibility for establishing and maintaining working bench marks and alignment markers

- 9.9.1 The Engineer, when necessary, will provide the contractor with the data necessary for setting out of the centerline. All dimensions and levels shown on the drawing or mentioned in the documents forming part of or issued under the contract shall be verified by the contractor on the site; he shall immediately inform the Engineer of any apparent errors or discrepancies noticed in such dimensions or levels. In consultation with the Engineer, the noticed mistakes should be corrected. These corrections should have the approval of the Engineer.
- 9.9.2 The contractor will be entirely responsible for accurate setting out of the works and safeguarding all survey monuments, bench marks, alignment references etc. The work of setting out shall be deemed to be a part of the general works preparatory to the execution of work and no separate payment shall be made for the same
- 9.9.3 The above-mentioned points have been repeated in the respective sections dealing with specifications for different works for laying emphasis on these items.
- 9.9.4 The contractor will be entirely responsible for accurate setting out of the works and safeguarding all survey monuments, bench marks, alignment references etc. The work of setting out shall be deemed to be a part of the general works preparatory to the execution of work and no separate payment shall be made for the same.

### 9.10 Issue of materials by Employer

- 9.10.1 The issue of materials by the Employer to contractor shall be governed by the following change.
- 9.10.2 The rails and other materials to be issued by the Employer to Contractor will be handed over at any convenient locations within Railway Land in the contract section. The contractor should collect the same from these locations and transport them to the work site as found necessary. He shall use only mechanical means for handling of rails during all stages of work to avoid any damages to the rails. Leading will be paid separately as per relevant item of BOQ.

### 9.11 Interfacing and Integrations of Works

- 9.11.1 As a part of provision of this tendered work Modification/shifting of Electrical utilities are to be executed by the successful tenderer. In proposed project area many other agencies are also working. The interfacing for the purpose of integration of works between the Civil or other agencies or between the Contractor and his sub-contractors, (if permitted) will arise. This has to be kept in view.
- 9.11.2 Land is available throughout the section for carrying out the works. However, if additional land is required in yards/mid-section, necessary arrangements will be made for acquiring the land without affecting the progress of work.
- 9.11.3 The contractor shall take full responsibility in terms of organizing, managing, coordinating and administrating the interfacing of all components of works including all issues related to and arising out of such tasks and responsibility. The contractor shall interface with all concerned authorities and other contractors as required to complete the work satisfactorily within the stipulated period.
- 9.11.4 Under consideration and application of the above clause, the contractor shall and has also the obligation to liaise with the other contractors and Authorities to obtain all necessary technical information, all necessary information concerning organization of works, coordinating the works etc. which are necessary to assess, mitigate, take care of contractual obligations, risks, liabilities and whatsoever arising out of interfacing, engineering issues, organization of the works etc. The employer/engineer shall not be held liable in any way, throughout the preparation of the offer and/or execution of the works and/or maintenance period and/or defects liability period for any omissions, misunderstanding, negligence etc. arising out of interfacing, coordinating, organizing etc. of the works. The employer will not entertain any claim arising out of misunderstanding, miscommunication, omission, withholding of necessary/required information or whatsoever between the concerned contractors/Authorities concerning interfacing, organizing etc. of works. In case of any claim arising from any of the contractors, as aforesaid, referring to interfacing and/or interfacing related issues; the Employer will hold the concerned contractors liable for not taking care of their contractual obligation concerning interfacing, organizing, co-ordination etc. of the related works.
- 9.11.5 Needless to say, that commissioning of this double line project requires close coordination among various agencies executing the works in this section, Engineer, Employer and the Railway authorities. The contractor shall therefore plan all his works requiring interfacing, like works in mid-section, station yards, with other agencies, meticulously, in consultation and coordination with all concerned parties, in advance, for expeditious execution, without causing any delay either to his works or those of others.
- 9.11.6 If, in the opinion of Engineer, any delay in execution of any part of the Project requiring interfacing is attributable to the failures of the contractor to take adequate steps for smooth execution of such works, then the Engineer shall have the right to take necessary steps to organize and streamline such works, including excluding the requisite portion of work from the scope of the Contractor and getting the same executed by other agencies, at the risk and cost of the contractor.

## 10.0 DAMAGE TO PROPERTY

The contractor shall organize all his activities so as not to cause any damage to the property of Railway or that of other agencies or any third party. In spite of taking all precautions, in the unfortunate event of any damage to the property, then the contractor shall not only indemnify the Employer of the claims made by the affected parties but also settle the matters with the affected parties as per law. If the nature of damage is one of that affecting the train movements or causing a safety hazard to the public, then the

situation will be treated as an emergency and the Engineer reserves the right to take all necessary steps as deemed necessary to restore train operations or to remove the hazardous situation or to mitigate the damage, at the risk and cost of the contractor.

All power requirements for execution of works shall be arranged by the Contractor from his own resources. Subject to availability of power, the Employer/Engineer will recommend to the Railway Authorities for providing power connection. The Contractor shall bear the cost of installation and payment of necessary charges for providing such power connections as per the Terms and Conditions of the Railway.

#### 10.1 Survey Equipment

The contractor should provide the survey equipment and other accessories as per the instructions of Engineer as and when required. He should also provide all necessary help as required by the Engineer for checking the works, whenever required.

10.2 All power requirements for execution of works shall be arranged by the Contractor from his own resources. Subject to availability of power, the Employer/Engineer will recommend to the Railway Authorities for providing power connection. The Contractor shall bear the cost of installation and payment of necessary charges for providing such power connections as per the Terms and Conditions of the Railway.

10.3 **Structural elements, shape and form - DELETED**

10.4 **Stability of the elements - DELETED**

10.5 **Stability of the Structure - DELETED**

#### 10.6 Temporary Works

Traffic barricade with reflective tapes and other necessary traffic signages should be provided wherever required so that safety is ensured during day and night continuously. Temporary traffic diversion for smooth flow of traffic during construction including necessary traffic signs, repairs to the diverted route/service lanes, if required, restoration of diverted route to original condition etc. shall be done by contractor at his cost. Contractor shall also provide any temporary support for the utilities (charted or uncharted), wherever required, at no extra cost to Employer. The above listed works are only brief but the actual scope of work shall be as specified in the concerned document and/or as specified or directed by the Engineer.

#### 10.7 Design for Temporary Works

The Design should cover all the items pertaining to all temporary works, traffic diversion scheme, launching scheme for RCC pole / OH conductor stringing/ cable laying or transportation scheme for various structural elements and materials to be transported to and from site during construction period.

The Contractor shall himself formulate a practical and viable scheme for design/ fabrication of shuttering, casting, curing, testing and launching/erection of poles/ stringing of conductor/ cable laying and all other

structures. The bidder should, along with the bid, specify the scheme that he proposes to adopt for carrying out all the works including fabrication, transportation, stacking and erection of steel structure and casting, curing, stressing, testing and erection of poles / stringing of conductor.

The contractor shall formulate the erection scheme in accordance with relevant provision of applicable standards and submit the same to the Engineer for approval with third party certificates. These works will be executed only after the approval has been obtained from Engineer.

## 11. DRAWINGS – DELETED

### 11.1 GFC Drawings: - DELETED

### 11.2 Meaning and intent of specifications and Drawings:

If any ambiguity arises as to the meaning and intent of any portion of the specifications and drawing or as to execution or quality of any work or material, or as to the measurement of the works, the decision of the Engineer thereon shall be final subject to the appeal (within 7 days of such decision being intimated to the Contractor) to Engineer/Employer who shall have the power to correct any errors, omissions, or discrepancies in the specifications, drawings, classifications of works or materials and whose decision in the matter in dispute or doubt shall be final and conclusive.

### 11.3 Responsibility for Specifications.

#### a) Specifications

RDSO/ CPWD, KPWD, BESCO specification / other Specifications / Codes viz. IS etc. shall be procured by the Contractor from the market. One set of these specifications shall always be kept at contractor's site office for reference.

Standards guaranteeing a level of quality or performance equivalent or superior to those indicated will also be accepted. Reference to trademarks or other specific designations that is necessary to explain the nature of the products required means that any other product of equal or superior quality or performance is also acceptable, subject to prior approval of the ENGINEER to be obtained in writing for adopting the new standards which are not provided in the contract.

#### b) Drawings for Permanent Works: - DELETED

#### c) Design, Drawings and Specifications for Temporary/ Ancillary works. -

- a) All Drawings shall be prepared on CAD using AUTO-CAD Version 2010 or Higher Plan, elevation and side view for proposed track crossing/modification and other HT/LT modification/shifting.

#### d) Completion Drawings

On completion of the work in all respects the contractor shall submit the following

- i. Five sets of "As Erected Drawings" in the standard sizes of A0, A1, A2, A3 or A4 Roll each containing complete set of drawings for every component of work on approved scale indicating the work "As Erected". Each set shall also contain technical literature.
- ii. These drawings shall be prepared on CAD using Auto-Cad version (latest/as directed by Engineer) and shall be recorded on writable CDs and one set of these CDs shall also be submitted.
- iii. The Contractor shall also submit one set of original "As Erected" drawings on polyester film or as directed by Engineer of quality as approved by Engineer/ Engineer's Representative.

The Certificate of Completion of Works as per the provisions in the General Conditions of Contract shall not be issued by the Engineer in the event of Contractor's failure to furnish aforesaid "As Erected" drawings for the entire works.

#### **e) Plans and Drawings for Layout of Plant and Equipment - DELETED**

#### **12. TRAFFIC MANAGEMENT - DELETED**

#### **13. LIGHTING AND FIRE PREVENTION - DELETED**

#### **14. UTILITIES - DELETED**

##### **14.1 Damage to Utilities**

The contractor shall be responsible for any theft, damage and / or protection of all the existing utilities within the site of work during currency of the Contract. In case of any theft/ damage occurring to these utilities while working or otherwise, the contractor shall immediately inform the Engineer's representative as well the utility owning agency and restore the same immediately to the entire satisfaction of the utility owning agency. Any damage due to working / negligence / fault of the Contractor (decision of Engineer in this regard shall be final and binding), the same shall be repaired / made good by the Contractor at his own cost. Any damage/ compensation / penalty etc. if charged by the utility owning agency in this regard shall also be payable by the Contractor and no claim in this regard shall be entertained by the Employer. Contractor shall always keep indemnified the Engineer / Employer against this.

## 15. BARRICADING OF SITE AND WORK AREAS

The contractor shall provide temporary barricade during construction at site, work areas (i.e., construction Depot, Store, Site office, Casting yard etc.,)

## 16. INTERFACE WORKS

In addition, the Contractor shall be required to carry out various interface works as per interfacing requirements. Such as interfacing with various contracts of signaling & Telecommunication, traction power & power supply, track work, rolling stock etc.,

## 17. RESPONSIBILITIES OF CONTRACTOR

17.1 The Contractor shall liaison with TNEB/ESCOM/ KPTCL/ PGCL, State/Central Government and local bodies till completion of works in all respect. It is the responsibility of the contractor to ensure proper liaison and co-ordination with State Authorities for availing line clearance, joint inspection, testing & commissioning energization of in to the full satisfaction of State Authorities and handing over, and KRIDE intervention should not be sought for any of the above.

### 17.2 ROW issues if any shall be sorted out by the contractor.

17.2.1 It is the responsibility of the Successful contractor to liaison with EB authorities for arranging joint inspections along with KRIDE representative or as and when required and to ensure for early preparation of estimations, obtaining approvals at various stages, getting sanctioning of estimations and supervision charges intimations (Modification work of HT/LT power line crossings, Additional load/ Availing new power supply for railway installations)

17.2.2 In connection with the work Contractors has to liaison with EB authorities / statutory authorities in getting the intimations towards the payment of the following and submit the same to this office in time to facilitate for processing the payment by Railway.

- a. Availing of new supply/service connection charges/deposit.
- b. Supervision charges (10% of estimate or latest as per EB guidelines) based on sanctioned estimate of ESCOM / KPTCL / PGCL authorities along with copy of sanctioned estimate.
- c. The contractor shall coordinate for payment of "Supervision Charges" to electricity authority and other charges payable to individual Govt. agencies as per the prevailing government rules, such payment shall be paid by KRIDE.

17.2.3 KRIDE will pay necessary statutory Charges, related ROW charges, Electrical inspectorate and inspection charges payable to ESCOM. Charges of stamp duties /agreements, TAQC/ MR charges as applicable and any other incidental charges payable to ESCOM / KPTCL/ PGCL / BBMP, GAIL, BWSSB, BDA, to be borne by contractor

17.2.4 Execution of agreement with KRIDE / Railways and SEB authorities/ DISCOM submitting Relevant documents for EIG approval as per the requirement. It is the responsibility of the contractor for proper handing over of released materials to State Authorities. For this purpose, it is suggested that a joint inspection with the State Authorities officials concerned shall be carried out, the items and quantities of materials to be released are assessed properly before the work is started.

#### 17.2.5 **Safe guarding the environment**

#### 17.2.6 **The contractor shall carry out expeditiously and without delay the following works**

- a. Identify and get approved the sources of various major construction materials.
- b. Material testing and mix designs of concrete as contemplated in the specifications.
- c. Any other pre-requisite items required for final execution.
- d. Any other items specified in other sections of contract.

### 18. **ASSOCIATED WORKS DEEMED INCLUDED IN ITEM RATES OF PERMANENT WORKS**

#### 18.1 **Contractor's Organization and Plant & Equipment**

##### **Project Organization Plan**

- (1) The Contractor's Personnel shall be deployed & maintained in consultation with Engineer and as per the requirements. The Contractor's Superintendence shall be also properly deployed and maintained to carry out the construction activities as described in the relevant General Conditions of Contract (GCC) clause.
- (2) The Contractor shall submit an updated Project Organization Plan which includes complete project organization chart during the Construction adding functions and personnel necessary to perform the Works during the Construction in accordance with the conditions of the Contract. This plan shall be updated and resubmitted whenever there are changes to the staff and / or the organizational structure. The plan shall show the management structure and state clearly the duties, responsibilities and authority of key staff member.
- (3) The contractor shall deploy the key personnel of requisite qualification and experiences. In case Engineer instructs (in writing) the Contractor to remove a person of his work force stating the reasons, the Contractor shall ensure that the person leaves the Work Area within seven days and shall have no further connection with the Works in the Contract. The Engineer shall also seek prior consent of the Employer in this regard.
- (4) The minimum requirements for man-power are attached as **Appendix [Organization charts and key positions]** to the Employer's Requirement.

### Plant and Equipment

- a) The minimum Plant and equipment as shall be maintained in consultation with Engineer and as per the requirements.
- b) The minimum requirements for plant & equipment are attached as **Appendix 5** [Plant and Equipment] to the Employer's Requirement.

### 19. PENALTY FOR NON-COMPLIANCE

Notwithstanding the provisions elsewhere in the bid documents, the Contractor shall be penalized as detailed below:

- a) Correction of Defects

If the Engineer determines that any item or part of it was constructed with bad workmanship and / or using sub-standard construction materials,

SI. No.	Nature of Defects	Penalty (Rs.)
1.	Not adhering safety guidelines as mentioned in the tender document	10,000/- each case
2	Usage of non-approved / sub-standard materials	25,000/- each case

The above said penalty is envisaged to act as deterrent against bad workmanship and usage of sub-standard construction materials by the Contractor and shall be imposed for every occurrence. These penalties are non-refundable.



## Appendix 01

### 1. PROGRAMME REQUIREMENTS

#### 1.1 General

##### 1.1.1 Construction programme and project monitoring

- a) The contractor shall propose and submit his detailed Power Supply arrangement and Electrification plan separately. Contractor may be asked to schedule and complete the work block wise / area wise in a phased manner fixing priorities to different stretches of the work to give access to other interfacing contracts as mentioned in the Bid documents.
- b) The tentative Working plan shall be submitted within the period as specified in the Bid document for approval of the Engineer as 'Baseline Program'.
  1. After the work has started, the Contractor shall deliver in the first week of every month to the Engineer an update of the Power supply Arrangement & Electrification plan showing changes, if any, in planning or progress scheduling and reflecting the progress of all the activities of the network and the project status as at the end of previous month.
  2. If the Contractor falls behind the approved Work program plan of Power Supply Arranging and Electrification by more than one month, he shall, within fourteen days of the date of such information, submit for approval, a revision of the Working Plan plan showing the proposed measures, including augmentation of plant, labor and material resources to complete the works on time.
  3. Whenever the Contractor proposes to change the Working plan, he shall immediately advise the Engineer in writing and, if the Engineer considers the change a major one, the Contractor shall submit a revised program for approval.

#### 4. DELETED

**Appendix-02**

**DELETED**

K RIDE

### Appendix-03

#### Quality Assurance Materials

a. All the equipment, materials, fittings and components will be subject to quality control programme of the manufacturer, being part of the quality Assurance programme of the Contractor. The materials may also be inspected by the Purchaser or his representative either at the manufacturer works or at the Contractor's depot. The Purchaser or his representative shall have the right to be present during all the stages of manufacture and shall be accorded free of charge all reasonable facilities for inspection and testing as well as to examine the stage inspection report of the manufacturer in addition to the quality audit which the Contractor may institute as a part of his programme so as to satisfy himself that the materials are in accordance with specifications, approved drawings and designs and Purchaser's prescribed quality Assurance Standards.

b. **Erection**

All erection work will also be subjected to the Quality Assurance Programme including inspection by the Purchaser or his representative to ensure that the work is done in accordance with the specifications and approved drawings and designs and Purchaser's prescribed Quality Assurance Standards.

(c) **Expenses of Purchaser's Representative- DELETED**

d. The decision of the Purchaser or his representative shall be final in respect of acceptability or otherwise of any material, fittings, components or equipment's required for the work.

e. **Quality Assurance Programme**

For proper control of quality and to ensure that the materials, equipment's and fittings are manufactured according to specification and the erection is according to approved instructions, ensure quality at all necessary points, whether at manufacturer's works, or in his depot or at work site as well as during erection. Such quality assurance programme shall also meet the requirement of the Purchaser's Prescribed Quality Assurance Standards. This programme of the Contractor shall generally cover the following: -

1. The organization to manage and implement the Quality Assurance programme.
2. The documentation control system: -
  - i) Basic control system.
  - ii) Adopted at manufacturer's works.
  - iii) Adopted at the Contractor's Depot and work site.
3. Procedure adopted for :-
  - i) Source Inspection.
  - ii) Incoming raw material inspection.
  - iii) Verification of materials purchased.
  - iv) Fabrication controls.
  - v) Site erection controls.
4. Inspection and Test Procedure for :-
  - i) Manufacture and quality control procedure.
  - ii) Field activities.

5. System of handling and storage.
6. System of quality audit.
7. System of maintenance of records.
8. For the purpose of obtaining 'On Account Payment' the Contractor shall submit along with the invoice, the documents indicated in the Prescribed Quality Assurance Standard which should inter-alia cover the following as may be applicable in each case.
  - i) Material test reports on raw materials used.
  - ii) Material type and routine test report on components specification.
  - iii) Inspection plan with reports of the Inspection plan check points.
  - iv) Routine test report.
  - v) Factory test results as required under the specification.
  - vi) Quality audit report including test check report of Purchaser's representative if any.

K RIDE

## Appendix-04

### ORGANISATION CHART AND KEY POSITIONS

The Contractor shall provide the following organization chart for the Works as follows:

#### Head office Organization Chart

One organization chart shall be provided for the Contractor head office indicating the management and staff structure, with responsible personnel/departments described for all aspects of the work.

#### Site organization Chart

The Contractor shall provide the proposed site organization indicating the proposed structure, staff partners and positions necessary to adequately manage and control the Works.

The Contractor shall have a competent team of Managers, Engineers, Technical staff etc. so as to complete the work satisfactorily as per various requirements of the contract.

**The Key Positions not limited to and corresponding qualification and experience are as under:**

S. No.	Position	Minimum No. of Personnel	Qualification	Minimum Experience in Similar Work [years]
1	Sr. Engineer	1	Graduate in Electrical Engg.	Min. 5 years and above
2	Technicians/ Electricians	2	Diploma/ ITI in Electrician	Min. 5 years and above

#### NOTES:

1. The above categories of key positions shall be minimum required for successful completion of the work which shall be deployed at different points of time as per the progress and requirement of work and may not be required to deploy simultaneously and continuously. However, these personnel shall be deployed at site in advance as per requirement and as directed by the Engineer and the decision of Engineer in this regard shall be final and binding.
2. The Contractor shall submit the CVs of the above key positions to Engineer for his approval within 28 days of issue of letter of Acceptance (LOA).
3. The contractor shall deploy resources as per the above-mentioned minimum requirement and also confirm to deploy manpower over and above the minimum numbers indicated above, if the work requires so.

4. The performance of project personnel deployed will be evaluated periodically by Employer during the contract period. In case the performance of any of the project personnel is not satisfactory, the Contractor shall replace them with better or equivalent personnel immediately as per directions of the Engineer.
5. Tenderer may propose any number of names of Personnel for each Key Position. Any of the proposed personnel as approved by the Employer for each key position have to be mandatorily deployed in case of award of work.
6. Non-deployment of the Key personnel sl. no 1 and 2 leads to imposition of Penalty of Rs 25,000 /- Per Key personnel per month.
7. The proposed Key personnel are not to be changed till the completion of the work. Under emergent circumstances, in case they are required to be changed, the new incumbent should have similar or better experience and qualification than as required above. These changes are permitted only with the approval of the Employer. Change in key personnel for one time without penalty is permitted. However, for subsequent changes there will be Penalty at Rs 25,000 /- Per Key personnel for SI .no 1 & 2.
8. All Key Personnel must be permanently stationed at Bangalore till the completion of the work.
9. The penalties imposed are non-refundable.

K RIDE

## Appendix-05

### PLANT AND EQUIPMENT

### Tools for Building and External Electrification Works

Sl. no	Item Description	Unit	Qty
1	Electric Hand Driller	No's	1
2	Digital Multi meter	No's	1
3	Insulation Megger	No's	1
4	Digital Earth Tester	No's	1
5	Ladder	No's	2
6	Hand Tool Kit	No's	2
7	Angle Grinder Machine	No's	2
8	Crimping Tool	Each	1
9	Set of Wrench, Socket Spanner	No's	1

#### NOTES:

1. The above type of plant and equipment (but not limited to) may be required for execution of the work. The contractor shall submit the details of plant & equipment to be deployed in the above table within 28 days of issue of LOA to the Engineer for approval.
2. Plant and Equipment indicated above is minimum to be deployed at appropriate stage of the work. However, depending on the requirement to complete the work in the stipulated completion period, the tenderer should deploy additional machinery as circumstances warrant at no extra cost.
3. Plant and equipment to be mobilized for the work shall be in good serviceable condition.

**Appendix-06**

**OFFICE ACCOMMODATION, EQUIPMENT AND TRANSPORT - DELETED**

K RIDE



**APPENDIX 7: DOCUMENT SUBMISSION AND RESPONSE PROCEDURE**

**DELETED**

K RIDE

### ANNEXURE 1

The Contractor shall prepare and submit his detailed Programme of Work so as to achieve key dates of various activities on time. The Contractor shall complete the work in a phased manner by fixing priorities to different stretches of work to give access to the other interfacing contractors as per the requirement of project from time to time and as per the key dates (mile stones) indicated below:

#### Name of Work

"BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

Key Dates No.	Description of stage	Liquidity Damages for non-achieving the key dates
KD 1	Joint inspections of site/locations along with K-Ride/Railway officials.	0.01% of contract value for each week or part of the week
KD 2	Start of work.	0.01% of contract value for each week or part of the week
KD 3	Completion of Work.	0.01% of contract value for each week or part of the week
KD 4	Testing and commissioning of work	0.01% of contract value for each week or part of the week
KD 5	Arranging EIG inspection wherever required, obtaining EIG Approval.	0.01% of contract value for each week or part of the week

--00--00--00--

## **SECTION 8A-1: GENERAL REQUIREMENT**

<b>SL. NO</b>	<b>DESCRIPTION</b>	<b>PAGE NO.</b>
1	CARE OF THE WORKS	256
2	PROTECTION OF THE WORKS FROM WEATHER	256
3	PROTECTION OF THE FINISHED WORK	257
4	DAMAGE AND INTERFERENCE	257
5	STRUCTURES, ROADS AND OTHER PROPERTIES	257
6	ALTERNATIVE ACCESS	257
7	TRANSPLANTED / CUTTING OF TREES	258
8	REMOVAL OF GRAVES AND OTHER OBSTRUCTIONS	258
9	PROTECTION THE ADJACENT STRUCTURES AND WORKS	258
10	SITE ESTABLISHMENT	258
11	SUBMISSIONS OF PARTICULARS	259
12	SECURITY	259
13	RECORDS OF WAGE RATES	259
14	PROVISION AND DISPOSAL OF EARTHWORKS / MATERIALS	259
15	RESTORATION OF AREAS DISTURBED BY CONSTRUCTION	259
16	CONTRACTOR'S LABOUR CAMPS	260

## **GENERAL REQUIREMENTS –CONSTRUCTION**

### **1.0 CARE OF THE WORKS**

- 1.1 Any error in the execution of work leading to redesign work shall be duly compensated by the Contractor as per the decision of Engineer. Any error attributable to the construction including Failure to locate underground utilities shall attract penalties.
- 1.2 Unless otherwise permitted by the Engineer all works shall be carried out in dry conditions.
- 1.3 The Works, including materials for using in the Works, shall be protected from damage due to water. Water on the Site and water entering the Site shall be promptly by temporary drainage or pumping system or by other methods capable of keeping the Works free of water. Silt and debris shall be removed by traps before the water is discharged and shall be disposed of at a location or locations to which the Engineer has given his consent.
- 1.4 The discharge points of the temporary systems shall be as per the consent of the Engineer. The Contractor shall make all arrangements with and obtain the necessary approval from the relevant authorities for discharging water to drains, watercourses etc. The relevant work shall not be commenced until the approved arrangements for disposal of the water have been implemented.
- 1.5 The methods used for keeping the Works free of water shall be such that settlement of, or damage to, new and existing structure does not occur. Measures shall be taken to prevent flotation of new and existing structures.

### **2.0 PROTECTION OF THE WORKS FROM WEATHER**

- 2.1 Work shall not be carried out in weather conditions that may adversely affect the Works unless proper protection is provided to the satisfaction of the Engineer.
- 2.2 Permanent Works, including materials for such Works, shall be protected from exposures of weather conditions that may adversely affect such Permanent Works or materials.
- 2.3 During construction of the Works storm restraint systems shall be provided where appropriate. These systems shall ensure the security of the partially completed and ongoing stages of construction in all weather conditions. Such storm restraint systems shall be installed as soon as practicable and shall be compatible with the right of way, or other access around or throughout the Site.
- 2.4 The Contractor shall at all times programme and carry out the work duly ensuring protective arrangements such that the Works can be made safe in the event of storms.

### 3.0 PROTECTION OF THE FINISHED WORK

- 3.1 The finished Works shall be protected from any damage that could arise from any activities on the adjacent site / works.

### 4.0 DAMAGE AND INTERFERENCE

- 4.1 Work shall be carried out in such a manner that there is no damage to or interference with: -

- a. Watercourses or drainage systems:
- b. Utilities:
- c. Structures (including foundations), roads, including street fixtures, or other properties:
- d. Public or private vehicular or pedestrian access:
- e. Monuments, temples, graves or burial grounds other than to the extent that is necessary for them to be removed or diverted to permit the execution of the Works. Heritage structures shall not be damaged or disfigured on any account.

The Contractor shall inform the Engineer as soon as practicable of any items which are not stated in the Contract to be removed or diverted but which the Contractor considers necessary to be removed or diverted to enable the Works to be carried out. Such items shall not be removed or diverted until the consent of the Engineer to such removal or diversion has been obtained.

- 4.2 Items which are damaged or interfered with as a result of the Works and items which are removed to enable the Works to be carried out shall be reinstated to the satisfaction of the Engineer and to at least the same condition as existed before the Work started. Any claims by Utility Agencies due to damage of utilities by the Contractor shall be borne by the Contractor.

### 5.0 STRUCTURES, ROADS AND OTHER PROPERTIES

- 5.1 The Contractor shall immediately inform the Engineer of any damage to structures, roads or other properties.

### 6.0 ALTERNATIVE ACCESS

- 6.1 Alternative access shall be provided to all premises if interference with the existing access, public or private is necessary to enable the Works to be carried out. The arrangements for the alternative access shall be as agreed by the Engineer and the concerned agency and at contractor's cost. Unless agreed otherwise, the permanent access shall be reinstated as soon as practicable after the work is complete and the alternative access shall be removing immediately it is no longer required, and the ground surfaces reinstated to the satisfaction of the Engineer. Proper signage and guidance shall be provided for the traffic / users regarding diversions. All temporary access diversion and roads the contractor has to arrange at his own cost.

## **7.0 TRANSPLANTED / CUTTING OF TREES**

- 7.1** The felling of trees in the Bangalore City is governed by The Karnataka preservation of Trees Act 1976. The Contractor is not permitted to cut any tree in terms of the provisions of the aforementioned Act. The Employer has assessed the number of trees existing within the right-of-way and has arranged for cutting and removal of trees, which are likely to be affected by the right of way (i.e., within the limits of permanent works) construction works. The trees requiring to be felled will have to be removed from ground level prior to commencement of the works. The Contractor have to cut and remove the trees as directed by the Employer.
- 7.2** The Contractor shall carefully survey the site and identify the additional trees, if any which are coming within the footprints of the permanent structure / building and within the space required for forming slopes / benching etc., for excavation of the basements and are required to be cut / trimmed. The Contractor must notify the Engineer of such requirements well in advance.
- 7.3** On receipt of the submission by the Contractor giving such details, the Engineer shall arrange to verify the requirement of tree cutting / removal and identify the trees, which can be transplanted subject to compliance with the aforementioned Act. These requirements and details will be forwarded to Forest Department for getting the permission. Contractor will lease with the Forest Department for getting the permission. The Contractor shall also submit a detailed procedure approved by the Engineer for such transplantation duly assisted by competent horticulturist. The trees have to be transplanted as directed by the Engineer. The Contractor has to obtain permission for tree cutting from the concerned authority and then only trees can be cut / transplanted. The Contractor has to arrange for tree felling / transplantation of the trees at the desired locations as suggested by the authorities.

## **8.0 REMOVAL OF GRAVES AND OTHER OBSTRUCTIONS**

- 8.1** If any grave and other obstructions are required to be removed in order to execute the Works and such removal has not already been arranged for, the Contractor shall draw the Engineer's attention to them in good time to make necessary arrangement for authorizations for such removal. The Contractor shall not himself remove them unless the Engineer has given consent.

## **9.0 PROTECTION THE ADJACENT STRUCTURES AND WORKS**

- 9.1** The Contractor shall be taking all necessary precautions to protect the structures or works being carried out by others adjacent to and, for the time being, within the Site from the effects of vibrations, undermining and any other earth movements or the diversion of water flow arising from its works.

## **10.0 SITE ESTABLISHMENT- DELETED**

### 11.0 Submissions of Particulars - DELETED

### 12.0 Security - DELETED

### 13.0 Records of Wage Rates-

13.1 The Contractor shall keep monthly records of the average, high and low wage rates for each trade/ tradesman employed on the Site and records shall be made available to the Engineer during inspection. Contractor has to follow all the existing labor laws.

### 14.0 Provision and Disposal of Earthworks / Materials

14.1 The Contractor shall be responsible for the provision of all classes of earthworks material required for the Works, whether sourced from the excavation within the Contractor obtained from any other source located outside the Site, for which the Engineer has given the concerned. For fill or dumping sites, the Contractor shall prepare a land plan with the details of surface drainage requirement, final formation levels and arrangement for spreading and comparison of the filled during dumping as acceptable to the Engineer, at contractors dumping yard. The contractor shall also provide security for the Site. The dumping site to be used by the Contractor shall be as directed by the Engineer, and has to be arranged by the contractor at his own cost.

14.2 All excavated material, including waste material shall be disposed of at the contractor dumping yard only. The useful material shall be placed and compacted in accordance with the Construction specification for Earth Works or as otherwise directed by the Engineer 's Representatives. The disposal of waste material, bentonite fluid and material contaminated with bentonite shall be the full responsibility of the Contractor and these materials shall be disposed of by the Contractor at his dumping yard and in an approved manner.

14.3 Rock / Dismantled Concrete deposited as fill material at contractors dumping yard.

### 15.0 Restoration of Areas Disturbed by Construction

Unless otherwise directed by the Engineer, any area disturbed by the construction activity, either inside or outside the Project Right of Way, shall be reinstated as follows:

All areas affected by the construction work shall be reinstated to their original condition, with new materials, including but not necessarily limited to, sidewalks, parking lots, access roads, adjacent roads, properties and landscaping. Grass cover shall be provided for any bare earth surface areas, along with proper provisions for surface drainage.

**16.0 Contractor's Labour Camps**

**16.1** The Employer will not provide living accommodation for use of the Contractor or any of his staff or labour employed on the works. Living accommodation shall not be established on any land provided to the Contractor by the Employer for the Works.

**16.2 Provision of Labour Camps**

The Contractor, shall, at his own expense, make adequate arrangements for the housing, supply of drinking water and provision of bathrooms, latrines and urinals, with adequate water supply, for his staff as well as for workmen employed on the Works directly or through sub-contractors at the location authorized by Engineer. No labour camp shall be allowed at work site or any unauthorized place.

The Contractor at his own cost shall maintain all campsites in a clean and sanitary condition. The Contractor shall obey all health and sanitary rules and regulations, and carry out at his cost all health and sanitary measures that may from time to time be prescribed by the Local/Medical Authorities and permit inspection of all health and sanitary arrangements at all times by the Employer, the Engineer and the staff of the local municipality or other authorities concerned.

**-0-0-0-**



# **SECTION-8B**

# **TECHNICAL SPECIFICATIONS**

## **1. GENERAL**

### **1.1 General**

- 1.1.1** These Specifications contained herein shall be read in conjunction with other tender documents.
- 1.1.2** The Work shall be carried out in accordance with the approved drawings and designs as would be submitted by the contractor and approved by the Engineer duly signed and stamped or issued to the Contractor by the Engineer duly signed and stamped by him as the case may be. The Contractor shall not take cognisance of any drawings, designs, specifications, etc. not bearing Engineer's signature and stamp. Similarly, the Contractor shall not take cognisance of instructions given by any other Authority except the instructions given by the Engineer in writing.
- 1.1.3** The work shall be executed and measured as per metric units given in the Schedule of Quantities, drawings etc. (FPS units where indicated are for guidance only).
- 1.1.4** Absence of terms such as providing, supplying, laying, installing, fixing etc. in the descriptions does not even remotely suggest that the Contractor is absolved of such providing, supplying etc. unless an explicit stipulation is made in this contract.
- 1.1.5** The specifications have been divided into different sections / sub-heads for convenience only. They do not restrict any cross-references. The Contractor shall take into account inter-relations between various parts of works/trades. No claim shall be entertained on the basis of compartmental interpretations.
- 1.1.6** The classification of various items of works for purposes of measurements and payments shall be as per Bills of Quantities (BOQ). Except where distinguished by BOQ, the rates apply to all heights, depths, leads, lifts, sizes, shapes and locations. They also cater for all cuts and wastes.
- 1.1.7** Reference to the Standard Codes of Practice.

Section:8B Technical Specifications

1. The contractor shall make available at site all relevant Codes of practice as applicable.
2. Legend:

BS	British Standard
CPWD	Central Public Works Department
IRS	Indian Railway Standards
IS	Indian Standards

**1.1.8 Other Publications: - DELETED**

**1.1.9 Contractor to Provide:**

The Contractor shall provide and maintain at site throughout the period of works the following at his own cost and without extra charge, except for the items specified in the Bill of Quantities the cost being held to be included in the Contract Rates :

1. General works such as site clearance before and on completion of works.
2. All labour, materials, plant, equipment and temporary works, overhead charges as well as general liabilities, obligations, insurance and risks arising out of GCC, required completing and maintaining the works to the satisfaction of the Engineer.
3. Adequate lighting for night works, and also at other times whenever and wherever required by the Engineer.
4. Temporary fences, barricades, guards, lights and protective work necessary for protection of workmen, supervisors, engineers, General public and any other persons permitted access to the site. Contractor shall provide proper signages as directed.

## Section:8B Technical Specifications

All fences, barricade shall be painted with colour shades as specified by the Engineer. The barricading should be of adequate height to ensure visual obstruction of work from public view.

5. All equipment, instruments, labour and materials required by the Engineer for satisfactory completion of works.
6. Design mixes and testing them as per relevant clauses of specifications giving proportion of ingredients, sources of aggregates and binder along with accompanying trial mixes. Test results to be submitted to the Engineer for his approval before adoption on works.
7. Cost of Preparation and compliance with provision of a quality assurance control program.
8. Cost of safe guarding the environment as per SCC.
9. Contractor has to provide Method statements i.e., detailed work procedure for all the works

### **1.1.10 Quality Assurance & Quality Control**

1. The work shall conform to high standards of design and workmanship, shall be structurally sound and aesthetically pleasing. The Contractor shall conform to the Quality standards prescribed, which shall form the backbone for the Quality Assurance and Quality Control system.
2. At the site, the Contractor shall arrange the materials, their stacking/storage in as per the standards manner to ensure the quality. The Contractor shall provide all the necessary equipment and qualified manpower to test the quality of materials, assemblies etc., as directed by the Engineer. The tests shall be conducted at specified intervals and the results of tests properly documented. The cost of all such testing shall be included in the quoted rates and nothing extra shall be paid for in this regard. In addition, the Contractor shall keep appropriate tools and equipment for checking alignments, levels, slopes and evenness of the surfaces.

Section:8B Technical Specifications

3. (a) The Engineer shall be free to carry out such tests as may be decided by him at his sole discretion, from time to time, in addition to those specified in this document as per provisions of General Conditions of Contract. The Contractor shall provide the samples and labour for collecting the samples. Nothing extra shall be payable to the Contractor for samples, or for the collection of the samples.

(b) The test shall be conducted at the Site laboratory that may (to) be established by the Contractor at his cost or at any other Standard Laboratory selected by the Engineer.

(c) The Contractor shall transport the samples to the laboratory for which nothing extra shall be payable. In the event of the Contractor failing to arrange transportation of the samples in proper time the Engineer shall have them transported and recover two times the actual cost from the Contractor's bills.

(d) All testing shall be performed in the presence of Engineer or his authorised representative. Testing may be witnessed by the Contractor or his authorised representative if permitted by the Test House. Whether witnessed by the Contractor or not, the test results shall be binding on the Contractor.
4. All materials which do not conform to these specifications shall be rejected. In the event of contractor not being able to arrange the material conforming to these specifications or in the event of failure of the contractor to get the sources approved within the agreed schedule submitted by contractor, the Engineer shall have the powers to cause the Contractors to purchase and use such materials from any particular source, as may, in the Engineer's opinion, be necessary for the proper execution of work.

**1.1.11 Dimensions**

1. Figured dimensions on drawings shall only be followed and drawings to a large scale shall take precedence over those to a smaller scale. Special dimensions or directions in the specifications shall supersede all others. All dimensions shall be checked on site prior to execution.
2. The size, measurements and other information concerning the existing site as shown on the drawings are believed to be correct,

## Section:8B Technical Specifications

but the Contractor should verify them for himself and also examine the nature of the ground as no claim or allowance whatsoever will be entertained on account of any errors or omissions in the levels or the description of the ground levels or strata turning out different from what was expected or shown on the drawings.

### **1.1.12 Setting out of Works-DELETED**

### **1.1.13 Materials**

#### **1. Source of Materials**

It shall be the responsibility of the contractor to procure all the materials required for construction and completion of the contract. The contractor shall indicate in writing the source of materials well in advance to the Engineer, after the award of the work and get it approved from the Engineer before commencing the work. If the material from any source is found to be unacceptable at any time, it shall be rejected by the Engineer.

#### **2. Quality**

All materials used in the works shall be of the best quality of their respective kinds as specified herein, obtained from sources and suppliers approved by the Engineer and shall comply strictly with the tests prescribed hereafter, or where tests are not laid down in the specifications, with the requirements of the latest issues of the relevant Indian & other Standards.

#### **3. Sampling and Testing**

All materials used in the works shall be subjected to inspection and test in addition to test certificates. Samples of all materials proposed to be employed in the permanent works shall be submitted to the Engineer at least 15 days in advance for approval before they are brought to the site.

Samples required for approval and testing must be supplied sufficiently in advance in required quantity and number to allow for testing and approval, due allowance being made for the fact that if the first samples are rejected further samples may be required. Delay to the works arising from the late submission of samples will not be acceptable as a reason for delay in completion of the works.

Materials shall be tested before leaving the manufacturer's premises, source. Materials shall also be tested at site and they may be rejected if not found suitable or in accordance with the specifications, notwithstanding the results of

## Section:8B Technical Specifications

the tests at the manufacturer's works or elsewhere or test certificates or any approval given earlier.

The contractor will bear all expenses for sampling and testing, whether at the manufacturer's premises at source, at site or at any testing laboratory or institution as directed by the Engineer subject to the provisions of No extra payment shall be made on this account.

### **4. Dispatch of materials**

Materials shall not be dispatched from the manufacturer's works to the site without written authority from the Engineer.

### **5. Test certificates**

All manufacturer's certificates of test, proof sheets, etc showing that the materials have been tested in accordance with the requirement of these specifications and of the appropriate Indian Standards are to be supplied free of charge to the Engineer.

### **6. Rejection**

Any materials that have not been found to conform to the specifications or otherwise not acceptable to the Engineer will be rejected forthwith and shall be removed from the site by the Contractor at his own cost within three days or as instructed by the Engineer.

#### **1.1.14 Storing of Materials at site**

All materials used in the works shall be stored on racks, supports, in bins, silos, go-downs, under cover etc. as appropriate to prevent deterioration or damage from any cause whatsoever to the entire satisfaction of the Engineer.

The storage of materials shall be in accordance with IS 4082 "Recommendation on stacking and storage of construction materials on site" and as per IS 7969 "Safety code for handling and storage of building materials".

The materials shall be stored in a proper manner at places at site approved by the Engineer. Should the place, where material is stored by the Contractor, be required by the Employer for any other purpose, the Contractor shall forthwith remove the material from that place at his own cost and clear the place for the use of the Employer within the time as communicated by the Engineer and at no extra cost to the Employer.

#### **1.1.15 Water**

##### **1. Water from approved source:**

Potable water only shall be used for the works. Contractor shall have his own source of water duly tested and approved by Engineer. The water shall be free

## Section:8B Technical Specifications

from any deleterious matter in solution or in suspension and be obtained from an approved source. The quality of water shall conform to IS 456.

### **2. Storage:**

The Contractor shall make his own arrangements for storing water, if necessary, in drums or tanks or cisterns, to the approval of the Engineer. Care shall be exercised to see that water is not contaminated in any way.

### **3. Testing:**

Before starting any concreting work and wherever the source of water changes, the water shall be tested for its chemical and other impurities to ascertain its suitability for use in concrete for approval of the Engineer. No water shall be used until tested and found satisfactory. Cost of all such Tests shall be borne by the contractor.

#### **1.1.16 Workmanship**

1. Any work not to the satisfaction of the Engineer or his representative will be rejected and the same shall be rectified, or removed and replaced with work of the required standard of workmanship at no extra cost.

#### **1.1.17 Load Testing On Completed Structures -DELETED**

#### **1.2 STRUCTURAL WORK-DELETED**

##### **1.2.1 Supply of Monthly Progress Photographs and Album-DELETED**

##### **1.2.2 Supply of Monthly Progress Video CD's-DELETED**

##### **1.2.3 Survey Work-DELETED**

##### **1.2.4 Barricading**

The work covers barricading for the work done along the Existing IR track, median and areas affecting road or rail traffic. Barricading for other areas like casting yard, batching plant, storage and other working area shall be done at own cost by the contractor. The detailed scope of work is:

- (i) Providing and installing the barricade of the design and type as shown in the typical sketch furnished as per the approved plan firmly to the ground and maintaining it during the progress of work.



- (ii) Providing adequate road and IR track safety devices. A tentative list given hereunder identifies minimum items, which may be required. However, actual numbers required shall be as per plan approved by the Engineer and clearance obtained from traffic department, Bangalore and concerned division of Railway officials. During execution of works, if any additional cost to this list is required then the contractor shall not be paid any extra cost.
- (iii) Dismantling of barricade, other temporary installation from the site and cleaning the site shall be as per direction of Engineer upon completion and acceptance of work.

Tentative Road or IR track Safety Devices are mentioned below or any other safety devices as per site requirement

1. Supply of Red portable traffic cones of 750mm height with white reflective tape bands on 100mm width all around.
2. Hazard warning light flashes with rechargeable. Maintenance free battery & charging system.
3. Safety light island post with 11 nos. parallel reflective.
4. Red reflective arrow fitted on enabled mild steel board of 360 x 220mm size.
5. Traffic Triangular Tripod made of fluorescent cloth fitted on steel frame.
6. Retro-reflective tape (I) 50mm width.
7. Fluorescent Jackets with reflective tape all around.
8. Yellow reflective cat eyes of size 115 x 11 x 22 mm made of ABS material having 19 glass beads on each side.
9. Metal Tabular Delineator of 610mm height with reflective tapes.
10. Retro-reflective arrows diversion board 450 x 900mm with crystal clear protective transparent coat to avoid damage on 14-gauge Mild Steel sheet with and without pole.
11. Retro-reflective "Men at Work" triangular board of size 900mm with crystal protective transparent coat to avoid damage on 14-gauge Mild Steel board with and without poles.
12. Retro-reflective board for "Go Slow Work in Progress" of size 1200 x 750mm with crystal clear protective transparent coat to avoid damage to the Mild Steel board with and without pole.
13. Retro-reflective advance direction signs cum Diversion Boards of size 1200 x 900mm with crystal clear protective transparent coat to avoid damage to the 14 gauge Mild Steel sheet with and without pole.

Section:8B Technical Specifications

14. Retro-reflective speed limit circular sign Boards of 600mm Diameter with crystal clear protective transparent coat to avoid damage on 14 gauge sheet (without pole).
15. 'SORRY FOR INCONVENIENCE' Retro-reflective Boards of size 900 x 300mm size with crystal clear protective transparent coat to avoid damage on 14 gauge Mild Steel sheet (without pole).
16. HAZARD MARKERS (Yellow & Black) must be put all over the construction sites. This Retro-reflective board is of size 300 x 900mm with crystal clear protective coat to avoid damage and the 14 gauge Mild Steel with or without pole.
17. 'CAUTION' tape which is normally yellow tape of special Polyether Material having 75mm width 'CAUTION' is written all over with Black colour is rolls of 300 meter.
18. For running trains ,Retro-reflective speed limit as per IR Specifications.

**1.2.4.1 Measurement-DELETED**

**1.2.5 Transplantation of Trees -DELETED**

**1.2.5.1 Measurement-DELETED**

**Sub-Contractor-DELETED**

**1.3 Guarantees and Maintenance: - DELETED**

**1.3.1 Responsibility for Shop drawings, Samples and Mock-ups:  
- DELETED**

**1.3.2 Cleaning - DELETED**

**1.3.3 Expansion bolts/ fasteners: -DELETED**

### 1.4 Applicable Codes, Standards & Publications for Electrical works

The important Codes, Standards and Publications to Contract are listed here under but not limited to:

Sl.no	Standard	Description
1	IS:3427	AC metal enclosed switchgear and control gear for rated voltages above 1 KV and up to and including 52 KV.
2	IS 12063	Classification of degrees of protection provided by enclosures of electrical equipment
3	IS 9920 (Parts 1 to 4):	High Voltage Switches.
4	IS 9921 (Parts 1 to 5):	Specification for AC disconnectors and earthing switches for voltages above 1000 V
5	IS 13118	HV AC Circuit Breakers
6	IS 12729	General requirements of switchgear and control gear for voltages exceeding 1000 V
7	IS 10601	Dimensions of terminals of HV Switchgear and Control gear.
8	IEC 1330	High voltage/Low voltage prefabricated substations
9	IEC 60694	Common clauses for MV switchgear standards.
10	IEC 6081	Monitoring and control.
11	IS 2705	Current Transformers
12	IS 3156	Voltage transformers
13	IS 8686	Specification for Static Protective Relays
14	IEC 62271-200	Standards for high voltage metal clad switchgear up to 52 KV.
15	IS 8130	Conductors for insulated electrical cables and flexible cords.
16	IS 10810(series)	Methods of tests for cables.
17	IS 10418	Drums for electric cables.
18	IS 7098 (Part 2)	Cross-linked Polyethylene insulation for Cables
19	IS 5831	Specification for PVC insulation sheath for electric cables

Section:8B Technical Specifications

20	IS 7098 (Part-II) 13573,1992	Power cables with extruded insulation and their accessories for rated voltages from 1 kV ( $U_m = 1,2$ kV) up to 30 kV ( $U_m = 36$ kV) - ALL PARTS
21	IS 3043	Code of Practice for Earthing
22	IS 398-part II	Aluminium Conductor for Overhead Transmission Purpose
23	IEC-99-4	Gapless Lightning Arrestor
24	IS 3070 P-III	Metal Oxide Surge Arrestors without gaps for AC Systems
25	IEC 99 P-III	Artificial Pollution Testing of Lightning Arrestor
26	IS 2071	Methods of H V Testing
27	IS 694	PVC Insulated cables for working voltages up to and including 1000V
28	IS 14786/2000	Specification for high voltage pre-fabricated Sub-station
29	IS 1180	Power Transformer
30	IS 3637	Gas Operated relays
31	IS 1347	Low Voltage Switchgear and Control gear
32	IS 1255	Code of practice for installation and maintenance of power cables up to and including 33 kv rating
33	IS 13158	Prestressed concrete circular spun poles for overhead power, traction and telecommunication lines -- specification
34	IS 785	Reinforced concrete poles for overhead power and telecommunication lines - specification
35	IS 4091	Code of practice for design and construction of foundations for transmission line, tower and poles

## **TECHNICAL SPECIFICATION**

### **1. POINT WIRING:**

Wire of size 2x1.5 sq. mm (Phase & Neutral) & 1x1.5 sq.mm (Earth Wire), 1100 V grade FRLS (Fire Retardant Low Smoke) PVC insulated, multistranded copper wire in PVC concealed conduit and approved color with necessary junction boxes, angle holder etc. as required with relevant IS spec (IS 694: and latest ammendements) with a 6A modular type SP control switch (Switch shall be paid seperately) which shall be fixed on existing plastic sheet / gang box, the other end of the wire shall be terminated with sufficient loose length in a wood / PVC block.

### **2. GI Modular Switch Boxes:**

Boxes for housing modular wiring accessories (switches, switched socket outlets, RJ 45 outlets, bell pushes, electronic fan regulators etc..) shall be fabricated from minimum 1.6 mm thick MS sheets provided with rust inhibiting zinc phosphating treatment. The MS boxes shall be suitable for a grid plate fixed over it for mounting wiring accessories leaving ample space at the back and on the sides for accommodating wiring conductors, MS boxes shall be provided with a brass earth terminal. The MS boxes shall have knockout holes for conduit entry which shall be secured in position by check nuts and provided with bushes. No timber shall be used for any supports.

### **3. Modular PVC switch plate:**

Switches, receptacles and telephone system outlet in wall shall be provided with moulded cover plates of shape, size and colour approved by the Engineer -in- charge made from high impact resistant, flame retarding and ultra-violet stabilized engineering plastic, and secured to the box with counter sunk round head chromium plated brass screws. Where two or more switches are installed together, they shall be provided with common switch cover plate as described above with notches to accommodate all switches either in one, two and three rows.

One and two gang switch cover plate, telephone outlet cover plate, 6/16A sockets with switch plates, shall have the same shape and size. Wherever five switches, seven switches, ten switches and eleven switches are to be fixed the next higher size of gang switch cover plate to be used and opening shall be provided with blank off covers at no extra cost.

### **4. SWITCH 6A:**

Flush type switch - 6 A to operate on AC single phase 240V, 50 Hz supply confirming to IS 3854/latest.

Switches controlling fans and plug points shall have engraved letters 'F' and 'P' respectively as applicable/available for the category.

### **5. PLUG POINT 6A:**

Wiring shall be with FR PVC insulated, multistranded copper of size 2.5 sq.mm for phase and neutral and 1.5 sq.mm for earthing with IS spec (IS 694 latest) with 6A modular switch and modular sockets mounted on GI box concealed on wall.

### **6. PLUG POINT 16A:**

The plug point shall be 5 pin, 16A rated. A modular switch of 16A (IS 1293) shall be provided with plug socket. This shall be fixed on GI box. The plug point shall be by means of 2 runs of 4 sq.mm FRLS PVC insulated, multi stranded copper wire, 1100 V grade relavent IS spec (IS 694 latest) and 1 run of 1.5 sq.mm FRLS PVC insulated, multi stranded copper wire, 1100 V grade relavent IS spec (IS 694 latest).

## **7. CEILING FAN POINT:**

The ceiling fan point wiring will be done with FRLS PVC insulated, PVC sheathed multi stranded copper wire of size, 2 runs of 1.5 sq. mm for Phase and Neutral and 1 run of 1.5 sq.mm for Earth, 1100V grade with IS Spec (IS 694) with fan junction box. A modular switch of 6A capacity shall be provided on switch board.

## **8. CEILING ROSE:**

Surface semi recessed types for pendent lighting and fan, wherever require, to be used in circuits with voltage not exceeding 240V, current 5A, conforming to IS 371/latest.

## **9. DB MAINS 6 SQ. MM & 10 SQ.MM :**

Wiring which is not covered under point wiring such as connection from Main Distribution Board to other Sub distribution board will be measured and recorded as DB mains. The DB mains shall be by means of Four nos of 6 /10 sq.mm FRLS PVC insulated, multi stranded copper wire, 1100 V grade relavent IS spec (IS 694 latest) and 1 run of 2.5 sq.mm FRLS PVC insulated, multi stranded copper wire, 1100 V grade relavent IS spec (IS 694 latest) in respective colours . All the DB main shall run suitable separate PVC conduit and earth connectivity shall be maintained.

## **10. PVC PIPE:**

### **10.1 TYPE & SIZE OF PVC PIPES:**

Heavy gauge PVC conduit pipe of of size 32mm dia, 2.5mm thick confirming to IS 2509 with suitable size bends, metal/ PVC junction boxes etc., All PVC pipes for wiring shall be confirming to IS 2509 with grey/ ivory colour.

Heavy gauge PVC conduit pipe of of size 25mm dia, 2.0mm thick confirming to IS 2509 with suitable size bends, metal/ PVC junction boxes etc., All PVC pipes for wiring shall be confirming to IS 2509 with grey/ ivory colour.

Heavy gauge PVC conduit pipe of of size 20mm dia, 2.0mm thick confirming to IS 2509 with suitable size bends, metal/ PVC junction boxes etc., All PVC pipes for wiring shall be confirming to IS 2509 with grey/ ivory colour

The number of insulated conductors that can be drawn into PVC pipes should be as per table III of IS:732/1963 and should be easy to pull at the time of rewiring. Conduit inspection type coupler at reasonable interval shall be provided. Scope includes supply of couplers, joint box, bends etc. at contractor's cost. No PVC pipe less than 20mm +/- 0.2mm in diameter with wall thickness of 2mm shall be used.

### **10.2 FIXING / CONCEALING OF CONDUIT:**

Conduits shall be laid inside roof slab or wall for concealed wiring. Replastering shall be done after laying the conduits in the wall / roof. Conduits shall be attached with existing PVC pipe if already laid in roof.

## **11. SYSTEM OF WIRING:**

Concealed or surface wiring system shall be adopted for wiring as per site condition as instructed by Engineer In Charge.

The system of wiring shall be such that separate phase and neutral wires shall be taken from the switch control board to each and every light/ fan point. Suitable Bakelite connectors shall be used in the switch control board for termination of phase and neutral wires controlling the light points. No jointing or twisting of wires is permitted either inside the control boards or anywhere else outside. Necessary earth continuity connection to fan/ light / socket points shall be provided along with wiring cable. Connection to light/fan from ceiling rose shall be with 3 core 1.5 sq.mm flexible copper cables with approved coloured sleeve. The wiring shall be carried out in an approved manner satisfying the relevant IS specification, code of practice available and additional specifications applicable if any for surface/ concealed wiring system.

The route of the wiring is to be decided in consultation with the authorised representative of Engineer-in charge. Chipping/ replastering of wall/ceiling as required for wiring shall be carried out by the contractor.

Before commissioning the installations, the following tests shall be conducted and the results shall conform to the values specified and shall be certified by the person whose competency certificate has been attached.

1. Insulation resistance test
2. Testing of polarity of non-linked single pole switches
3. Earth continuity path (Bell tester)
4. Earth resistance value
5. Any other test as desired by Engineer-in-charge on safety point of view.

Modular type switches/ sockets/ceiling roses/unbreakable boxes for switch boards etc shall be used for carrying out the wiring. Switch boards and MCB DBs shall be fixed in concealed/surface manner as per instruction of Engineer in charge. Blanking plates shall be provided for modular switch boards wherever necessary and this is in contractors scope of work at their cost.

Modular unbreakable boxes of various sizes shall be used for switch board as required. White finish cover frames shall be generally used with white switches and other accessories. Acceptance shall be obtained for the switches/boards etc. including colour selection before using at site. Modular boxes shall be inclusive of cover frame and inner plate.

## **12. 4 FEET 1x10/20W LED LIGHT BATTEN FITTING:**

Fitting shall be of complete set with driver circuit, LED lamp etc. complying with CEE/SWR specification. (CEE/SWR specification No. SWR/LED Light fitting (Indoor/Outdoor)/001-2016 Dt. 18.04.016) given at para No.16

LED 10/20W fittings on the wall shall be mounted on suitable PVC round blocks - 2 Nos fixed as per standard wiring practice.

## **13. CEILING FAN:**

The contractor should supply, assemble the ceiling fan, fix, and commission at the required location, with fixing of regulator. Fan should be connected to terminated wiring point (Ceiling Rose) by 1.5 Sq.mm Copper 3 core round flexible sheathed wire wherever necessary. This work includes fixing 1200 mm sweep BLDC ceiling fan with suitable electronic regulator, fixing fan hooks in ceiling with all necessary accessories.

<b>Description:</b> Energy Efficient brush less DC Motor (BLDC) Ceiling Fan		
<b>Technical Specification:</b>		
1.	<b>Sweep</b>	1200mm
2.	<b>BEE rating</b>	5star
3.	<b>Rated power</b>	28 Watts
4.	<b>Operating Voltage</b>	230V Single Phase AC
5.	<b>Frequency</b>	50 Hz
6.	<b>Air Delivery</b>	220M <sup>3</sup> /min
7.	<b>Harmonic Distortion</b>	5% Max
8.	<b>Speed Control</b>	Smart remote control with Minimum three steps
9.	<b>Blade thickness</b>	1.1MM
10.	<b>Blade material</b>	Aluminium
11.	<b>Bearing</b>	Double Ball Bearing
12.	<b>Down Rod Size (without Shackles)</b>	300mm
13.	<b>Shank and Shackle Thickness</b>	2mm (Minimum)
14.	<b>Canopy</b>	2 Nos
15.	<b>Colour</b>	Standard White
16.	<b>Warranty</b>	5 Years
17.	<b>IS Specification</b>	1. The performance test for air delivery shall be conducted as per clause 10.3 of IS Specification No: 394 / 1979. 2. The fan shall comply with IS: 616 / 2010 for safety requirements for electronics equipment's.
18.	<b>Test Report</b>	The firm has to submit type test report from Govt. accredited test labs like NABL/CPRI etc.,

#### 14. WARRANTY FOR BLDC FANS

Successful tenderer has to submit warranty certificate against failure for the BLDC fan(1200mm) for a period of 5 years from the date of passing of Final Completion Certificate for the work. In precedence to the same, the tenderer should submit a copy of an original undertaking on Stamp Paper of value Rs 200/-citing abidance to the 5 year warranty obligation duly signed by the tenderer and certified by Notary. Later the Original Undertaking should be submitted to this office by the successful tenderer. In case of failure to comply with the warranty obligation; this undertaking will be a valid binding document for taking legal action for default.

#### 15. LED STREET LIGHT FITTING:

Fitting shall be of complete set with driver circuit, LED lamp etc. Fitting shall be similar to Bajaj make Model No. BCLST 25/40 W LED or any approved make.

When the fitting is mounted on pipe bracket, 25x6mm size GI clamps with fasteners shall be used for fixing the fitting on the building/ on pole. When fixing on building/ on the pole, wiring shall be extended from ceiling rose/from OH line with 1.5sqmm copper wires as part of fixing of fitting which included in fixing cost.



## 16. LED LIGHT FITTINGS AND STREET LIGHT FITTINGS

**General requirements of LED Type (INDOOR/OUTDOOR) light fitting.**

**CEE/SWR specification No: SWR/LED LIGHT FITTING (Indoor/Outdoor) /001-2016**

1	LED Make	NICHIA / OSRAM / SEQUL / PHILIPS LUMILEDS / CREE / LEDNIUM / AVAGO
2	Type of LED	High Power, SMD (Surface Mounting Device) LED
3	Lumen Output/Efficiency	> 100 Lumens / Watt
4	Lumen Output at fitting level/ Efficiency	> 75 Lumens / Watt
5	LED Life	> 50,000 burning hours
6	Depreciation	30% max, after 50,000 burning hours
7	Colour Rendering Index (CRI)	> 75
8	Nominal Voltage	220 V AC
9	Input Operating Voltage	105-295 V AC
10	Power Factor	> 0.9
11	Protections	
	i. Surge protection	1.5 KV for 50 micro seconds
	ii. Over voltage protection	300 V AC for 2 minutes
	iii. High voltage protection	1.72 KV AC for 1 minute
	iv. Insulation Resistance	Minimum 2 mega ohms with 500 V megger
12	Driver Type	Constant Current driver with short circuit protection
13	Driver Components	Industrial grade only
14	THD	< 20%
15	Efficiency of Driver Electronic	Efficiency of driver > 85%
16	Construction of Housing	Pressure die cast aluminum or CRCA or Extruded aluminum
17	Finishing	Power coated / anodized
18	Lamp Cover	Toughened glass of min. 0.8 mm thickness of sufficient strength of high transmittance efficiency (min.90%) Acrylic diffuser as per need of fitting
19	Secondary optics	Polycarbonate reflector / polycarbonate lence

## Section:8B Technical Specifications

20	Mounting	Indoor: Suitable for Surface / Recessed / Hung Type Outdoor: Suitable for Existing pole etc.,
21	Ingress Protection	IP 20 – Indoor IP 65 – Outdoor.

### NOTE

- Supplied LED Luminaires shall conform to BIS:16107 or IEC 62722 and LEDs to BIS:16103 or IEC: 62717
- LED Luminaires shall also conform to LM- 79 (For quoted fitting) and LM- 80 for LEDs used.
- Firms have to submit LM80& LM79 test certificate from National/International accredited Laboratory and OEM certificate for compliance of BIS/IEC along with offer.
- Firms have to submit warranty certificate for 5 (five) years along with supply
- Make of whole LED Luminaire shall be as per approved make

Following information's are to be furnished prior to supply of item and approval is to be obtained:

- Type of luminaire: Like Street light, Flood light, focus light, retrofit (for retrofit type luminaire, this specification may be referred wherever applicable)
- Total wattage of LED luminaire
- Arrangement of LED: Single LED/ Multi LED
- Dimensions if required.
- Indoor/ Outdoor
- Mounting type: i.e., Indoor: Suitable for Surface / Recessed /Hung Type
- Outdoor: Suitable for Existing Pole etc.

## 17. 1.5 TONNAGE AC UNIT (INVERTER TYPE):

The 1.5 TON ACs to be supplied shall meet the following parameters

Sl.no	Particulars	Technical specifications
1	Make	As per approved list of items
2	Tonnage	1.5 Tonne
3	Refrigerant	R 32
4	Rated Voltage	230V
5	BEE Rating	5 star
6	Rated frequency	50 Hz
7	Phase	Single Phase
8	Compressor	Rotary
9	Condenser coil	Copper
10	Cooling Capacity	5000 Watts minimum
11	Air Flow (Hi/ Mi/ Lo) in (m <sup>3</sup> /h)	875 minimum

The Stabilizer suitable for 1.5 TON split AC to be supplied should meet the following parameters.

- Similar to V-Guard model No. VG 400
- Capacity-12A
- Working Voltage-170V – 270V
- Time Delay-ITDS 3 Min±20 sec
- Thermal overload protection
- High voltage cut-off

## 18. EXHAUST FANS:

The exhaust fan shall be minimum of 3-star energy rating issued by BEE and conforming IS:2312

### Technical parameters for Exhaust fan

Sl.no	Particulars	Technical specification
1	Make	As per approved list of items
2	Sweep	150/300 mm
3	BEE rating	3 Star
4	Rated power	150 W
5	Operating Voltage	230V
6	Rated Frequency	50 Hz
7	Air Delivery	280 m <sup>3</sup> /min
8	Guard	With Louver Shutters

## 19. DISTRIBUTION BOARD

Power Panel board shall be cubicle type made out of 16 SWG MS sheet powder coated consisting of copper bus bar arrangements and MCCB/MCBs/meters as per schedule. Copper Bus bars shall be of 4 no's each of cross section size 1 ½"x 1/8" or equivalent size.

Electronic energy meter shall be as per ESCOM approved make. Panel shall be erected on suitable stand or on CC foundation 1:3:6 mix or on the wall as instructed by Engr. in charge in concealed /surface manner.

MCCBs shall be adjustable type with 25KA breaking capacity.

MCBs shall be with C curve characteristics of 10KA category. Energy meter shall be fixed on suitable Hylem Sheet or suitably insulated from the panel board. AutoCAD drawings shall be submitted for approval before supply of panel board.

## 20. MINIATURE CIRCUIT BREAKER (MCB):

MCB DP/SPN/SP/FP/TPN of rating as specified in the schedule, 240 V/415V, 50 Hz. to automatically isolate the electrical circuit under sustained overloads or short circuits and comply to IS 13947.

MCB DB shall be powder coated made of 14 SWG MS sheet with all internal accessories. All MCBs shall be of 10 KA breaking capacity with 'C' curve characteristics.

## 21. MOULDED CASE CIRCUIT BREAKERS (MCCB)

MCCB shall be TPN of rating as specified in the relevant BOQ item and shall conform to IS- 13947/Pt-2/1993 (Ics = 100%Icu or as specified in the relevant BOQ item) with thermal release setting 70/80%-100% or fixed type as specified in the relevant BOQ item) with breaking capacity of not less than 25 kA for load currents up to 200 amp. & 35 kA for load currents above 200 amp rating. MCCBs shall be suitable for three phase, 415 Volt, AC supply.

## 22. RESIDUAL CURRENT CIRCUIT BREAKER RCCBS:

Section:8B Technical Specifications

RCCB DP/TPN of rating as specified, 240/415V, 50Hz with IS:12640 part-1 with 10KA short circuit withstand capacity. The RCCB shall be fixed on the distribution board in suitable enclosure.

**23. SINGLE PHASE ONLINE UPS**

FAULT TOLERANT UNINTERRUPTED POWER SUPPLY (UPS) SYSTEM FOR PRS, EDP CENTERS AND OTHER SIMILAR REQUIREMENTS OF ONLINE UPS SYSTEM

**23.1 Codes and standards**

23.1.1 The UPS shall comply with the requirements of latest issue of relevant Indian Standard/ IEC. Some of the applicable IS/IEC standards are listed below:

IEC:62040-13. Ed. 1.0 b	Specification for UPS- General and Safety requirements
IEC:62040-2	Specification for UPS-EMC requirement
IEC:62040-3	Method of specifying the performance and test requirements of UPS
IS: 9000	Environmental test
IEC: 61643	Surge Protection Devices

23.1.2 The equipment shall also conform to the provisions of Indian Electricity rules and other statutory regulations currently in force.

23.1.3 In case of any contradiction between the standards listed in Cl. 2.1 and this specification, the requirements laid down in this specification shall prevail.

**23.2 GENERAL REQUIREMENTS**

23.2.1 The UPS system shall be an integrated system comprising of input rectifier, charger, inverter, static bypass switch and manual bypass switch. The charger shall be designed such that it shall be able to charge the battery in constant voltage, constant current mode. Charging capacity shall be at the rate of 0.1C ('C' is the AH capacity of the Battery).

23.2.2 The UPS system shall be suitable to feed all loads connected to output which are primarily computers, printers, servers, scanners, modems, etc.

23.2.3 The UPS system shall be of true double conversion with an in-built isolation transformer (copper wound) and shall be based on latest generation technology having proven performance of satisfactory operation for similar applications. UPS of up to 5 kVA capacity shall be provided with inverter of type PWM IGBT. In UPS of capacity higher than 5 kVA, inverter of type PWM IGBT (IGBT modules only) shall be provided. All components shall be of quality and reliability that satisfies the requirements of a secure AC power to vital equipment. Components shall be capable of withstanding the thermal and dynamic stresses resulting from internal and external short circuits and circuit switching operations, etc.

23.2.4 The UPS shall be single phase system with single-phase input and single-phase output.

### 23.3 TECHNICAL REQUIREMENTS

#### 23.3.1 Input Power Supply

23.3.1.1 The UPS shall be suitable for the following input power supply:

i)	<b>For category A</b>	
	Voltage	170V -270V for single 1 phase*
	Frequency	50 Hz $\pm$ 8%

Standard voltage range is 170V – 270V. Optionally, the purchaser can ask for voltage range of 140 V – 280V.

#### 23.3.2 UPS design & performance requirements

- 23.3.2.1 Incoming AC supplies shall be converted to DC through input rectifier. The rectifier/charger shall operate according to the constant voltage current limiting principle and shall incorporate a “Soft Start” feature to gradually accept load on initial energizing.
- 23.3.2.2 The rectifier section/battery charger of the UPS system shall be capable of precise regulation to prevent damage to the battery. The output voltage of rectifier’s DC bus without the battery shall be stabilized to within 2% of set value during load variation between 0 to 100% of the rectifiers and specified mains input supply voltage variation. Current ripple content shall be less than 3% in the battery with battery connected.
- 23.3.2.3 An R.F. filter shall be provided at the input and output of UPS to suppress the radio frequency interference.
- 23.3.2.4 Transient/surge protection shall be provided in the input circuit to rectifiers to protect the UPS from surges & voltage spikes. Class C type SPD of appropriate rating with indication should be used where chances of lightning strikes are more or at those places where the chances of indirect surges in power supply are high. Otherwise, conventional surge protection with MOVs is to be done.
- 23.3.2.5 UPS shall be designed to operate satisfactorily while deriving power from an emergency diesel generating set. Suitable protection shall be provided in the control circuits to guard against electrical oscillations which may be present in the input supply as caused by emergency DG sets.
- 23.3.2.6 The UPS shall be provided with automatic sequence and power walk/ soft start in circuit(s) with appropriate time delay such that the rectifiers and inverters can start operating automatically when incoming AC power is restored allowing the UPS to be loaded automatically.
- 23.3.2.7 150 AH Sealed Maintenance Free (SMF) lead acid Batteries, having testing reports of NABL approved laboratory of one of the following makes --- AMARAJA/ Exide/ Bosch/ AMCO/ Hitachi shall be provided (2 Volt single cells or in the form of crate of 6V/12V preferable). With 180 mins backup.
- 23.3.2.8 For prescribing the battery VAH, the purchaser will consider the following:

Section:8B Technical Specifications

- a. Load Power Factor of 0.65 to unity
- b. Minimum ambient temperature shall be taken as 27°C.
- c. Battery Current = Inverter rated VA X Power factor/ (Inverter efficiency X End cell voltage X No. of cells).
- d. Ageing factor of 0.8.
- e. Minimum end cell voltage for lead acid battery 1.75V per cell. Battery low pre-alarm to be set at 1.8 volts per cell.

23.3.2.9 The rectifiers/ chargers shall be designed to completely re-charge the battery in a maximum time of 10 hours after complete discharge. The rectifier/charger shall be sized based on the maximum inverter input load when inverter is delivering its rated output at 0.8 pf lagging and recharge the battery to nominal rated capacity of the battery.

23.3.2.10 The rectifiers/charger shall sense the battery charging current and adjust the DC bus voltage to maintain the charging current to pre-set level. A separate current limit circuit shall also be provided for adjustment of battery current. Subsequent to a discharge cycle when battery is connected to rectifier/charger, the battery current shall be monitored, controlled and limited to set value automatically, irrespective of the inverter input current. The rectifier shall be protected against reverse battery connection at dc link voltage.

23.3.2.11 The UPS output voltage waveform shall be sinusoidal. The Total Harmonic Distortion (THD) of voltage waveform at inverter output shall not exceed 3% considering any linear load up to maximum rated output of UPS system at rated power factor and shall not exceed 15% under non-linear load.

23.3.2.12 The UPS system shall be able to operate satisfactorily on rated loads (in kVA) with power factors in the range of 0.65 lag to 1.0. Under the aforesaid load, load pf and input voltage, the minimum efficiency requirement shall be as follows: 75% for  $\leq 3$  kVA.

23.3.2.13 The UPS shall have capacity to deliver a minimum overload of 125% for 10 minutes and 150% for 60 sec. UPS shall be provided with current limit circuit to avoid excessive loading beyond its permissible overload withstand capability.

23.3.2.14 Unless otherwise specified, the voltage variation shall not exceed  $\pm 5\%$  and complete recovery to normal steady state shall be within 40 ms.

- a. 100% step load and unload (for hot standby only)
- b. 50% step load.
- c. Momentary interruption in power supply.
- d. Complete load transfer to other healthy UPS when one of the UPS develops a fault and automatic retransfer to the first UPS when it becomes healthy.

For diode rectifier type load systems, a voltage variation of up to 100% for no more than 2 cycles is acceptable at load turn on.

## Section:8B Technical Specifications

- 23.3.2.15 The battery may be taken out of service for maintenance during which period it shall be possible for the UPS to continue operation by drawing power from the rectifier.
- 23.3.2.16 All the thyristors, diodes, IGBTs and other electronic devices of UPS shall be given adequate protection from short circuits.
- 23.3.2.17 All PCBs shall be provided with a transparent epoxy coating for environmental protection and topicalization. They shall be suitably located away from heat sources.
- 23.3.2.18 All electronic control and monitoring printed circuit cards shall be suitable for easy replacement. Monitoring points shall be provided with identification on each of the PCBs and the PCB shall be firmly clamped in position so that vibration or long usage does not result in loose contacts.
- 23.3.2.19 Fans, if any, shall be of good quality and high reliability. The failure of fan shall only cause thermal tripping at pre-set temperature, without causing any damage.
- 23.3.2.20 Maximum noise level from UPS system measured from a distance of 1 meter from UPS in all directions under rated load shall not exceed 55 dB
- 23.3.2.21 Maintenance bypass isolator – Provision shall be available for manually operated maintenance bypass isolator which shall be incorporated into the UPS cabinet to directly connect the critical load to the input AC power source bypassing the rectifier, inverter and static transfer switch.
- 23.3.2.22 The UPS shall have a data logging facility, with USB download capability. This will be an optional feature and is not to be provided, unless specifically called for in the indent / tender. The data logged shall be:
- a) 80 faults in a FIFO with date and time stamp (faults to be recorded include, but are not limited to those listed in section 4 (B))
  - b) The LCD display shall enable interrogation of the fault data log by the operator

### **23.3.3 Construction**

- 23.3.3.1 Rectifier/charger, inverter and static switch sections shall be suitably housed in sheet steel panels complete with all interconnections. The panels shall be fabricated with cold rolled sheet steel/ structural steel min. 1.2 mm thick. The panels shall be free standing, fitted with suitable louvers for ventilation and cooling fans as required. Hinged doors shall be provided at the front. The enclosure shall provide minimum IP-20 degree of protection.
- 23.3.3.2 UPS system shall be suitable for either floating output or earthed neutral, or earthing of star point, in case of single phase/three phase system respectively.

## Section:8B Technical Specifications

- 23.3.3.3 The power supply for fans shall be tapped from UPS output. However, the rating of UPS as specified in the data sheet shall be the net output of UPS after deducting power consumption for fans, etc.
- 23.3.3.4 A suitable sized earthing point shall be provided either at the bottom of the panels or at the back side of the panels.
- 23.3.3.5 Cables and terminal blocks (if any) for power or control cable connections should be of appropriate voltage, current and temperature rating.
- 23.3.3.6 All control wiring shall preferably be enclosed in plastic channel or otherwise neatly bunched together.
- 23.3.3.7 All metal surfaces shall be thoroughly cleaned and de-greased to remove mill scale, rust, grease and dirt. Fabricated structures shall be pickled and then rinsed to remove any trace of acid. The exterior of the panel shall be spray painted with two coats of epoxy-based panel paint or powder coated.
- 23.3.3.8 Battery Accessories: Batteries if provided outside the UPS system, shall be in a formation which is commensurate with the available space. The stand shall be made of standard L angle channel and duly spray painted with two coats of epoxy-based panel paint or powder coated.

### **23.3.4 PROTECTION/INDICATION/METERING ETC.**

**(A) Following protections shall be available:**

- i) Overload.
- ii) Short circuit at output of UPS.
- iii) Over and under voltage at battery terminals.
- iv) Over temperature
- v) Input surge protection.

**(B) Following indications shall be available:**

1. Charger On/Main's presence.
2. Mains Normal / Abnormal.
3. Low Battery.
4. Load on bypass.
5. UPS On.
6. UPS Trip.
7. Audible alarm for mains failure, battery low pre-alarm, battery low trip and inverter trip.
8. Visual indication and audio alarm near working place of operators.
9. Indication for SPD failure.

**(C) Monitoring by analogue Meter/LCD Display for the following:**

- i) AC Input voltage
- ii) AC Output voltage
- iii) AC Output current
- iv) Battery voltage



## Section:8B Technical Specifications

- v) Battery charging & discharging current
- vi) Output frequency
- vii) Fault Data

### 23.4.1 Controls

- (a) Inverter ON/OFF switch (to initiate inverter operation).
- (b) Emergency shut down switches on the panel.

### 23.4.2 Reliability

All necessary care shall be taken in selection, design and manufacture, testing and commissioning of the equipment for ensuring high system reliability.

## 23.5 TESTS

Separate acceptance, routine and investigation tests for UPS shall be conducted.

### 23.6 GUARANTEE

- i. One Year for UPS.
- ii. Two Year for battery.

## 24. POWER CONTACTOR:

The power contactor to be supplied should meet the following parameters

Sl. No	Particulars	Technical Specifications
1	Number of Main Contacts (NO)	3
2	Number of Main Contacts (NC)	0
3	Number of Auxiliary Contacts (NO)	1
4	Number of Auxiliary Contacts (NO)	0
5	Rated Operational Voltage	Main Circuit 690 V
6	Rated Frequency	Main Circuit 50/60 Hz
7	Rated Operational Current	(690 V) 40°C 60A (220/240 V) 55°C 60A
8	Maximum Breaking Capacity	Cos Ø=0.45 (Cos Ø=0.35 for I <sub>e</sub> > 100 A) at 440V 820A Cos Ø=0.45 (Cos Ø=0.35 for I <sub>e</sub> > 100 A) at 690V 340A
9	Rated Impulse Withstand Voltage (U <sub>imp</sub> )	6 kv
10	Terminal Type	Screw Terminal

## 25. TIME RELAY:


Sl. No	Particulars	Technical Specifications
1	Time Relay Type	ON-Delay
2	Rated Control Supply Voltage	220-240 V AC
3	Rated Operational Current	(230 V) 4A
4	Output	1 c/o (SPDT) Contact
5	Terminal Type	Screw Terminal
6	Mounting	DIN Rail Mounting

## 26. DIGITAL TIME SWITCH:

Sl. No	Particulars	Technical Specifications
1	Rated Operational Voltage	230 V AC
2	Rated Impulse Withstand Voltage (U <sub>imp</sub> )	Maximum 4 kv
3	Maximum Switching Current	16 A
4	Rated Frequency	50 Hz
5	Contact type	Change-over (CO)
6	Battery Chemical Composition	Lithium
7	Battery Life	5 Years
8	Battery Type	Button Cell

## 27. EARTHING ARRANGEMENTS:

Perforated steel galvanized pipe of 'B' class of 42mm dia and 2500 mm long shall be erected in an earth pit as shown in drawing below. The earth wire used shall be of GI strip of size 25mm x 3mm for HT and 8 SWG GI wire for LT with suitable clamping of size not less than 25 x 3mm on to the terminal structure and embedded in concrete for raising to the top of terminal structure. Both ends of the GI strip/GI wire should be fixed with GI bolts, nuts and spring washer. An RCC slab of size 450 x 450 x 40mm thick is to be placed over RCC box/brick masonry work. Earth box shall be painted above the ground level to facilitate painting of earth values. The earth pit shall be filled with alternate layers of charcoal and salt each of thickness 150 mm and 200 mm surrounding the pipe. The earth value when measured individually and combined should be less than 10 ohms. 8 SWG GI earth wire shall be used for earthing single pole structure. In the ground GI wire shall be buried at a depth of 0.5m and connected to the earth terminal. Earth resistance value in ohms, earth pit No. and date of testing to be painted in the plinth by white paint. Supply of GI pipe and all accessories for earthing (excluding GI wire/ flat) is included in the scope of work for earthing arrangements.

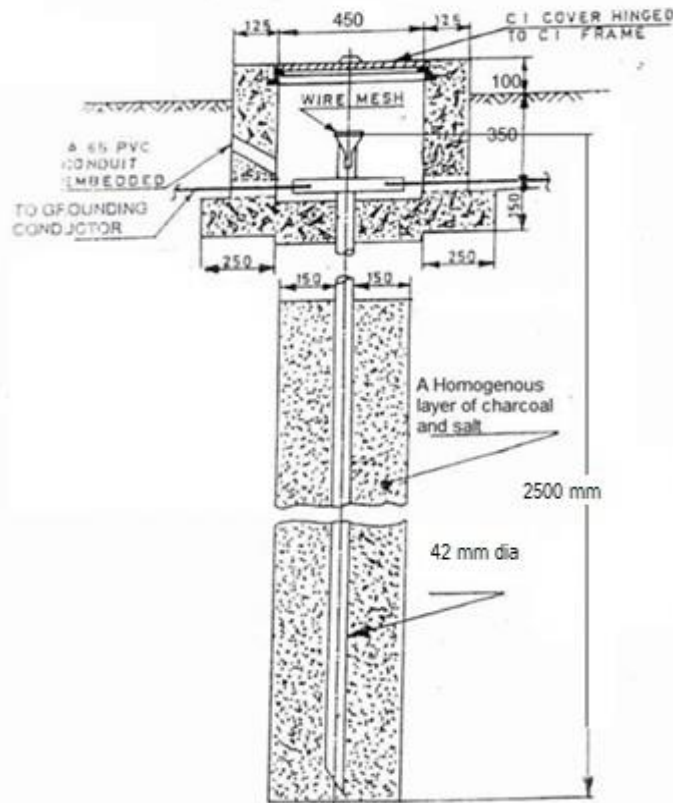

## 28. GI EARTHING STRIPS

### 28.1 Scope:

This section of the specification covers the supply, erection, testing and commissioning of Galvanized Iron Earthing Strips for the Distribution Network equipment's.

### 28.2 Applicable Standards:

The galvanizing and testing of materials shall confirm to the latest edition of the following standards except otherwise specified in the specification. Recommended practice for hot dip galvanized of Iron Earthing Strips	IS: 2629(1966)
Methods of testing weight, thickness & uniformity of coating on hot dip galvanized articles	IS: 2633(1972)
Specification for hot dip galvanized coating on fastness I	IS: 5358(1969)
Specification for Electroplating	IS:3203
Specification for hot dip Zinc coating on structural & other allied products	IS: 4759(1968)

### 28.3 General Technical Requirements:

#### MATERIAL

Supplier has to purchase raw materials (MS Flat) as per relevant IS at his own cost. The zinc required for galvanizing shall be quality Zn-98 & shall confirm to IS: 209- 1966 and its latest amendments. The

## Section:8B Technical Specifications

Supplier shall make his own arrangement for procurement before the commissioning of work, sufficient quantity of electrolytic zinc of proper quality for galvanizing. The Supplier shall however, not link the delivery period with the supply of zinc. The KRIDE is at liberty to have sample of zinc used and to test in any laboratory at his own cost and reject the particular supply, if found below standard. All raw materials required for galvanizing etc. and for complete execution of work shall be stocked in adequate quantities by the Supplier to ensure that the progress of work is not hampered.

### **GALVANISING**

Fully galvanized Iron strips shall be used. Galvanized Iron strips shall confirm to IS: 2629 (1966). The zinc deposition should not be less than 610 grams/meter square of the galvanized surface area of the MS Earthing strips. All galvanized materials shall withstand test as per IS: 2633 (1972). The weight of zinc coating shall determine as per the method stipulated in IS: 2633(1964). The standard length of Galvanized Iron Earthing Strip shall be minimum 7 Mtrs and not exceeding 10 Mtrs.

### **29. ERECTION OF STAY SET:**

The stay shall be erected in a pit of size 1.2m long x 0.6M width and 1.3M depth in a mass concrete of 1:3:6 mix, coping of 0.3mx0.3mx0.3m, smoothly finished. The stay set should comprise of stay rod, base plate of size 300x300x10mm, stay wire, stay insulator and stay clamp of size not less than 50mmx10mm size. The stay wire shall be of 45T quality, 7/11 SWG size steel galvanised, complete with stay tightner. All metallic parts shall be applied with one coat of primer red oxide and two coats of aluminium paint.

### **30. SINGLE POLE STRUCTURE WITH CROSS ARM FOR THE 11KV HT LINE:**

The S.P structure is made out of RCC poles of 9 Mtr. long 145 Kgs working load. The structure shall be erected in concrete foundation of mix 1:3:6 with coping of 0.3M x 0.3M x 0.3M size of 1:2:4 mix smoothly finished. Size of pit shall be 0.6M x 0.6M & depth shall be 1.65 Mtr. Painting shall be as in DP structure. Scope includes 11 KV cross arm, pin insulators, clamp with bolts (similar in LT) etc. and HT single top support.

### **31. DOUBLE POLE STRUCTURE FOR TRANSFORMER (3.3mtr width - Pole centre to centre)**

DP structure is made out of RCC poles of 9 Mtr. long of width 3.3mtr (it shall be adjusted to get 3 Mtrs width from pole to pole). The flats used for the manufacture of clamps shall not be lesser than 50mm x 10mm size (However flat size equivalent available commercially is acceptable). The structure shall be erected in concrete foundation of 1:3:6 mix with coping of 0.3M x 0.3M x 0.3M size smoothly finished. One coat of red oxide paint and two coats of aluminium paint should be applied for the MS items. Signal red colour band painted to a height of 150mm should be applied just below the Anti-climbing device on each pole. Size of foundation pit shall be 0.8 x 0.8 m & depth shall be 1.75 Mtr. The assembly includes supply & erection of fasteners, 11 KV disc insulators -3Nos., Danger board- 2 Nos. and standard anti- climbing device-2 Nos etc. (Pin insulators are not in scope of supply of DP structure) Transformer shall be erected on the DP structure by means of 100x50mm channels- 2nos and with suitable guide rails (channels) for supporting the transformer.

Scope includes supply and fixing of additional 100x50mm channel -1no for fixing HT disc insulators, 75x40mm channels -2nos necessary for fixing LA/pin insulators and DOL and angle cross arms of 65x65x6mm for fixing pin insulators/ transformer top body support as applicable.

## 32. LIGHTNING ARRESTOR:

Lightning arrestors shall be polymeric type with ground disconnector suitable for 11 KV system of grade 10KV 5 KA type conforming to ISS 3070 Part-I latest.

## 33. GANG OPERATED SWITCH: (GOS)

- 33.1 **Scope:** This specification covers the manufacture, testing and supply of 11KV Group operating switches of single break 200 Amps. Capacity complete with accessories, such as operating pipe, connecting pipe guides, supporting insulators, link work and locking arrangement, etc., complete conforming to IS-9921(Part 1 to 5) and the enclosed typical drawings.
- 33.2 **Weather Conditions:** The switches are to be installed at places with the following weather conditions.
- |               |                   |  |
|---------------|-------------------|--|
| Temperature   | : Maximum ambient | - 45°C                                     |
| Daily average | : Average         | - 35°C                                     |
|               | : Minimum         | - 5°C                                      |
|               | : Altitude        | - Not to exceed 1000 Mtrs. above sea level |
- 33.3 The equipment offered shall conform to IS-9921 and latest amendments thereof. The switches shall be suitable for horizontal upright mounting.
- 33.4 **Construction:**
- 33.4.1 The base shall be made of robust rolled M.S. channel section of size 75 x 40 x 6 mm. All ferrous parts shall be hot dip galvanized and all copper parts shall be tinned. The rotating parts shall be fitted with suitable bearing.
- 33.4.2 The blades and contacts shall be made of best quality electrolytic copper and shall be capable of carrying the rated current without exceeding the temperature limits specified in table-4 of IS-9921 (part-II).
- 33.4.3 The insulators shall be of post type, brown glazed porcelain pedestal post type design E.22 as per ISS:5350 (Part-III)/1971 with cap screws and spring washers and to technical specification enclosed conforming to IS:2544-1973 with amendments thereof.
- 33.4.4 The operating pipe shall consist of Tandem pipe (spindle rod) of length 2000 mm and the vertical pipe of length 5400 mm. The pipe shall be seamless 25mm diameter "B" type class (i.e., medium class) G.I. Pipe. The G.I. Pipe used shall conform to IS-1239-Part-I-1979 and amendments thereof. A guide shall be provided to the vertical operating pipe an intermediate position to arrest its lateral movement. Necessary fixing arrangements of the guide to the pole should also be supplied.
- 33.4.5 The Tenderer shall clearly indicate in the tender, the Brand name of the insulators used in manufacture of 200 Amps Single Break GOS along with relevant type test reports. The successful bidder should get the insulator make approved by KRIDE, before making supplies.
- 33.4.6 95 Sq mm heavy duty long barrel tinned copper lugs-6 Nos., suitable for terminating Weasel/Rabbit ACSR Conductor shall be provided for connecting conductor to the copper flats in the GOS.
- 33.4.7 All the iron parts shall be hot dip galvanized and shall conform to the relevant IS specifications with latest amendments those of.

Section:8B Technical Specifications

33.4.8 **Arcing Horns:** The switches shall be supplied with hot dip galvanized arcing horns so that while closing or opening the switches, arcing takes place between the arcing horns and not between the main contacts.

33.4.9 **Locking Arrangements:** Suitable locking arrangements shall be provided for the operating handle.

33.4.10 The switches shall be designed to withstand the test voltage as per IS: 9921 or its latest revision thereof. The switches shall be designed to have the following current ratings.

Continuous current carrying capacity

Without over heating : 200A

Short Time Current for 1Second rating : 8 kA

Rated peak dynamic withstand current : 20kA

33.5.0 **Test and Test Certificate:**

33.5.1 **Routine Tests:** The Routine test as per IS:9921 shall be conducted on each G.O.S in the presence of KRIDE representative and certificate shall be submitted duly signed by a responsible officer of the tenderers/organization before dispatch of consignment.

33.5.2 KRIDE/ Railway reserves the right to get the type test conducted as per IS:9921 on a selected G.O.S in the presence of KRIDE's/Railway's testing staff at the cost of the supplier.

- 1) Impulse Voltage dry test
- 2) Power frequency voltage dry test
- 3) Power frequency voltage wet test
- 4) Temperature rise test
- 5) Measurement of resistance
- 6) Test for rated peak short circuit current
- 7) Operation test
- 8) Mechanical endurance test

33.5.3 **Packing:** The group operating switches shall be securely packed to withstand rough handling during the transit and storage.

33.5.4 **Name Plate:** The group operating switch shall be provided with the name plate legibly and indelibly marked with the following information:

- 1) Name of materials
- 2) Name of the manufacturer/Trade mark
- 3) Purchase order No. and Date
- 4) Type-designation and Sl. No.
- 5) Rated voltage
- 6) Rated current
- 7) IS specification

**TECHNICAL SPECIFICATION FOR 11KV PEDESTAL POST INSULATORS**

**General Requirements:**

The porcelain shall be sound, free from defects, thoroughly vitrified and smoothly glazed, the glaze on insulators shall be brown in colour and should cover all exposed porcelain parts except those areas which serve as supports during fixing are required to be left unglazed as detailed in IS:2544-1963.

Precaution shall be taken during design and manufacture to avoid the following:

- a) Stress due to expansion and contraction which may lead to deterioration.
- b) Stress concentration due to direct engagement of the porcelain with the metal fittings.
- c) Retention of water in recesses of metal fittings and shape which do not facilitate easy cleaning by normal methods.

All metal parts except those of stainless steel shall be hot dip galvanized after machining zinc coating shall satisfy the requirement of relevant IS specification. The finished galvanized surface shall be smooth.

The threads of the tapped holes on the post insulator metal fittings shall be cut after galvanizing and shall be protected against rust by greasing or other similar means. All other threads shall be cut before galvanizing.

The post insulator unit shall be assembled in a suitable jig to ensure the correct positioning of the top and bottom metal fittings relative to one another. The faces of the metal fittings shall be parallel and at right angles to the axis of the insulator and the corresponding holes in the top and bottom metal fitting shall be in vertical plane containing the axis of the insulator.

**Technical Particulars:**

- |   |  |
|---|--|
| Individual Units  | : 11kV stacking units.                             |
| 1) Rating   | : 11kV   |
| 2) a) Unit description (as per ISS:5350/Part-III/1971)            | : E-22 (Except torsion strength<br>: as specified) |
| b) Mechanical strength as per Clause 3.2 of IS:5350/Prt-III/1971. | : Strength class 'C' 7.5 to 12KN                   |
| 3) Highest system voltage   | : 12 kV (rms)                                      |
| 4) Impulse withstand voltage                                      | : 75 KV (peak)                                     |
| 5) One minute Power frequency withstand Voltage                   |  |
| Dry   | : 35 kV (rms)                                      |
| Wet   | : 35 kV (rms)                                      |
| 6) Power Frequency Puncture                                       |  |

Section:8B Technical Specifications

- withstand voltage (rms) : 1.3 times the actual dry flash cover voltage of the unit.
- 7) Visible Discharge test voltage : 9 KV (rms)
- 8) Creepage distance : 230 mm
- 9) Failing load (as per IS:5350 Part-III/1971)  
 (a) to (d) in Newtons and  
 (e) in Newton meters
- a) Upright : 9000 N
- b) Under hung : 4500 N
- c) Tension : 20000 N
- d) Compression : 40000 N
- e) Torsion : 340 Nm
- 10) Height of insulator (Min) : 254mm (Tolerance  $\pm 1$ mm)
- 11) Insulating part dia (Max) : 152 mm
- 12) Top metal fitting pitch circle dia : 57 mm
- 13) Bottom metal fitting pitch circle dia : 57 mm
- 14) a) No. of bolts : 4 Nos.  
 b) Bolts holes dia : 10 mm tapped holes at the top and 12 mm plain holes at the bottom.
- c) Nominal dia of mounting : 85 mm  
 face not to exceed

**Marking:** Each insulator shall be legibly and indelibly marked with the following.

- a) Name or trade mark of the manufacture  
 b) Month and year of manufacture  
 c) ISI certificate mark if any


Marking shall be durable and shall be printed by the transfer process before firing.

**NOTE:** Manufacturer's Test Certificate and type test certificate conducted on similar sample insulator shall be submitted for approval before commencement of supplies.





Bill of Materials as per Drawing.



Section:8B Technical Specifications

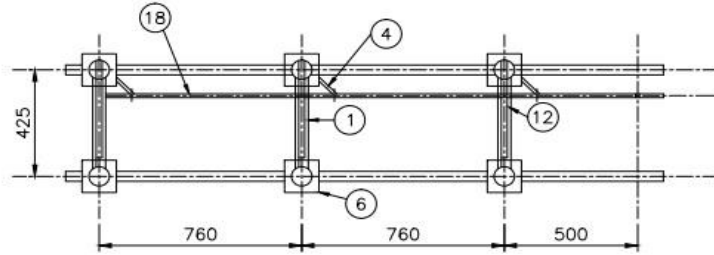

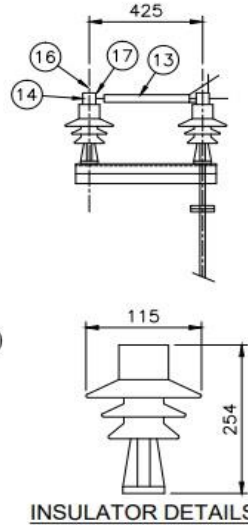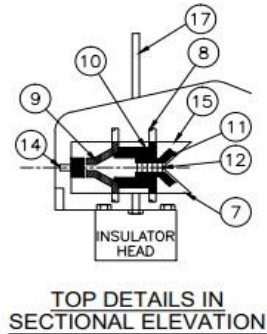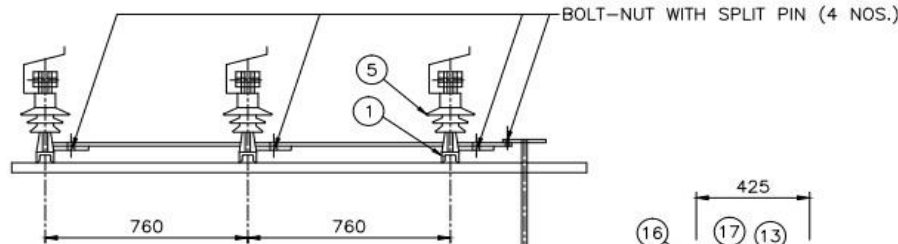



11KV 200A GOS (SINGLE BREAK)



SL. NO.	DESCRIPTION	SIZE	SECTION IN mm	QUANTITY
1.	M.S CHANNEL	500mm	75x40x6	3 NOS.
2.	GUN METAL BUSH (TOP) FOR SPINDLE (STANDARD PARTS NOT SHOWN IN THE DRG.)	10mm HT.	25mm#	3 NOS.
4.	SPINDLE PLATE WITH SPINDLE	290mm	75x6mm	3 NOS.
5.	11KV POST INSULATOR	-	-	6 NOS.
6.	TOP PLATE	100mm	50x6mm	6 NOS.
7.	CONTACT BOX (BOTTOM)	110x16mm L.3mm Th	42mm W	3 NOS.
8.	COPPER CONTACT PIN (TINNED)	8mm ROD	50mm L	12 NOS.
9.	PHOISPHUR BRONZE COPPER STRIPS (TINNED)	100 (0.5Th.)	25mm W	12 NOS.
10.	SPRING(STAINLESS STEEL)	25mm Long	14G	12 NOS.
11.	COPPER CONTACT (TINNED)	90mm	25x6	6 NOS.
12.	COPPER KNIFE (TINNED)	460mm	32x6	3 NOS.
13.	MOVABLE ANGLE	400mm	45x45x5	3 NOS.
14.	LEADING FLAT, COPPER (TINNED)	190mm	25x6	3 NOS.
15.	CONTACT BOX (TOP)	110x16mm	3mm Th. 32mm W	3 NOS.
16.	MOVABLE ARCING HORN	300mm	8mm#	3 NOS.
17.	FIXED ARCING HORN	300mm	8mm#	3 NOS.
18.	HORIZONTAL G.I PIPE	2000mm	25mm# B-CLASS	1 NO.
19.	VERTICAL G.I PIPE	5400mm	25mm# B-CLASS	1 NO.
20.	HANDLE PIPE	500mm	25mm# B-CLASS	1 NO.
21.	LOCKING ARRANGEMENT	PLATES 6mm	210x90, 100x90 360x90, 300x50	4 NO.
22.	<b>NUT &amp; BOLTS</b> 80 x 10mm - 24 NO, 25mm LONG- 5 NO, 30mm - 18 NO, 32mm LONG - 60 NO. ABOVE MENTIONED NUT & BOLTS ARE 10mm #			
23.	64 x 12mm - 4 NO. ABOVE MENTIONED NUT & BOLTS ARE 10mm #			

NOTES:-

1. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
2. THE INSULATORS USED IN GOS SHALL BE GOT APPROVED BEFORE PLACING THE PURCHASE ORDER.
3. ALL COPPER PARTS ARE TO BE TIN PLATED.
4. ALL BOLT NUTS USE FOR OPERATING ANGLE SHALL BE WITH SPLIT PIN.
5. THE CONNECTING END OF BOTH MOVING AND FIXED CONTACT SHOULD BE FITTED WITH WEDGE CONNECTORS (RABBIT TO RABBIT)
6. CREEPAGE DISTANCE OF POST INSULATOR SHALL BE 320mm(Min.)
7. ALL FERROUS PARTS SHALL BE HOT DIP GALVANIZED.

Signatures		All dimensions are in mm unless otherwise stated.	 BESCOM
Chd	 ASM (QS&S)	11 KV, 200A SINGLE BREAK ISOLATOR	Approved:  General Manager,(Elec.) QS&S
Sub	 DGM (QS&S)		DRG.NO.BESCOM/GM/QS&S/23 REV-004 DATED:24-01-2022
SCALE: N.T.S			

### **34. DROP OUT FUSE:**

Drop out fuse shall be out door expulsion type fuse cut out 11 KV 200 A capacity single phase with 2 Nos. of post type insulators mounted on M S Channel of size 75x40mm with clamp of size 50x10mm on DP structure. All hard ware parts shall be hot dip galvanised. The DOLO set of fuse unit will have three Nos. of single-phase fuses to cater for three phases.

### **35. INDUSTRIAL CABLE FOR SUBMERSIBLE PUMP:**

Flat submersible Three Core PVC Insulated & PVC Sheathed Industrial Cable for Submersible Pump Motors for working voltage up to and including 1100 volts and conforming to IS694 shall be provided.

### **36. SINGLE CORE PVC INSULATED FLEXIBLE COPPER CONDUCTOR CABLES FOR VOLTAGE GRADE 650 / 1100 VOLTS**

Single Core PVC insulated multi stranded flexible copper cable conforming to IS: 694-2010 or its latest editions with bright annealed based copper conductor as per IS: 8130 of 1984 or its latest editions, working voltage 650/ 1100 volts with ISI marked of following sizes: a) 1.5 sq.mm (22/0.3 mm) b) 2.5 Sq.mm (36/ 0.3 mm) c) 4.0 sq.mm (56/0.3 mm) d) 6.0 sq.mm (84/0.3 mm)

### **37. LOW TENSION PVC INSULATED UNDER GROUND CABLE:**

1.1 kV LTUG Cable having stranded aluminium conductor PVC insulated extruded Inner sheathed Armoured LT UG cable as per IS-1554 (part-1) or IS-7098 Part-1,armouring strip thickness and resistivity as per IS-3975 & confirming to GTP (Guaranteed technical particular) with overall satisfactory performance for minimum period of 5 years.

### **38. HIGH TENSION UNDER GROUND CABLE:**

HTUG cable to supply shall be high tension 11KV cable, Dry Curing & Dry Cooling with true triple extrusion, simultaneously through a single common head, 3 core underground XLPE(E) cable having stranded compact circular aluminium conductor, screened insulated, insulation screened with extruded semiconducting compound in combination with copper tape, core laid up extruded inner sheathed of GI flat strip armoured and overall PVC sheathed with specified IS 7098 with latest amendments & conforming to the (Guaranteed technical particular) GTP with overall satisfactory performance for minimum period of 5 years.

The cable should be suitable for AC 3 phase, 50 Hz., earthed system and shall conform to ISS:

7098/P1/88, P2/85, P3/93 (or) latest with up-to-date amendments in all respects and the "HT" cable armoured should be earthed by GI flat to the nearest GI flat main which is about 3-4 mtr. in length.

### **39. OUTDOOR CABLE JOINTING KIT FOR HT UG CABLES:**

HT, 11 kV, Outdoor, cable jointing kit to suit 3 core, XLPE cable of size as indicated in the schedule with complete kit for termination on DP structure. This comprises of supply including fixing of cable jointing kits and jointing of cables to the OH lines. The jointing kit shall be tested as per IS:13573 (with latest amendment) also necessary test certificates shall be submitted with supply of this item. Jointing kit shall be heat shrinkable/ push on type as required by ESCOM authorities. In case of LT pot head fitting, it shall be of complete set with filling compound.

## 40. METHODS OF LAYING OF LT CABLES:

When the cable is to be laid in trenches, two layers of sand coarse of 150mm and 150mm thickness respectively shall be provided on both bottom and top of the cable. When the cable is to be run on members of supporting structures /shelters/ wall, the same shall be clamped with MS clamps made out of 25mm x 3mm thickness flats, spaced not more than 1.0 M apart and cost shall be borne by the contractor. The minimum internal dia of bends of multicore PVC insulated LT cables shall not be lesser than 15D where D is the diameter of the cable to be laid.

- **CABLE LEADING/PROTECTING PIPE:**

The cable protecting pipe shall be heavy duty rigid PVC pipe of dia given in the schedule. The pipe shall be secured with either walls or posts using clamps made out of MS flats of 25 mm wide and 6 mm thick, spaced not more than 1.0 M apart. The clamps shall be applied with one coat of red oxide and two coats of aluminium paint. The top of the leading pipe shall be sealed with sealing compound to prevent entry of water. The PVC pipe shall conform to IS 4985-2000, latest and shall be capable of withstanding 6 kgf / sq.cm pressure.

Raising of cables on terminal structure: Cables shall be raised on terminal structures as well as in deep cuttings through PVC pipes of 40/50mm/75mm & 100mm inner dia 3.0 M long, of which 1 M is buried in the ground. The pipe shall be fixed to the terminal structure with clamps made out of flats of size 25mm width and 6mm thick with suitable bolts and nuts spaced not more than 1 metre apart. The diameter of bends in cable should not be lesser than 20 d for HT & 15d for LT where 'd' is the diameter of the cable. The top of the pipe shall be filled with sealing compound to prevent entry of water.

- **EXCAVATION OF CABLE TRENCH:**

a) Trench for cable on either side of track: The trench shall be of 0.5 to 0.75 M width and 1M depth for LT cables. A bed of sand of 150mm is spread for entire width at the bottom of the trench. The excavated earth is filled up in the trench and the trench is made to the original ground level by watering and ramming processes.

b) Trench for cable underneath the track/road: HT/LT cables shall be drawn through HDPE pipe.

Trench to accommodate HDPE pipe shall be of suitable width and excavated at 1.5 M below the formation level. No sand cushioning and spreading of bricks are required. But once the pipes are laid in the trench, it should be made to its original formation level by filling it up with excavated earth by watering and ramming process and resetting the ballast of track to its original level. Similarly, wherever road has been dug for laying the cable the same should be filled, rammed and asphalted and brought to original condition.

**Note:**

1. Excavation means, earthwork for laying of cable, erection of structures, stay, strut etc., irrespective of soil condition.

2. If any tar road requires to be excavated, it will be classified under Item (b) above.

## Section:8B Technical Specifications

### • CABLE ROUTE INDICATOR:

The description of cable route indicator (cable marker) is detailed in the schedule. Construction of cable marker and lettering shall be as specified by Engineer in Charge.

It shall be spaced not more than 25m apart. It should be placed at the following places also.

1. On either side of track/road exactly at points where HDPE pipe ends.

2. At points where there are changes in the route of cable laying.

## 41. GALVANISED OCTAGONAL POLE 5 Mtr LONG (SINGLE/ DOUBLE ARM BRACKET)

The Octagonal pole shall be made of hot dip galvanized 3 mm thick steel sheet with BSEN 10025 grade S355 JO steel plate for shaft, IS 2062 for base plate with door opening arrangements, including suitable boards, Bakelite sheet and MCBs as per IS specifications suitable to withstand the wind speed of 47 m/s for 5m Pole in single section and single joint welded as per IS 9595/IS10178AWS having dimensions, Top 70mm A/F and Bottom 130 mm M/F with Base plate 200 x 200 x 12mm and inbuilt junction box with single/ double arm bracket with 1000 mm standard 40/ 50 mm dia, B class GI pipe bracket for mounting of light fitting.

The Octagonal pole shall be erected by excavating a pit and concreting the foundation in all kinds of soil with plastering above ground level, with base plate 200x200x12mm, installed by means of 4 nos of foundation bolts of suitable size/nuts/check nuts and provided with inbuilt junction box and suitable power strip connector and 16A cut out shall be provided inside the box. The Pole shall be hot dip galvanized in single dipping with not less than 65micron as per ASTM-A123 and 153 etc., as per drawing appended.


PCC foundation in 1:4:8 mix of size 0.05m depth x 0.7m width x 0.7m breadth shall be provided  
RCC foundation in 1:1.5:3 mix of size 1.6m depth x 0.7m width x 0.7m breadth shall be provided for erecting the pole.

Steel reinforcement to the foundation shall be provided as appended in the drawing.



Excavation and clearing the balance soil shall be in contractors' scope of work. Foundation above ground level shall be adjusted as per the instruction of Engr. in charge as per site condition.

32mm dia PVC pipe shall be provided for cable entry while casting the foundation.

## Section:8B Technical Specifications

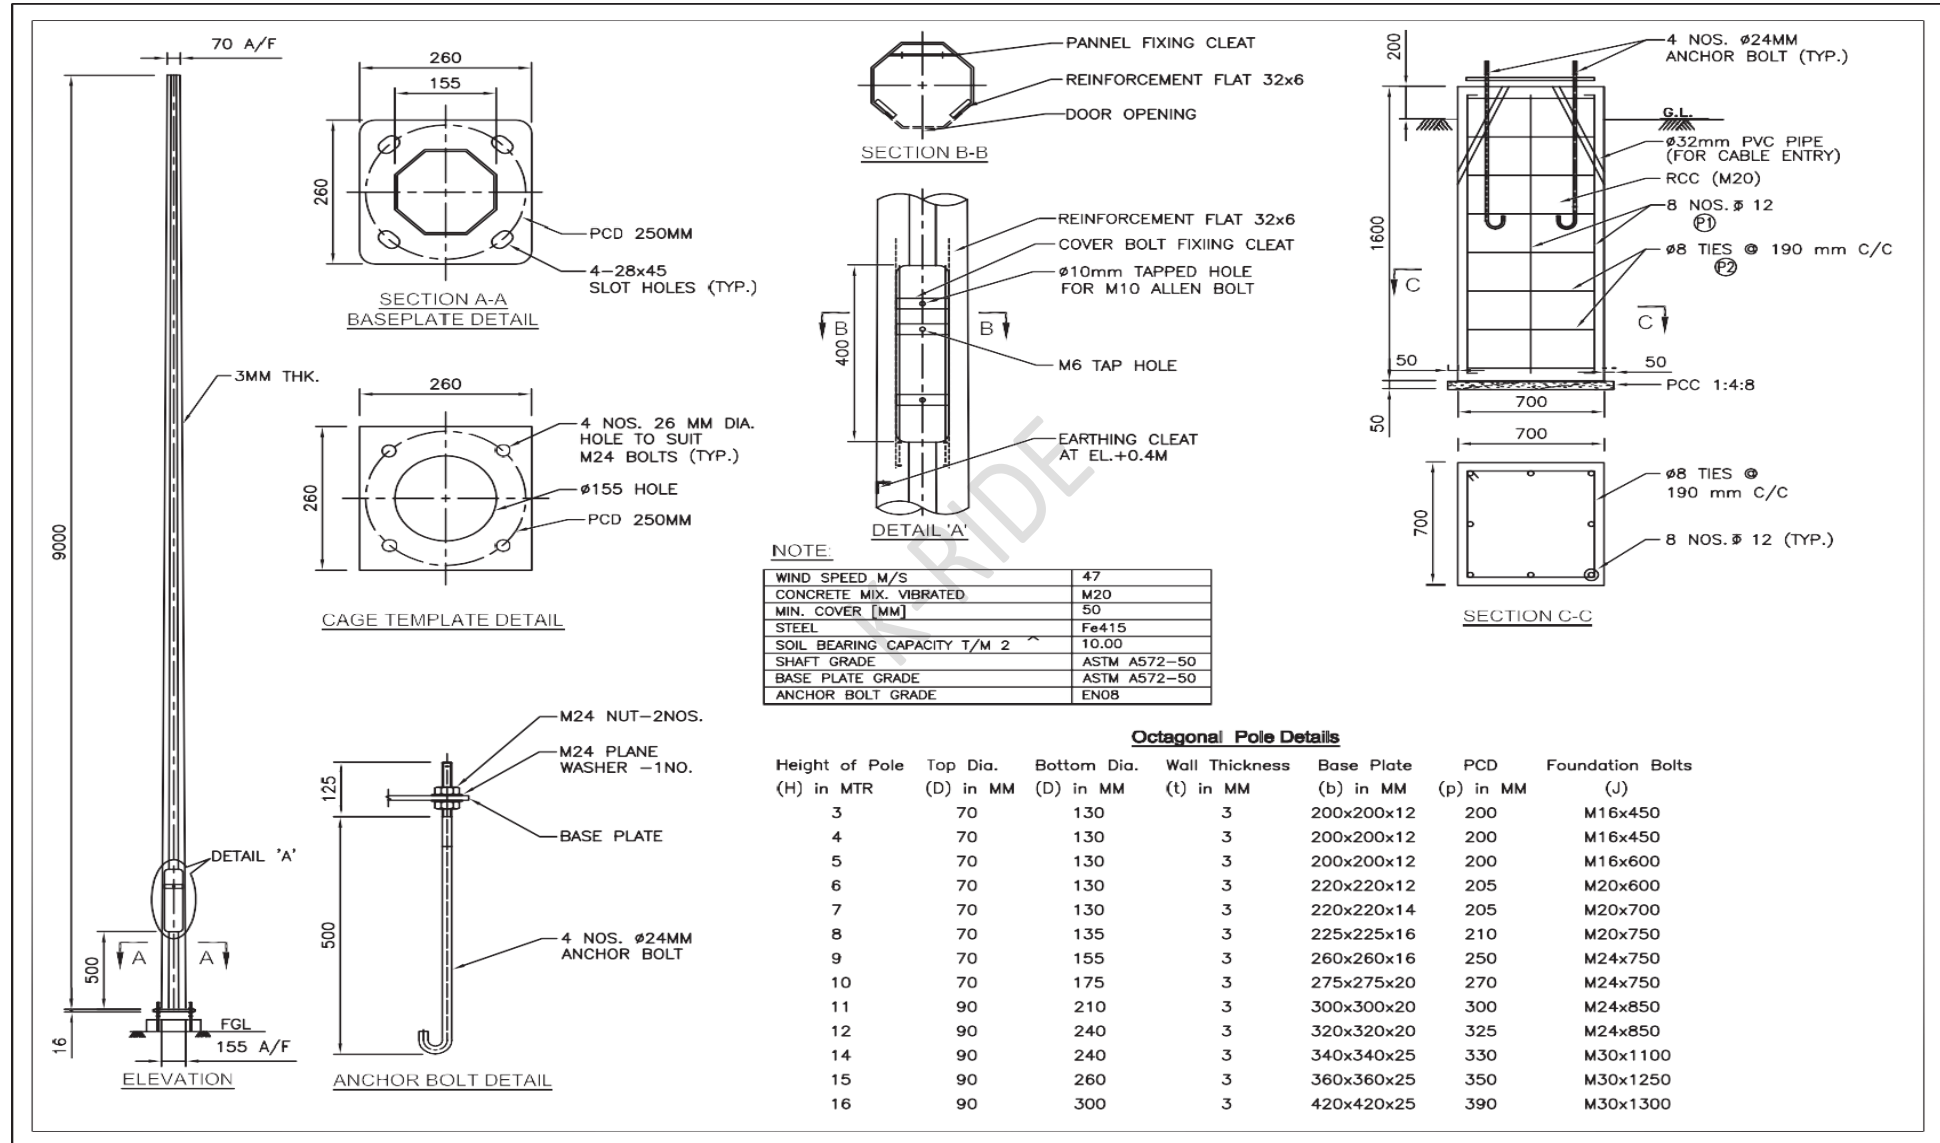

### Section:8B Technical Specifications

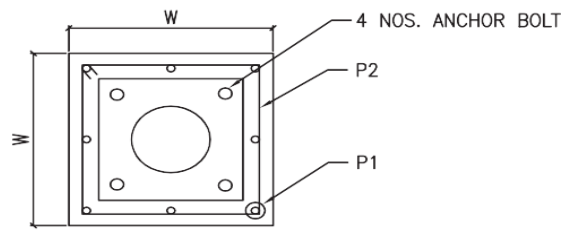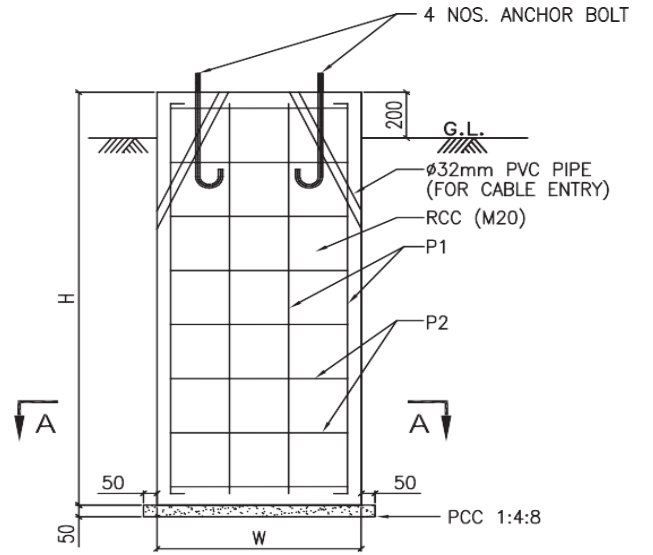

SECTION A-A

\* ABOVE FOUNDATION DETAILS BASED ON WIND SPEED 47 m/s FOR NORMAL SOIL CONDITION

**NOTES:**

1. ALL DIMENSIONS ARE IN 'MM' UNLESS OTHERWISE SPECIFIED.
2. MATERIAL AND CONSTRUCTION TO BE IN ACCORDANCE WITH IS: 456.
3. THE CONCRETE GRADE FOR FOUNDATION AND OTHER WORKS SHALL BE OF MIX M20 U.N.O.
4. IT IS ASSUMED THAT SOIL TYPE IS CLAY SOIL
  - 4.1 THE SOIL BEARING CAPACITY IS 10.0 T/m<sup>2</sup>
5. REINFORCEMENT SHALL BE OF GRADE Fe415 COMPLYING WITH IS:1786-1985.
6. CLEAR COVER TO MAIN REINFORCEMENT AT END OF MAIN BARS COLUMN : 40MM
7. DEVELOPMENT LENGTH FOR TENSION LDT =50 TIMES THE DIA OF BAR.
8. FOR ANY OTHER DETAILS CLAUSES OF IS-456, SP-34 AND SP-23 SHALL BE REFERRED.
9. IT IS ASSUMED THAT WATER TABLE IS NOT FOUND

**BAR BENDING DETAILS**

SR. NO.	HEIGHT (M)	SHAPE	RCC (M <sup>3</sup> )	PCC (M <sup>3</sup> )	STEEL (Kg.)	RAFT REINFORCEMENT	
						BOTTOM REINF. BOTHSIDE P1	TOP REINF. BOTHSIDE P2
1	3	OCTAGONAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
2	4	OCTAGONAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
3	5	OCTAGONAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
4	6	OCTAGONAL	0.540	0.025	18.34	8 ϕ 12	ϕ 8 @ 190 C/C
5	7	OCTAGONAL	0.540	0.025	18.34	8 ϕ 12	ϕ 8 @ 190 C/C
6	8	OCTAGONAL	0.676	0.028	19.76	8 ϕ 12	ϕ 8 @ 190 C/C
7	9	OCTAGONAL	0.784	0.032	20.47	8 ϕ 12	ϕ 8 @ 190 C/C
8	10	OCTAGONAL	0.900	0.036	26.93	12 ϕ 12	ϕ 8 @ 190 C/C
9	11	OCTAGONAL	1.152	0.041	30.93	12 ϕ 12	ϕ 8 @ 190 C/C
10	12	OCTAGONAL	1.458	0.050	32.49	12 ϕ 12	ϕ 8 @ 190 C/C
11	14	OCTAGONAL	2.178	0.144	43.72	16 ϕ 12	ϕ 8 @ 190 C/C
12	15	OCTAGONAL	2.880	0.169	50.09	16 ϕ 12	ϕ 8 @ 190 C/C
13	16	OCTAGONAL	3.125	0.182	58.19	20 ϕ 12	ϕ 8 @ 190 C/C
14	3	CONICAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
15	4	CONICAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
16	5	CONICAL	0.350	0.018	15.53	8 ϕ 12	ϕ 8 @ 190 C/C
17	6	CONICAL	0.540	0.025	18.34	8 ϕ 12	ϕ 8 @ 190 C/C
18	7	CONICAL	0.540	0.025	18.34	8 ϕ 12	ϕ 8 @ 190 C/C
19	8	CONICAL	0.676	0.028	19.76	8 ϕ 12	ϕ 8 @ 190 C/C
20	9	CONICAL	0.784	0.032	20.47	8 ϕ 12	ϕ 8 @ 190 C/C
21	10	CONICAL	0.900	0.036	26.93	12 ϕ 12	ϕ 8 @ 190 C/C
22	11	CONICAL	1.152	0.041	30.93	12 ϕ 12	ϕ 8 @ 190 C/C
23	12	CONICAL	1.458	0.050	32.49	12 ϕ 12	ϕ 8 @ 190 C/C
24	14	CONICAL	1.625	0.110	34.67	12 ϕ 12	ϕ 8 @ 190 C/C
25	15	CONICAL	1.800	0.140	35.54	12 ϕ 12	ϕ 8 @ 190 C/C
26	16	CONICAL	2.420	0.144	48.19	16 ϕ 12	ϕ 8 @ 190 C/C

## **42. LOOP-IN-LOOP-OUT BOX OUTDOOR TYPE FOR LIGHTING POLES.**

BOX: Made from thermo plastic, polystyrene which should be shock proof, safe, IP65 (Weather proof), rust proof, dust proof, water proof having internally embedded gasket with provision for cable entry through IP 65 Thermoplastic, polyamide glands and /or grommets ideal for outdoor application.

Cable Entry: This is through 3 Holes with grommets at equal distances provided below the box suitable for 16sq mm cable, Provision should be made for Light fittings wires to run through the channel behind the box.

Fixing: 5mm Thick M.S. strip 2 Nos for pole mounting should be provided within the box with suitable holes to avoid rusting of MS strip.

Box size (Minimum): 200 (H) x 200 (W) x 98 (D) mm, Wall Thickness of box = 3mm.

Accessories:

- (1) Fuse cut out 20 Amps-1 No,
- (2) 32 Amps 6-way terminal block-1No,
- (3) 16 Amps neutral Link

Properties of Box Material: Thermoplastic, polystyrene

- Non-rusting/non-corrosive
- Shockproof/ non-reactive to weather changes.
- Non-sparking, /Resistant to propagation of fire.

## **43. 11/0.433KV, CLASS DISTRIBUTION TRANSFORMERS OF RATING 100/63KVA**

The Distribution transformer of rating 11/0.433 kV, 100/63kVA supplied shall comply with IS-1180 (Part-1): 2014.

## **44. SPECIFICATION FOR HDPE PIPE**

The HDPE pipe material should be confirming to standard IS 4984-1995 or latest and should be of PE-80 material designation which has MRS (Minimum Required Strength) of 8.0MPa and maximum allowable hydrostatic design stress of 6.3 MPa (@20 °C) with pressure rating of PN-6(6kg/cm<sup>2</sup>), heavy gauge has to be provided. The cable has to be laid through HDPE pipe with all necessary accessories for jointing, clamping, bends etc as per site condition has to be provided.

## 45. LED SIGNAGE BOARD

### 45.1 Specification For LED Based Name Boards:

#### NOTE:

- The contractor has to make his own arrangements for transportation of men & material at site. Contractor is advised to visit the sites to have information about the scope of the work to be executed before submitting the offer.
- The exact name & spelling in all languages is tentative and successful tenderer should take approval for spelling in all 3 languages and design before starting the work.
- The LED luminaries should confirm with CEE/SWR specification No. SWR/LED Light fitting (Indoor/ Outdoor)/ 001-2016 Dt. 18.04.2016.
- Design LED name board to be submitted before starting of the work & written approval should be obtained before supply of material.
- The LED name board should be provided for fixed type name and not for scrolling type.
- The letters along with LED will be fixed on 4mm thick aluminium composite panel sheet of 9-10 feet height (minimum) and entire frame shall be supported on MS angle frame from the back side to withstand wind pressure. The successful tenderer shall submit a detailed drawing of the structure and boards for approval of AGM/K-RIDE before manufacturing.

### 45.2 SPECIFICATION:

Sl. No	Parameter	Description
1	No. of LED's	As per requirements
2	Frame type	Heavy quality aluminium rectangle tubes of 25mm x 50mm with minimum 1mm thickness and front cover of 4mm thick ACP sheet.
3	Physical dimensions for acrylic sheet	As per the letter requirement
4	Thickness of acrylic sheet	3.00 mm with 0.40 grade
5	Language	Kannada, Hindi, English
6	Wattage per letter	15-22 watts (approx.), each LED wattage =3 Smd 1.8 Watt (minimum), white LED and the spacing between adjacent LED



Section:8B Technical Specifications

		modules must not be more than 20-25 mm.
7	LED control	Current Regulator
8	Viewing angle	120 Deg (Minimum)
9	Nominal Voltage	220 V AC
10	Operating Voltage	105 V to 295 V AC, 50 Hz
11	Protection	As per CEE/SWR specification No. SWR/LED Light fitting (Indoor/ Outdoor)/001-2016 Dt 18.04.2016.
12	Height of letter	2 feet
13	Letters Colour	Kannada – Saffron, Hindi – White & English -Green
14	Approved sources of LED	As per CEE/SWR specification No. SWR/spec/LED dated.12.06.2015.
15	Warranty	5 years total fitting

**45.3 DETAILS:**

- a) Each letter box should be made of aluminum, Acrylic and PVC trim cap.
- b) Back and sides of letter box should be of 65mm (minimum) raising (height) and made with 18-gauge 0.80 microns grade aluminum sheet with MRF or similar powder coating on the Aluminum sheet.
- c) 2mm (minimum) thick PVC trim cap on top of Aluminum raising sheet.
- d) Front face should be with Marga cipta or similar make 3mm thick 0.40 grade acrylic sheet in Saffron, white & green colour for each language.
- e) Aluminum box back side should be with machine slotted and riveted.
- f) The ACP Sheet of 4mm thick (0.5 mm Front & back aluminum) with approved colour with heavy quality rectangular aluminum tubes of 25mm x 50mm x 1mm frame on the MS angle structure for fixing ACP sheet.
- g) The structure to be built with proper support to with stand wind pressure and to hold 9-10 feet height (minimum) ACP sheet with frame as per requirement to fix the letters with MS structure with Red oxide initial coat & BLACK Paint with suitable channels as per site condition. (Structure drawing to be approved before starting the work).

Tenderers are requested to visit site to get further information regarding requirement of structure.

- h) Led should be water proof 3 Nos SMD white colour LED as per CEE/SWR specification No. SWR/LED Light fitting (Indoor/ Outdoor)/001-2016 Dt 18.04.2016.
- i) The number of power supplies should be based on total wattage of name board and each driver should drive only 90% of its capacity maximum.

## Section:8B Technical Specifications

- j) Separate timer along with the proper capacity contactor to be provided inside LED driver box for automatic switching ON & OFF of name board.
- k) The cost is inclusive of power supply drivers as per requirement and timer with contactor.

### **45.4 Operating Conditions:**

The equipment shall be sturdy and suitable for the following service conditions to be normally met in service:

The dust content in air may be as high as 1.6mg/m<sup>3</sup>. During dry weather, the atmosphere is likely to be full of dirt and dust. The equipment shall be designed to work in corrosive atmosphere.

In industrial areas, there may be airborne contaminants like smoke and chemical vapours and conducting particles.

### **45.5 Specification of LED for fitted with fire resistance silicon base board:**

- a) White SMD LED Module of uniform intensity and luminosity shall be used for excellent visibility. The intensity of the illumination shall be such that it should be possible to read the letters clearly from a distance of 200 meters or more.
- b) All system units should be modular, such that any module (i.e., LED modules, connector, cable, power supply unit etc.) can be easily removed when defective and a fresh module can be fixed to make the system functional again.

### **45.6 Power Supply Unit:**

- a) All power supply units supplied shall be switch mode power supply (SMPS) type operated from AC source in the voltage range 105-295 V AC, 50 HZ AC (minimum) and single phase.
- b) Over voltage and short circuit protection is incorporated within the power supply.

Summary details of each power supply:

Power supply Switched Mode Power Supply

Rated Working Voltage 220V AC, 50Hz

Working voltage range 105V – 295 V AC

Output 400W (Minimum)

Power Factor > 0.95

### **45.7 General Requirements:**

- a) The unit shall be suitable for mounting/hanging and shall be specially designed for protection against dust specification.



Section:8B Technical Specifications

- b) The unit should be compact and robust.
- c) The unit should have protected against open circuit & short circuit for the cables and circuits used. The design shall be modular, so that only the defective part need be replaced.

**Probable Makes:**

Sl.NO	Description of item	Tentative approved makes
1	PVC copper wire	Polycab, Finolex, Havells, KEI, V-Guard, Anchor, Sbee, Universal, Indo Asian

**SIGNAGE SPECIFICATIONS FOR ALUMINIUM LED LIT LETTER**

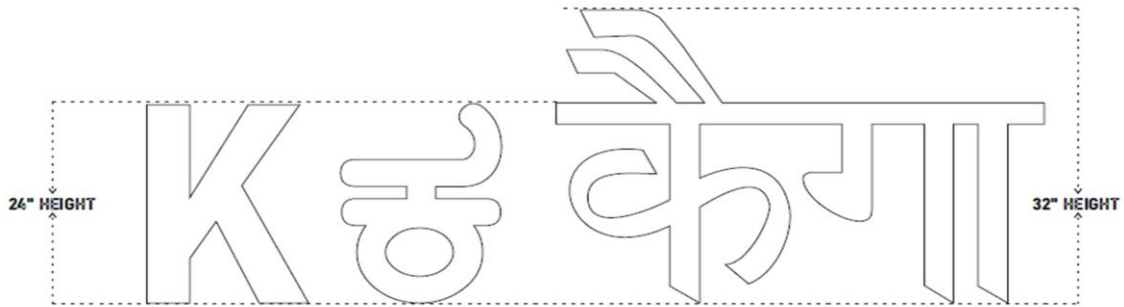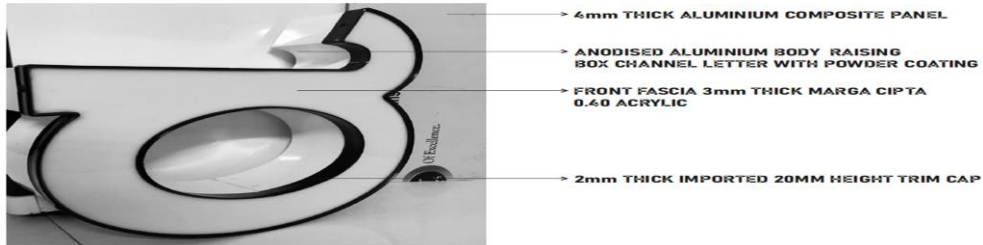

**46. CABLE TRAYS:**

Cable trays, of sizes as per schedule of quantities and drawings shall be of perforated doubled bend channel or of ladder design as specified in BOQ. Cable trays shall be fabricated from sheet steel of thickness as per BOQ and shall be complete with tees, elbows, risers, and all necessary hardware

## Section:8B Technical Specifications

Trays shall be hot dip galvanized and all the accessories shall be factory fabricated, site fabricated accessories are not permitted Cable trays shall be erected in perfect level and plumb and shall comply with the following:

Trays shall have suitable strength and rigidity to provide proper support for all the contained cables. Trays shall not have sharp edges, burrs or projections injurious to cable insulation. Trays shall include fittings such as bends, risers etc. for changes in direction and elevation. Each run of cable tray shall be completed before laying of cables, Cable trays shall be erected so as to be exposed and accessible.

Cable trays shall be mounted on support structure adequately at interval of 1-meter (Min) distance by means of painted galvanized (as specified) MS structural members secured to the structure by welding. Spacing of the support structure shall be such that the cable trays shall remain perfectly horizontal without buckling when fully loaded with cable runs.

The length of vertical supporting members for horizontal tray runs shall be to suit the number of tray tiers required. Cable trays shall be bolted to the support structure. Minimum clearance between the top most tray tier and the ceiling shall be 300 mm and the next tier shall be at a minimum distance of 250mm. Trays shall be erected properly to present a neat and clean appearance.

This support should be capable of withstanding the entire weight of cable trays and cable contained in the trays. Additional supports are to be provided at both ends of the cable trays and at all bends. The entire cable tray system shall be rigid.

Support structure shall be fabricated from suitable size L Angles/Square Tubes of 6mm thick (Min).

Cables shall be fixed to the tray using proper cable ties, cables shall be dressed properly so as to provide minimum one cable diameter clearance between adjacent cables and from tray ends.

Cable trays shall be earthed by 2 runs of 25 mm x 3 mm GI strips throughout their lengths.

## **47. CONCRETE:**

The detailed cement concrete specification gives information about quality and the quantity of the materials, proportion of mortar, workmanship, method of preparation and execution of work etc. The cement concrete specification is properly prepared which makes it easy on site for execution of cement concrete work.

### **Coarse Aggregates:**

Coarse aggregate shall be of broken stones of granite or similar stones. They shall be free from dust, dirt and other foreign matters. Size of the stones should be 20 mm and down all should be retained on 5 mm square mesh and well graded such that it should not have voids more than 42 %.

## Section:8B Technical Specifications

### Fine Aggregates:

Fine aggregates shall be of coarse sand and should have hard, sharp and angular grains. The grains should pass the screen of 5 mm square mesh. The sand should be of standard specification and should be free from dust, silt and it should not be obtained from sea. Cement used for the construction should be fresh and it should not be too old. It should be of good quality and should meet all the standard specifications. The minimum compressive strength of cement should be 175 kg/ m<sup>2</sup>.

### Water:

Water should be clean and free from alkaline and other acidic matter. It should be suitable for drinking purpose.

### Proportion:

#### M7.5:

The proportion of the cement concrete should be 1:4:8 or as prescribed. For the proportion of 1:4:8 the quantity of materials goes as one part of cement, four parts of sand and eight parts of aggregates.

#### M10:

The proportion of the cement concrete should be 1:3:6 or as prescribed. For the proportion of 1:3:6 the quantity of materials goes as one part of cement, three parts of sand and six parts of aggregates.

#### M15:

The proportion of the cement concrete should be 1:2:4 or as prescribed. For the proportion of 1:2:4 the quantity of materials goes as one part of cement, two parts of sand and four parts of aggregates.

#### M20:

The proportion of the cement concrete should be 1:1.5:3 or as prescribed. For the proportion of 1:1.5:3 the quantity of materials goes as one part of cement, one and half parts of sand and three parts of aggregates.

#### M25:

The proportion of the cement concrete should be 1:1:2 or as prescribed. For the proportion of 1:1:2 the quantity of materials goes as one part of cement, one part of sand and two parts of aggregates.

Grade of Concrete	Mix of (Cement: Sand: Aggregate)	Size of Coarse Aggregates
M25	1:1:2	20mm
M20	1:1.5:3	20 mm
M15	1:2:4	12.5 mm, 40 mm, 60 mm
M10	1:3:6	20 mm, 40 mm, 60 mm
M7.5	1:4:8	40 mm, 63 mm

## Section:8B Technical Specifications

M5	1:5:10	40 mm, 63 mm
Low Grade	1:6:12	40 mm, 63 mm

### Mixing:

#### Hand Mixing:

Hand mixing is done on masonry platform or iron sheet tray. For the proportion of 1:2:4 first of all 2 boxes of sand and one bag of cement shall be properly and thoroughly mixed. Then 4 boxes of aggregates are added into the mix and then it is again properly mixed. The mixture should be dry mixed till all the materials are mixed together. Water is then added gradually along with turnings of the mixture. Generally, 25-30 litres of water per bag of cement is used to obtain plastic mix of required workability and water cement ratio.

#### Machine Mixing:

In machine mixing for the proportion of 1:2:4 first of all 2 boxes of sand are dumped into the cement concrete mixer then one bag of cement and four boxes of aggregates are gradually added and rotated for dry mix to obtain required colour and then required quantity of water is added by water can. While being mixed, generally 25-30 lit of water per bag of cement is used to obtain required workability and water cement ratio.

### Curing:

When the concrete gets hardened (generally after 3-5 hours of laying) wet gunny bags are placed on the concrete surface to keep the surface damp till 24 hours. The next day onward the concrete surface is flooded with water for 15 days for proper curing.

## 48. HIGH MAST

The scope of this work covers Design, manufacture, transport, installation, testing and commissioning of the complete lighting system, using Raising and Lowering type of High mast Towers the Civil Foundation Works shall be paid separately and arrangements with contractor and timer for operation of flood light fittings during all night & part night. All items required for the safe and efficient operation and maintenance of the lighting system, including the high mast, whether explicitly stated or not shall be made by The Contractor.

### 48.1 Applicable standards:

The following shall be the Reference Standards for the loading of the High mast:

Code No.	Title
a. L.S. 875 (Part III)1987	Code and practice for design loads for structures
b. BSEN 10025	Grades of MS Plates
c. BS.ISO 1461	Galvanizing
d. TR No.7 2000 of IL.E. UK.	Specification for mast and foundation

### 48.2 Design of mast structure:

## Section:8B Technical Specifications

The mast shall be capable of withstanding the wind pressure existing in Bangalore division/ area under worst condition.

Design shall be based on dynamic condition resulting from the maximum wind pressure.

Dynamic Loading for the Mast:

The mast structure shall be suitable to sustain an assumed maximum reaction arising from a wind speed as per IS 875 (three second gust), and shall be measured at a height of 10 meters above ground level. The design life of the mast shall be 25 years

### **Construction of mast:**

The mast shall preferably be manufactured from mild steel / BSEN 10025/ DIN 17100 / FE to form a multifaceted continuously tapered profile and shall be delivered in multiple sections of effective length 10metres. The mast shall be 16/20 Meters high and of polygonal construction presenting a good visual appearance Thus a 16/20 M mast in 2 sections to site. Weight of Mass shall be not less than 910Kg. Weight of Lantern Carriage shall not be less than 200 Kgs.

Each section shall be fabricated out of single plate duly folded and welded. There shall be only one longitudinal seam weld per section. Sections with more than one weld, circumferential or longitudinal, shall not be accepted. At site the sections shall be joined together by slip-stressed-fit method and joining shall be done with stressing equipment, thus conforming a sleeve joint. No site welding or bolted joint shall be done on the minimum top diameter shall be 150mm. The overlap distance shall have full penetration of longitudinal welds.

Bottom diameter and plate thickness shall be as per the structural requirements.

The mast shall be hot dip galvanized both internally and externally having a uniform thickness with average of 70 microns and two coat of aluminum marine paint. The life of the mast shall not be less than 25 years.

The procedural weld geometry and the workmanship shall be exhaustively tested by Radiography on the completed welds and certificates submitted.

The dimensions of the mast shall be decided based on proper design and design calculations shall be submitted for verification.

The offered mast shall be rigorously tested under "Wind tunnel testing" to ensure safety of the structure. The testing method, factors taken and norms applied shall be furnished along with the offer.

### **48.3 Base flange of mast:**

The mast shall be provided with fully penetrated base flange which shall be free from any lamination or incursion. The welded connection of the base flange shall be fully developed to the strength of the entire section.

The base flange shall be provided with supplementary environmental protection of the mast, the entire fabricated mast shall be hot dip galvanized, internally and externally, having a uniform average thickness of 85 microns for plates with more than 5mm thickness and

## Section:8B Technical Specifications

70 microns for 5mm or less. Galvanizing shall be done in single dipping method for better adhesion and life. Minimum Base Dimension shall be 410 mm for 16 Mtrs and 460 mm for 20 Mtrs High Mast.

### **48.4 Base compartments:**

#### **Door Opening:**

An adequate door opening shall be provided at the base of the mast and the opening shall be such that it permits clear access to equipment like winches, cables, plug and socket etc. and also facilitate easy removal of the winch. The door opening shall be complete with a close fitting, vandal resistant, weatherproof door, provided with a heavy-duty double internal lock with special paddle key.

The door opening shall be carefully designed and reinforced with welded steel section, so that the mast section at the base shall be unaffected and undue buckling of the cut portion is prevented. Size of door opening shall not be more than 1200 x 250 mm to avoid buckling of the mast section under heavy wind conditions.

### **48.5 Head Frame:**

The Head Frame which is to be designed as a capping unit of the mast, shall be of welded steel construction, galvanized both internally and externally after assembly. The top pulley shall be of appropriate diameter, large enough to accommodate the stainless-steel wire ropes and the multi-core electric cable. The pulley block shall be made of non-corrodable material, and shall be of die cast Aluminum Alloy (LM-6). Pulley made of synthetic materials such as Plastic or PVC are not acceptable. Self-lubricating bearings and stainless-steel shaft shall be provided to facilitate smooth and maintenance free operation for a long period. The pulley assembly shall be fully protected by a canopy galvanized internally and externally.

Close fitting guides and sleeves shall be provided to ensure that the ropes and cables do not dislodge from their respective positions in the grooves. The head frame shall be provided with guides and stops with PVC buffer for docking the lantern carriage.

### **48.6 Lantern Carriage:**

The fabricated Lantern Carriage shall be provided for holding the flood light fittings and control gear boxes.

Lantern Carriage shall be of special design and of durable steel tube construction to act as conduits with cable holes fully protected by grommets.

It shall be designed to hold required Nos. of flood light fittings and the control gear boxes and lanterns and also have a perfect self-balance

It shall be provided with cast Aluminum junction box and mounting plates.

It shall be fabricated in two halves and joined by bolted flanges with stainless steel bolts and nyloc/stainless steel nuts to enable easy installation / removal from the erected mast during maintenance.



## Section:8B Technical Specifications

The inner lining of the carriage shall be provided with the raising and lowering operation of the carriage

This assembly shall not touch the lower surface of the mast.

It shall be so installed that it does not cause any damage to the surface of the mast and is provided with protection buffer arrangement.

It shall be hot dip galvanized after fabrication.

### **Raising and Lowering mechanism:**

For the installation and maintenance of the luminaires and lamps, it will be necessary to lower and raise the Lantern Carriage Assembly. To enable this, a suitable Winch arrangement shall be provided, with the winch fixed at the base of the mast and the specially designed head frame assembly at the top.

### **48.7 Winch arrangements:**

For easy raising and lowering of lantern carriage assembly a suitable Winch Arrangement shall be provided in the base of the mast complete with top pulley, Winch, Stainless steel wire ropes and Winch driving power tool.

The winch shall be of completely self-sustaining type without the need for brakes, springs or clutches so as to eliminate any requirement of adjustment or possibility of being affected by moisture or lubrication. Each driving spindle of the winch shall be positively locked when not in use, gravity activated PAWLS, operating speed, safe working load, recommended lubrication and serial number of the winch shall be clearly marked on each winch.

The winch shall be provided with water proof canopy.

The capacity, operating speed and the dimensions of the drum length and the recommended lubrication etc. shall be clearly marked on the winch.

It shall be capable to operate the winch by hand or by an integral power tool. Integral power tool with worm type gear is not acceptable.

A test certificates shall be furnished along with the winch for maximum load operated and for safety operation at full load.

The winch shall be certified for its capacity to handle a maximum load of required Nos. of flood light fittings as per the Schedule.

### **48.8 Top pulley assembly:**

The pulley assembly shall be complete with Self-lubricating bearings and stainless-steel spindle

Suitable arrangements shall be made in pulleys such that the electric cables and the stainless-steel ropes are separated before passing over their respective pulleys.

## Section:8B Technical Specifications

The sleeve pulley arrangement shall be provided with axially and adjustable guides and stops shall be provided for docking the lantern carriage.

The pulley assembly shall be protected by a Aluminum painted canopy.

An external divider shall be provided on the pulley to separate stainless wire ropes and cables so that chances of wrapping together of the ropes and the cables in wound condition or when the lantern are in lowered position can be prevented.

### **48.9 Stainless Steel Wire Ropes:**

The suspension system shall essentially be without any intermediate joint and shall consist of only non-corrodable stainless steel of AISI 304 grade of suitable size with factor of safety of 1:10. The load bearing capacity and factor of safety adapted has to be indicated.

The stainless-steel wire ropes shall be of 7/19 construction, the central core being of the same material. The overall diameter of the rope shall not be less than 6mm. The breaking load of each rope shall not be less than 2350KN for 16 Mtrs and 3400KN for 20 Mtrs mast. Giving a factor of safety of over 5 for the system at full load as per the TR-7 referred to in the beginning of this specification. The end constructions of ropes to the winch drum shall be fitted with talurit. The thimbles shall be secured on ropes by compression splices. Two continuous lengths of stainless-steel wire ropes shall be used in the system and no intermediate joints are acceptable in view of the required safety. No intermediate joints/terminations, either bolted or else, shall be provided on the wire ropes between winch and lantern carriage.

### **48.10 Cable Connections:**

The cable connections shall be made by suitable flexible power cables of appropriate size and rating.

The base compartment of the high mast shall have a terminal box for terminating the incoming cable.

Provision shall be made for electric supply at the base compartment to enable operation of power tool for raising and lowering of the lantern carriage assembly.

The trailing cables of the lantern carriage rings shall be terminated by means of metal cased plug and socket provided in the base compartment to enable flexibility.

Also, suitable provision shall be made at the base compartment of the mast to facilitate the operation of internally mounted, electrically operated power tool for raising and lowering of the lantern carriage assembly. The trailing cables of the lantern carriage rings shall be in the base compartment to enable easy disconnection when required.

### **48.11 Power drive:**

#### **Power Tool for the Winch:**

A suitable high-powered, electrically driven internally mounted power tool, with manual over ride shall be supplied for the rising and lowering of the lantern carriage for maintenance purpose. The speed of the power tool shall be to suit the system. The power tool shall be

## Section:8B Technical Specifications

single speed, provided with a motor of the required rating. The power tool shall be supplied complete with suitable control. The capacity and lifting of the electric motor used in the power tool shall be suitable for the lifting of the design load installed on the lantern carriage.

The power tool mounting shall be so designed that it will be not only self-supporting but also aligns the power tool perfectly with respect to the winch spindle during the operations. Also, a handle for the manual operation of the winches in case of problems with the electrically operated tool, shall be provided and shall incorporate a torque limiting device. The power tool operation shall always be through a separate torque-limiting device to protect the wire ropes from over stretching. It shall be mechanical with suitable load adjusting device. The torque limiter shall trip the load when it exceeds the adjusted limits. There shall be suitable provision for warning the operator once the load is tripped off. The torque limiter is a requirement as per the relevant standards in view of the overall safety of the system. Each mast shall have its own power tool motor.

The single speed electric power drive shall be provided with reversible motor suitable for 400/230V operation.

The power drive shall be connected to the winch via matching coupler. To protect the hoist rope system against over load the coupler shall incorporate a torque limiting clutch preset at the factory.

### **48.12 Winch winding and adjustable handle**

For manual operation of the winch drum and for minor adjustment of the lantern carriage suitable handles shall be supplied.

### **48.13 Lightning finial**

One number heavy duty hot dip galvanized lighting finial shall be provided for each mast. The lightning finial shall be minimum 1.2M in length and shall be provided at the center of the head frame. It shall be bolted solidly to the head frame to get a direct conducting path to the earth through the mast. The lightning finial shall not be provided on the lantern carriage under any circumstances in view of safety of the system.

### **48.14 Aviation obstruction lights:**

Suitable Aviation Obstruction Lights of reliable design and reputed manufacturer shall be provided on the top of each mast.

### **48.15 Luminaires**

Luminaires shall be specially designed with cast aluminum housing suitable for housing the lamp and control gears for the lamps. The luminaires shall be tested as per Indian standards and test reports shall be submitted along with the materials. The luminaires shall be suitable for installation on high masts. The specification of luminaire shall meet CEE/SWR specification No. SWR/LED Light fitting (Indoor/Outdoor)/001-2016 Dt.18.04.2016

### **48.16 Timer db**

Supply and installation of Digital Timer DB 32A with suitable incoming and outgoing MCBs, timer switch, contactor for automatic ON/OFF of the above light fittings at a preset time,

## Section:8B Technical Specifications

housed in water proof cabinet including cost of all materials, labour charges complete including all accessories as per specification

Note:

Work shall be carried out under close supervision of Engineer of KRIDE, Bengaluru.  
2 sets of sample wiring materials shall be submitted to AGM/K-RIDE for approval before fabrication/commencement of work

Person (Contractor or his representative) who possesses a competency certificate from the EI shall supervise the work.

All the materials wherever applicable shall be of ISI marked.

No joint in the wiring is permitted. If any jointing is found subsequently, a penalty of Rs. 500/- for each joint will be deducted from the bills and also the contractor has to redo the portion.

The light fitting points have to be provided according to site condition and as per instructions of Engineer-in-charge.

### **48.17 Foundation:**

**The High mast shall be erected on foundation with the details appended in the below drawing**

The size of footing shall be 2600mm x 2600mm for 16Mtr High Mast and 3000mm x 3000mm for 20 Mtr High mast

The other dimensions and calculations are as appended in the HIGH MAST bar bending details given below

PCC foundation in 1:4:8 mix of size

RCC foundation in 1:1:2 mix of size

Steel reinforcement to the foundation shall be provided as appended in the drawing.

75 mm dia PVC pipe shall be provided for cable entry while casting the foundation.

<b>TECHNICAL DATA FOR HIGH MAST</b>	<b>12 Mtr/12.5Mtr</b>	<b>16Mtr</b>	<b>20Mtr</b>	<b>25Mtr</b>	<b>30Mtr</b>
Base dia. and top diameter (A/F)	Base - 310 mm, Top - 100 mm	Base - 410 mm, Top - 150 mm	Base - 460 mm, Top - 150 mm	Base - 540 mm, Top - 200 mm	Base - 610 mm, Top - 150 mm
Plate thickness	3 mm	Bottom - 4 mm, Top - 3mm	Bottom - 4 mm, Top - 3 mm	Bottom - 5 mm, Middle - 4 mm, Top - 3 mm	Bottom - 5 mm, Middle - 4 mm, Top - 4 mm
Cross section of Mast	12-sided polygon.	20-sided polygon.	20 sided polygon.	20 sided polygon.	20 sided polygon.
Diameter of base plate	460 mm	570 mm	670 mm	730 mm	840 mm
Thickness of base plate	20 mm	25 mm	25 mm	30 mm	30 mm
Lightning protection finial	G.I single spike of length 1200 mm	G.I single spike of length 1200 mm	G.I single spike of length 1200 mm	G.I single spike of length 1200 mm	G.I single spike of length 1200 mm
Number of foundation bolts	6 nos.	8 nos.	8 nos.	12 nos.	12 nos.
PCD of foundation bolts	385 mm	490 mm	490 mm	640 mm	640 mm
Type / diameter / length of foundation bolts	TS600 / 24 mm dia / 750 mm long	TS600 / 24 mm dia / 850 mm long	TS600 / 30 mm dia / 750 mm long	TS600 / 30 mm dia / 850 mm long	TS600 / 30 mm dia / 850 mm long
<b>LANTERN CARRIAGE</b>					
Material of construction	50 OD ERW Class B - M. S. Pipe	60 OD ERW Class B - M. S. Pipe	60 OD ERW Class B - M. S. Pipe	60 OD ERW Class B - M. S. Pipe	60 OD ERW Class B - M. S. Pipe
Load carrying capacity	6 Luminaires	12 Luminaires	12 Luminaires	16 Luminaires	12 Luminaires
<b>TRAILING CABLE</b>					
Conductor	Copper, 5 core, 2.5 sq mm	Copper, 5 core, 4 sq mm	Copper, 5 core, 4 sq mm	Copper, 8 core, 2.5 sq mm	Copper, 5 core, 4 sq mm
Insulation /Sheathed	PVC insulated & PVC sheathed	EPR insulated & PCP sheathed	EPR insulated & PCP sheathed	EPR insulated & PCP sheathed	EPR insulated & PCP sheathed
No. of cables / circuits per mast	One	One	One	One	One
<b>WINCH / POWER TOOL</b>					




Section:8B Technical Specifications


Type / SWL of wncn	Double Drum / 350 Kg	Double Drum / 500 Kg	Double Drum / 750 Kg	Double Drum / 750 Kg	Double Drum / 750 Kg
Method of operation	Motorised / Manual	Motorised/Manual	Motorised/Manual	Motorised/Manual	Motorised/Manual
Motor capacity	0.5 HP	1 HP	1 HP	1.5 HP	1.5 HP
No of speeds	Single speed	Single speed	Single speed	Single speed	Single speed
<b>STAINLESS STEEL WIRE ROPE</b>					
Breaking load capacity	1450 KN	2350 KN	3400 KN	3400 KN	3400 KN

K-RIDE

Section:8B Technical Specifications

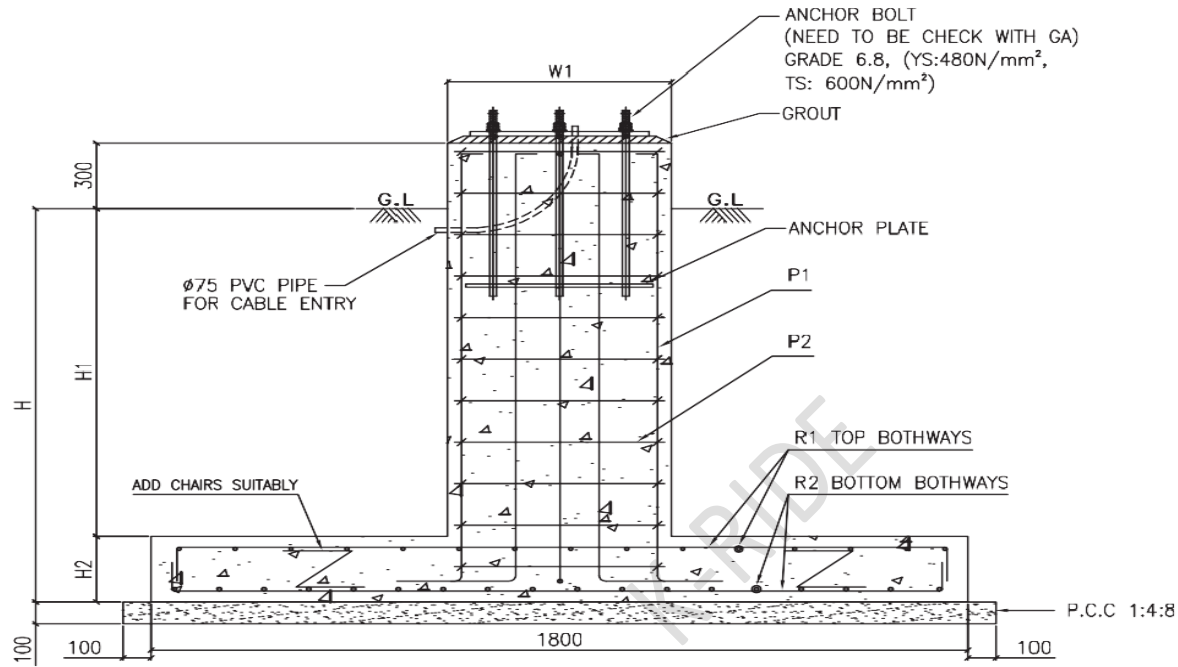

SECTIONAL ELEVATION

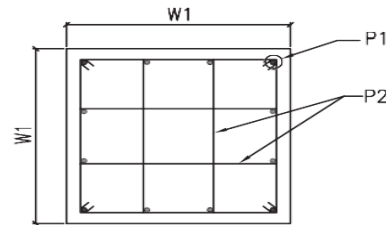

DETAIL OF PEDESTAL

NOTES:

1. ALL DIMENSIONS ARE IN 'MM' UNLESS OTHERWISE SPECIFIED.
2. MATERIAL AND CONSTRUCTION TO BE IN ACCORDANCE WITH IS: 456.
3. THE CONCRETE GRADE FOR FOUNDATION AND OTHER WORKS SHALL BE OF MIX M25 U.N.O.
4. REINFORCEMENT SHALL BE OF HIGH YIELD STRENGTH DEFORMED BARS COMPLYING WITH IS:1786-1985.
5. CLEAR COVER IS 50MM TO MAIN REINFORCEMENT AT END OF MAIN BARS
6. DEVELOPMENT LENGTH FOR TENSION  $L_{DT}=50$  TIMES THE DIA OF BAR.
7. FOR ANY OTHER DETAILS CLAUSES OF IS-456, SP-34, SP-16 AND SP-23 SHALL BE REFERRED.
8. IT IS ASSUMED THAT SOIL TYPE IS SANDY SOIL WITH CLAY CONTENT 5-10% WITHOUT WATER TABLE, IF ANY CHANGE APPROACH VALMONT FOR REVISED DESIGN DRAWING.
  - 8.1 THE SOIL BEARING CAPACITY IS 10.0 T/m<sup>2</sup>
  - 8.2 ANGLE OF REPOSE 0 DEG
  - 8.3 DENSITY OF SOIL 1.44 T/m<sup>3</sup>

Section:8B Technical Specifications

SR. NO.	HEIGHT (M)	POLYGON	LUMINARIES	RCC (M )	PCC (M )	STEEL (Kg.)	SIZE OF PEDESTAL W1xW1) (mm X mm)	PEDESTAL REINFORCEMENT		SIZE OF FOOTING (WXW) (mm X mm)	DEPTH OF FOOTING			RAFT REINFORCEMENT	
								MAIN BAR P1	STIRRUPS P2		H (mm)	H1 (mm)	H2 (mm)	BOTTOM REINF. BOTH SIDE R1	TOP REINF. BOTH SIDE R2
1	12	12 SIDED	6 LUM.	2.19	0.58	99	700 X 700	12 12	6 @ 190 C/C	2200 X 2200	1500	1200	300	10 @ 250C/C	10 @ 250C/C
2	12.5	12 SIDED	6 LUM.	2.32	0.63	101	700 X 700	12 Φ12	6 @ 190 C/C	2300 X 2300	1500	1200	300	Φ10 @ 250C/C	Φ10 @ 250C/C
3	16	20 SIDED	8 LUM.	2.87	0.78	125	750 X 750	12 Φ16	6 @ 190 C/C	2600 X 2600	1500	1200	300	Φ10 @ 250C/C	Φ10 @ 250C/C
4	16	20 SIDED	12 LUM.	3.31	0.90	148	800 X 800	12 Φ16	6 @ 190 C/C	2800 X 2800	1500	1200	300	Φ10 @ 220C/C	Φ10 @ 250C/C
5	20	20 SIDED	8 LUM.	3.85	1.02	186	800 X 800	12 Φ16	6 @ 190 C/C	3000 X 3000	1800	1500	300	Φ10 @ 170C/C	Φ10 @ 250C/C
6	20	20 SIDED	12 LUM.	4.16	1.02	192	900 X 900	12 Φ20	6 @ 190 C/C	3000 X 3000	1800	1500	300	Φ10 @ 180C/C	Φ10 @ 250C/C
7	25	20 SIDED	12 LUM.	5.71	1.37	266	900 X 900	12 Φ20	6 @ 190 C/C	3500 X 3500	1800	1450	350	Φ12 @ 200C/C	Φ10 @ 220C/C
8	25	20 SIDED	16 LUM.	6.80	1.60	335	1000 X 1000	12 Φ24	6 @ 190 C/C	3800 X 3800	1800	1450	350	Φ12 @ 170C/C	Φ10 @ 220C/C
9	30	20 SIDED	12 LUM.	7.72	1.76	389	1100 X 1100	12 Φ32	6 @ 190 C/C	4000 X 4000	1800	1450	350	Φ12 @ 160C/C	Φ10 @ 230C/C
10	30	20 SIDED	16 LUM.	9.02	1.85	449	1100 X 1100	12 32	6 @ 190 C/C	4100 X 4100	2000	1600	400	12 @ 150C/C	10 @ 190C/C



## 49. L.T. DISTRIBUTION BOX FOR 63 / 100 KVA 11/0.44 KV TRANSFORMER (3 PHASE, 200A)

### 49.1 SCOPE:

The scope of this specification is for design, manufacture, testing and supply of outdoor type L.T. distribution boxes suitable for operation on 433 volts, 3 phase, four wires AC, 50 Hz system and required to be installed at the secondary terminals of distribution Transformer centers of 100KVA and 250KVA & above.

### 49.2 COMPONENTS:

The L.T. Distribution boxes shall comprise of the following components.

1. Enclosures fabricated out of M.S. sheet
2. Bus Bars
3. Moulded case circuit breakers.

### 49.3 APPLICABLE STANDARDS:

The L.T. Distribution Boxes with its components shall conform to the following standards of Bureau of Indian Standard (IS) and International Electro Technical Commission (IEC).

- |                  |  |
|------------------|--|
| 4. IS-5          | Ready mixed paints.                            |
| 5. IS-104        | Ready Mixed paints, Brushing and zinc chroming |
| 6. IS-117        | Paints finishing exterior.                     |
| 7. IS- 440       | Chemical analysis of copper: -                 |
| 8. IS-1079       | Hot rolled carbon steel.                       |
| 9. IS-1730       | Steel sheet and strip dimensions.              |
| 10. IS-13947     | Parts I & II Circuit breakers.                 |
| 11. IS-6639      | Hexagonal Bolts for steel structures.          |
| 12. IS-8828 1996 | MCCB's for voltages not exceeding 1000V.       |

### 49.4 NORMAL SERVICE CONDITIONS:

Generally, as per IS -13947 - Part I & II with latest amendments thereon.

### 49.5 DEFINITION & TERMINOLOGY - As per

- i) IEC-56 Clause (3) and sub- clause thereof for circuit breakers.
- ii) As per IS-13947 Part I & II thereof for circuit breakers.

### 49.6 DESIGN & CONSTRUCTION:

The enclosure shall be fabricated out of 2mm MS Sheet. The doors shall be provided with spring loaded latch operated by common key for all boxes. Hinges shall be provided at a distance of 150mm from the top and bottom of the distribution box for easy swinging. Doors shall be of non-removable type. The design shall be such that the boxes are water tight, dust and vermin proof. U- type drains shall be provided on the top and sides of drain away rainwater. Four angles of ventilating louvres with perforated sheet weld mesh shall be provided on both the doors for each box. Two earthing terminals one on either side of the box, legibly identified and marked shall be provided.

A general arrangement drawing of L T Distribution boxes, suitable for 100KVA and 250/300KVA Distribution Transformers is enclosed.

**49.7 BUS BARS:**

49.7.1 The Bus bars shall be of Aluminium flat and provided with PVC/heat shrink insulation with red yellow, blue and green colour code to identify each of the phases and the neutral.

49.7.2 The Bus bar clearances shall be as per drawing enclosed.

49.7.3 The recommended sizes of the main bus bars and vertical riser links shall be as follows:

Capacity of Transformers	Current rating in Amps	Size of Main bus bars in mm	aluminum vertical riser links in mm	Number of circuits (outgoing)
100KVA	240	6 X 40	8 X 20	2
250KVA	630	10 X 50	10 X 30	2

The bus bars shall be arranged in a staggered vertical formation and shall be supported by porcelain insulators.

**49.8 MOULDED CASE CIRCUIT BREAKERS (MCCB):**

MCCB's shall generally comply with IS-13947 Part-I & II. The design and construction shall be in accordance with IS-8828-1996. The MCCB shall be a compact unit comprising of all the protective circuits. The MCCB's shall be suitable for 100KVA and 250KVA Transformers.

**49.9 RATING & CHARACTERISTICS:**

Capacity of Transformer	Continuous current	Rated short circuit rating capacity at 0.25 PFkA (rms)	Rated peak making capacity kA (rms)
100KVA	<b>160Amps</b>	50	105
250KVA	<b>250Amps</b>	50	105

- a) Rated operating voltage 433V phase to Phase  
250 V Phase to neutral.
- b) Rated insulation voltage 660V Minimum
- c) Category as per IS 13947 -- Part I & II: Icu= Ics= 100%.

## Section:8B Technical Specifications

- d) Current Limiting: - The moulded case circuit breakers directly feeding the loads shall be preferably of current limiting type such that under short circuit conditions very low cut off current and are let through for better protection of loads, cables etc.,
- e) Protective Release: - The MCCB's shall be fitted with suitable protective release to give overload short circuit protection. The protective release and the tripping mechanism shall be such that all three poles of the MCCB shall open in case of fault on any one/two or all three poles.
- f) Current Setting: The Current of the MCCB shall be for 100% of the MCCB thermal rating. The setting shall be fixed at 100% setting suitable for momentary rating and compatible with the full load current of the Transformers.

### **49.10 AMBIENT COMPENSATION:**

The current setting or the tripping time shall not be affected by change in ambient conditions. The ambient compensation shall be effective over 0°C to 55°C.

### **49.11 TIME CURRENT CHARACTERISTICS:**

The protective release shall have inverse time current tripping for over load and instantaneous for short circuit.

### **49.12 MECHANISM:**

The MCCB shall have manual closing mechanism, which shall be quick make, quick brake and trip free. The position of the knob shall give indication of 'ON', 'OFF' & 'TRIP'.

Facility for manual tripping shall be provided.

### **49.13 TERMINATION:**

The terminals shall have adequate capacity for termination of Aluminum cables of size up to 3 x 240 Sq mm.

### **49.14 EARTHING:**

The Earthing shall be as per clause 4.5 and sub clause thereof IS 8828 – 1996 with latest revisions etc.

### **49.15 PAINTING & FINISHING:**

The Frame work and surface of steel panels shall be treated with seven tank process to remove rust and scales. The interiors and exteriors shall be powder coated with admiralty grey pure polyester powder with thickness of 60-80 microns.

### **49.16 TESTS:**

Type and Routine Tests on the circuit breaker shall be as per IS-13947 Part I & II and as per IS- 8828 - 1996.

- i) Type tests: As per clause R.1.2 (a), (b) & (c) of IS-8828-1996
- ii) Routine tests: As per IS - 13947 part I & II with latest revisions there on.

### **49.17 INSPECTION:**

In respect of bought out items the manufacturer shall use equipment's/items supplied by standard/reputed manufacturers and furnish manufacturers Test Certificate as well as the proof of purchase from these manufacturers (Excise gate pass) for information of the

## Section:8B Technical Specifications

owner. The supplier shall give the owner sufficient advance intimation to arrange for inspection of the LT Distribution Boxes. The owner shall have easy access to the manufacturers works at all reasonable times of the day.

### **49.18 MARKING & NAME PLATE:**

Each outgoing and incoming circuit near the MCCB and the exit shall be dearly marked.

A Caution board of 433V rating shall be affixed on the front of the box.

A name plate incorporating the following shall be provided.

- iii) Manufacturer name and address
- iv) Purchase order reference
- v) Rating of the Distribution Box
- vi) Rating of MCCB used with make and other ratings.

### **49.19 DESPATCH:**

The Supplier shall fabricate one box and offer for approval before commencement of bulk supplies. The Bulk supplies shall commence only after the sample is approved. Further the manual containing operation, maintenance of the equipment/components shall be supplied along with each distribution box.

The fabrication and assembly of equipment shall be strictly in accordance with the approved drawings and no deviations shall be permitted without the written approval of the owner. All the manufacturing and fabrication work in connection with the equipment prior to approval of drawing shall be at contractor's risk.

### **49.20 PACKING & FORWARDING:**

The equipment shall be packed suitably. The contractor is responsible for any damage to the equipment due to improper and inadequate packing. The contractor without any extra cost shall supply any material found short without any extra cost.

## **50. FEEDER PILLAR BOX**

### **50.1 General**

- a) Medium voltage feeder pillar shall be cubicle type, floor mounted, free standing type, dust and vermin proof, totally enclosed, of uniform height and for outdoor utilization and suitable for 3-phase, 4 wire, 415 V, 500 Hz AC, solidly earthed neutral, electric supply system complete with 4 nos. pedestals, accessories, inter-connections, bus bar chamber with copper/aluminium bus bar (as specified in the relevant BOQ item), ON/OFF indication, CTs, switchgears ( as specified in the relevant BOQ item), timer etc. in position duly wired up with copper conductor cable with colour coding, etc. and other accessories though not mentioned here but necessary to complete the equipment in all respects.
- b) The manufacturer shall have ISO: 9001 certification with testing arrangement and powder coating facilities in the works.

50.2 Digital Time switch (Timer) of suitable rating and contactors (as specified in the relevant BOQ item) shall be provided in the feeder pillar

## Section:8B Technical Specifications

to operate pump/street lights etc. and this shall be controlled with independent switchgear/s.

### 50.3 Construction

50.3.1 The feeder Pillar shall be fabricated from 2.0 mm thick CRCA sheet steel. The shroud & partitions shall be of minimum 1.6 mm thickness and shall be fabricated from CRCA sheetsteel. The feeder pillar shall be powder coated in approved shade by seven tank process. The degree of protection shall not be less than IP 54 as per IS: 13942/Pt.1.

50.3.2 Pedestals and base frame shall be of MS angle of 75mm x 75mm x 8 mm (nominal size). The Feeder Pillar shall have the provision of flush doors on front and back in two equal parts with hinges and concealed lock openable with special key.

50.3.3 The following minimum clearances shall be maintained:

i)	Between Phases	- 32 mm
ii)	Between Phases & Neutral	- 26 mm
iii)	Between Phases & Earth	- 26 mm
iv)	Between Neutral & Earth	- 26 mm

50.3.4 All functional units shall be arranged in multi-tier formation & each such unit shall be fully compartmentalized. Vertical cable alley shall be provided. Each compartment shall have its own individual door with concealed hinges & the door shall have interlocking so that it can only be opened after switching off the module.

### 50.4 Bus Bars

50.4.1 The bus bars shall be made of high conductivity aluminium/copper (as specified in BOQ) conforming to the requirement of IS 5082/1998 for aluminium and IS: 1897/1983 for copper. The bus bars shall have uniform cross section (basis of bus bar cross section will be maximum of 1000 A/sq. inch for copper and 630A/sq. inch for aluminium). The cross-section of the neutral bus bar shall be same as that of the phase bus bar for bus bars of capacity upto 200 Amp. For higher capacities, the neutral bus bar shall not be less than half (50 %) the cross-section of that of the phase bus bars.

50.4.2 Bus bars shall be supported on suitable non-hygroscopic, non-combustible, material such as DMC/SMC.

50.4.3 Bus bars shall be insulated with PVC tapes/ tubes (heat shrink type) with colour coding (Red/Yellow/Blue/ Black) to withstand the test voltage of 2.5 kV for one minute.

### 50.5 Moulded Case Circuit Breakers (MCCB)

50.5.1 MCCB shall be TPN of rating as specified in the relevant BOQ item and shall conform to IS- 13947/Pt-2/1993 ( $I_{cs} = 100\%I_{cu}$  or as specified in relevant BOQ item) with thermal release setting 70/80%-100% or fixed type (as specified in the relevant BOQ item) with breaking

## Section:8B Technical Specifications

capacity of not less than 25 kA for load currents up to 200 amp. & 35 kA for load currents above 200 amp rating. MCCBs shall be suitable for three phase, 415 Volt, AC supply.

50.5.2 Tripping unit shall be of thermal – magnetic type provided in each pole and connected by a common trip bar such that tripping of any one pole operates all the poles and they open simultaneously.

### 50.6 Fuse Switch/ Switch Fuse Unit

Fuse switch/switch fuse unit shall be heavy duty, TPN double break of rating (as specified in the relevant BOQ item), utilization category AC 23, conforming to IS: 13947/Pt. III/1993 with 3 HRC fuses conforming to relevant IS and one neutral link

### 50.7 Current Transformers

50.7.1 Current transformers shall be in conformity with IS: 2705 (Part I, II & III). Current transformers shall be rated for 1 kV. Current Transformer shall have rated primary current, rated burden and class of accuracy. The rated secondary current shall be 5 A. The acceptable minimum class of various applications shall be as given below:

Measuring :  
Class 1  
Protection :  
Class 5 P10.

50.7.2 The VA rating of the CTs shall be not less than 5 VA.

### 50.8 Cable Termination

50.8.1 Cable entries shall be provided with metal glands to prevent damage to the insulation of the cable and terminals shall be provided to suite the number, type and size of aluminium conductor power cables.

50.8.2 Provision shall be made for bottom entry of cables through removable gland plates.

### 50.9 Tests at Manufacturers' Works

50.9.1 All routine tests shall be carried out in the presence of the inspecting Engineer.

50.9.2 Original test certificates of all equipment's/ instrument shall be submitted by the contractor along with the supply of panel board after the Inspecting Officer passes the feeder pillar.

## 50.10 SWITCH BOARD

### General

- a) Medium voltage switch board shall be cubicle type, floor mounted, free standing type, dust and vermin proof, totally enclosed, of uniform

## Section:8B Technical Specifications

height and for indoor utilization and suitable for 3- phase, 4 wire, 415 V, 50 Hz Ac, solidly earthed neutral, electric supply system complete with accessories, inter connections, bus bar chamber with copper/aluminium busbar (as specified in the relevant BOQ item), ON/OFF indication, CTs, switchgears (as specified in the relevant BOQ item) timer etc. in position duly wired up with copper conductor cable with colour coding and other accessories though not mentioned here but necessary to complete the equipment in all respects.

- b) The switch board manufacturer shall have ISO: 9001 certification with testing and powder coating facilities in the works.

### 50.11 Testing and Commissioning at Site

Following tests shall be carried out prior to Commissioning:

- a) Insulation test  
b) Trip Tests & Protection Tests

### 50.12 Erection

Brick masonry platform of suitable size with 450 mm height (approximate) shall be constructed in the specified location and cement finish. Feeder pillar shall be erected on this platform by grouting of pedestals as approved by the Engineer.

- 50.13 Digital time switch (Timer) of suitable rating and contactors (as specified relevant BOQ item) shall be provided in the panel to operate pump/street lights etc. and shall be controlled with independent switchgear/s. Construction

The panel shall be fabricated from 2.0 mm thick CRCA sheet steel. The shroud & partitions shall be minimum 1.6 mm thickness and shall be fabricated from CRCA sheet steel. The panel shall be powder coated in approved shade by seven-tank process. The degree of protection shall not be less than IP 42 as per IS: 13942/Pt.1.

The following minimum clearances shall be maintained:

- |                              |         |
|------------------------------|---------|
| i) Between Phases            | - 32 mm |
| ii) Between Phases & Neutral | - 26 mm |
| iii) Between Phases & Earth  | - 26 mm |
| iv) Between Neutral & Earth  | - 26 mm |

All functional units shall be arranged in multi-tier formation & each such unit shall be fully compartmentalized. Vertical cable alley shall be provided. Each compartment shall have its own individual door with concealed hinges & the door shall have interlocking so that it can only be opened after switching off the module.

### 50.14 Bus Bars

- 1) The bus bars shall be made of high conductivity aluminium/copper (as specified in BOQ) conforming to the requirement of IS 5082/1998 for aluminium and IS: 1897/1983 for copper. The bus bars shall have uniform cross section (basis of bus bar cross section will be maximum of 1000 A/sq.

## Section:8B Technical Specifications

inch for copper and 630A/sq. inch for aluminium). The cross-section of the neutral bus bar shall be same as that of the phase bus bar for bus bars of capacity upto 200 Amp. For higher capacities, the neutral bus bar shall not be less than half (50 %) the cross-section of that of the phase bus bars.

- 2) Bus bars shall be supported on suitable non-hygroscopic, non-combustible, material such as DMC/SMC Bus bars shall be insulated with PVC tapes/tubes (heat shrink type) with colour coding (Red/Yellow/Blue/ Black) to withstand the test voltage of 2.5 kV for one minute.

### **50.15 Molded Case Circuit Breakers (MCCB)**

MCCB shall be TPN of rating as specified in the relevant BOQ item and shall conform to IS- 13947/Pt-2/1993 (Ics = 100% Icu or as specified in the relevant BOQ item) with thermal release setting 70/80%-100% or fixed type as specified in the relevant BOQ item) with breaking capacity of not less than 25 kA for load currents up to 200 amp. & 35 kA for load currents above 200-amp rating. MCCBs shall be suitable for three phase, 415 Volt, AC supply.

Tripping unit shall be of thermal – magnetic type provided in each pole and connected by a common trip bar such that tripping of any one pole operates all the poles and they open simultaneously.

### **50.16 Fuse Switch/ Switch Fuse Unit**

Fuse switch/switch fuse unit shall be heavy duty, TPN double break of rating (as specified in the relevant BOQ item), utilization category AC 23, conforming to IS: 13947/Pt. III/1993 with 3 HRC fuses conforming to relevant IS and one neutral link

### **50.17 Current Transformers**

Current transformers shall be in conformity with IS: 2705 (Part I, II & III). Current transformers shall be rated for 1 kV. Current Transformer shall have rated primary current, rated burden and class of accuracy. The rated secondary current shall be 5 A. The acceptable minimum class of various applications shall be as given below:

Measuring: Class 1  
Protection: Class 5  
P10.

The VA rating of the CTs shall be not less than 5 VA.

### **50.18 Cable Termination**

Cable entries shall be provided with metal glands to prevent damage to the insulation of the cable and terminals shall be provided to suite the number, type and size of aluminum conductor power cables.

Provision shall be made from bottom for entry of cables through removable gland plates.



#### 50.19 Tests at Manufacturers' Works

All routine tests shall be carried out in the presence of the inspecting Engineer.

Original test certificates of all equipment's/ instrument shall be submitted by the contractor along with the supply of panel board after the Inspecting Officer passes the feeder pillar.

Testing and Commissioning at Site

**Following tests shall be carried out prior to Commissioning:**

- 1) Insulation test
- 2) Trip Tests & Protection Tests

K-RIDE

# SECTION 8C EXPLANATORY NOTES

## General:

1. The tenderers are expected to go through the Explanatory notes for various items of work in Electrical General Services Schedule are given separately before bidding.
2. All electrical works should comply with Indian Electricity Act 2003 and Rules framed there under.
3. All electrical installations shall conform to the relevant Indian Standard and shall be carried out as per the relevant safety Code of Practices and guidance for Safety Procedures in Electrical Works as per IS:5216/Pt I & II/1982.
4. Electrical works shall be carried out by only class-1 electrical contractor license.
5. Notwithstanding the ratings specified in the BOQ, all components proposed to be used in the installations, shall be of appropriate rating of voltage, current and frequency without any additional financial implication on KRIDE. Discrepancies, if any, in this regard, shall be brought to the notice of the Engineer by the Contractor.
6. All minor items viz. hardware items, foundation bolts, termination lugs for electrical connections etc. as required and necessary for proper working of the equipment shall be deemed to have been included in the Bill of Quantities, whether such items are specifically mentioned or not.
7. The basic quantities of components & materials required to make up a unit of work for selected items are approximate. The Contractor shall plan the work, estimate the actual quantities required and get the same approved by the Engineer before placing orders.
8. In estimating the prices for various items of work, provision for loss or wastage in transit and erection including freight, handling, taxes and duties (but excluding GST), insurance if any etc. should be taken into account and firm unit price offered for a complete unit of work to be done by the contractor.
9. The various items to be supplied/provided/erected should be as per the approved list. Items not appearing in the approved list shall be procured from good quality sources in line with best industries practices and shall be either ISI marked or conforming to latest IS (if any). **Before procurement, vendor approval shall be obtained from the Employer.**
10. Good workmanship and total compliance with safety and other statutory rules and regulations, shall invariably be observed by the Contractor.
11. All approvals from the relevant and appropriate government & statutory authorities shall be the total responsibility of the Contractor unless specified otherwise.
12. All quoted rates shall cover supply of materials, handling of materials, labour required, civil works, taxes and duties, fabrication, installation, testing and commissioning, training and free maintenance till handing over to the Employer's representative.
13. If any activity of work is essential for the satisfactory completion of the work but is not mentioned specifically in the Bill of Quantities or elsewhere in the bidding documents, the same shall be deemed to be included in the scope of work and shall be executed by the contractor within the accepted cost. The work shall be handed over in a functional manner complete in all respects.
14. The inspection of items will be done at the manufacture's works/place decided by the Employer based on item, its quantity, Inspecting Authority etc.
15. No conduit shall be of size less than 20 mm.
16. Occupancy of wiring cable in conduit shall not exceed 45% of the capacity of conduit.
17. Switch boxes shall be of galvanized sheet metal of suitable sizes from approved sources.
18. Separate conduit shall be laid for each circuit/sub main/main wiring.
19. Water cooler/AC Points and other such inductive loads shall be controlled with "C" series MCBs.
20. Neutral cable shall be brought into each switch box.
21. Earth cable shall be brought into each switch box.
22. Fan point wiring shall include supply & fixing of fan box.

Section:8C Explanatory Notes

23. Approx.150 mm long wiring cable shall be kept loose in switch box/SDB/DB etc.
24. Conduits laid in sheds shall be clamped with the shed structure with clamps made from GI strips of 25x1.6mm and spaced at about 1000mm interval, fixed with 8mm dia bolts with nuts.
25. Brass screw and cup washers shall be used for fixing sheets on the front of switch box.
26. All the wiring work shall be in conformity with IS732/1989 (Latest Version) CODE OF PRACTICE FOR ELECTRICAL WIRING INSTALLATIONS & IS 4648/1968 (Latest Version) Guide for Electrical Wiring in Residential Buildings.
27. The equipment which are available with ISI mark in Indian market, they shall be supplied having ISI mark only whether specifically mentioned in BOQ & its explanatory notes or not.
28. All the energy consuming equipment which are available in Indian market with energy star rating issued by BEE, shall be supplied with minimum 5-star energy rating only whether specifically mentioned in BOQ & its explanatory notes or not.
29. Equivalent LED fitting and lamp (as approved by Engineer) may be used in place of other type of lighting fixtures with lamp for better life and energy efficiency.

### **DRAWINGS**

- i. The contractor shall prepare drawings in Auto Cad for all LT/HT installations, indicating proposed works and shall obtain approval of Engineer prior to taking up the work. Such drawings shall be prepared in coordination with all other agencies executing works at the same site and a maximum of 04 (Four) copies as are required by KRIDE with one tracing on RTF paper.
- ii. After commissioning, these drawings shall be duly updated as per erection work at site and submitted in six copies and one tracing in RTF paper, as Completion Drawings, along with a soft copy to the Employer.
- iii. Where the contractor proposes to use an item of equipment, other than that specified or detailed on the drawings, which requires any re- design of the structure, partitions, foundation, piping, wiring or any other part of the mechanical, electrical or architectural layouts, he shall inform the Engineer well in advance and obtain his approval. Delays resulting from such re-design shall be On Contractor's account. He shall also submit all related information as may be required for approval of such redesign, to the Engineer.
- iv. Where the work of the Contractor has to be executed in close proximity to or will interfere with work of other agencies, the Contractor shall work out space/time adjustments in coordination with other agencies. If the contractor installs his work before coordinating with other agencies, so as to cause any interference with their work, he shall make the necessary changes without extra cost to the owners of the installation.

## EXPLANATORY NOTES

### **Light point/Circuit point:**

The scope includes Supplying and Wiring with 2 runs in existing PVC Conduit / Casing Caping using Wire of size 1.5 sq. mm (Phase and Neutral), 1x1.5 sq.mm (Earth Wire) FRLS multi strand PVC Insulated copper wire with relevant IS spec (IS 694; and latest amendments), a 6A Switch modular type Single Pole switch control shall be placed on existing modular switch plate on Existing modular GI switch box, the other end of wires shall be terminated with sufficient loose length connected to a ceiling rose mounted on a PVC round block. Complete for each outlet. The points shall be as below.

- a. Short Point up to 3 Mtr from tapping point to outlet via switch
- b. Medium Point above 3 Mtr up to 6 Mtr from tapping point to outlet via switch
- c. Long Point above 6 Mtr up to 10 Mtr from tapping point to outlet via switch

### **10 sq. mm Wire:**

The scope includes Supplying and Wiring in existing PVC Conduit / Casing Caping which is not covered under point wiring such as jointless connection from main board to other distribution board will be measured and recorded as per running meter. The circuit shall be by means of two / four runs for Single / Three phase respectively of Colour coded (RYB-N or R/Y/B-N) FRLS, PVC insulated, 10 sq.mm multistranded copper wire, 1100V grade relevant IS spec (IS 694 latest). The wire shall be terminated on both ends by using either pin or ring type lugs of relevant size as required and one number of 2.5 sq.mm multistranded copper wire.

### **6 sq. mm Wire:**

The scope includes Supplying and Wiring in existing PVC Conduit / Casing Caping which is not covered under point wiring such as jointless connection from main board to other distribution board will be measured and recorded as per running meter. The circuit shall be by means of two / four runs for Single / Three phase respectively of Colour coded (RYB-N or R/Y/B-N) FRLS, PVC insulated, 6 sq.mm multistranded copper wire, 1100V grade relevant IS spec (IS 694 latest). The wire shall be terminated on both ends by using either pin or ring type lugs of relevant size as required.

### **4 sq. mm Wire:**

The scope includes Supplying and Wiring in existing PVC Conduit / Casing Caping which is not covered under point wiring such as jointless connection from main board to other distribution board will be measured and recorded as per running meter. The circuit shall be by means of two / four runs for Single / Three phase respectively of Colour coded (RYB-N or R/Y/B-N) FRLS, PVC insulated, 4 sq.mm multistranded copper wire, 1100V grade relevant IS spec (IS 694 latest). The wire shall be terminated on both ends by using either pin or ring type lugs of relevant size as required.

### **2.5 sq. mm Wire:**

The scope includes Supplying and Wiring in existing PVC Conduit / Casing Caping which is not covered under point wiring such as jointless connection from main board to other distribution board will be measured and recorded as per running meter. The circuit shall be by means of two runs for Single phase of Colour coded (R/Y/B-N) FRLS, PVC insulated, 2.5 sq.mm multistranded copper wire, 1100V grade relevant IS spec (IS 694 latest). The wire shall be terminated on both ends by using either pin or ring type lugs of relevant size as required.

**1.5 sq. mm Wire:**

The scope includes Supplying and Wiring in existing PVC Conduit / Casing Capping which is not covered under point wiring such as jointless connection from main board to other distribution board will be measured and recorded as per running meter. The circuit shall be by means of two runs for Single phase of Colour coded (R/Y/B-N) FRLS, PVC insulated, 1.5 sq.mm multistranded copper wire, 1100V grade relevant IS spec (IS 694 latest). The wire shall be terminated on both ends by using either pin or ring type lugs of relevant size as required.

**Flexible Multi Core Cable - 3Cx1.5 sq.mm:**

The Scope includes Supplying and laying of flexible jointless 3 core 1.5 sq.mm multi core cable on existing wall / structure on rigidly mounted cable tray or saddle and clamp arrangement using cable ties, manufactured with electrolytic grade flexible copper confirming to IS: 8130-1984 and (virgin) PVC insulation sheathed suitable for working voltage up to 1100 Volts as per IS:694:2010.

**Flexible Multi Core Cable - 4Cx4 sq.mm:**

The Scope includes Supplying and laying of flexible jointless 4 core 4 sq.mm multi core cable on existing wall / structure on rigidly mounted cable tray or saddle and clamp arrangement using cable ties, manufactured with electrolytic grade flexible copper confirming to IS: 8130-1984 and (virgin) PVC insulation sheathed suitable for working voltage up to 1100 Volts as per IS:694:2010.

**Concealed Conduit:**

The scope involves supply and laying of heavy gauge conduit inside roof slab before concreting for concealed wiring. All PVC conduit for wiring shall be conforming to IS 2509. No PVC conduit shall be less than 20 mm +/- 0.2mm in diameter and wall thickness of 2 mm shall be used for 19/20 mm & 25 mm and 2.8 mm wall thickness for 32 mm. The number of insulated conductors that can be drawn into PVC conduit should be as per table III of IS:732/1963 and should be easy to draw at the time of wiring. The cost includes supply of couplers, junction box, bends and other accessories etc. The specification and details of fixing / concealing of PVC conduit is given in technical specification. The conduit shall be properly anchored to roof rebars using GI wire / steel ties at regular intervals. The conduits shall be extended using collar / connected to other accessories using PVC cement properly spread / smeared all around the outer edge of conduit and inner edge of receiving end. The joint shall be reinforced using adhesive insulation tape for added strength. The ends of conduit shall be terminated on end by using a bend and nominal extension below the roof level for future connection to Main power Panel / DB / Switch box.

**Groove cutting Conduit:**

The scope involves supply and laying of heavy gauge conduit inside by wall groove cutting before Plastering for concealed wiring. All PVC conduit for wiring shall be conforming to IS 2509. No PVC conduit shall be less than 20mm +/- 0.2mm in diameter and wall thickness of 2mm shall be used for 19/20 mm & 25 mm and 2.8 mm wall thickness for 32 mm. The number of insulated conductors that can be drawn into PVC conduit should be as per table III of IS:732/1963 and should be easy to draw at the time of wiring. The cost includes supply of couplers, junction box, bends and other accessories etc. The specification and details of fixing / concealing of PVC conduit is given in technical specification. The conduit shall be properly anchored inside the groove by fixing-by-bracing U or J hooks and cement plastering up to the wall surface and run with 18 SWG GI fish wire run throughout the conduit wherever necessary.

**Open conduit system:**

Supplying heavy gauge PVC conduit pipe of 20, 25 / 32 mm dia and 2.0 / 2.8 mm thick conforming to IS 2509 with suitable size bends, junction boxes, adhesive paste etc, and fixing using inverted wood plugs in case of RCC ceiling and RCC wall / stone structure or rawl plugs in case of brick walls and cement plastering the damaged portion using heavy gauge saddles at an interval of 700mm using NF screws.

**GI Modular box:**

The cost includes Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall. The specification of item is given in technical specification.

**Modular plates:**

The cost includes Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nut etc., complete on the existing metal / PVC box.

**Modular sockets:**

The cost includes Supply and fixing of modular 3 pin 5/6/16/32Amps, Socket outlet on the existing modular plate and switch box including connections as required (the cost includes erection charges). The modular socket shall meet specification of IS 3854 & IS 1293. The detailed specification of sockets is given in technical specification.

**Socket Outlets**

- (i) Socket outlets modular type shall be 6A 3 pin, 16 Amp 3 pin or 16/6 Amp 6 pin. 5 pin socket outlets will not be permitted.
- (ii) The third pin shall be connected to earth through protective (loop earthing) conductor. 2 pin or 5 pin sockets shall not be permitted to be used.
- (iii) Conductors connecting electrical appliances with socket outlets shall be of flexible type with an earthing conductor for connection to the earth terminal of plug and the metallic body of the electrical appliance.
- (iv) Sockets for the power outlets of rating above 1KW shall be of industrial type with associated plug top and controlling MCB.
- (v) Where specified, shutter type (interlocking type) of sockets shall be used.
- (vi) Every socket outlet shall be controlled by a switch or MCB, as specified. The control switch/MCB shall be connected on the 'live' side of the line.

**Modular switches:**

The cost includes Supply and fixing of modular switch of 5/6/16/32Amps on the existing modular plate and switch box including connections as required (the cost includes erection charges). The modular switch shall meet specification of IS:3854 & IS 1293. The detailed specification of switches is given in technical specification.

**Stepped Regulator:**

The cost includes Supply and fixing of two module type modular stepped electronic speed regulator of 100 Watts with operating voltage ranging from 175 to 250 VAC 50 Hz on the existing

## Section:8C Explanatory Notes

modular plate and switch box including connections as required (the cost includes erection charges). The modular fan regulator shall meet specification of IS:3854 & IS 1293. The detailed specification of switches is given in technical specification.

### **Lamp Holder:**

The cost includes Supply and fixing Lamp holders of various types like batten, angle, pendant or bracket holder type as required. The holder shall be made of brass and shall be rigid enough to maintain shape on application of a nominal external pressure. There should be sufficient threading for fixing the base to the lamp holder part so that they do not open out during attention to the lamp or shade.

### **Ceiling Rose:**

- (i) A ceiling rose shall not be used on a circuit, the voltage of which normally exceeds 250V.
- (ii) Only one flexible cord shall be connected to a ceiling rose. Specially designed ceiling roses shall be used for multiple pendants.
- (iii) A ceiling rose shall not embody fuse terminal as an integral part of it.

### **Surface/wall mounted LED batten type light fitting 20/10W watt:**

The scope involves supply of LED batten type 10/20W lights. The item includes cost of LED surface/wall mounted light fitting and other accessories required for fixing of light fitting on wall/structure. The scope also includes fixing all types and all capacities of fluorescent / false ceiling / spot light / CFL / LED fittings indoor on the wall / ceiling / rafters / girders using 23/0.0076" twin twisted PVC insulated wires, required Nos of round blocks and clamps. On wall / ceiling / Rafter / Girders.

### **15/18-20-watt bulb:**

The scope involves supply and fixing retrofit of 15/18-20-watt LED bulb in existing PBBC angle / straight holder with all necessary connections.

### **BLDC ceiling fan 1200mm:**

#### **• Supply and erection of BLDC fan of 1200mm sweep with remote:**

The scope of work involves supply of 5 Nos, Energy Efficient BEE 5 star rating brushless DC motor (BLDC) fan per quarter of size 1200 mm sweep with double ball bearing, 300 mm down rod, canopies, shackles, 3 Nos. of blades, suitable for operation on 230V AC 50Hz, Single phase supply, as per the specification.

- The price shall also cover assembling of ceiling fan complete besides fixing to the hook and undertaking connection from ceiling rose. The price covers fixing phenolic laminated sheet cover on the fan box, FRLS PVC insulated multistranded single/three core copper conductor cable wiring and connecting with earthing system, etc.. The detailed specification of fan is given in Technical specification.

### **Wall Mounting Fan:**

The scope involves supply of 300 mm wall mounting fan complete with wall mount bracket, speed adjuster thread. The fan shall be supplied with safety mesh around the circulating blade.



The wall mounted fan shall have built in oscillator function with separate pull chain operation to engage or disengage the oscillation.

**Air Conditioner:**

The scope involves supply of 1.5ton split AC unit, 5 star rating inverter type working on single phase supply with features of cooling complete with LCD display, cordless remote (for control of functions, on/off, timer, selecting fan speed (three speeds) and setting up of temperature), suitable for operation on single phase 180 to 260 volts, 50 Hz incoming AC supply with cooling capacity of 5000 Watts minimum and air flow with Hi/Mi/Lo in (m<sup>3</sup>/h) with 875 m<sup>3</sup>/h minimum air flow.

**Voltage Stabilizer:**

The scope involves supply and Installation of wall mounted stabilizer conforming to relevant IS (latest version), suitable for operation on single phase 180 to 260 volts, 50 Hz incoming AC supply and output 200 to 230 volts A.C supply, with time delay relay, voltmeter, instant start provision with push button switch.

**Installation of Air Conditioner:**

The scope involves installation of Air conditioner units by supply, fabrication and fixing of MS brackets for mounting outdoor units, installation of wall mounted stabilizer, installation and commissioning of AC plant, provision of rubber pads below the outdoor unit, heavy duty PVC flexible pipe (ISI marked) for drain, interconnecting cable and refrigerant copper pipes with thermal insulation. The item price also includes labour & cost of items required for interconnection cables, screws etc. Modular type single phase starter switch for AC operation similar to ABB product ID 1SYK100001A1556 or any other approved make and a Dual channel digital time switch with battery back-up 24 Hr operation similar to ABB product ID 2CSM222521R1000 or any other approved make should be provided for the alternate operation of AC. The scope includes supply and erection of Single-phase starter and digital time switch.

**High Bay Light:**

The cost involves supply and fixing of 50W, Energy saving, environment friendly and robust open type vertical high bay lighting with high power COB LED light as source. The light fitting shall be similar to Havells Iliosbay Plus highbay. The scope shall include provision to hang the fixture from existing hook with PVC insulated 3Cx1.5 Sq.mm cable.

**2/3 KVA online UPS:**

Supply, erection, testing and commissioning of online UPS 2/3 kVA with isolation transformer suitable for single phase AC input and single-phase AC output, floor mounted type indicative backup time 30 min. The cost of work includes supply and fixing VRLA battery set, battery stand cable connectors, nut bolts etc required for satisfactory commissioning of above work. The detailed specification of UPS has been discussed under specification chapter enclosed as annexure-I.

**LED street light luminaire:**

Supply and fixing of 25-40W LED weatherproof (IP-65) streetlight fitting suitable driver on the octagonal pole as per the technical specifications. The scope of work involves provision of 1 mtr long 25 mm dia B class GI pipe bracket with fixing accessories. The item price also includes labour & cost of all materials including cost of FR PVC insulated multistranded single core copper conductor cable, earthing connection, supply and erection of suitable clamps/brackets/screws etc to fix light fittings under COP/FOB/Poles/roofs/walls/ sheds etc.

### Exhaust fan:

The scope involves supplying and fixing of exhaust fan of 1440 RPM of 300mm (12") size with bracket, blades, complete for light duty/Heavy Duty suitable to operate on 230V 50Hz, AC supply. Extension of supply wire shall be as per requirement. The scope includes fixing exhaust fan in the notch already left in the wall with bolts and nuts and 5 amps. ceiling rose with sufficient length of 23 / 0.0076-inch PVC insulated twin core wire with necessary bolt nuts, fan bracket, bird guard etc.,

The installations to be provided shall comply to the following:

- (i) Exhaust fans shall conform to relevant Indian Standards.
- (ii) Exhaust fans shall be erected at the places indicated by the Engineer-in-charge. For fixing an exhaust fan, a circular opening shall be provided in the wall to suit the size of the frame, which shall be fixed by means of rag bolts embedded in the wall. The hole shall be neatly plastered to the original finish of the wall. The exhaust fan shall be connected to the exhaust fan point, which shall be wired as near to the opening as possible, by means of a flexible cord, care being taken to see that the blades rotate in the proper direction.
- (iii) Exhaust fans for installation in corrosive atmosphere, shall be painted with special PVC paint or chlorinated rubber paint.
- (iv) Installation of exhaust fans in kitchens, dark rooms and such other special locations need careful consideration; any special provisions needed shall be specified.

### L.T. Distribution Boards:

Supplying and fixing regular MCB distribution boards of 12way TP&N, 12way SP&N, 6way SP&N etc., as necessary on wall / wood board / flush mounting using required clamps, bolts, nuts etc., with provision for fixing suitable type capacity MCB's single phase / 3phase / Double door with powder coated painting. Made out of 16 SWG MS enclosure.

### MCB / MCCB / RCCB:

The scope of work also includes supply and fixing of different capacity of MCBs and RCCBs as per the capacity of the MCB & RCCBs mentioned in BOQ. The item price also includes labour & cost of items required interconnection cables, screws etc. The detailed specification of MCB, RCCB, Timer and contactor is given in technical specification.

### Timer:

The scope of work includes supply and fixing of on delay Timer 24A AC/DC, 220-240AC in necessary DB similar to ABB product ID 1SVR550107R5100 or any other approved make

### Earthing:

The scope involves the cost of labour & materials including cost of GI pipe, concrete enclosure, MS cover plate with lifting handle, charcoal/coke and salt, etc. Earthing shall be in conformity to IS 3043/1987 (Latest Version) and as per approved drawing. Excavation shall be done complying with Code of Safety as per IS 3764/1992(Latest Version). Earth resistance shall not be greater than 5 ohms in normal soil and 8 ohms in rocky area. The detailed specification of earthing is given in technical specification.

**Water pump:**

The scope of work involves supply, erection, testing and commissioning of electrically operated water pump of 0.37kW / 0.5 HP capacity with head range of 3 – 42m, voltage range of 180 to 240 volts operated on single phase. The cost also includes installation of water pump complete with all associated items like clamps, screws etc. The detailed specification of water pump shall be as per technical specifications.

**UG cables:**

The scope involves supplying, laying, testing and commissioning of Jointless 1.1 KV LT UG cable XLPE or Heat resistant PVC insulated, PVC extruded Inner sheath armoured UG LT cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness in average +5% and resistivity 14 Ohms/Kms (Max) as per IS-3975 (23 GI Strips – 4x0.8mm). The cable shall be laid in existing trench/GI pipe/stone ware/RCC HUME pipe with proper dressing, crimping and termination using relevant lugs and metal glands with proper earth connection.

**Cable laying:**

- a. **Trench:** The scope involves digging of trench of suitable width with safe depth along with providing river sand bed for the cable, brick protection, using GI / HDPE pipe for Road / track crossing and refilling the trench with the dug-up soil, making good the route, installing cable route marker and carrying and dumping the excess lead away as per requirement.
- b. **Duct:** The scope involves laying of cable in existing brick / concrete duct with suitable saddle and clamp arrangement, taking good safety precautions for protecting the laid cables, providing cable identification tags at regular intervals.
- c. In case cable is to be laid underneath the track/road, the cables shall be drawn through HDPE/RCC hume pipes. Trench to accommodate pipe shall be of suitable width and excavated at 1.0 mtr. below the formation level. No sand cushioning and spreading of bricks are required. But once the pipes are laid in the trench, it should be made to its original formation level by filling it up with excavated earth by watering and ramming process and resetting the ballast of track to its original level. Similarly, when road has been dug for laying of the cable the same should be re-filled, rammed and asphalted and brought to original condition. The cable rising above ground shall be taken through GI pipe neatly clamped and open end of GI pipe has to be sealed with bitumen compound. The cable has to be laid along the route as per instruction of Engineer. The laying of cables includes uncoiling of cable from cable drum, laying of the cable in the trench free from twists, bends, peeling of insulation, dressing at terminal ends, provision of cable glands, crimping with suitable shoe, connection at both ends & earthing of armour at both ends. The scope also includes making loose coil pit for keeping extra cable near transformer centre and re-consolidation of the same.

**HDD:**

The scope involves Laying of UG Cables by Trenchless Technology by adopting Horizontal Boring & Drawing of cable including preparation at site in Normal soil 5/6" Bore with HDPE Pipe.

HDD is a trenchless method for installing a product that serves as a conduit for Electrical cable or wire line products. It is a multi-stage process consisting of site preparation and restoration,

Section:8C Explanatory Notes

equipment setup and drilling a pilot bore along a predetermined path and then pulling the cable back through the drilled space. When necessary, enlargement of the pilot bore hole may be necessary to accommodate a product larger than the pilot bore hole size. This process is referred to as back reaming and is done at the same time the cable is being pulled back through the pilot bore hole.

**LT cast iron pot head:**

Supplying and fixing LT cast iron pot-heads suitable for 1.1 KV class UG cable filled with necessary bitumen/insulating compound complete with terminals, clamps, bolts and nuts & washers etc.,

<b>Size of Cable in Sq. mm</b>	<b>6</b>	<b>10</b>	<b>16</b>	<b>25</b>	<b>35</b>	<b>50</b>	<b>70</b>	<b>95</b>	<b>120</b>	<b>150</b>	<b>185</b>	<b>225</b>	<b>240</b>
<b>No. of Cores</b>	<b>4</b>	<b>4</b>	<b>4</b>	<b>4</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>	<b>3.5</b>

**Joining Kit:**

The Heat Shrinkable Straight through joints to be supplied against this specification are required for vital installations where continuity of service is very important. The design, materials and manufacture of the Straight through joints shall, therefore, be of the highest order to ensure continuous and trouble-free service over the years.

1. The Heat Shrinkable Straight through joints offered shall be complete with all parts necessary for their effective and trouble-free operation. Such parts will be deemed to be within the scope of the supply irrespective of whether they are specifically indicated in the commercial order or not.
2. It is not the intent to specify herein complete details of design and construction of Heat Shrinkable Straight through joints. The Heat Shrinkable Straight through joints offered shall conform to the relevant standards and be of high quality, sturdy, robust and of good design and workmanship complete in all respects and capable to perform continuous and satisfactory operations in the actual service conditions at site and shall have sufficiently long life in service as per statutory requirements.
3. The Heat Shrinkable Straight through joints offered shall be reliable, fast and easy-to-install jointing system to assure and maintain high network reliability in the most severe conditions and under high electrical, thermal, mechanical and environmental stress.

The scope of work also includes making straight through cable joint and the cost of other accessories for satisfactory completion of cable joint.

**Energy Meter:**

The scope of work involves supplying and fixing of electronic energy meter on existing meter box of class -1 accuracy, 5 to 20Amps single phase energy meter or Electronic Trivector Meter (ETV) of class -1 accuracy, 5 to 32/63Amps three phase 4 wire Energy Meter as required. Energy meter to be procured from concerned BESCO's Sub Division.-

**Meter Box:**

Scope involves supplying and fixing of Outdoor type thermoplastic modular panel enclosure with transparent polycarbonate Lid, shock proof, IP 65 (weatherproof), rust proof, dust proof, water proof, corrosion proof having internally embedded gasket on both lid and and flap suitable to fix Single Phase / Three Phase Energy meter in suitable base plate and having a provision for Fuse / MCB cut out with suitable transparent hinged flap opening for operating MCB along with complete tamper proof sealing facility.

**High mast:**

The scope involves fabrication, supplying, erection, testing and commissioning of 20/16 Mtrs long 20 side polygonal high mast with single / multiple telescopic sections having thickness as per BSEN 10025 grade S 355 JO / ASTM A572-50 steel sheet plate for shaft suitable to withstand a wind velocity of 47 m/sec as per IS 875 part 3. The scope also involves making required foundation along with installing foundation bolts and base plate with concreting work. The mast shall have power tool reversible geared motor operating on 230 / 415V, 50 Hz. The mast shall have two-way head frame with die cast LM-6 pulleys, stainless steel axle, phosphorous bronze bearing bush press fitted with separate guides for 2 runs of 5mm dia, stainless steel wire rope of AISI 304 grade 7/19 core, (factor safety as per TR no-7). The high mast shall also have provision for installing lighting arrestor. The detailed specifications of High mast is discussed in Technical Specifications chapter.

**High mast luminaire:**

The scope involves supplying and installing of LED luminaires of required wattage with relative LED drivers mounted in weatherproof aluminium casing with fins for effective heat dissipation, cable gland arrangement, clear glass for effective light spread and bracket mounting provision.

**High mast control panel:**

The scope involves supply of High mast control light control panel with necessary protection and switch gear with timer provision for automatic operation and manual override. The panel shall be mounted on concrete base and shall be made of weather proof 16 SWG GI sheet with rain canopy, double door with panel lock arrangement, with rubber gasket, cable entry arrangement and proper earthing arrangement.

**Octagonal pole:**

The scope involves supplying and erection of 5 Mtrs long hot dip Galvanized Octagonal pole with BSEN 10025 grade S 355 JO steel plate for shaft, IS 2062 for base plate with door opening arrangements, including suitable boards, Bakelite sheet and MCBs as per IS specifications suitable to withstand the wind speed of 47 m/sec for 5 Mtrs pole in single section and single joint welded as per requirement with base plate and foundation bolts. The scope also includes supply and installations of hot dip galvanised MS single / double arm bracket suitable for outdoor luminaries and mounted on octagonal pole using necessary bolts & nuts etc.

**Bus bar box:**

Supplying and fixing Bus bar box on wall / wood board using required clamps, bolts, nuts etc., with provision for fixing suitable type capacity bus bar, single phase / 3phase / bolted door with powder coated painting. Made out of 16 SWG MS enclosure and cable entry – exit arrangements.

**LT panels:**

## Section:8C Explanatory Notes

The item price includes labour & cost of all material including cost of LT Switch board, erection, connections of cables, testing, and commissioning etc. as per technical specifications. LT panel shall be cubical type, floor mounted, dust & vermin proof, multi-tier construction, fabricated with 2mm thick CRCA sheet with base MS channel 100x50x7.5mm (nominal size), and powder coated. The LT switchboard shall conform to IS:8623 (latest version) and shall be suitable for operation on 3 phases, 4 wire, 415-volt, AC supply system. The switch board shall be complete with inter connections, instrument connections with copper conductor cable, copper bus bars, front operated switchgears, selector switches, ammeter, voltmeter etc. on each incoming and ammeter on each outgoing with LED type indication lights, cable glands, earthing studs etc. Each panel shall be in segregated compartment. The cost of work involves for satisfactory completion of supply and erection of above work.

### **RCC pole-9 Mtr long, 145 Kg WL:**

The scope of work involves supply, erection of 9 mtr. long 145 kg working load RCC/PSCC pole (as per drawing No.(BESCOM/GM/QS&S/02 dtd 24/11/2018) as IS-785 : The scope of work involves supply and installation of RCC/PSCC pole of 9mtr long 145 Kg working load, Installation of 11 KV Horizontal cross arm with clamps, HTST supports, bolts, nuts & washers for RCC/PSCC poles, RCC clamp, Guy set complete with 8/15 strain insulator and associated concrete work, 11kv 5KN polymeric insulator (where ever necessary), 11kv 5KN polymeric insulator (24 mm dia FRP rod), PG clamps for rabbit conductor etc., The scope of work also involves earth excavation with required size for RCC/PSCC pole foundation, base concreting with CC 1:4:8 of dimensions (500x650x150mm), Pole concreting with CC 1:2:4 of dimensions (650x500x1700), coping if necessary, with CC 1:2:4 (as per actuals) 150mm all around the pole for a height of 300mm, guy concerting with boulders, mud and sand, Installation of anticlimbing device, Caution/Danger boards etc., complete. The cost of work involves for satisfactory completion of supply and erection of above work. The specification of pole has been discussed in section-8-B under technical specification.

### **RCC Double pole structure-9 Mtr long, 145 Kg WL:**

The scope of work involves supply, erection of 9 mtr. long 145 kg working load RCC/PSCC double pole structure (as per drawing No.(BESCOM/GM/QS&S/71 rev-002 dtd 24/11/2018) as IS-785:, Installation of 11/0.433kV, 3-Phase, Aluminium wound distribution transformer, LT Distribution Box with suitable MCCBs, 11 KV GOS(as per the drawing No. BESCOM/GM/QS&S/23 dtd 24/11/2018) (wherever necessary), Horizontal cross arm with clamps, H-Frame set with or without transformer seating (MS/GI), HTST supports, bolts, nuts & washers for RCC/PSCC poles, RCC clamp, Guy set complete with 8/15 strain insulator and associated concrete work, 11kv Disc insulator (wherever necessary), PG clamps for rabbit conductor, stringing of rabbit conductor, cable raising if necessary etc., The scope also involves earth excavation for RCC/PSCC pole foundation, Base concreting with CC 1:4:8 of dimensions (650x650x150mm), Pole concreting with CC 1:2:4 of dimensions (650x650x1700), coping with CC 1:2:4 (as per actuals), guy concerting with boulders, mud and sand, Installation of anticlimbing device, Caution/Danger boards etc., complete. The cost of work involves for satisfactory completion of supply and erection of above work. The specifications of pole, transformer, GOS, LT Distribution Box etc., has been discussed in section-8-B under technical specification.

### **Chain link fencing:**

Fabrication and fixing of galvanised wire net fencing chain made of 10 SWG MS frame of 40x40x5mm angle including erection. Fabrication of galvanised wire net fencing shall be made in rectangular formation as required with MS angle iron of 40x40x5mm spaced at about 2 meters

## Section:8C Explanatory Notes

and 10 SWG GI wire mesh shall be cut according to size and welded with angle frame. MS strip not less than 15x3mm size shall be provided and welded above GI wire along the angle frame to hold GI wire mesh. Height of enclosure shall be 2 meter above ground level. The portion of MS angle to be grouted in foundation shall be 500 mm. The fencing panels shall be erected on foundation constructed of size 200mmx200mmx500mm deep with cement concrete of M-10.

The iron gate shall be fabricated with 40mmx40mmx5mm MS angle iron frame with iron grill etc. as approved. The size of the gate shall be 2 mtr (height) x3.5 mtr (height) x3.5 mtr (width) and fabricated in two parts of 1.75 mtr each. Gate shall be provided with sliding lockable bolt with pad lock. Gate shall be fixed on channels of size not less than 100\*50mm, weighing 7.9 kg per meter with bolts and nuts and welded. Channels shall be erected on foundation constructed of size 300mmx300mmx500mm deep with cement concrete of M-10 grade.

Complete enclosure including gate and angles (except galvanised portion) shall be painted with approved shade of enamel paint over two coats of red oxide primer. Prior to construction approval of drawing shall be obtained from KRIDE.

### **Power supply arrangement.**

- i. Supply, fabrication, assembling, digging suitable pit and erection of 9 mtr long, RCC DP structure suitable for 100 kVA transformer seating. The scope also includes supply and fixing of disc insulator with hardware, 2 Nos. of danger boards, 2 Nos. of anticlimbing device with suitable side rails and MS channels to mount the transformer, supply and fixing of metal oxide lightning arrestors which shall be of gapless type as per IEC60099-44 and IS3070 part (iii) of 11 kV rating for RYB phases with earth connection by suitable GI flat of sizes 25\*3 mm, supply and fixing of 200A of GOS with suitable drop out fuses, clamps, connection with ACSR conductors, supply and fixing of guy set with 15 No. strain insulators with suitable concreting materials. The scope of work includes cost of all material, loading and unloading charges, labour charges and other incidental charges. The detailed specification of poles, lightning arrestor, insulators, GOS is given under technical specification under section 8-b.
- ii. Supply, installation, testing and commissioning of 11 kV/440V, outdoor type, Delta/star connected, copper wound, DYn11, ONAN cooled, power distribution transformer conforming to IS:1180/2014 or latest (energy efficiency shall not be less than-II) complete with all accessories and first oil filling oil as required. The detailed specification of transformer is given under section-8B under technical specification. The scope of work also includes fabrication and construction of fencing enclosure, providing iron gate. The requirement of fencing and gate is as follows:
  - **Foundation:**

M-10 grade cement concrete foundation shall be constructed with 20mm coarse aggregate. The size of the foundation shall be as approved drawing based on size but shall not be less than 2\*1.5 (length\*breadth) and 600 mm above ground level duly plastered and finished surface. Curing shall be done as per code applicable. Excavation shall be done complying with code of safety as per IS 3764/1992 (latest version).
  - **Fencing**

Fabrication of enclosure for housing transformer shall be made in rectangle formation as required with MS angle iron 50\*50\*8mm spaced at 2 meters and 12 SWG GI wire mesh. GI wire shall be cut according to size and welded with the angle frame. MS strip not less than 15\*3 mm size shall be provided and welded with above GI wire along the angle frame to hold

## Section:8C Explanatory Notes

GI wire mesh. Height of enclosure shall be 2 mtr. above from ground level. The portion of MS angle to be grouted in foundation shall be 500 mm.

The fencing panels shall be erected on foundation constructed of size 200mm\*200mm\*500mm deep with cement concrete of M-10 grade.

- **Iron gate:**

Iron gate shall be fabricated with 50mm\*50mm\*8 mm MS angle iron frame with Iron grill etc. as approved. The size of the gate shall be 2m (height) \* 3.5mtr (width) and fabricated in two parts of 1.75 each. Gate shall be provided sliding lockable bolt with padlock. The gates shall be fixed on channels of size not less than 100\*50mm, weighing 7.90 kg per meter with bolts and nuts and welded. Channels shall be erected on foundation constructed of size 300mm\*300mm\*500mm deep with cement concrete of M10 grade. Complete enclosure including gate and angles (except galvanized portion) shall be painted with approved shade enamel paint over two coats red oxide primer. Installation shall be as per IS:10028 (Pt. II/1981) latest version). Drawing of enclosure with iron gate, foundation etc. shall approved by the engineer / CA.

### **Cable tray:**

The scope involves supply, installation of cable trays, of sizes as per schedule of quantities. Cable tray shall be of perforated doubled bend channel or of ladder design. Cable trays shall be fabricated from sheet steel of required thickness and shall be complete with tees, elbows, risers, and all necessary hardware, offsets can be fabricated on site. The cable tray shall be used for laying of cables for Platform Shelters, FOB and in electrical room for cable raising etc.,

### **Station Building name Board:**

The scope involves design, supply, erection, testing and commissioning of STATION name board of LED type glow sign in trilingual i.e., Kannada, Hindi and English with combination of LED driver unit, angle iron supporting structure with foundation accessories. The contractor has to make his own arrangements for transportation of men and material at site. The exact name and spelling in all languages is tentative and successful tenderer should take approval for spelling in all 3 languages and design before supply and starting the work. The detailed specification of above sign board has been discussed under technical specification chapter.

### **Liaisoning:**

Arranging required Power supply from BESCO with Submission of application for Power supply, Obtaining Power sanction, Feasibility report, preparing wiring Diagram, Completion report, Agreement papers as per the requirement of BESCO, liaisoning and Final Servicing of the Installation with Permanent power supply (Excluding Deposits & other Charges to be remitted to BESCO.)

### **System of Distribution and Wiring**

- (i) The wiring shall be done from a distribution system through main and/or branch distribution boards. The system design and location of boards will be properly worked out.
- (ii) Each main distribution board and branch distribution board shall be controlled by an incoming circuit breaker. Each outgoing circuit shall be controlled by a circuit breaker.
- (iii) Only MCCB/MCB/HRC fuse type DBs shall be used. Rewireable type fuses shall not



Section:8C Explanatory Notes

be used.

- (iv) 'Power' wiring shall be kept separate and distinct from light wiring, from the level of circuits, i.e., beyond the branch distribution boards. Conduits for light/power wiring shall be separate.
- (v) Essential/non-essential/UPS distribution each will have a completely independent and separate distribution system starting from the main, switchboard up to final wiring for each system. As for example, conduit carrying non-essential wiring shall not have essential or UPS wiring. Wiring for essential and UPS supply will have their own conduit system. No mixing of wiring is allowed.
- (vi) Generally, no switchboard will have more than one source of incoming supply. More than one incoming supply will be allowed only at main board with proper safety and interlocking so that only one source can be switched on at a time.
- (vii) Each MDB/DB/Switch Board will have reasonable spare outgoing ways for future expansion.
- (viii) Balancing of 3-phase circuit shall be done.

K-RIDE

# SECTION – 9

## **BILL OF QUANTITIES (BOQ)**

**BILL OF QUANTITIES (BOQ)**

**Tender No: KRIDE/2023-24/EL/WORK\_INDENT7**

"BYPL-HSRA Doubling: Internal Electrification of Belandur road and Huskur station buildings, provision of lighting arrangements for open and covered platforms at Belandur road station, power supply arrangement for Belandur road and Huskur stations and any other associated works"

**PREAMBLE**

1. The Price Schedule shall be read in conjunction with the Instructions to Tenderers, Conditions of Contract, Notice Inviting Tender, Technical Specifications, Tender Drawings, Schedule, Annexures and Addendums.
2. The tenderer shall quote the single Percentage/Amount over the overall price schedule Above/ At Par/ Below on Karnataka public procurement portal
  - i. The quoted Percentage/Amount are for completed and finished items of work and complete in all respects. It will be deemed to have included all constructional plant, tools, machinery, labour, supervision, materials, fuel, oil, consumables, electric power, water, transportation, all leads and lifts, dewatering, all temporary works, construction of temporary stores and buildings, fencing, watering, lighting, erection maintenance, night working, inspection facilities, safety measures at work sites for workmen and road users, charges of liaison with ESCOM / KPTCL / PGCL/TNEB, state / Central Government and local bodies, availing clearance, joint inspection, testing, commissioning and energization, all the other incidental charges payable to ESCOM / KPTCL/ PGCL/TNEB/ BBMP, GAIL, BWSSB, BDA, Electrical Inspectorate charges (State Govt.), charges for stamp duties/ agreements, inspection charges, statutory amount to remit for approval from local bodies, execution of agreement with KRIDE / Railways and SEB authorities/ DISCOM submitting Relevant documents for EIG approval as per the requirement etc., Establishment and overhead charges, labour camps, insurance costs for labour and works, contractor's profit, all taxes, royalties, duties, cess, octroi, GST other levies and other charges together with all general risks, liabilities and obligations set out or implied in the contract and including remedy of any defects during the Defect Liability Period, unless otherwise provided in Price schedule. However, statutory supervision charges of 10% payable to State Authorities/DISCOM will be paid by KRIDE.
3. Providing concrete for all works deemed to be inclusive of the cost towards production of concrete by batching plant, transit mixer, transportation of concrete with all leads and lifts, form work, shuttering including staging as required, pouring of concrete by pump/tower crane to all heights /depths, tremie or other approved means, compaction by vibrators, curing by approved means such as water, steam or curing compound and all labour, tools, plants, machinery required for execution of work complete in all respects including de-shuttering after completion of work.
4. The whole cost of complying with the provisions of the Contract shall be deemed to have been included in the quoted Percentage/Amount.
5. General directions and description of works and materials are not necessarily repeated or summarized in the Price Schedule.

Section 9: BILL OF QUANTITIES

6. The method of measurement of completed work for payment shall be in accordance with the requirements as stated in the individual sections of the Technical Specifications and Conditions of Contract.
7. Shuttering required for concrete work shall be of steel except wherever there are site constraints as decided by Engineer.
8. Tenderer may please note that to perform this contract, nothing extra shall be payable on account of field constraints, availability of front, preparation of detailed scheme for taking necessary clearance and approval from the concerned authority and other local bodies etc.
9. Contract prices shall be inclusive of all taxes and duties payable by them. Income tax and any other statutory taxes to be deducted at source, if any, will be deducted by the Employer in accordance with Income Tax Act and any other acts in force in accordance with instructions issued by authorities on this behalf, from time to time.
10. The Tenderer is required to furnish the PAN for all members of Group.
11. Replace CA audit with Statutory Auditor wherever applicable, except in qualification of experts.
12. Individual items of BoQ are uploaded on Karnataka Public Procurement Portal to quote the rates.

**Note:**

1. The Tenderer are advice to quote in percentage rate in two decimals.
2. If no percentage rate has been indicated for any particular schedule/bill in words, as well as in figures, irrespective of the fact whether the Tenderer has written or not written above/below/at par, in such cases, the rate shall be considered as Zero and the price shall be calculated accordingly (Refer: Additional Instructions to Tenderers Clause no: 24.4 (d)).
3. Unit rates and prices shall be quoted by the Tenderer in Indian Rupees.
4. Where there is a discrepancy between the rate in figures and words, the lower of the two will govern. [ITT Clause 24.1]

Section 9: BILL OF QUANTITIES

<b>Schedule A- Schedule of Rates and Quantities for Internal Electrification of Belandur Road Station Building</b>					
<b>item_code</b>	<b>description</b>	<b>uom_name</b>	<b>quantity</b>	<b>rate</b>	<b>Amount</b>
code01	Supplying heavy gauge PVC conduit pipe <b>25 mm dia 2 mm thick</b> confirming to IS 2509 with suitable size bends, metal/PVC Junction boxes, adhesive paste etc., and running before concreting the slab. The conduit should be tied to the reinforcement rods by using binding wires and unused ways of junction boxes and pipe ends should be covered using PVC end enclosures, run with 18SWG GI fish wire wherever necessary. <b>25 mm dia 2 mm thick</b>	M	830	82.60	68,558.00
code02	Supplying heavy gauge PVC conduit pipe <b>32 mm dia 2.5 mm thick</b> confirming to IS 2509 with suitable size bends, metal/PVC Junction boxes, adhesive paste etc., and running before concreting the slab. The conduit should be tied to the reinforcement rods by using binding wires and unused ways of junction boxes and pipe ends should be covered using PVC end enclosures, run with 18SWG GI fish wire wherever necessary. <b>32 mm dia 2.5 mm thick</b>	M	103	109.74	11,303.22
code03	Supplying heavy gauge PVC Conduit Pipe <b>25 mm dia 2 mm thick</b> with suitable size bends, metal junction boxes adhesive paste etc., by groove cutting in the wall and fixing by bracing U or J hooks and cement plastering upto the wall surface and run with 18 SWG GI fish wire run throughout the conduit wherever necessary. <b>25 mm dia 2 mm thick</b>	M	495	94.40	46,728.00
code04	Supplying heavy gauge PVC Conduit Pipe <b>32 mm dia 2.5 mm thick</b> with suitable size bends, metal junction boxes adhesive paste etc., by groove cutting in the wall and fixing by bracing U or J hooks and cement plastering upto the wall surface and run with 18 SWG GI fish wire run throughout the conduit wherever necessary. <b>32 mm dia 2.5 mm thick</b>	M	20	123.90	2,478.00

Section 9: BILL OF QUANTITIES

code05	<p>Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm<sup>2</sup> (Phase &amp; Neutral) &amp; 1x1.5 mm<sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet.<b>Short point upto 3m from tapping point to out let via switch box</b></p>	Point	22	296.18	6,515.96
code06	<p>Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm<sup>2</sup> (Phase &amp; Neutral) &amp; 1x1.5 mm<sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet.<b>Medium point above 3m upto 6m from tapping point to out let via switch box</b></p>	Point	42	425.98	17,891.16
code07	<p>Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm<sup>2</sup> (Phase &amp; Neutral) &amp; 1x1.5 mm<sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet.<b>Long point above 6m upto 10m from tapping point to out let via switch box</b></p>	Point	51	639.56	32,617.56

Section 9: BILL OF QUANTITIES

code08	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. <b>Two outlet in a row, above 3m upto 6m from tapping point to out let via switches</b>	Point	2	791.78	1,583.56
code09	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>1.5 mm<sup>2</sup></b>	M	731.8	30.68	22,451.62
code10	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>2.5 mm<sup>2</sup></b>	M	661.6	47.20	31,227.52
code11	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>4 mm<sup>2</sup></b>	M	807.6	69.62	56,225.11
code12	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>6 mm<sup>2</sup></b>	M	66	102.66	6,775.56

Section 9: BILL OF QUANTITIES

code13	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>10 mm2</b>	M	210	185.26	38,904.60
code14	Supplying and drawing Flexible Multicore Cable manufactured with electrolytic grade flexible copper with low conductor confirming to IS 8130-1984 and (Virgin) PVC insulation sheathed suitable for working voltage upto 1100V as per IS- 694:2010 <b>3C X 1.5 mm2</b>	M	15	81.42	1,221.30
code15	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>1-3 Way</b>	Each	10	145.14	1,451.40
code16	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>4-5 Way</b>	Each	3	162.84	488.52
code17	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>6 Way</b>	Each	22	250.16	5,503.52
code18	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>8 Way</b>	Each	5	295.00	1,475.00



Section 9: BILL OF QUANTITIES

code19	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>10-12 Way</b>	Each	23	383.50	8,820.50
code20	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>1 to 3 Module</b>	Each	10	179.36	1,793.60
code21	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>4 Module</b>	Each	3	206.50	619.50
code22	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>6 Module</b>	Each	22	287.92	6,334.24
code23	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>8 Module</b>	Each	5	356.36	1,781.80
code24	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>10-12 Module</b>	Each	23	428.34	9,851.82

Section 9: BILL OF QUANTITIES

code25	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6A One Way Switch</b>	Each	170	103.84	17,652.80
code26	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6A Two Way Switch</b>	Each	12	179.36	2,152.32
code27	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6A Three Way socket</b>	Each	51	191.16	9,749.16
code28	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>Stepped Fan Regulator Two Module</b>	Each	28	369.34	10,341.52
code29	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>16A One Way Switch</b>	Each	35	293.82	10,283.70
code30	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6/16A Universal Socket</b>	Each	35	293.82	10,283.70
code31	Supplying And fixing/replacing of 6/16/32A electrical accessories on existing switch board. <b>6A Bakelite Ceiling Rose</b>	Each	123	74.34	9,143.82
code32	Supplying And fixing/replacing of 6/16/32A electrical accessories on existing switch board. <b>6A Lamp Holder</b>	Each	2	74.34	148.68

Section 9: BILL OF QUANTITIES

code33	<p>Supplying and fixing regular MCB distribution boards on wall/wood board / flush mounting using required cIA, bolts, nuts etc., with provision for fixing suitable type capacity MCB's single phase/3 phase/single door with powder coated painting Made out of 14 SWG MS enclosure.</p> <p><b>III-Double Door 6 Way TP &amp; N</b></p>	Each	1	4,407.30	4,407.30
code34	<p>Supplying and fixing regular MCB distribution boards on wall/wood board / flush mounting using required cIA, bolts, nuts etc., with provision for fixing suitable type capacity MCB's single phase/3 phase/single door with powder coated painting Made out of 14 SWG MS enclosure.</p> <p><b>III-Double Door 12 Way TP &amp; N</b></p>	Each	2	6,777.92	13,555.84
code35	<p>Supplying &amp; fixing miniature circuit breakers on existing MCB distribution boards using necessary fixing materials and 'C' Type curve, indicator ON/OFF, energy cross-3 with Short circuit breaking capacity of 10K and complete wiring as required confirming to IEC 60898.</p> <p><b>6-32 A SP</b></p>	Each	18	617.14	11,108.52
code36	<p>Supplying &amp; fixing miniature circuit breakers on existing MCB distribution boards using necessary fixing materials and 'C' Type curve, indicator ON/OFF, energy cross-3 with Short circuit breaking capacity of 10K and complete wiring as required confirming to IEC 60898.</p> <p><b>6-32 A DP</b></p>	Each	26	1,301.54	33,840.04

Section 9: BILL OF QUANTITIES

code37	Supplying & fixing miniature circuit breakers on existing MCB distribution boards using necessary fixing materials and 'C' Type curve, indicator ON/OFF, energy cross-3 with Short circuit breaking capacity of 10K and complete wiring as required confirming to IEC 60898. <b>40 A TPN</b>	Each	3	2,823.74	8,471.22
code38	Supplying and fixing Microprocessor based Electronic timer (without contactor, Din Mounting using necessary bolts, nuts and washers etc.,) 3-120sec setting.	Each	1	2,453.22	2,453.22
code39	Supplying and fixing Microprocessor Based Astronomical timer Switch with using necessary bolts, nuts and washers.	Each	11	5,135.36	56,488.96
code40	Supplying of 4 feet -PVC Batten with integrated LED tube <b>20/22 W</b> with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI > 80. Power Input: 220-240V@ 50/60Hz & Power factor >0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. <b>LED light fitting 1 x 4' - 20/22 W</b>	Each	68	873.20	59,377.60
code41	Supplying of 1 feet -PVC Batten with integrated LED tube <b>9/10 W</b> with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI > 80. Power Input: 220-240V@ 50/60Hz & Power factor >0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. <b>LED light fitting 1 x 2' - 9/10 W</b>	Each	10	585.28	5,852.80
code42	Fixing all types and all capacities of fluorescent /false ceiling /spot light / CFL / LED fittings indoor on the wall/ ceiling /rafters / girders using 23/0.0076" twin twisted PVC insulated wires, required Nos of round blocks and cIA.	Each	78	140.42	10,952.76

Section 9: BILL OF QUANTITIES

code43	Supply and fixing of 50W, Energy saving, environment friendly and robust open type vertical high bay/medium bay lighting with high power COB LED light as source-The light fitting shall be similar to Havells Iliosbay Plus highbay	Each	4	6,689.42	26,757.68
code44	Supplying of <b>1.5 TR</b> Inverter type split Air conditioners suitable for operation on A/C supply single phase 50 Hz 230 V with hermetically sealed inverter compressor with air cooled condenser, latest R410A / R-32 refrigerant fan motor, start & run capacitors, relay & over load protector internal unit, with one indoor & one outdoor unit The condenser unit will be placed outside the room avoid noise including standard length of suitable size copper tubing covered with nitrile rubber insulation tube. suitable capacity 3 core sheathed/ PVC copper cable and a battery operated wireless remote unit. <b>5 Star 1.5 Ton capacity</b>	Each	2	77,818.64	1,55,637.28
code45	Installation charges for 1 to 2 Ton capacity window type Air Conditioner with 50 x 75mm thick teak wood frame of suitable size and allied works complete.	Each	2	2,076.80	4,153.60
code46	Supplying and installation of insulated refrigerant copper tubing of 5/8" and 3/8" with polythene foam insulation 3 core 80 stand copper wiring between indoor and outdoor unit Leak testing oil and gas charging for additional piping length of tube.	M	5	1,924.58	9,622.90
code47	Extra for Fabrication supply and fixing of Stand fabricated using slotted angle /L angle of size 6mm x 50mm for mounting out door/indoor A.C. unit/ Batteries.	Each	3	5,399.68	16,199.04

Section 9: BILL OF QUANTITIES

code48	Supplying of Ceiling Fan with Capacitor rating As per guideline of BEE 5 star rating and IS:374/79 and also comply with IS: 1709/1984 with latest amendment, Rated voltage 220 V/50 Hz, Rated power input 48 W +/- 10 %, Rated current As per IS:374/79, Rated power factor 0.9 lagging(min), Rated speed 350 +/- 10% RPM, Rated air delivery 210 +/- 10% Cubic Meter Minimum, Rated service value 4.2 CMM / W, Three Blades of blade leaf 1.05 mm thick Aluminium Alloy sheet, Class B motor insulation, Bearing Two ball bearings, Top 6202, Bottom 6201, as per IS specification, Motor winding. Temp rise Shall not exceed 75 deg C over and ambient of 40 0C by resistance method at 245 V, Insulation resistance Shall not be less than Two Mega Ohms (2M Ohms), Leakage current Should not exceed 210 Micro Amp, Power input, W& current, Air Delivery & Fan Speed as per IS:374/1979 with latest amendment, 2 year manufacturer Warranty. <b>48" Sweep 5 Star (1200 mm)</b>	Each	28	3,479.82	97,434.96
code49	Supplying of wall mounting fan suitable to operate at singlephase 230v AC. supply. <b>300mm Sweep</b>	Each	4	3,124.64	12,498.56
code50	Fixing a ceiling / Wall mounting fan of all capacities and all types to the existing 'S' hook with fan regulator to the existing board together with supplying and fixing 5 A. ceiling rose, necessary length of 23 / 0.0076 inch PVC insulated twin twisted copper wire and wiring.	Each	32	191.16	6,117.12
code51	Supplying of 1440rpm heavy duty exhaust fan with bracket blades suitable to operate on 230V 50Hz, AC Supply complete. <b>12" Sweep (300 mm)</b>	Each	2	3,536.46	7,072.92

Section 9: BILL OF QUANTITIES

code52	Supply, erection, testing, commissioning of exhaust fan suitable for 1- phase, 230 Volts, AC supply system complete with capacitor, louver shutters, grouting bolts with nuts, making opening/ modification in the wall to suit the size of the fan, making good the damages, connections with 1.5sq. mm FR, PVC insulated, multi stranded copper conductor, single core/ three cable as instructed, earthing etc. as required. <b>AC exhaust fan 150 mm with louver shutters.</b>	Each	6	2,172.64	13,035.86
code53	Fixing one exhaust fan in the nitch already left in the wall with bolts and nuts and 5 A. ceiling rose with sufficient length of 23/0.0076 inch PVC insulated twin core wire.	Each	2	509.76	1,019.52
code54	Supplying And Fixing Metal Fan Box with Round Hook.	No	32	192.34	6,154.88
code55	Supplying, erecting, testing & commissioning of ON-LINE UPS system suitable for operation on 230V, 50Hz, A/C supply, with isolation transformer all accessories complete and Excluding batteries and wiring complete. <b>3 kVA ON LINE UPS</b>	Each	1	56,608.14	56,608.14
code56	Supplying, installation, testing & commissioning of 12V DC, AH batteries in poly propylene container for U.P.S. Sealed maintenance free batteries. <b>42 AH capacity</b>	Each	6	8,527.86	51,167.16
code57	<b>Grounding Pipe</b> GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	4	770.00	3,080.00
code58	<b>Grounding Pipe</b> Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	4	660.00	2,640.00

Section 9: BILL OF QUANTITIES

code59	<b>Grounding Material</b> Pipe Grounding Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	4	303.00	1,212.00
code60	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	4	682.04	2,728.16
code61	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	4	3,823.20	15,292.80
code62	Supply, erection, testing and commissioning of self contained drinking water cooler 150 liters capacity complete with all connected standard fittings, accessories etc. and 5 kVA, wall mounted, I.C. controlled electronic auto-voltage corrector with time delay relay, supply and erection of earth electrode and connection to earthing system etc. as required.	No	2	72,947.98	1,45,895.96
code63	Supply, installation, testing & commissioning of weather proof, LT. feeder pillar of different capacities <b>LT feeder pillar 125 Amp comprising of the items indicated under as</b> i) incoming MCCB 125A, 4 pole, 35kA (Ics=100%Icu) - 1 No ii) Outgoing MCCB 63A, 4 pole, 25kA (Ics=100%Icu) - 4 Nos iii) Outgoing MCB 40A, 4 pole, 10kA - 4 Nos iv) Outgoing MCB 32A, DP, 10kA, 4Nos v) Outgoing MCB Single pole 32A, 10kA-4Nos vi) Modular digital time switch and 3 phase contactor 63 A - 2 Set vii) Sleeved/Epoxy coated copper busbar 250A in bus bar Chamber viii) Indication lights	Each	1	1,02,707.16	1,02,707.16



Section 9: BILL OF QUANTITIES

code64	Supply, installation, testing & commissioning of weather proof, LT. feeder pillar of different capacities <b>LT feeder pillar 63Amp comprising of the items indicated as under</b> (i) incoming MCCB 63A, 4 pole, 35kA, fixed type (Ics=100%Icu) - 1 Noii) Outgoing MCCB 40A, 4 pole, 25kA, fixed type (Ics=100%Icu) - 4 Nosiii) Outgoing MCB double pole, 40A,10kA-2Nosiv) Outgoing MCB Single pole, of 40 A, 10kA- 4Nos v) Sleeved/Epoxy coated copper bus-bar 200 A in bus bar Chambervi) Indication lights	Each	1	93,632.09	93,632.09
code65	Supply and laying 25mm x6mm G.I. strip at not less than 0.50 meter below ground or in recess as required.	M	150	79.68	11,951.85

**Schedule B- Schedule of Rates and Quantities for provision of Platform Lights at Belandur Road Station Building**

item_code	description	uom_name	quantity	rate	Amount
code01	Fabricating, supplying and erection of 5M ms long hot dip Galvanized Octagonal hot dip Pole with BSEN 10025 grade S 355 JO steel plate for shaft, IS 2062 for base plate with door opening arrangements, including suitable boards, Bakelite sheet and MCBs as per IS specifications suitable to withstand the wind speed of 47 m/s for 5M Pole in single section and single joint welded as per IS 9595/IS10178AWS having dimensions bottom 130 mm , top 70 mm with 3 mm thick, suitable base plate and 4Nos of ..... long J bolts along with template and the Pole shall be hot dip galvanized in single dipping with not less than 65micron as per ASTM-A123 and 153 etc., (excluding foundation) as per drawing appended. 5 m - Top 70 mm and Bottom 130 mm dia	Each	50	10,467.78	5,23,389.00

Section 9: BILL OF QUANTITIES

code02	Supplying, and fixing of Hot dip Galvanized M.S.Bracket suitable for out door luminaries and mounted on Octagonal pole using necessary bolts, nuts etc., complete.Single Arm Bracket with 1000 mm Standard 40/50 mm dia	Each	50	1,821.92	91,096.00
code03	KSRB 4-1.3: Providing and Laying in position plain cement concrete of mix 1:4:8 with OPC Cement @ 180 Kgs, with 40 mm and down size graded granite metal coarse aggregates @ 0.85 CMT and fine aggregates @ 0.57 CMT machine mixed, machine mixed, concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	17.5	6,329.52	1,10,766.60
code04	KSRB 4-1.6: Providing and Laying in position plain cement concrete of mix 1:2:4 with Cement @ 240 Kgs, with 20 mm and down size graded granite metal coarse aggregates @ 0.878 CMT and fine aggregates @ 0.459 CMT machine mixed concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth and cills, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	0.9	7,193.28	6,473.95
code05	KSRB 4.9.1: Providing mild steel reinforcement for RCC work including straightening, cutting, bending, hooking, placing in position, lapping and/or welding wherever required, and Laying with binding wire and anchoring to the adjoining members wherever necessary complete as per design (laps, hooks and wastage shall not be measured and paid)cost of materials labour, HOM of machinery complete as per specifications. SPECIFICATION No. KBS 4.6.3	Quintal	7.765	7,635.78	59,291.83

Section 9: BILL OF QUANTITIES

code06	Supplying of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Sheath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975 16 Sqmm, 4 Core, (11 GI Strips - 4 x 0.8 mm)	km	1.3	1,83,442.00	2,38,474.60
code07	UG Cable WorkEarth work excavation for cable trench of 0.5 to 0.75 Mtr. Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed.In Ordinary Soil	cum	465	306.80	1,42,662.00
code08	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	441.75	68.44	30,233.37
code09	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff. LT Cable 2.5 to 25 Sqmm	km	1.3	19,067.62	24,787.91
code10	Optical Fibre Cable (OFC) and its Accessories Supply and laying of HDPE/PLB Pipe 50/42 mm	km	1.3	82,906.00	1,07,777.80

Section 9: BILL OF QUANTITIES

code11	<p>Supplying, laying and jointing HDPE pipes of specified grade and conforming to IS 4984-2016 with latest ammendments and conveying to work site including loading and unloading at both destinations and rolling and lowering into trenches, laying true to line and jointing of pipes and specials with electrofusion welding, giving hydraulic test as per relevant ISS with all lead and lifts including encasing the pipe alround to a depth of not less than 15 cms. with soft gravel or selected earth available from the excation, testing and commissioning. The rate is exclusive of required specials and fittings wherever necessary like saddle Tee, stub ends, flanged sets, bedns, reducers etc. complete (Contractor will make his own arrangements for procuring water for testing) etc. Note: Upto 110mm dia Coil shall be used. For Grade PE80 PN6.0 :</p> <p>HDPE Grade PE80-PN6.0, 63mm dia</p>	M	90	168.74	15,186.60
code12	<p>Supplying, laying and jointing HDPE pipes of specified grade and conforming to IS 4984-2016 with latest ammendments and conveying to work site including loading and unloading at both destinations and rolling and lowering into trenches, laying true to line and jointing of pipes and specials with electrofusion welding, giving hydraulic test as per relevant ISS with all lead and lifts including encasing the pipe alround to a depth of not less than 15 cms. with soft gravel or selected earth available from the excation, testing and commissioning. The rate is exclusive of required specials and fittings wherever necessary like saddle Tee, stub ends, flanged sets, bedns, reducers etc. complete (Contractor will make his own arrangements for procuring water for testing) etc. Note: Upto 110mm dia Coil shall be used. For Grade PE80 PN6.0 :</p> <p>:HDPE Grade PE80-PN6.0,110mm dia</p>	M	60	410.64	24,638.40

Section 9: BILL OF QUANTITIES

code13	<p>Supply of LED Streetlight luminaire with pressure die cast aluminium housing body for optimal thermal dissipation. Lamp compartment comprising of anti glare clear diffuser with Injection moulded polycarbonate material, delivering superior light output Rated life Burning Hrs 50000 hr @ Lumen Maintenance of 70%, maximum light intensity should be between 60 degrees to 70 degrees. CCT &gt; 5500K, IP66 optical and electrical compartment &amp; impact resistance of complete luminaire &gt; IK08. Power Factor &gt;0.9 with mains, Surge Protection- Min 5KV along with Over voltage/Overload, short circuit/ miss-wiring protection. Compatible for pole mounting with outer dia of 40mm to 50mm. Universal Voltage driver to operate wide voltage range from 100V to 270V 50/60Hz application. Compliance to IS 10322/IEC 60598, LM 79 &amp; LM 80 Adherence with RoHS. UL approved MCPCB. Top access street light with single screw to ensure ease of maintenance at the sight site location with minimized minimal tools. LED Light fixture with 40 W System Power consumption. LED Efficiency&gt;130lm/w, nominal CRI &gt;75. Luminaire manufacturer should have in-house facility accredited by NABL/CPRI &amp; any Government certified agency &amp; Design &amp; Development facility certified by ISO 9001:2008. Housing with supplier word mark /name shall be Engraved / Embossing on the die cast housing/ Body part. Warranty of 2 Years against any manufacturing defect working under standard electrical conditions as mentioned.LED Streetlight 40W</p>	Each	50	4,308.18	2,15,409.00
code14	<p>Fixing halogen/metal halide /SVL/IL/LED floodlight fitting over existing pole / wall ceiling including c/a, bolts, nuts and wiring using suitable capacity wires.</p>	Each	50	223.02	11,151.00

Section 9: BILL OF QUANTITIES

code15	Grounding Material Pipe Grounding GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	8	770.00	6,160.00
code16	Grounding Material Pipe Grounding Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	8	660.00	5,280.00
code17	Grounding Material Pipe Grounding Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	8	303.00	2,424.00
code18	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	8	3,823.20	30,585.60
code19	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	8	682.04	5,456.32
code20	Supply of Aluminium End Terminal (Lug) 16 Sqmm	No	400	3.00	1,200.00
code21	Supply of PVC Pipe as per IS-2509 PVC Pipe - 32 mm Dia	M	100	100.00	10,000.00
code22	Supplying and drawing Flexible Multicore Cable manufactured with electrolytic grade flexible copper with low conductor confirming to IS 8130-1984 and (Virgin) PVC insulation sheathed suitable for working voltage upto 1100V as per IS-694:2010 3C x 2.5 mm <sup>2</sup>	M	325	128.62	41,801.50

<b>Schedule C- Schedule of Rates and Quantities for provision of Covered Platform Lights at Belandur Road Station Building</b>					
<b>item_code</b>	<b>description</b>	<b>uom_name</b>	<b>quantity</b>	<b>rate</b>	<b>Amount</b>
code01	Supplying of 4 feet -PVC Batten with integrated LED tube 20/22 W with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI greater than 80. Power Input: 220-240V@ 50/60Hz & Power factor greater than 0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. LED light fitting 1 x 4' - 20/22 W	Each	176	873.20	1,53,683.20
code02	Fixing all types and all capacities of fluorescent /false ceiling /spot light / CFL / LED fittings indoor on the wall/ ceiling /rafters / girders using 23/0.0076 twin twisted PVC insulated wires, required Nos of round blocks and clA. On wall/ ceiling / Rafter / Girders	Each	176	140.42	24,713.92

Section 9: BILL OF QUANTITIES

code03	<p>Supplying of Ceiling Fan with Capacitor rating As per guideline of BEE 5 star rating and IS:374/79 and also comply with IS: 1709/1984 with latest amendment, Rated voltage 220 V/50 Hz, Rated power input 48 W +/- 10 %, Rated current As per IS:374/79, Rated power factor 0.9 lagging(min), Rated speed 350 +/- 10% RPM, Rated air delivery 210 +/- 10% Cubic Meter Minimum, Rated service value 4.2 CMM / W, Three Blades of blade leaf 1.05 mm thick Aluminium Alloy sheet, Class B motor insulation, Bearing Two ball bearings, Top 6202, Bottom 6201, as per IS specification, Motor winding. Temp rise Shall not exceed 75 deg C over and ambient of 40 0C by resistance method at 245 V, Insulation resistance Shall not be less than Two Mega Ohms (2M Ohms), Leakage current Should not exceed 210 Micro Amp, Power input, W&amp; current, Air Delivery &amp; Fan Speed as per IS:374/1979 with latest amendment, 2 year manufacturer Warranty.</p> <p>48" Sweep 5 Star (1200 mm)</p>	Each	32	3,479.82	1,11,354.24
code04	<p>Fixing a ceiling / Wall mounting fan of all capacities and all types to the existing 'S' hook with fan regulator to the existing board together with supplying and fixing 5 A. ceiling rose, necessary length of 23 / 0.0076 inch PVC insulated twin twisted copper wire and wiring</p>	Each	32	191.16	6,117.12
code05	<p>Supplying heavy gauge PVC conduit pipe 25 mm dia 2 mm thick confirming to IS 2509 with suitable size bends, junction boxes, adhesive paste etc , and fixing using inverted wood plugs in case of RCC ceiling and RCC wall/ stone structure or rawl plugs in case of brick walls and cement plastering the damaged portion using heavy gauge saddles at an interval of 700mm using NF screws.</p> <p>25 mm dia 2 mm thick</p>	Mtr	400	94.40	37,760.00



Section 9: BILL OF QUANTITIES

code06	Supplying PVC/GI flexible conduit pipe 25 mm dia fixing on surface over inverted tapered wooden plugs or phill plugs or rawl plugs and clamped using heavy gauge saddles at an interval of 300 mm using NF screws and on either end of the pipe terminated completely 25 mm	Mtr	200	36.58	7,316.00
code07	Supplying and drawing Flexible Multicore Cable manufactured with electrolytic grade flexible copper with low conductor confirming to IS 8130-1984 and (Virgin) PVC insulation sheathed suitable for working voltage upto 1100V as per IS- 694:2010. 3C X 1.5 mm <sup>2</sup>	Mtr	936	81.42	76,209.12
code08	Supplying And Fixing M.S. Rafter Clamp Set made out of M.S. Flat & 14 mm M.S. rod.	No	32	187.62	6,003.84
code09	Supplying and fixing surface/flush mounting unbreakable PVC modular box suitable for mounting modular switch plates with due groove cutting in Brick/C.C wall, including necessary rawl plugs, Machine/NF screws etc., complete. 6 Way	Each	88	175.82	15,472.16
code10	Supplying and fixing surface/flush mounting unbreakable PVC modular box suitable for mounting modular switch plates with due groove cutting in Brick/C.C wall, including necessary rawl plugs, Machine/NF screws etc., complete. 1-3 Way	Each	32	107.38	3,436.16
code11	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. 1 to 3 Module	Each	32	179.36	5,739.52

Section 9: BILL OF QUANTITIES

code12	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. 6 Module	Each	88	287.92	25,336.96
code13	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. 1.5 mm <sup>2</sup>	Mtr	416	30.68	12,762.88
code14	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. 2.5 mm <sup>2</sup>	Mtr	1664	47.20	78,540.80
code15	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. 6A Three Way socket	Each	208	191.16	39,761.28
code16	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. 6A One Way Switch	Each	208	103.84	21,598.72
code17	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Seath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-397516 Sqmm, 4 Core, (11 GI Strips - 4 x 0.8 mm)	KM	1.342	1,83,442.00	2,46,179.16
code18	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff. LT Cable 2.5 to 25 Sqmm	KM	1.342	19,067.62	25,588.75

Section 9: BILL OF QUANTITIES

code19	PVC Pipe as per IS-2509 Supply and laying of PVC Pipe - 100 mm Dia	Mtr	80	256.00	20,480.00
code20	Supplying And fixing/replacing of 6/16/32A electrical accessories on existing switch board. 6A Three Pin Top	No	208	61.36	12,762.88
code21	Hot Dipped Galvanized Iron Cable Tray Supplying and installing following size of perforated Hot Dipped Galvanised Iron cable tray (Galvanisation thickness not less than 50 microns) with perforation not more than 17.5%, in convenient sections, joined with connectors, suspended from the ceiling with G.I. suspenders including G.I. bolts & nuts, etc. as required. 100 mm width X 50 mm depth X 1.6 mm thickness	Mtr	400	789.42	3,15,768.00
code22	Supply and Installation / Fixing / Provision of Pole box with HRC Fuse / MCB provision and suitable connector / terminal for 3 Ph/ 1 Ph connections with Loop-In & Loop- Out terminals for 10 mm <sup>2</sup> /25 mm <sup>2</sup> 3.5 C Al/Ar/Cu/Ar Cable and branch out 2.5 mm <sup>2</sup> 2 core Al/Cu PVC Insulated cable, enclosed in a Thermoplastic, Polystyrene enclosure, which should be shock proof, safe, IP65(Weather Proof), rust proof, dust proof, water proof having Internally Embedded Gasket with provision for cable entry through IP65 Thermoplastic, polyamide glands and/or grommets. 260 mm x 210 mm x 116 mm	No	8	2,617.24	20,937.92

**Schedule D- Schedule of Rates and Quantities for provision of Approach Road Lighting at Belandur Road Station Building**

item_code	description	uom_name	quantity	rate	Amount
-----------	-------------	----------	----------	------	--------

Section 9: BILL OF QUANTITIES

code01	Fabricating, supplying and erection of 5M ms long hot dip Galvanized Octagonal hot dip Pole with BSEN 10025 grade S 355 JO steel plate for shaft, IS 2062 for base plate with door opening arrangements, including suitable boards, Bakelite sheet and MCBs as per IS specifications suitable to withstand the wind speed of 47 m/s for 5m Pole in single section and single joint welded as per IS 9595/IS10178AWS having dimensions bottom 130 mm, top 70 mm with 3 mm thick, suitable base plate and 4Nos of long J bolts along with template and the Pole shall be hot dip galvanized in single dipping with not less than 65micron as per ASTM-A123 and 153 etc., (excluding foundation) as per drawing appended. 5 m - Top 70 mm and Bottom 130 mm dia	Each	18	10,467.78	1,88,420.04
code02	Supplying, and fixing of Hot dip Galvanized M.S.Bracket suitable for out door luminaries and mounted on Octagonal pole using necessary bolts, nuts etc., complete. Single Arm Bracket with 1000 mm Standard 40/50 mm dia	Each	18	1,821.92	32,794.56
code03	KSRB 4-1.3: Providing and Laying in position plain cement concrete of mix 1:4:8 with OPC Cement @ 180 Kgs, with 40 mm and down size graded granite metal coarse aggregates @ 0.85 CMT and fine aggregates @ 0.57 CMT machine mixed, machine mixed, concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	6.3	6,329.52	39,875.98

Section 9: BILL OF QUANTITIES

code04	KSRB 4-1.6: Providing and Laying in position plain cement concrete of mix 1:2:4 with Cement @ 240 Kgs, with 20 mm and down size graded granite metal coarse aggregates @ 0.878 CMT and fine aggregates @ 0.459 CMT machine mixed concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth and cills, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	0.324	7,193.28	2,330.62
code05	KSRB 4.9.1: Providing mild steel reinforcement for RCC work including straightening, cutting, bending, hooking, placing in position, lapping and/or welding wherever required, and Laying with binding wire and anchoring to the adjoining members wherever necessary complete as per design (laps, hooks and wastage shall not be measured and paid) cost of materials labour, HOM of machinery complete as per specifications. SPECIFICATION No. KBS 4.6.3	Quintal	2.7954	7,635.78	21,345.06
code06	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Sheath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975 16 Sqmm, 4 Core, (11 GI Strips - 4 x 0.8 mm)	km	0.5	1,83,442.00	91,721.00
code07	UG Cable Work Earth work excavation for cable trench of 0.5 to 0.75 Mtr. Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed. In Ordinary Soil	cum	192.9	306.80	59,181.72

Section 9: BILL OF QUANTITIES

code08	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	183.255	68.44	12,541.97
code09	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff.LT Cable 2.5 to 25 Sqmm	km	0.5	19,067.62	9,533.81
code10	Optical Fibre Cable (OFC) and its Accessories Supply and laying of HDPE/PLB Pipe 40/33 mm	km	0.5	60,790.00	30,395.00

Section 9: BILL OF QUANTITIES

code11	<p>Supply of LED Streetlight luminaire with pressure die cast aluminium housing body for optimal thermal dissipation. Lamp compartment comprising of anti glare clear diffuser with Injection moulded polycarbonate material, delivering superior light output Rated life Burning Hrs 50000 hr @ Lumen Maintenance of 70%, maximum light intensity should be between 60 degrees to 70 degrees. CCT greater than 5500K, IP66 optical and electrical compartment &amp; impact resistance of complete luminaire greater than IK08. Power Factor greater than 0.9 with mains, Surge Protection- Min 5KV along with Over voltage/Overload, short circuit/ miss-wiring protection. Compatible for pole mounting with outer dia of 40mm to 50mm. Universal Voltage driver to operate wide voltage range from 100V to 270V 50/60Hz application. Compliance to IS 10322/IEC 60598, LM 79 &amp; LM 80 Adherence with RoHS. UL approved MCPCB. Top access street light with single screw to ensure ease of maintenance at the sight site location with minimized minimal tools. LED Light fixture with 40 W System Power consumption. LED Efficiency greater than 130lm/w, nominal CRI greater than 75. Luminaire manufacturer should have in-house facility accredited by NABL/CPRI &amp; any Government certified agency &amp; Design &amp; Development facility certified by ISO 9001:2008. Housing with supplier word mark /name shall be Engraved / Embossing on the die cast housing/ Body part. Warranty of 2 Years against any manufacturing defect working under standard electrical conditions as mentioned.</p> <p>LED Streetlight 40W</p>	Each	16	4,308.18	68,930.88
--------	--	------	----	----------	-----------

Section 9: BILL OF QUANTITIES

code12	<p>Supply of LED Streetlight luminaire with pressure die cast aluminium housing body for optimal thermal dissipation. Lamp compartment comprising of anti glare clear diffuser with Injection moulded polycarbonate material, delivering superior light output Rated life Burning Hrs 50000 hr @ Lumen Maintenance of 70%, maximum light intensity should be between 60 degrees to 70 degrees. CCT greater than 5500K, IP66 optical and electrical compartment &amp; impact resistance of complete luminaire greater than IK08. Power Factor greater than 0.9 with mains, Surge Protection- Min 5KV along with Over voltage/Overload, short circuit/ miss-wiring protection. Compatible for pole mounting with outer dia of 40mm to 50mm. Universal Voltage driver to operate wide voltage range from 100V to 270V 50/60Hz application. Compliance to IS 10322/IEC 60598, LM 79 &amp; LM 80 Adherence with RoHS. UL approved MCPCB. Top access street light with single screw to ensure ease of maintenance at the sight site location with minimized minimal tools. LED Light fixture with 40 W System Power consumption. LED Efficiency greater than 130lm/w, nominal CRI greater than 75. Luminaire manufacturer should have in-house facility accredited by NABL/CPRI &amp; any Government certified agency &amp; Design &amp; Development facility certified by ISO 9001:2008. Housing with supplier word mark /name shall be Engraved / Embossing on the die cast housing/ Body part. Warranty of 2 Years against any manufacturing defect working under standard electrical conditions as mentioned.LED Streetlight 70W</p>	Each	2	7,074.10	14,148.20
code13	<p>Fixing halogen/metal halide /SVL/IL/LED floodlight fitting over existing pole / wall ceiling including c/a, bolts, nuts and wiring using suitable capacity wires.</p>	Each	18	223.02	4,014.36



Section 9: BILL OF QUANTITIES

code14	Grounding Material Pipe Grounding GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	3	770.00	2,310.00
code15	Grounding Material Pipe Grounding Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	3	660.00	1,980.00
code16	Grounding Material Pipe Grounding Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	3	303.00	909.00
code17	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover.	Each	3	3,823.20	11,469.60
code18	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	3	682.04	2,046.12
code19	Supply of Aluminium End Terminal (Lug) 16 Sqmm	No	144	3.00	432.00
code20	Supply of PVC Pipe as per IS-2509 PVC Pipe - 32 mm Dia	m	36	100.00	3,600.00
code21	Supplying and drawing Flexible Multicore Cable manufactured with electrolytic grade flexible copper with low conductor confirming to IS 8130-1984 and (Virgin) PVC insulation sheathed suitable for working voltage upto 1100V as per IS-694:2010 3C x 2.5 mm <sup>2</sup>	m	117	128.62	15,048.54

<b>Schedule E- Schedule of Rates and Quantities for provision of Subway Lighting Arrangement at Belandur Road Station Building</b>					
<b>item_code</b>	<b>description</b>	<b>uom_name</b>	<b>quantity</b>	<b>rate</b>	<b>Amount</b>
code01	Supplying of 4 feet -PVC Batten with integrated LED tube 36/40 W with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI greater than 80. Power Input: 220-240V@ 50/60Hz & Power factor greater than 0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. LED light fitting 1 x 4' - 36/40 W	Each	15	1,412.46	21,186.90
code02	Fixing all types and all capacities of fluorescent /false ceiling /spot light / CFL / LED fittings indoor on the wall/ ceiling /rafters / girders using 23/0.0076 inch twin twisted PVC insulated wires, required Nos of round blocks and clA. On wall/ ceiling / Rafter / Girders	Each	15	140.42	2,106.30
code03	Open Conduit System Supplying heavy gauge PVC conduit pipe 25 mm dia 2 mm thick confirming to IS 2509 with suitable size bends, junction boxes, adhesive paste etc , and fixing using inverted wood plugs in case of RCC ceiling and RCC wall/ stone structure or rawl plugs in case of brick walls and cement plastering the damaged portion using heavy gauge saddles at an interval of 700mm using NF screws. 25 mm dia 2 mm thick	m	120	94.40	11,328.00
code04	Supplying PVC/GI flexible conduit pipe 25 mm dia fixing on surface over inverted tapered wooden plugs or phill plugs or rawl plugs and clamped using heavy gauge saddles at an interval of 300 mm using NF screws and on either end of the pipe terminated completely 25 mm	m	30	36.58	1,097.40

Section 9: BILL OF QUANTITIES

code05	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Medium point above 3m upto 6m from tapping point to out let via switch box	Point	2	425.98	851.96
code06	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Long point above 6m upto 10m from tapping point to out let via switch box	Point	9	639.56	5,756.04
code07	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Two outlet in a row, above 3m upto 6m from tapping point to out let via switches	Point	2	791.78	1,583.56

Section 9: BILL OF QUANTITIES

code08	Supply and Installation / Fixing / Provision of Pole box with HRC Fuse / MCB provision and suitable connector / terminal for 3 Ph/ 1 Ph connections with Loop-In & Loop- Out terminals for 10 mm <sup>2</sup> /25 mm <sup>2</sup> 3.5 C Al/Ar/Cu/Ar Cable and branch out 2.5 mm <sup>2</sup> 2 core Al/Cu PVC Insulated cable, enclosed in a Thermoplastic, Polystyrene enclosure, which should be shock proof, safe, IP65(Weather Proof), rust proof, dust proof, water proof having Internally Embedded Gasket with provision for cable entry through IP65 Thermoplastic, polyamide glands and/or grommets.200 mm x 200 mm x 98 mm	Each	1	2,442.60	2,442.60
code09	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Seath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975 16 Sqmm, 4 Core, (11 GI Strips - 4 x 0.8 mm)	km	0.1	1,83,442.00	18,344.20
code10	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff. LT Cable 2.5 to 25 Sqmm	km	0.1	19,067.62	1,906.76
code11	GI Pipe B - Class as per IS-1239 Supply of GI Pipe - 50 mm Dia	km	6	383.00	2,298.00
code12	Laying the GI Pipe 80 mm to 150 mm dia at Drainage Water Supply Crossing including fixing collars elbows, bends, Tees and other fitting with Cuts and Threads wherever necessary complete.	m	6	68.44	410.64

Section 9: BILL OF QUANTITIES

code13	<p>Supply, installation, testing &amp; commissioning of Occupancy Sensor Switch:-Surface Mount with movement detector with built-in switch. It will switch off the lights in a room or area when it is vacated and thus save upto 30% of electrical energy The Occuswitch Surface Mount can switch any load upto 6A, Device mounting heights between 2.5 and 3.5 meter, for movement detection covering an area of 4 to 5 square meters (desk work) and 6 to 8 meters for larger movements like walking (at 25 deg Cel ambient). Functions- Automatic control of lights/electrical load switch ON/OFF automatically when any movement is detected, with adjustable time settings for Switch ON/OFF( 30 seconds to 30 minutes ). Red LED indicator on detection of movement. Smart timer- The smart timer will extend the delay time by the set delay time if movement is detected shortly after switch off, assuming that the area is still in use, but very little movement is made. Power Supply- Voltage 230 V +/-1 0%,. 50/60Hz AC Supply,.. Maximum load 6 A. (1440 VA) any load, .. Maximum wire range 0.75 to 1.5mm2, .. Mains distribution system TN-S with Neutral grounded.</p>	Each	3	3,563.60	10,690.80
--------	---	------	---	----------	-----------

**Schedule F- Schedule of Rates and Quantities for provision of Lift at Belandur Road Station Building**

item_code	description	uom_name	quantity	rate	Amount
-----------	-------------	----------	----------	------	--------

Section 9: BILL OF QUANTITIES

code01	<p>Design, supplying, erection, testing and commissioning of - passenger/ Bed-cum-passenger hospital lift with speed of 1mtr per second, variable voltage variable frequency drive, with or without machine room for the available well size, operating at 415 V 3 phase 50 cycles AC supply, powder coated / Stainless Steel car entrance doors enclosures with suitable colour vinyl flooring, LED car illumination, emergency light, intercom and fan as desired by the user, central opening / side opening door with or without attendant operation, 7 segment display buttons, call register indicator, fireman drive, SS handrails inside car, full length infrared curtain in car door, automatic rescue device with batteries, voice announcing in regional / international languages, Braille buttons with one year warranty and maintenance with necessary scaffolding and minor civil works like fixing of guide rail, counter weight etc.,                  With Out Machine Room-SS Finish                  13 Passengers                  2 Stops</p>	Job	1	18,77,557.00	18,77,557.00
code02	<p>supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Seath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975                  50 Sqmm, 4 Core, (17 GI Strips - 4 x 0.8 mm)</p>	KM	0.05	2,96,715.00	14,835.75
code03	<p>Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff.                  LT Cable                  35 to 95 Sqmm</p>	KM	0.05	27,903.46	1,395.17

Section 9: BILL OF QUANTITIES

code04	Open Conduit System Supplying heavy gauge PVC conduit pipe 25 mm dia 2 mm thick confirming to IS 2509 with suitable size bends, junction boxes, adhesive paste etc , and fixing using inverted wood plugs in case of RCC ceiling and RCC wall/ stone structure or rawl plugs in case of brick walls and cement plastering the damaged portion using heavy gauge saddles at an interval of 700mm using NF screws.25 mm dia 2 mm thick	M	50	94.40	4,720.00
code05	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Medium point above 3m upto 6m from tapping point to out let via switch box	Point	3	425.98	1,277.94
code06	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Long point above 6m upto 10m from tapping point to out let via switch box	Point	3	639.56	1,918.68

Section 9: BILL OF QUANTITIES

code07	Supplying & fixing of retrofit type - LED bulb 15W with OPAL acrylic diffuser comprising of LED source with CCT 6500 degree K, CRI> 70%. efficacy >80 lumen per W, life> 25000 burning hours and Compliance to IS 10322/IEC 60598, LM 79 & LM 80. The LED are driven by HF electronic driver integrated in the system, with PF > 0.95, power loss should < 5% of lamp Wage., short circuit & open circuit protection to be integrated in the circuit, THD less than 20%, Life as per LM 79. The operating input voltage should be between 130 to 275 V. BIS Approved and Tested by NABL/CPRI accredited laboratory with 2 years Warranty against any manufacturing defect working under standard electrical condition.15W, 6500K	Each	2	397.66	795.32
code08	Supplying and fixing of round or oblong type bulk head fitting glass cover	No	2	80.24	160.48
code09	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. 6/16A Universal Socket	Each	2	293.82	587.64
code10	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. 32A DP Switch	Each	2	442.50	885.00
code11	Supplying and fixing surface/flush mounting unbreakable PVC modular box suitable for mounting modular switch plates with due groove cutting in Brick/C.C wall, including necessary rawl plugs, Machine/NF screws etc., complete. 4-5 Way	Each	2	143.96	287.92
code12	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. 4 Module	Each	2	206.50	413.00



Section 9: BILL OF QUANTITIES

code13	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments.1.5 mm <sup>2</sup>	M	50	30.68	1,534.00
code14	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. 2.5 mm <sup>2</sup>	M	50	47.20	2,360.00
code15	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. 4 mm <sup>2</sup>	M	50	69.62	3,481.00
code16	Grounding Material Pipe Grounding GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	2	770.00	1,540.00
code17	Grounding Material Pipe Grounding Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	2	660.00	1,320.00
code18	Grounding Material Pipe Grounding Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	2	303.00	606.00

Section 9: BILL OF QUANTITIES

code19	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	2	3,823.20	7,646.40
code20	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	2	682.04	1,364.08

**Schedule G- Schedule of Rates and Quantities for Power Supply Arrangement at Belandur Road Station Building**

item_code	description	uom_name	quantity	rate	Amount
code01	Line Supports (Pole) Supply of Pre-Stressed Tubular Spun Pole - 11 Mtr Long, 500 Kg WL (Dwg No. BESCOM/GM/QS&S/45 Dtd 24.11.2018) as per IS-13158: 1991	No	2	18,140.00	36,280.00
code02	Supply of Three H Frame without Transformer Seating and Seating angle support cross arm for 11 Mtr Spun Pole for 63/100/250/500 kVA (UG Cable) - MS (Dwg No. BESCOM/GM/QS&S/69 Dtd 24.11.2018)	Set	2	22,098.00	44,196.00
code03	Supply of HT ST Support 50x8 mm Flat - MS (Dwg No. BESCOM/GM/QS&S/04 Dtd 24.11.2018)	No	2	96.00	192.00
code04	HG Fuse Unit as per IS-5350 Part-2 157 20.01 Supply of 11 kV, HG Fuse Unit with Solid Core Insulator (Dwg No. BESCOM/GM/QS&S/21 Dtd 24.11.2018)	Set of 3 Nos	2	1,032.00	2,064.00
code05	Lightning Arrester as per IEC-60099-4 Supply of 9 kV, 5 kA Lightning Arrester Metal Oxide Ceramic type with GROUND DISCONNECTOR (Dwg No. BESCOM/GM/QS&S/26 Dtd 24.10.2007)	Set of 3 Nos	2	975.00	1,950.00

Section 9: BILL OF QUANTITIES

code06	GOS as per IS-9921, IS-1977 Supply of 11 kV, 200 Amps Single Break GOS (Dwg No. BESCO/M/GM/QS&S/23 Dtd 24.11.2018)	Set	4	9,125.00	36,500.00
code07	GOS as per IS-9921, IS-1977 Supply of H - Frame Set for fixing 11 kV, 200 Amps Single Break GOS - (For DP structure for providing New GOS for sectionalisation) - MS	Set	4	4,543.00	18,172.00
code08	Insulator as per IS-1445 for Ceremic, IS- 7935 for GI Pin, IEC-61109 for Polymeric Supply of 11 kV, 5 kN Composite/Polymeric Pin Insulator (24 mm dia FRP Rod)	No	12	221.00	2,652.00
code09	Insulator as per IS-1445 for Ceremic, IS- 7935 for GI Pin, IEC-61109 for Polymeric Supply of DISC Insulator 45 kN Porcelain	No	6	470.00	2,820.00
code10	ACSR Conductor as per IS-398 (Part - 2/1996) Supply of Rabbit ACSR (6/3.35 mm Al + 1/3.35 mm St), Std Wt: 214 Kg/KM	KM	0.3	61,515.00	18,454.50
code11	Supply of 11 kV, 3 Core, XPLE HTUG Cable with pressure extruded inner sheeth, ROUND WIRE ARMOURED as per IS-7098 (Part-2) Armouring wires dia and Resistivity as per IS-3975 95 Sqmm, (54 GI Wires - 2.5 mm Dia)	KM	0.8	11,15,615.00	8,92,492.00
code12	Supply of 11 kV, Jointing & Cable Termination Kit as per IS-13573 Heat Shrinkable Straight Through Jointing Kit for XLPE Cable with Copper Lug & Al Ferrule 3x95 Sqmm	Set	2	7,129.00	14,258.00
code13	Supply of 11 kV, Jointing & Cable Termination Kit as per IS-13573 Supply of Heat Shrinkable Outdoor Type Cable Termination Kit for XLPE Cable 3x95 Sqmm	Set	4	3,966.00	15,864.00

Section 9: BILL OF QUANTITIES

code14	Distribution Transformer - 3 Phase, 11kV/433V - Stacked CRGO Core with Oil as per IS-1180 (Part-1): 2014 A. OPEN BUSHING TYPE Supply of 100 kVA, Aluminium Wdg, Star 2 (5 Star)	No	1	2,14,306.00	2,14,306.00
code15	Single Pole Mounted Transformer (SPMT) Kit for erection of Transformer on 11 Mtr Spun Pole as per IS-1977 Prefabricated Platform for erection of 250 kVA Transformer on 11 Mtr Spun Pole Structure involving Rectangular hollow Sections 96x48x4.87 Thk and 66x3x4.5 Thk, Circular hollow section of 165.6 OD x 10 Thk, MS Stiffner plate 12 mm Thk, MS plate Base Plate 16 mm Thk, J Blots 12 mm dia, Gusset Plates, Clamps, 15 mm rods 2.5 Mtr length as per drawing details. Tor Steel Rods cut of Dia 8 mm, 10 mm, 12 mm, 16 mm and 20 mm bent as per drawing & tied inclusive of labour for Reinforced foundation (Dwg No. BESCOM/GM/QS&S/70 Dtd 24.11.2018)	Set	1	55,699.00	55,699.00
code16	Supply of 1.1 KV Class HR (Heat Resistant) PVC Insulated & UnSheathed Aluminium Wires Multistrand Single Core Lead wires as per IS-694: 2010 PVC Wire - 95 Sqmm Al Wt: 25 Kg, Total Wt: 36 Kg/100 Mtr Coil	Coil	1	14,080.00	14,080.00
code17	Supply of LT Distribution Box as per IS-13947 Part-1&2 LT Distribution Box for 100 kVA DTC with MCCB's (Sheet Metal) (Dwg No. BESCOM/GM/QS&S/58 Dtd 24.11.2018)	No	1	22,809.00	22,809.00
code18	Measuring Equipment Supply of LT 3 Phase, 4 Wire, CT Operated DLMS Complaint ETV Meter-5A, class 0.5s Accuracy (Used for 25 HP/18KW & Above Installations, DTC Metering).	No	1	3,312.00	3,312.00
code19	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Sheath Armoured LTUG Cable as per IS-1554 (Part- 1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975. 95 Sqmm, 3.5 Core, (21 GI Strips - 4 x 0.8 mm)	KM	0.3	5,14,040.00	1,54,212.00

Section 9: BILL OF QUANTITIES

code20	Supply of Epoxy Terminating Kit (Pothead) suitable for 1.1 kV, LTUG Cable 3.5 x 70/95/120 Sqmm	Set	4	373.00	1,492.00
code21	GI Pipe B - Class as per IS-1239 Supply of GI Pipe - 150 mm Dia	Mtr	6	1,529.00	9,174.00
code22	Grounding Material Pipe Grounding Supply of GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	7	770.00	5,390.00
code23	Grounding Material Pipe Grounding Supply of Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	7	660.00	4,620.00
code24	Grounding Material Pipe Grounding Supply of Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	7	303.00	2,121.00
code25	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	7	3,823.20	26,762.40
code26	Alkathine tube Supply of Transparent Alkathine tube 19 mm dia, 2 mm thick in coils of 30 Mtr	Coil	2	504.00	1,008.00
code27	PVC Pipe as per IS-2509 Supply of PVC Pipe - 75 mm Dia	Mtr	5	160.00	800.00
code28	Supply of Caution/Danger Board.	No	3	146.00	438.00

Section 9: BILL OF QUANTITIES

code29	Erection of 11 Mtr long Concrete Spun Pole in a pit of 2.5 Mtr depth (Mechnised Labour)	No	2	2,239.64	4,479.28
code30	Digging of Pit 2.5 Mtr depth for erection of 11 Mtr long Tubular Spun Pole as per approved Drawing. Ordinary Soil	Per Pit	2	1,698.02	3,396.04
code31	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) A) Base Concreting with CC 1:4: 8 Pole base for 11 Mtr Spun Pole (1000x1000x150mm)	Each	2	991.20	1,982.40
code32	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) B) Pole Concreting with CC 1:2:4 (without coping) 11 Mtr Spun Pole (1000x1000x2500mm)	Each	2	16,524.72	33,049.44
code33	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) C) Providing Coping for Pole with CC 1:2:4 (As per actuals) 390 mm all around the Pole for an height of 300 mm for Spun Pole	Each	2	2,619.60	5,239.20
code34	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	7	682.04	4,774.28
code35	Fixing of HT/LT Single Top Support	Each	2	95.58	191.16
code36	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing DOLO Cutout/Horn Gap Fuse including fixing of cross arm and wiring	Each	2	210.04	420.08

Section 9: BILL OF QUANTITIES

code37	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing of GOS including wiring (11 kV Single Break 200 Amps)	Set	4	949.90	3,799.60
code38	Erection of H-Frame.	No	4	285.56	1,142.24
code39	Fixing of 3 Nos Lightning Arrestor including wiring	Set of 3 Nos	2	106.20	212.40
code40	Erection of Transformer & Structures Erection of 100 kVA Transformer	Each	1	1,358.18	1,358.18
code41	UG Cable WorkEarth work excavation for cable trench of 0.5 to 0.75 Mtr Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed. In Ordinary soil	cum	550	306.80	1,68,740.00
code42	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	522.5	68.44	35,759.90
code43	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff HT Cable 3x95 to 150 Sqmm	KM	0.8	53,435.12	42,748.10
code44	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff LT Cable 35 to 95 Sqmm	KM	0.3	27,903.46	8,371.04

Section 9: BILL OF QUANTITIES

code45	Making and Fixing pot head for HT Cable only type Heat shrinkable 3x95 to 3x150 Sqmm	No	4	2,318.70	9,274.80
code46	Cable Joint and wiring (for HT Cable only) Heat shrinkable Straight Through Joint 3x95 to 3x150 Sqmm	No	2	2,531.10	5,062.20
code47	Stringing of conductor Squirrel, Weasel, binding of conductor on each insulator and dead ending on strain or disc/strain insulator by means of clamps. do - for Rabbit ACSR per KM/Wire	km	0.3	3,892.82	1,167.85
code48	Providing chain link fencing 50 mm size of 8 guage properly stretched between rectangular Poles and fixed with suitable bolts & nuts, the free ends shall be welded to the Pole and block pipe at top and bottom as required including cost of all materials, labour, lead and lifts, cutting, bending wherever necessary,wastage and lapping etc., complete as per the direction of the engineer incharge for work including two coats of approved quality paint over one coat of primer paint.	Sqm	32	1,164.66	37,269.12
code49	Wiring of 1 Circuit of LT Wiring for for 25/63/100 kVA DTC to the existing LT protection Kit/Distribution Box via metering box. (includes fixing of necessary supports like 2 Pin cross arm, Spacer etc)	Set	1	848.42	848.42

**Schedule H- Schedule of Rates and Quantities for Provision of Pump**

item_code	description	uom_name	quantity	rate	Amout
-----------	-------------	----------	----------	------	-------



Section 9: BILL OF QUANTITIES

code01	Supplying and drawing 3 core flat PVC sheathed submersible pump cable manufactured with electrolytic grade copper with flexible copper with low resistance conductor confirming to IS-8130-1984 and virgin grade PVC insulation and powder coating extruded PVC sheathed suitable for working voltage upto 1100 V as per IS-694:2010. 3C x 4 mm <sup>2</sup>	Mtr	600	197.06	1,18,236.00
code02	Supply, installation, testing and commissioning of submersible pump set suitable to operate on 3 phase, 415V, 50 Hz AC supply along with control panel etc. complete for supplying water at suitable discharge and head as per site requirement. 5 HP pump set	Job	2	84,670.98	1,69,341.96
code03	1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Sheath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975 16 Sqmm, 4 Core, (11 GI Strips - 4 x 0.8 mm)	KM	0.2	1,83,442.00	36,688.40
code04	UG Cable WorkEarth work excavation for cable trench of 0.5 to 0.75 Mtr. Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed. In Ordinary Soil	cum	75	306.80	23,010.00
code05	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	71.25	68.44	4,876.35

Section 9: BILL OF QUANTITIES

code06	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff. LT 2.5 to 25 Sqmm	Cable	KM	0.18	19,067.62	3,432.17
--------	--	-------	----	------	-----------	----------

**Schedule I- Schedule of Rates and Quantities for Provision of Diesel Generator at Belandur Road Station Building**

item_code	description	uom_name	quantity	rate	Amount	
code01	DIESEL GENERATOR SET Supplying, installing, testing and commissioning of Diesel Generator set with following specifications. Power rating as per standard reference condition as per-BS 5514/ISO 3046/ ISO 8528 & IS 1002/ISO 3046 Generator set specifications. 62.5 kVA/50kW Please refer item No. 10.1 of chapter-10 DIESEL GENERATOR SETS of Schedule of rates for Electrical works for 2021-22, PWD part-I Electrical items	Set	1	7,29,930.30	7,29,930.30	
code02	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Seath Armoured LTUG Cable as per IS-1554 (Part- 1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975.95 Sqmm, 3.5 Core, (21 GI Strips - 4 x 0.8 mm)	KM	0.04	5,14,040.00	20,561.60	
code03	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff. LT 35 to 95 Sqmm	Cable	KM	0.04	27,903.46	1,116.14

Section 9: BILL OF QUANTITIES

code04	UG Cable Work Earth work excavation for cable trench of 0.5 to 0.75 Mtr Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed. In Ordinary soil	cum	20	306.80	6,136.00
code05	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	20	68.44	1,368.80
code06	Providing and constructing load bearing wall with Solid Concrete blocks of size 400x200x200mm having block density more than 1800kg/m <sup>3</sup> and minimum compressive strength of 4.00 N/mm <sup>2</sup> conforming to IS 2185 (Part - I) - 2005 and constructed with CM 1:4 as per IS 2572:2005 including cost of all materials, labour, scaffolding and curing, usage charges of machinery etc complete as per specifications.	cum	3.8	1,418.36	5,389.77
code07	Providing 15 mm cement plaster on the rough side of single or half brick wall of mix 1:4 (1 cement: 4 fine sand) including rounding off corners wherever required smooth rendering, providing and removing scaffolding, including cost of materials, labour, curing complete as per specifications and as per directions of Engineer-in-charge.	sqm	7.14	298.54	2,131.58

Section 9: BILL OF QUANTITIES

code08	KSRB 4-1.3: Providing and Laying in position plain cement concrete of mix 1:4:8 with OPC Cement @ 180 Kgs, with 40 mm and down size graded granite metal coarse aggregates @ 0.85 CMT and fine aggregates @ 0.57 CMT machine mixed, machine mixed, concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	0.6125	6,329.52	3,876.83
code09	KSRB 4-1.6: Providing and Laying in position plain cement concrete of mix 1:2:4 with Cement @ 240 Kgs, with 20 mm and down size graded granite metal coarse aggregates @ 0.878 CMT and fine aggregates @ 0.459 CMT machine mixed concrete laid in layers not exceeding 15 cm. thick well compacted, in foundation and plinth and cills, including cost of all materials, labour, HOM of machinery, curing complete as per specifications. SPECIFICATION No. KBS 4.1, 4.2	cum	1.628	7,193.28	11,710.66
code10	KSRB 4.9.1: Providing mild steel reinforcement for RCC work including straightening, cutting, bending, hooking, placing in position, lapping and/or welding wherever required, and Laying with binding wire and anchoring to the adjoining members wherever necessary complete as per design (laps, hooks and wastage shall not be measured and paid)cost of materials labour, HOM of machinery complete as per specifications. SPECIFICATION No. KBS 4.6.3	Quintal	1.3024	7,635.78	9,944.84
code11	Grounding MaterialPipe GroundingGI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	4	770.00	3,080.00

Section 9: BILL OF QUANTITIES

code12	Grounding Pipe Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	Material Grounding	No	4	660.00	2,640.00
code13	Grounding Pipe Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Material Grounding	Bag	4	303.00	1,212.00
code14	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..		Each	4	3,823.20	15,292.80
code15	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil		Per Pit	4	682.04	2,728.16
code16	Providing chain link fencing 50 mm size of 8 guage properly stretched between rectangular Poles and fixed with suitable bolts & nuts, the free ends shall be welded to the Pole and block pipe at top and bottom as required including cost of all materials, labour, lead and lifts, cutting, bending wherever necessary,wastage and lapping etc., complete as per the direction of the engineer incharge for work including two coats of approved quality paint over one coat of primer paint.		Sqm	32	1,164.66	37,269.12

**Schedule J- Schedule of Rates and Quantities for Internal Electrification of Huskur Station Building**

item_code	description	uom_name	quantity	rate	Amount
-----------	-------------	----------	----------	------	--------

Section 9: BILL OF QUANTITIES

code01	Supplying heavy gauge PVC conduit pipe 25 mm dia 2 mm thick confirming to IS 2509 with suitable size bends, metal/PVC Junction boxes, adhesive paste etc., and running before concreting the slab. The conduit should be tied to the reinforcement rods by using binding wires and unused ways of junction boxes and pipe ends should be covered using PVC end enclosures, run with 18SWG GI fish wire wherever necessary. 25 mm dia 2 mm thick	M	569.96	82.60	47,078.70
code02	Supplying heavy gauge PVC conduit pipe 32 mm dia 2.5 mm thick confirming to IS 2509 with suitable size bends, metal/PVC Junction boxes, adhesive paste etc., and running before concreting the slab. The conduit should be tied to the reinforcement rods by using binding wires and unused ways of junction boxes and pipe ends should be covered using PVC end enclosures, run with 18SWG GI fish wire wherever necessary. 32 mm dia 2.5 mm thick	M	73	109.74	8,011.02
code03	Supplying heavy gauge PVC Conduit Pipe 25 mm dia 2 mm thick with suitable size bends, metal junction boxes adhesive paste etc., by groove cutting in the wall and fixing by bracing U or J hooks and cement plastering upto the wall surface and run with 18 SWG GI fish wire run throughout the conduit wherever necessary. 25 mm dia 2 mm thick	M	337.5	94.40	31,860.00
code04	Supplying heavy gauge PVC Conduit Pipe 32 mm dia 2.5 mm thick with suitable size bends, metal junction boxes adhesive paste etc., by groove cutting in the wall and fixing by bracing U or J hooks and cement plastering upto the wall surface and run with 18 SWG GI fish wire run throughout the conduit wherever necessary. 32 mm dia 2.5 mm thick	M	19.5	123.90	2,416.05

Section 9: BILL OF QUANTITIES

code05	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Short point upto 3m from tapping point to out let via switch box	Point	9	296.18	2,665.62
code06	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Medium point above 3m upto 6m from tapping point to out let via switch box	Point	24	425.98	10,223.52
code07	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet. Long point above 6m upto 10m from tapping point to out let via switch box	Point	33	639.56	21,105.48

Section 9: BILL OF QUANTITIES

code08	Supplying and wiring adopting loop system in existing PVC Conduit /casing capping using 2x1.5mm <sup>2</sup> (Phase & Neutral) & 1x1.5 mm <sup>2</sup> (Earth wire) FRLS multi strand PVC insulated copper wire (confirming to IS-694: and latest amendments) without control switch shall be fixed on the existing plastic sheet/ gang box, the other end of the wires shall be terminated with sufficient loose length in a wood/PVC round block. complete for each outlet.Two outlet in a row, above 3m upto 6m from tapping point toout let via switches	Point	4	791.78	3,167.12
code09	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>1.5 mm<sup>2</sup></b>	M	534.36	30.68	16,394.16
code10	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>2.5 mm<sup>2</sup></b>	M	378.72	47.20	17,875.58
code11	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>4 mm<sup>2</sup></b>	M	721.6	69.62	50,237.79
code12	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>6 mm<sup>2</sup></b>	M	66	102.66	6,775.56



Section 9: BILL OF QUANTITIES

code13	Wiring for lighting/power circuit using one of FRLS PVC insulated 1100V grade, multistrand copper wire with low conductor resistance single core in open or concealed system of wiring with specified IS-694:confirming to latest amendments. <b>10 mm<sup>2</sup></b>	M	120	185.26	22,231.20
code14	Supplying and drawing Flexible Multicore Cable manufactured with electrolytic grade flexible copper with low conductor confirming to IS 8130-1984 and (Virgin) PVC insulation sheathed suitable for working voltage upto 1100V as per IS- 694:2010 <b>3C X 1.5 mm<sup>2</sup></b>	M	15	81.42	1,221.30
code15	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>1-3 Way</b>	Each	6	145.14	870.84
code16	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>6 Way</b>	Each	19	250.16	4,753.04
code17	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>8 Way</b>	Each	3	295.00	885.00
code18	Supplying and flush mounting powder coated / galvanized metal box suitable for mounting modular switch plates. The box should be firmly flush mounted after due groove cutting in Brick/Stone/C.C wall <b>10-12 Way</b>	Each	21	383.50	8,053.50

Section 9: BILL OF QUANTITIES

code19	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>1 to 3 Module</b>	Each	6	179.36	1,076.16
code20	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>6 Module</b>	Each	19	287.92	5,470.48
code21	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>8 Module</b>	Each	3	356.36	1,069.08
code22	Supplying and fixing superior quality modular switch mounting polycarbonate plate with necessary supporting back plate with required nos. of machine screws, bolts nuts etc., complete on the existing metal/PVC box. <b>10-12 Module</b>	Each	21	428.34	8,995.14
code23	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6A One Way Switch</b>	Each	116	103.84	12,045.44
code24	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6A Three Way socket</b>	Each	44	191.16	8,411.04
code25	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>Stepped Fan Regulator Two Module</b>	Each	26	369.34	9,602.84

Section 9: BILL OF QUANTITIES

code26	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>16A One Way Switch</b>	Each	33	293.82	9,696.06
code27	Supplying and fixing of modular switch & connected accessories on existing modular switch plate as per IS 3854 and IS 1293. <b>6/16A Universal Socket</b>	Each	33	293.82	9,696.06
code28	Supplying And fixing/replacing of 6/16/32A electrical accessories on existing switch board. <b>6A Bakelite Ceiling Rose</b>	No	84	74.34	6,244.56
code29	Supplying And fixing/replacing of 6/16/32A electrical accessories on existing switch board. <b>6A Lamp Holder</b>	No	2	74.34	148.68
code30	Supplying and fixing regular MCB distribution boards on wall/wood board / flush mounting using required cIA, bolts, nuts etc., with provision for fixing suitable type capacity MCB's single phase/3 phase/single door with powder coated painting Made out of 14 SWG MS enclosure. III-Double Door <b>6 Way TP &amp; N</b>	Each	1	4,407.30	4,407.30
code31	Supplying and fixing regular MCB distribution boards on wall/wood board / flush mounting using required cIA, bolts, nuts etc., with provision for fixing suitable type capacity MCB's single phase/3 phase/single door with powder coated painting Made out of 14 SWG MS enclosure. III-Double Door <b>12 Way TP &amp; N</b>	Each	2	6,777.92	13,555.84

Section 9: BILL OF QUANTITIES

code32	Supplying & fixing miniature circuit breakers on existing MCB distribution boards using necessary fixing materials and 'C' Type curve, indicator ON/OFF, energy cross-3 with Short circuit breaking capacity of 10K and complete wiring as required confirming to IEC 60898. 6-32 A DP	Each	22	1,301.54	28,633.88
code33	Supplying & fixing miniature circuit breakers on existing MCB distribution boards using necessary fixing materials and 'C' Type curve, indicator ON/OFF, energy cross-3 with Short circuit breaking capacity of 10K and complete wiring as required confirming to IEC 60898.40 A TPN	Each	3	2,823.74	8,471.22
code34	Supplying and fixing Microprocessor based Electronic timer (without contactor, Din Mounting using necessary bolts, nuts and washers etc..) 3-120sec setting.	Each	1	2,453.22	2,453.22
code35	Supplying of 4 feet -PVC Batten with integrated LED tube 20/22 W with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI greater than 80. Power Input: 220-240V@ 50/60Hz & Power factor greater than 0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. LED light fitting 1 x 4' - 20/22 W	Each	45	873.20	39,294.00
code36	Supplying of 1 feet -PVC Batten with integrated LED tube 9/10 W with high quality diffuser with Life of 25000 burning hours & 70% lumen maintenance with CRI greater than 80. Power Input: 220-240V@ 50/60Hz & Power factor greater than 0.9 along with CE approved. 2 years Warranty against any manufacturing defect working under standard electrical condition. LED light fitting 1 x 2' - 9/10 W	Each	5	585.28	2,926.40

Section 9: BILL OF QUANTITIES

code37	Fixing all types and all capacities of fluorescent /false ceiling /spot light / CFL / LED fittings indoor on the wall/ ceiling /rafters / girders using 23/0.0076" twin twisted PVC insulated wires, required Nos of round blocks and clA. On wall/ ceiling / Rafter / Girders	Each	50	140.42	7,021.00
code38	Supplying of 1.5 TR Inverter type split Air conditioners suitable for operation on A/C supply single phase 50 Hz 230 V with hermetically sealed inverter compressor with air cooled condenser, latest R410A / R-32 refrigerant fan motor, start & run capacitors, relay & over load protector internal unit, with one indoor & one outdoor unit The condenser unit will be placed outside the room avoid noise including standard length of suitable size copper tubing covered with nitrile rubber insulation tube. suitable capacity 3 core sheathed/ PVC copper cable and a battery operated wireless remote unit.5 Star1.5 Ton capacity	Each	2	77,818.64	1,55,637.28
code39	Installation charges for 1 to 2 Ton capacity window type Air Conditioner with 50 x 75mm thick teak wood frame of suitable size and allied works complete.	Each	2	2,076.80	4,153.60
code40	Supplying and installation of insulated refrigerant copper tubing of 5/8" and 3/8" with polythene foam insulation 3 core 80 stand copper wiring between indoor and outdoor unit Leak testing oil and gas charging for additional piping length of tube.	M	5	1,924.58	9,622.90
code41	Extra for Fabrication supply and fixing of Stand fabricated using slotted angle /L angle of size 6mm x 50mm for mounting out door/indoor A.C. unit/ Batteries.	Each	3	5,399.68	16,199.04

Section 9: BILL OF QUANTITIES

code42	Supplying of Ceiling Fan with Capacitor rating As per guideline of BEE 5 star rating and IS:374/79 and also comply with IS: 1709/1984 with latest amendment, Rated voltage 220 V/50 Hz, Rated power input 48 W +/- 10 %, Rated current As per IS:374/79, Rated power factor 0.9 lagging(min), Rated speed 350 +/- 10% RPM, Rated air delivery 210 +/- 10% Cubic Meter Minimum, Rated service value 4.2 CMM / W, Three Blades of blade leaf 1.05 mm thick Aluminium Alloy sheet, Class B motor insulation, Bearing Two ball bearings, Top 6202, Bottom 6201, as per IS specification, Motor winding. Temp rise Shall not exceed 75 deg C over and ambient of 40 0C by resistance method at 245 V, Insulation resistance Shall not be less than Two Mega Ohms (2M Ohms), Leakage current Should not exceed 210 Micro Amp, Power input, W& current, Air Delivery & Fan Speed as per IS:374/1979 with latest amendment, 2 year manufacturer Warranty.48" Sweep 5 Star (1200 mm)	Each	26	3,479.82	90,475.32
code43	Supplying of wall mounting fan suitable to operate at singlephase 230v AC. supply. <b>300mm Sweep</b>	Each	4	3,124.64	12,498.56
code44	Fixing a ceiling / Wall mounting fan of all capacities and all types to the existing 'S' hook with fan regulator to the existing board together with supplying and fixing 5 A. ceiling rose, necessary length of 23 / 0.0076 inch PVC insulated twin twisted copper wire and wiring	Each	30	191.16	5,734.80
code45	Supplying of 1440rpm heavy duty exhaust fan with bracket blades suitable to operate on 230V 50Hz, AC Supply complete. <b>12" Sweep (300 mm)</b>	Each	2	3,536.46	7,072.92

Section 9: BILL OF QUANTITIES

code46	Supply, erection, testing, commissioning of exhaust fan suitable for 1- phase, 230 Volts, AC supply system complete with capacitor, louver shutters, grouting bolts with nuts, making opening/ modification in the wall to suit the size of the fan, making good the damages, connections with 1.5sq. mm FR, PVC insulated, multi stranded copper conductor, single core/ three cable as instructed, earthing etc. as required.AC exhaust fan 150 mm with louver shutters.	Each	3	2,172.64	6,517.93
code47	Fixing one exhaust fan in the nitch already left in the wall with bolts and nuts and 5 A. ceiling rose with sufficient length of 23/0.0076 inch PVC insulated twin core wire.	Each	2	509.76	1,019.52
code48	Supplying And Fixing Metal Fan Box with Round Hook.	No	26	192.34	5,000.84
code49	Supplying, erecting, testing & commissioning of ON-LINE UPS system suitable for operation on 230V, 50Hz, A/C supply, with isolation transformer all accessories complete and Excluding batteries and wiring complete. <b>3 kVA ON LINE UPS</b>	Each	1	56,608.14	56,608.14
code50	Supplying, installation, testing & commissioning of 12V DC, AH batteries in poly propylene container for U.P.S. Sealed maintenance free batteries. <b>42 AH capacity</b>	Each	6	8,527.86	51,167.16
code51	<b>Grounding Material</b> <b>Pipe Grounding</b> GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	4	770.00	3,080.00
code52	<b>Grounding Material</b> <b>Pipe Grounding</b> Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	4	660.00	2,640.00

Section 9: BILL OF QUANTITIES

code53	<b>Grounding Material</b> Pipe Grounding Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	4	303.00	1,212.00
code54	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	4	3,823.20	15,292.80
code55	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	4	682.04	2,728.16
code56	Supply, installation, testing & commissioning of weather proof, LT. feeder pillar of different capacities LT feeder pillar 125 Amp comprising of the items indicated as under i) incoming MCCB 125A, 4 pole, 35kA (Ics=100%Icu) - 1 No ii) Outgoing MCCB 63A, 4 pole, 25kA (Ics=100%Icu) - 4 Nos iii) Outgoing MCB 40A, 4 pole, 10kA - 4 Nos iv) Outgoing MCB 32A, DP, 10kA, 4Nos v) Outgoing MCB Single pole 32A, 10kA-4Nos vi) Modular digital time switch and 3 phase contactor 63 A - 2 Set vii) Sleeved/Epoxy coated copper busbar 250A in bus bar Chamber viii) Indication lights	Each	1	1,02,707.16	1,02,707.16



Section 9: BILL OF QUANTITIES

code57	Supply, installation, testing & commissioning of weather proof, LT. feeder pillar of different capacitiesLT feeder pillar 63Amp comprising of the items indicated as under(i) incoming MCCB 63A, 4 pole, 35kA, fixed type (Ics=100%Icu) - 1 No(ii) Outgoing MCCB 40A, 4 pole, 25kA, fixed type (Ics=100%Icu) - 4 Nos(iii) Outgoing MCB double pole, 40A,10kA-2Nos(iv) Outgoing MCB Single pole, of 40 A, 10kA- 4Nos (v) Sleeved/Epoxy coated copper bus-bar 200 A in bus bar Chamber(vi) Indication lights	Each	1	93,632.09	93,632.09
code58	Supply and laying 25mm x6mm G.I. strip at not less than 0.50 meter below ground or in recess as required.	M	100	79.68	7,967.90

**Schedule K- Schedule of Rates and Quantities for Power Supply Arrangement at Huskur Station Building**

item_code	description	uom_name	quantity	rate	Amount
code01	Line Supports (Pole) Supply of PSCC Pole - 9 Mtr Long, 300 Kg WL (Dwg No. BESCOM/GM/QS&S/55 Dtd 24.11.2018) as per REC Standards	No	2	5,050.00	10,100.00
code02	Insulator as per IS-1445 for Ceremic, IS- 7935 for GI Pin, IEC-61109 for Polymeric Supply of DISC Insulator 45 kN Porcelain	No	3	470.00	1,410.00
code03	Insulator as per IS-1445 for Ceremic, IS- 7935 for GI Pin, IEC-61109 for Polymeric Supply of 11 kV, 5 kN Composite/Polymeric Pin Insulator (24 mm dia FRP Rod)	No	3	221.00	663.00

Section 9: BILL OF QUANTITIES

code04	Lightning Arrester as per IEC-60099-4 Supply of 9 kV, 5 kA Lightning Arrester Metal Oxide Ceramic type with GROUND DISCONNECTOR (Dwg No. BESCOM/GM/QS&S/26 Dtd 24.10.2007)	Set of 3 Nos	1	975.00	975.00
code05	HG Fuse Unit as per IS-5350 Part-2 Supply of 11 kV, HG Fuse Unit with Solid Core Insulator (Dwg No. BESCOM/GM/QS&S/21 Dtd 24.11.2018)	Set of 3 Nos	1	1,032.00	1,032.00
code06	Supply of Double Pole TC Set for erection of Transformer on RCC/PSCC 9 Mtr Long Poles as per IS-1977 For 25/63/100 kVA 4/5 Star Rated Transformer on PSCC Pole - 9 Mtr Long, 300 Kg WL - MS (Dwg No. BESCOM/GM/QS&S/62 Dtd 24.11.2018)	Set	1	18,418.00	18,418.00
code07	GOS as per IS-9921, IS-1977 Supply of 11 kV, 200 Amps Single Break GOS (Dwg No. BESCOM/GM/QS&S/23 Dtd 24.11.2018)	Set	4	9,125.00	36,500.00
code08	Supply of H - Frame Set for fixing 11 kV, 200 Amps Single Break GOS - (For DP structure for providing New GOS for sectionalisation) - MS	Set	4	4,543.00	18,172.00
code09	Clamps A Type (MS & GI) as per IS-1977 Supply of Guy Clamp - MS (Dwg No. BESCOM/GM/QS&S/07 Dtd 24.11.2018)	No	2	92.00	184.00
code10	Clamps A Type (MS & GI) as per IS-1977 Supply of Anchor Rod using 12 mm rounds/Guy Rod - MS (Dwg No. BESCOM/GM/QS&S/07 Dtd 24.11.2018)	No	2	265.00	530.00
code11	Guy Wire & GI Wire as per IS-2141 Supply of 7/10 SWG Guy Wire (7/3.251 mm Dia), Std Wt: 680 Kg/KM	MT	0.02	80,119.00	1,602.38
code12	Supply of Insulator as per IS-1445 for Ceramic, IS- 7935 for GI Pin, IEC-61109 for Polymeric No. 15 Strain Insulator	No	2	55.00	110.00

Section 9: BILL OF QUANTITIES

code13	Supply of Distribution Transformer - 3 Phase, 11kV/433V - Stacked CRGO Core with Oil as per IS-1180 (Part-1): 2014 63 kVA, Aluminum Wdg, Star 2 (5 Star)	No	1	1,76,257.00	1,76,257.00
code14	LT Protection Supply of LT Protection Kit (Dwg No. BESCO/GM/QS&S/10 Dtd 24.11.2018)	No	1	1,915.00	1,915.00
code15	LT Distribution Box as per IS-13947 Part-1&2 Supply of LT Distribution Box for 100 kVA DTC with MCCB's (Sheet Metal) (Dwg No. BESCO/GM/QS&S/58 Dtd 24.11.2018)	No	1	22,809.00	22,809.00
code16	Measuring Equipment Supply of LT 3 Phase, 4 Wire, CT Operated DLMS Complaint ETV Meter-5A, class 0.5s Accuracy (Used for 25 HP/18KW & Above Installations, DTC Metering)	No	1	3,312.00	3,312.00
code17	Meter Protection/Tamper Proof Box (MS) for LT Installations 25 HP and above Supply of LT Metering Box for housing the ETV Meter without CT's busbar wiring etc	Unit	1	3,664.00	3,664.00
code18	Alkathine tube Supply of Transparent Alkathine tube 19 mm dia, 2 mm thick in coils of 30 Mtr	Coil	2	504.00	1,008.00
code19	11 kV, 3 Core, XPLE HTUG Cable with pressure extruded inner sheath, ROUND WIRE ARMOURED as per IS-7098 (Part-2) Armouring wires dia and Resistivity as per IS-3975 95 Sqmm, (54 GI Wires - 2.5 mm Dia)	KM	0.6	11,15,615.00	6,69,369.00
code20	Supply of 1.1 kV, XLPE or Heat resistant PVC insulated, PVC extruded Inner Seath Armoured LTUG Cable as per IS-1554 (Part-1) or IS-7098 Part-1, Armouring strip thickness and resistivity as per IS-3975 70 Sqmm, 3.5 Core, (18 GI Strips - 4 x 0.8 mm)	KM	0.5	4,23,672.00	2,11,836.00

Section 9: BILL OF QUANTITIES

code21	11 kV, Jointing & Cable Termination Kit as per IS-13573 Heat Shrinkable Outdoor Type Cable Termination Kit for XLPE Cable 3x95 Sqmm	Set	4	3,966.00	15,864.00
code22	Supply of Epoxy Terminating Kit (Pothead) suitable for 1.1 kV, LTUG 3.5 x 70/95/120 Sqmm	Set	4	373.00	1,492.00
code23	Supply of LT Line Spacer For TC Wiring (Dwg No. BESCOM/GM/QS&S/38 Dtd 24.11.2018)	No	1	41.00	41.00
code24	Grounding Material Pipe Grounding Supply of GI Grounding pipe, B - Class, 42 mm dia, 2.5 Mtr long, 3.2 mm thick with bolt, nut, GI Strips and washer complete Minimum Weight of GI Pipe: 7.3 Kg	No	7	770.00	5,390.00
code25	Grounding Material Pipe Grounding Supply of Good Quality well burnt Charcoal for grounding purposes packed in non returnable gunny bag of 30 Kg each	No	7	660.00	4,620.00
code26	Grounding Material Pipe Grounding Supply of Good Quality Salt for grounding purposes packed in 50 Kg gunny bag	Bag	7	303.00	2,121.00
code27	Constructing brick masonry chamber of internal dimension 450x300mm and depth of 600mm (inner dimensions) with modular bricks of CD 75 in cement mortar 1:6, bed concrete 150mm thick with 1:3:6, plastering 12 mm thick with cement mortar 1:4, CC 1:2:4 coping 75mm thk for fixing CI cover & frame etc. excluding the cost of CI frame and cover..	Each	7	3,823.20	26,762.40

Section 9: BILL OF QUANTITIES

code28	Supply of Heavy Duty Copper Terminal Long Barrel 70 Sqmm Copper Terminal, Apprx Wt: 38 Gm	No	16	92.00	1,472.00
code29	Supply of GI Pipe B - Class as per IS-1239 GI Pipe - 150 mm Dia	Mtr	12	1,529.00	18,348.00
code30	Supply of 1.1 KV Class HR (Heat Resistant) PVC Insulated & UnSheathed Aluminium Wires Multistrand Single Core Lead wires as per IS-694: 2010 PVC Wire - 70 Sqmm Al Wt: 18.7 Kg, Total Wt: 28.5 Kg/100 Mtr Coil	Coil	1	11,201.00	11,201.00
code31	Digging of Pit Digging of Pit 1.8 Mtr depth for erection of 9 to 10 Mtr Long Steel/RCC/PSCC supports as per approved Drawing. Ordinary Soil	Per Pit	2	564.04	1,128.08
code32	Digging of Pit for GUY SET Ordinary Soil	Per Pit	1	291.46	291.46
code33	Digging of Pit for providing GI Pipe type Earthing Ordinary Soil	Per Pit	7	682.04	4,774.28
code34	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) A) Base Concreting with CC 1:4: 8 a) Pole base for 11/9.5/9/8 Mtr supports (500x650x150mm)	Each	2	322.14	644.28
code35	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) B) Pole Concreting with CC 1:2:4 (without coping) a) 9 Mtr support (650x500x1700mm)	Each	2	3,726.44	7,452.88

Section 9: BILL OF QUANTITIES

code36	Concrete works Providing cement concrete to Poles and Guy sets with material and labour including necessary curing etc., complete (cost does not include excavation) B) Pole Concreting with CC 1:2:4 (without coping) g) Guy concreting with Boulders, Mud & Sand As per Drawing No. BESCOM/GM/CP/7/dt: 24.10.07. (with out cement)	Each	1	236.00	236.00
code37	C) Providing Coping for Pole with CC 1:2:4 (As per actuals) a) 150 mm all around the Pole for an height of 300 mm for RCC, PSCC Pole	Each	2	639.56	1,279.12
code38	Erection of Double Pole Transformer Structure using 9 Mtr Long RCC (145 Kg WL)/PSCC (300 Kg WL) Pole including fixing of Structure Materials, Erection of Poles etc., complete for mounting of Transformer as per approved drawing. For 25/63/100 kVA	Per Structure	1	5,013.82	5,013.82
code39	Fixing of GUY Set with break insulator making use of 7/3.15 mm (7/10 SWG) galvanised steel wire with turn buckle and anchoring arrangement as per approved drawing. (Excluding excavation of PIT)	Per Set	1	237.18	237.18
code40	Erection of Transformer & Structures Erection of 25 to 63 kVA Transformer on Transformer Structure	Each	1	1,018.34	1,018.34
code41	Distribution Box for DTC Fixing LT Distribution box for 100/250/500 kVA DTC (Excluding wiring)	Per Box	1	679.68	679.68
code42	Fixing Metering Box for housing the ETV Meter 3 Phase 4 Wire along with CT's, Meter & wiring for DTC 25/63 kVA TC	Per Set	1	1,709.82	1,709.82

Section 9: BILL OF QUANTITIES

code43	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing DOLO Cutout/Horn Gap Fuse including fixing of cross arm and wiring	Each	1	210.04	210.04
code44	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing of GOS including wiring (11 kV Single Break 200 Amps)	Set	4	949.90	3,799.60
code45	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing of 3 Nos Lightning Arrestor including wiring	Set of 3 Nos	1	106.20	106.20
code46	Fixing of DOLO, GOS, LA, Fuse Board, Service Mains, Spacer, Insulator Etc., Fixing of LT Line spacer	No	1	61.36	61.36
code47	Fixing of LT Protection Kit	Per Kit	1	306.80	306.80
code48	Wiring of 1 Circuit of LT Wiring for for 25/63/100 kVA DTC to the existing LT protection Kit/Distribution Box via metering box. (includes fixing of necessary supports like 2 Pin cross arm, Spacer etc)	Set	1	848.42	848.42
code49	UG Cable Work Earth work excavation for cable trench of 0.5 to 0.75 Mtr. Width and Depth upto 1 Mtr including trial pits, depositing on bank upto a lead of 50 Mtr, Supplying and Displaying necessary Danger Boards and Lighting, Using sight Rails and Sign Boards at every 100 Mtr wherever necessary as directed. In Ordinary Soil	cum	550	306.80	1,68,740.00
code50	Refilling the cable trenches with selected available earth from trench excavation including watering, consolidation in layers of 15 cm. Thickness including depositing of the surplus earth with a lead of 200 Mtr	cum	522.5	68.44	35,759.90

Section 9: BILL OF QUANTITIES

code51	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff HT Cable 3x95 to 150 Sqmm	KM	0.6	53,435.12	32,061.07
code52	Laying of cable in Existing Trench/GI pipe/Stone Ware/RCC Hume pipe using Wooden/Aluminum Rollers as directed by the departmental staff LT Cable 35 to 95 Sqmm	KM	0.5	27,903.46	13,951.73
code53	Making and Fixing pot head for HT Cable only type Heat shrinkable 3x95 to 3x150 Sqmm	No	4	2,318.70	9,274.80



## PAYMENT TERMS

1. Supply payments: The contractor shall be entitled to be paid against supply of material only for such works as in the opinion of Engineer he has supplied in terms of the contract. All payments shall be subject to deductions. Payments provided always that the engineer may withhold if the works or part thereof are not being carried out to his satisfaction.

2. Contractor shall take prior approval of Engineer-in-charge before supplying of the material along with the approval of makes, drawing and quantity.

### **i. Payment procurement of material and progress of work is given below:**

i. Procurement of following items shall be as approved by Engineer-in-charge. Payment of 70% of the accepted price shall be paid on the receipt and accountal of material at site or required destination after inspection and production of documents as listed below:

- a. E-way bill.
- b. Supplier's Delivery Challans and supplier's Tax invoice/GST.
- c. Inspection certificate granted by the authorized /approved agency/Purchaser's representative as per contract.
- d. Certificate of receipt of material at Contractor depot/work sites duly accepted by the Engineer.
- e. Quality Assurance Documents including Guarantee/Warrantee, if any.
- f. Insurance certificate of 100% value valid till liability period.
- g. Indemnity bond.

List of items proposed for payment

- a. RCC, PCC and Spun pole.
- b. ACSR conductor of any size.
- c. HT & LT cables of any size.
- d. HT & LT cable end termination kits and cable jointing kits.
- e. Transformers.
- f. LT distribution box.
- g. LT feeder pillar.
- j. Metering cubicle, control boxes.

### **ii. Progress payments against erection of material**

On completion of item/ work of BOQ, the contractor shall receive payment on submission of bill to the extent of 70% erection costs after making recoveries, if any.

**iii. Payment of other items against supply and erection of material.**

On completion of each item/work of other items mentioned in BOQ, the contractor shall receive payment on submission of bill to the extent of 70% of the supply and erection costs of other items after making necessary recoveries if any.

**(iv). 20% PAYMENT:**

The 20% of each item of the BOQ shall be paid to the contractor after erection and testing of the portion of the work.

**(v). 10% PAYMENT:**

The Balance 10% of each item of the BOQ shall be paid to the contractor after the EIG Approval and handing over of the installation and released materials to the ESCOM/Railways and furnishing the acknowledgment to KRIDE, whichever is later.

**a. Rounding off amounts:** The total amount due on each certificate shall be rounded off to the nearest rupee i.e., sum less than 50 paise shall be omitted and sums of 50 paise and more up to Rs.1 will be reckoned as Rs.1.

**b. Manner of payment:** Unless otherwise specified payments to the contractor will be transferred electronically to his bank account.

**c. FINAL SETTLEMENT:** On expiry of the defect liability period and issue of the taking over certificate of the entire installation, the Bank Guarantee for Performance security shall be released to the contractor after adjustment of any dues payable by the contractor.

**d. RECOVERIES FROM THE CONTRACTOR:** All the recoveries for materials supplied and services rendered by KRIDE to the Contractor, if any and other refunds due from the Contractor shall be made by deductions from payments due to the Contractor covering the value of supply and erection in the progress payment.

**3. TAXES AND DUTIES:**

i. All taxes, duties and levies (including octroi, works contract tax, GST etc.,) arising out of the transactions between the contractor and his sub-contractor/Suppliers for this work will be deemed to be included in the accepted rates, unless otherwise specified in the BOQ or technical specification.

ii. Where the law makes it statutory for the Purchaser to deduct any amount towards GST or any other taxes on works contract, the same shall be deducted and remitted to the concerned authority.

### LIST OF MATERIALS/ APPROVED BRANDS

The make of materials shall be any one of the following approved make or any make having ISI approval / ISI marked or any make / manufacturer having ISO approval.

Sl.no	Description	Make intended to be supplied by the contractor.
1	MCCB / MCB / DB/ RCCB, COS etc	Legrand, L&T, ABB, Schneider, Siemens, C&S, Crompton Greaves Limited, Havells, Anchor, Indo Asian.
2	LT PVC insulated Single & Multicore Wire for Internal Wiring	Polycab, Finolex, Havells, KEI, V-Guard, Anchor, Sbee, Universal, Indo Asian.
3	Cable-Lugs & accessories for electrical general services.	Multi, 3M, Dowells.
4	Light fittings/Lamp	Philips, Bajaj, Crompton Greaves, Havells, Syska, C&S, Wipro
5	LED make	Nichia, Osram, Seoul, Philips Lumileds, Cree, Lednium, Avago.
6	PVC Rigid Conduit Pipes	Universal, VIP, Sudhakar.
7	Modular Switches, Switch box, Covering plate, Sockets, Holders	Anchor Roma, Havells, Crabtree, Legrand, GM, C&S, Schneider, ABB, Cona, Siemens.
8	Industrial Sockets/ Ray Roll plug and Socket	Legrand, Indo Asian, Schneider, Siemens, Standard, Havells.
9	Switch fuse unit Single and Three Phase, Change over Switch	Abb, Cgl, Siemens, Indo Asian, Standard, Bch, C&S Schneider, Legrand, Havells.
10	LT Switch gear and control gears contactors and motor starters	Abb, L&T, Cgl, Siemens, Legrand, Schneider, Havells, Indo Asian.
11	FRP Meter Box	Sintex or Hensel.
12	LTUG/ HTUG XLPE cable	Sbee, Unistar, Finolex, Havells, Gloster, KEI, Universal.
13	Jointing Kit-HT/LT	Venus, Denson, Raychem.
14	BLDC Fan	Usha, Atomberg, Orient, Crompton, Havells, Bajaj, Khaitan.
15	Exhaust Fan/Wall Mounting fan	Crompton, Havells, Khaitan, Bajaj, Usha, Orient.
16	HDPE Pipe	Jindal Pex, Supreme, Finolex, Mangalam.
17	LILO Box/ Meter Box	Schneider, Sintex, Hensel, ABB.
18	Multi data Meter	Schneider, ABB, L&T, Elmeasure, Hpl
19	Submersible Pump	KSB, Kirloskar, Crompton, L&T, Jyothi, Cgl, Suguna.
20	Pump Starter	L&T, Siemens, Crompton, KSB, Kirloskar, C&S.
21	Digital Water Level Controller	L&T, Schneider, Siemens, Legrand, ABB.
22	Microcontroller Timer Control Unit	Bajaj, Philips, Crompton, Siemens, Legrand.
23	Solar Hybrid Emergency Lighting System	Tata or Equivalent.
24	Air conditioner	Blue Star, Hitachi, LG, Samsung, Carrier,

## Section 9 : Payment Terms

		Voltas, Daikin, Toshiba.
25	Water Cooler	Voltas, Bluestar, Usha.
26	Geyser	Racold, Usha, Bajaj, Crompton, Havells, V-Guard.
27	Metering Cubicle	Any ESCOM Approved Make with Latest Approval.
28	Transformer	Any ESCOM Approved with Latest Star Rating as Per ESCOM Requirement.
29	CSS	Abb, L&T, Schneider, Siemens.
30	RMU	Any ESCOM Approved Make.
31	High Mast	Bajaj, Philips, Crompton Greaves.
32	Insulators	Any ESCOM Approved Make with Latest Approval.
33	HT DOLO FUSE	Any ESCOM Approved Make with Latest Approval.
34	Lightening Arrestor	Any ESCOM Approved Make with Latest Approval.
35	GOS	Any ESCOM Approved Make with Latest Approval.
36	Octagonal Pole/Swaged Pole	Philips, Bajaj, Crompton, Utkarsh Tubes, Jindal.
37	MS/GI Tubular Poles	Jindal, Tata.
38	GI Pipe Class B	Jindal, Tata.
39	Indoor outdoor Potheads for HT cable	Any ESCOM Approved Make.
40	VRLA 12/120AH Battery Unit	AMARAJA, Exide, Bosch, AMCO, Hitachi.

### NOTE:

1. Products Certified by the Bureau of Indian Standards and Provided with ISI Mark are only acceptable. The Contractor must obtain a specific approval of engineer in charge in writing prior to using of any substitute make not mentioned in the list above or in case make without ISI or BIS standard are to be supplied.
2. Raw materials of fabricated products like Steel poles should be tested at approved test laboratory and certificate should be furnished by the contractor. Materials, welding, galvanizing etc., shall conform to IS specifications latest. DP test should be carried out on all the seam as per IS: 3658:1999 or latest.
3. Successful tenderer should obtain relevant approved ESCOM specification for Transformers (if supply of Tr. is involved) with endorsement of acceptance for Execution of work at respective location.
4. The successful tender shall obtain design drawings of CSS, RMU, LT/HT Switchgears and LT/HT panels prior to supply of items at the site of work.
5. Before supply of the materials without approval of makes/models no supply shall be accepted
6. Approval shall be obtained from **AGM/Electrical/K-RIDE**

**SECTION-10**  
**FORMAT OF BANK GUARANTEE FOR  
SECURITY DEPOSIT ETC.,**

## INDEX

### Table of Forms

SL. NO	DESCRIPTION	PAGE NO
1	FORMAT OF BANK GUARANTEE FOR SECURITY DEPOSIT	419
2	FORM OF BANK GUARANTEE FOR PERFORMANCE SECURITY	420
3	FORM OF BANK GUARANTEE FOR ADDITIONAL PERFORMANCE SECURITY	423
4	ADVANCE PAYMENT SECURITY	426
5	INDEMNITY BOND FOR THE SAFE CUSTODY OF THE MATERIALS SUPPLIED BY THE CONTRACTOR	430

**NOTE:** *This Section contains forms which, once completed, will form part of the Contract. The forms for Performance Security and Advance Payment Security, when required, shall only be completed by the successful Bidder after contract award.*

*All italicized text is for guidance how to prepare the various forms and shall be deleted from the final documents.*

---

**FORMAT OF BANK GUARANTEE FOR SECURITY DEPOSIT**

---

To,.....( Name of the Employer)  
 .....(Address of the Employer).

Whereas .....(Name and Address of the contractor) (herein after called the Contractor) has undertaken, in pursuance of contract no.....  
 Dated:.....(Name of the contract and brief description of the work) (herein after called the Contract)

AND WHEREAS it has been stipulated by you in the said Contract that the Contractor shall furnish you with a Bank Guarantee by a recognized bank for the sum specified therein as security for compliance with his obligations in accordance with the Contract;

AND WHEREAS we have agreed to give the Contractor such a Bank Guarantee;

NOW THEREFORE we hereby affirm that we are the Guarantor and responsible to you, on behalf of the Contractor, up to a total of Rs. \_\_\_\_\_ [amount of guarantee]  
 Rupees \_\_\_\_\_ [in words], and we undertake to pay you, upon your first written demand and without cavil or argument, any sum or sums within the limits of \_\_\_\_\_ [amount of guarantee] as aforesaid without your needing to prove or to show grounds or reasons for your demand for the sum specified therein.

We hereby waive the necessity of your demanding the said debt from the Contractor before presenting us with the demand.

We further agree that no change or addition to or other modification of the terms of the Contract or of the Works to be performed there under or of any of the Contract documents which may be made between you and the Contractor shall in any way release us from any liability under this guarantee, and we hereby waive notice of any such change, addition or modification.

This guarantee shall be valid until 28 days from the date of expiry of the Defects Liability Period.

Signature and seal of the guarantor \_\_\_\_\_  
 Name of Bank \_\_\_\_\_  
 Address \_\_\_\_\_  
 Date \_\_\_\_\_

### **FORM OF BANK GUARANTEE FOR PERFORMANCE SECURITY**

*(On non-judicial stamp paper of the appropriate value in accordance with stamp Act. The stamp paper to be in the name of Executing Bank).*

**From:**

Name and Address of the Bank.....

.....

**To:**

The Managing Director,  
 Rail Infrastructure Development Company (Karnataka) Limited,  
 "Samparka Soudha" , 1st Floor,  
 B.E.P Premises (Opp. Orion Mall),  
 Dr. Rajkumar Road,  
 Rajajinagar 1st Block,  
 Bangalore - 560 010

WHEREAS, Rail Infrastructure Development Company (Karnataka) Limited, hereinafter called the **Employer**, acting through **[Insert Designation and address of the Employer's Representative]**, has accepted the bid of **[Insert Name and address of the Contractor]**, hereinafter called the **Contractor**, for the work of **[Insert Name of Work]**, vide Notification of Award No **[Insert Notification of Award No...]**  
**AND**

WHEREAS, the contractor is required to furnish Performance Security for the sum of **[Insert Value of Performance Security required]**, in the form of bank guarantee, being a condition precedent to the signing of the contract agreement.

WHEREAS, **[Insert Name of the Bank]**, with its Branch **[Address]** having its Headquarters office at **[Address]**, hereinafter called the **Bank**, acting through **[Designation(s) of the authorised person of the Bank]**, have, at the request of the **[Insert name of the JV partner]**, a JV partner on behalf of the contractor, agreed to give guarantee for performance security and additional performance security as hereinafter contained:

- 1 KNOW ALL MEN by these present that I/We the undersigned **[Insert name(s) of authorized representatives of the Bank]**, being fully authorized to sign and incur obligations for and on behalf of the Bank, confirm that the Bank, hereby, unconditionally and irrevocably guarantee to pay the Employer the full amount in the sum of **[Insert Value of Performance Security required]** as above stated.
- 2 The Bank undertakes to immediately pay on presentation of demand by the Employer any amount up to and including aforementioned full amount without any demur, reservation or recourse. Any such demand made by the Employer on the Bank shall be final, conclusive and binding, absolute and unequivocal not withstanding any disputes raised/ pending before any Court, Tribunal, Arbitration or any Authority or any threatened litigation by the Employer of Bank.
- 3 On payment of any amount less than aforementioned full amount, as per demand of the Employer, the guarantee shall remain valid for the balance amount i.e. the aforementioned full amount less the payment made to the Employer.



- 4 The Bank shall pay the amount as demanded immediately on presentation of the demand by Employer without any reference to the contractor and without the Employer being required to show grounds or give reasons for its demand or the amount demanded.
5. The Bank Guarantee shall be unconditional and irrevocable.
- 6 The guarantee hereinbefore shall not be affected by any change in the constitution of the Bank or in the constitution of the Contractor.
- 7 The Bank agrees that no change, addition, modifications to the terms of the Contract Agreement or to documents, which have been or may be made between the Employer and the Contractor, will in any way release us from the liability under this guarantee; and the Bank, hereby, waives any requirement for notice of any such change, addition or modification to the Bank.
- 8 This guarantee is valid and effective from the date of its issue, which is **[insert date of issue]**. The guarantee and our obligations under it will expire **on [Insert the date Sixty days after the expected end of completion of work]**. All demands for payment under the guarantee must be received by us on or before that date.
- 9 The Bank agrees that the Employers right to demand payment of aforementioned full amount in one instance or demand payments in parts totaling up to the aforementioned full amount in several instances will be valid until either the aforementioned full amount is paid to the Employer or the guarantee is released by Employer before the Expiry date.
- 10 The Bank agrees that its obligation to pay any amount demanded by the Employer before the expiry of this guarantee will continue until the amount demanded has been paid in full.
- 11 The expressions Bank and Employer herein before used shall include their respective successors and assigns.
- 12 The Bank hereby undertakes not to revoke the guarantee during its currency, except with the previous consent in writing of the employer. This guarantee is subject to the Uniform Rules for Demand Guarantees, ICC Publication No. 758.
- 13 The Guarantee shall be in addition to and without prejudice to any other security Guarantee (s) of the contractor in favour of the Employer available with the Employer. The Bank, under this Guarantee, shall be deemed as Principal Debtor of the Employer.
14. This guarantee shall be valid for 60 days after the date of completion.

Date .....

Place.....

.....  
 [Signature of Authorized person of  
 Bank/Guarantor]

.....  
 [Name in Block letters]

.....  
[Designation]

.....  
[P/Attorney] No.

.....  
Bank's Name and Seal

[P/Attorney] No.....

Witness:

1. *Signature*  
*Name & Address & Seal*
  
2. *Signature*  
*Name & address & Seal*

Note :

1. *All italicized text is for guidance on how to prepare this bank guarantee and shall be deleted from the final document.*
  
2. *In case the guarantee is issued by a foreign Bank, which does not have operations in India, the said bank shall have to provide a counter-guarantee by State Bank of India.*
  
3. *In case the Contractor is a JV, the Performance Security is required to be furnished on behalf of the JV in favour of the Employer by the JV Partners in proportion of their respective percentage share specified in the JV Agreement. The percentage share of M/s **[Insert Name of the JV Partner]** in the JV is **[Fill share % in the JV]** percent. All the Bank Guarantee of JV Partners are liable to be encashed cumulatively.*

**FORM OF BANK GUARANTEE FOR ADDITIONAL PERFORMANCE SECURITY**

**(On non-judicial stamp paper of the appropriate value in accordance with stamp Act. The stamp paper to be in the name of Executing Bank)**

**From:**

Name and Address of the Bank.....  
.....

**To:**

The Managing Director,  
Rail Infrastructure Development Company (Karnataka) Limited,  
"Samparka Soudha" , 1st Floor,  
B.E.P Premises (Opp. Orion Mall),  
Dr. Rajkumar Road,  
Rajajinagar 1st Block,  
Bangalore - 560 010

WHEREAS, Rail Infrastructure Development Company (Karnataka) Limited, hereinafter called the **Employer**, acting through **[Insert Designation and address of the Employer's Representative]**, has accepted the bid of **[Insert Name and address of the Contractor]**, hereinafter called the **Contractor**, for the work of **[Insert Name of Work]**, vide Notification of Award No. **[Insert Notification of Award No.]**.  
**AND**

WHEREAS, the contractor is required to furnish Performance Security for the sum of **[Insert Value of Performance Security required]**, in the form of bank guarantee, being a condition precedent to the signing of the contract agreement.

WHEREAS, **[Insert Name of the Bank]**, with its Branch **[Address]** having its Headquarters office at **[Address]**, hereinafter called the **Bank**, acting through **[Designation(s) of the authorised person of the Bank]**, have, at the request of the **[Insert name of the JV partner]**, a JV partner on behalf of the contractor, agreed to give guarantee for performance security and additional performance security as hereinafter contained:

- 1 KNOW ALL MEN by these present that I/We the undersigned **[Insert name(s) of authorized representatives of the Bank]**, being fully authorized to sign and incur obligations for and on behalf of the Bank, confirm that the Bank, hereby, unconditionally and irrevocably guarantee to pay the Employer the full amount in the sum of **[Insert Value of Performance Security required]** as above stated.
- 2 The Bank undertakes to immediately pay on presentation of demand by the Employer any amount up to and including aforementioned full amount without any demur, reservation or recourse. Any such demand made by the Employer on the Bank shall be final, conclusive and binding, absolute and unequivocal notwithstanding any disputes raised/ pending before any Court, Tribunal, Arbitration or any Authority or any threatened litigation by the Employer of Bank..
- 3 On payment of any amount less than aforementioned full amount, as per demand of the Employer, the guarantee shall remain valid for the balance amount i.e. the aforementioned full amount less the payment made to the Employer.

- 4 The Bank shall pay the amount as demanded immediately on presentation of the demand by Employer without any reference to the contractor and without the Employer being required to show grounds or give reasons for its demand or the amount demanded.
5. The Bank Guarantee shall be unconditional and irrevocable.
- 6 The guarantee hereinbefore shall not be affected by any change in the constitution of the Bank or in the constitution of the Contractor.
- 7 The Bank agrees that no change, addition, modifications to the terms of the Contract Agreement or to any documents, which have been or may be made between the Employer and the Contractor, will in any way release us from the liability under this guarantee; and the Bank, hereby, waives any requirement for notice of any such change, addition or modification to the Bank.
- 8 This guarantee is valid and effective from the date of its issue, which is ***[insert date of issue]***. The guarantee and our obligations under it will expire on ***[Insert the date twenty-eight days after the expected end of defect liability period]***. All demands for payment under the guarantee must be received by us on or before that date.
- 9 The Bank agrees that the Employers right to demand payment of aforementioned full amount in one instance or demand payments in parts totaling up to the aforementioned full amount in several instances will be valid until either the aforementioned full amount is paid to the Employer or the guarantee is released by Employer before the Expiry date.
- 10 The Bank agrees that its obligation to pay any amount demanded by the Employer before the expiry of this guarantee will continue until the amount demanded has been paid in full.
- 11 The expressions Bank and Employer herein before used shall include their respective successors and assigns.
- 12 The Bank hereby undertakes not to revoke the guarantee during its currency, except with the previous consent in writing of the employer. This guarantee is subject to the Uniform Rules for Demand Guarantees, ICC Publication No. 758.
- 13 The Guarantee shall be in addition to and without prejudice to any other security Guarantee (s) of the contractor in favour of the Employer available with the Employer. The Bank, under this Guarantee, shall be deemed as Principal Debtor of the Employer.

Date .....

Place.....

.....  
[Signature of Authorised person of Bank].....  
[Name in Block letters].....  
[Designation]

.....  
[P/Attorney] No.

.....  
Bank's Seal

[P/Attorney] No.....

Witness:

3. *Signature*  
*Name & Address & Seal*
  
4. *Signature*  
*Name & address & Seal*

Note :

- 1 *All italicized text is for guidance on how to prepare this bank guarantee and shall be deleted from the final document.*
  
- 2 *In case the guarantee is issued by a foreign Bank, which does not have operations in India, the said bank shall have to provide a counter-guarantee by State Bank of India.*
  
- 3 *In case the Contractor is a JV, the Performance Security is required to be furnished on behalf of the JV in favour of the Employer by the JV Partners in proportion of their respective percentage share specified in the JV Agreement. The percentage share of M/s **[Insert Name of the JV Partner]** in the JV is **[ Fill share % in the JV ]** percent. All the Bank Guarantee of JV Partners are liable to be encashed cumulatively.*

**ADVANCE PAYMENT SECURITY**

***(On non-judicial stamp paper of appropriate value in accordance with stamp Act. The stamp paper to be in the name of Executing Bank)***

**From**

*[Name and Address of the Bank]*

**To**

The Managing Director,  
Rail Infrastructure Development Company (Karnataka) Limited,  
"Samparka Soudha" , 1st Floor,  
B.E.P Premises (Opp. Orion Mall),  
Dr. Rajkumar Road,  
Rajajinagar 1st Block,  
Bangalore - 560 010

**Beneficiary/Employer:** Rail Infrastructure Development Company (Karnataka) Limited.

**Guarantee No.:** *[.....reference number of the guarantee.....]* **Dated:** *[.....]*

WHEREAS, Rail Infrastructure Development Company (Karnataka) Limited (**hereinafter called the Employer**) has entered into Contract No. *[....reference number of the Contract....]* dated *[.....]* for the execution of *[name of the contract]* (**hereinafter called the Contract**) with *[....name of the Contractor....]* (**hereinafter called the Contractor**).

WHEREAS, according to the Conditions of the Contract, an advance payment is admissible to the contractor against submission of bank guarantee(s).

At the request of the Contractor, we *[....name of the Bank....]* with our branch at *[....address....]*, having our Head Office at *[....address....]* (**hereinafter called the Bank**) have, at the request of *[.....Insert name of the JV partner.....]*, a JV partner on behalf of the Contractor, agreed to give the said guarantee as hereinafter contained:

1. KNOW ALL MEN by these present that I/We the undersigned *[....Insert name(s) of authorized representative(s) of the Bank....]*, being fully authorized to sign and incur obligations for and on behalf of the Bank, confirm that the Bank, hereby, unconditionally and irrevocably guarantees

to pay the Employer the sum of Rs.*[....value in figure....]* (Rupees *[....value in words....]*) **only (hereinafter called the Full Amount)**.

2. The Bank undertakes to immediately pay to the Employer, without any demur, reservation or recourse, any amount up to and including aforementioned full amount upon first written demand/demands from the Employer.
3. On payment of any amount less than aforementioned full amount, as per demand of the Employer, the guarantee shall remain valid for the balance amount i.e., the aforementioned full amount less the payment made to the Employer.
4. The Bank shall pay the amount so demanded without any reference to the contractor and without the Employer being required to show grounds or give reasons for its demand or the amount demanded.
5. The guarantee hereinbefore shall not be affected by any change in the constitution of the Bank, the Contractor or the Employer.
6. The Bank agrees that no change, addition, modification to the terms of the Contract Agreement or to any document, which have been or may be made between the Employer and the Contractor, will in any way release us from the liability under this guarantee; and the Bank, hereby, waives any requirement for notice of any such change, addition or modification to the Bank.
7. This guarantee is valid and effective from the date of its issue, which is [...date of issue...]. The guarantee and our obligations under it will expire on dated .....[...Please refer note 4 & 5...]. All demands for payment under the guarantee must be received by us on or before that date.
8. The Bank agrees that the Employer's right to demand payment of aforementioned full amount in one instance or demand payments in parts totaling up to the aforementioned full amount in several instances will continue until either the aforementioned full amount is paid to the Employer or the guarantee validity period expires.
9. The Bank agrees that it's obligation to pay any amount demanded by the Employer before the expiry of this guarantee will continue until the amount demanded has been paid in full.
10. The expressions Bank and Employer herein before used shall include their respective successors and assigns.
11. The Bank hereby undertakes not to revoke the guarantee during its currency, except with the previous consent in writing of the employer. This guarantee is subject to the Uniform Rules for Demand Guarantees, ICC Publication No. 758.

**Dated** [.....]

**Place** [.....]

.....  
**(Signature of the Authorized Person of the Bank)**

.....  
**(Name in Block Letters)**

.....  
**(Designation)**

.....  
**(Bank's Seal)**

.....  
**(Authorization No.)**

**Witness:**

1. ....  
Signature, Name & Address
2. ....  
Signature, Name & Address

**Note:**

1. *All italicized text in brackets [...text...] is for guidance on how to prepare this bank guarantee and shall be deleted from the final document.*
2. *In case the guarantee is issued by a foreign Bank, the said bank shall have operations in India and should be issued by Indian operations branch of the said bank.*

**3. Mobilization Advance**

**(a) For Single Entity**

*For each Installment of Advance, two Bank Guarantees of equal amounts (each equal to half of the first installment of advance plus 10%) shall be furnished. Each Bank Guarantee shall be valid for the stipulated completion period of the contract.*



**OR**

**(b) For JV/Consortium**

*For each Installment of Advance, individual JV/Consortium partner shall furnish Bank Guarantee equal to his share in the installment of Advance plus 10%. Each Bank Guarantee shall be valid for the stipulated completion period of the contract.*

**4. Advance against Plant and Machinery**

**(a) For Single Entity**

*For each Installment of Advance, a Bank Guarantee equal to the installment of advance plus 10% shall be furnished. The Bank Guarantee shall be valid for the stipulated completion period of the contract.*

**OR**

**(b) For JV/Consortium**

*For each Installment of Advance, individual JV/Consortium partner shall furnish a Bank Guarantee equal to his share in the installment of advance plus 10%. Each Bank Guarantee shall be valid for the stipulated completion period of the contract.*

K-RIDE

**INDEMNITY BOND FOR THE SAFE CUSTODY OF THE  
MATERIALS SUPPLIED BY THE CONTRACTOR**

(To be executed on Non-Judicial Stamp Paper of Appropriate Value and notarized)

THIS INDEMNITY BOND made on this \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_ by \_\_\_\_\_ (*insert the name of the Contractor and its registered address*) (hereinafter called "the Contractor") which expression shall where the context do admits or implies be deemed to include its executors, administrators and assigns, in favour of the Rail Infrastructure Development Company (Karnataka) Limited, Samparka Soudha", 1st Floor, B.E.P Premises (Opp. Orion Mall), Dr. Rajkumar Road, Rajajinagar 1st Block, Bangalore - 560 010 (hereinafter called "K RIDE") on the other part.

WHEREAS by an Agreement/Letter of Acceptance No. \_\_\_\_\_ dated \_\_\_\_\_ (hereinafter called "the said agreement"), the Contractor has agreed to execute the \_\_\_\_\_ (*Name of Work*) (hereinafter called "the Works").

AND WHEREAS the Contractor has submitted to K RIDE/ the Engineer for payment on materials procured by him and brought to the site of the Works or his workshop for use in the Works.

AND WHEREAS K RIDE/ the Engineer has agreed to make advance/stage payment to the Contractor the total sum of Rs. \_\_\_\_\_ (*in Figures*) [Rupees \_\_\_\_\_ (*in Words*) in Interim Payment Certificate (IPC) No. \_\_\_\_\_, the quantities and other particulars of which are detailed in this IPC for the said works signed by the Contractor on \_\_\_\_\_ for the Materials brought by the Contractor to site of the works. Brief details are also mentioned in schedule 1 appended hereto.

NOW THIS INDEMNITY BOND WITNESS that in pursuance of the said agreement and in consideration of the sum of Rs. \_\_\_\_\_ (*in Figures*) \_\_\_\_\_ (*in Words*) on or before the execution of these presents to be paid to the Contractor by K RIDE so aforesaid, the Contractor doth hereby covenant and agree with K RIDE and declare as follows: -

1. That the said sum of Rs. \_\_\_\_\_ (*In Figures*) \_\_\_\_\_ (*in Words*) to be paid by K RIDE to the Contractor as aforesaid shall be utilized by the Contractor in or towards the execution of the said works and for no other purpose whatsoever.
2. That the Materials detailed in the said IPC which have been offered to and accepted by K RIDE/ the Engineer, are absolutely the Contractor's own property and free from encumbrances of any kind and the Contractor will not make any application for or receive any further payment on the Materials which are not absolutely his own property and free from encumbrances of any kind, the Contractor indemnifies the K RIDE against all claims on any Materials in respect of which payment is to be made to him as aforesaid.
3. That the Contractor undertakes that the Materials shall be used exclusively for the performance / execution of the Contract strictly in accordance with the terms and conditions of the Contract and no part of the Materials shall be utilized for any other work or purpose whatsoever.

4. That the Contractor is obliged and shall remain absolutely responsible for the safe transit / protection and custody of the Materials against all risks whatsoever including acts of the God till the Materials are duly incorporated in the works, commissioned and are taken over by K RIDE/Railway (including surplus Materials, if required as instructed by K RIDE/ the Engineer) in accordance with the terms of the Contract. The Contractor undertakes to keep K RIDE harmless against any loss or damage that may be caused to the Materials.
5. That the said Materials shall not on any account be removed from the site of the works except with the written permission of K RIDE/ the Engineer. Further, K RIDE/ the Engineer shall always be free at all times to take possession of the materials in whatever form the materials may be in, if in its opinion, the Materials are likely to be endangered, mis-utilized or converted to uses other than those specified in the Contract, by any acts or omission or commission on the part of the Contractor or any other person or on account of any reason whatsoever and the Contractor binds himself and undertakes to comply with the directions of demand of K RIDE to return the Materials without any demur or reservation.
6. That the said materials shall, at all times, be open to inspection by K RIDE/ the Engineer or any authorized representative. In the event of the said material or any part thereof at any time being found to be in lesser quantity than for which payment has been released or the same has been stolen, destroyed or damaged or becoming deteriorated, the Contractor will forthwith replace the same or repair and make good the same as required by K RIDE/ the Engineer.
7. That making payment does not mean that Materials are of required specifications and quality or that whole of the quantity brought to site by Contractor will be used in the work. The Contractor is fully responsible for the materials to conform to required quality and specification and if at any time K RIDE/ the Engineer do not find the material satisfactory, the Contractor at his own cost would replace these. K RIDE/ the Engineer would be at liberty to recover cost of these from any dues of the Contractor. Also any Materials which are in excess of what is finally required under the contract would be the Contractor's property without any liability on K RIDE/ the Engineer who would recover the cost of this from the Contractor.
8. That this INDEMNITY BOND is irrevocable. If at any time, any loss or damage occurs to the Materials or the same or any part thereof is mis-utilized in any manner whatsoever, then the Contractor hereby agrees that the decision of K RIDE/ the Engineer as to assessment of loss or damage to the Materials shall be final and binding on the Contractor. The Contractor binds itself and undertakes to replace the lost and/or damaged Materials at its own cost and/or shall pay the amount of loss to K RIDE without any demur, reservation or protest. This is without prejudice to any other right or remedy that may be available to K RIDE/ the Engineer against the Contractor under the Contract or under this Indemnity Bond
9. That if the Contractor shall at any time make any default in the performance or observance in any respect of any of the terms and provisions of the said agreement or of those presents, the total amount of the payment shall immediately on the happening of such default be recovered by K RIDE/ the Engineer from any dues of Contractor. It is also clearly understood by the Contractor that non-observance of the obligations under this Indemnity Bond by the Contractor shall inter-alia constitute

a criminal breach of trust on the part of the Contractor for all intents and purpose including legal / penal consequences.

10. IN WITNESS WHEREOF, the Contractor has hereunto set its hand through its authorized representative, the day, month and year first above mentioned.

11. SCHEDULE 1

Particulars of the Materials	Quantity	Value of the Materials

Signed, Sealed and Delivered by the said Contractor

(Contractor's Name)

Dated: .....

(AUTHORISED SIGNATORY)

Place: .....

SEAL OF COMPANY

IN THE PRESENCE OF:

WITNESS: SIGNATURE \_\_\_\_\_

NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

**Note:**

*The contractor has the option to submit the INDEMNITY BOND to cover all the items and quantities of Materials of stage payment or to submit INDEMNITY BOND each time the stage payment is to be taken or Materials advance is to be taken.*

No.

Office of the .....

Date: .....

--00--00--00--